


3  
E1  
EXISTING BUILDING 1 - ELECTRICAL

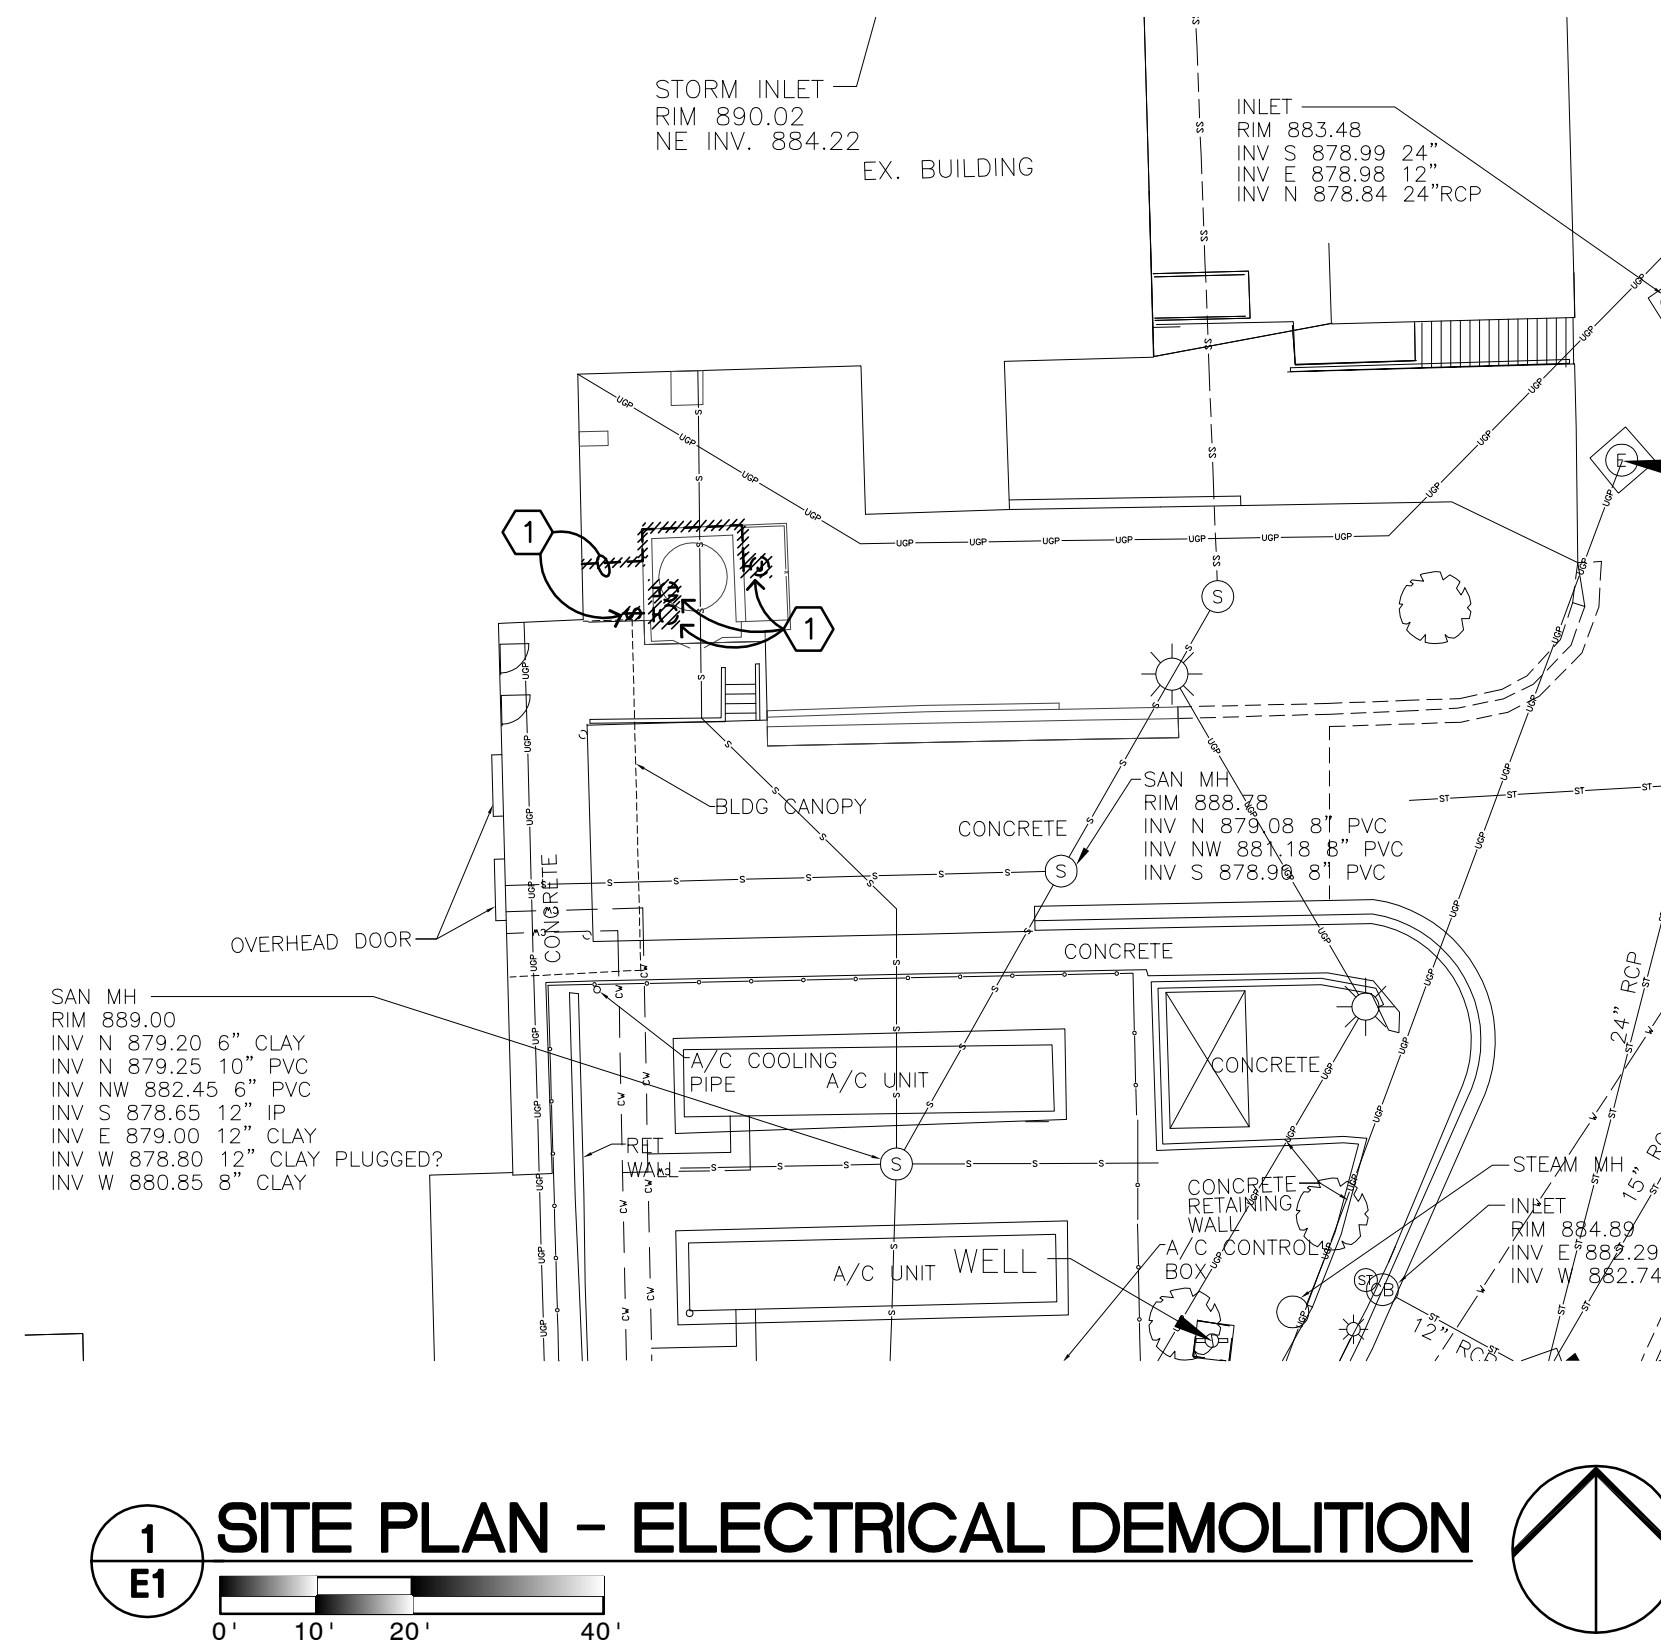

2  
E1  
SITE PLAN - ELECTRICAL REMODELING

- PLAN NOTES:
- 1 DISCONNECT EXISTING RECEPTACLE, LIGHT SWITCH, LIGHT, ELECTRICAL JUNCTION BOXES AND ANY REMAINING ELECTRICAL DEVICES. REMOVE EXISTING EXTERIOR ELECTRICAL CONDUIT. REMOVE CONDUCTORS BACK TO SOURCE OF SUPPLY. DEMOLITION WILL NOT BEGIN UNTIL THE NEW LIQUID OXYGEN SITE IS COMPLETE.
  - 2 PROVIDE HOME RUN TO PANEL EB10E2P. PROVIDE AND CONNECT TO NEW 20/1 BREAKER. SEE 3/E1 FOR PANEL LOCATION.
  - 3 PROVIDE 120V CONNECTION TO ALARM BOX LOCATED AT PRESSURE CONTROL MANIFOLD.
  - 4 PROVIDE INVUE SERIES VFM MEDIUM VISION FLOOD LIGHT, WIDE FLOOD, 120V, ALUMINUM HOUSING, IMPACT RESISTANT FLAT LENS FULLY GASKETED, BRONZE COLOR, 150W PULSE START METAL HALIDE LAMPING, KNUCKLE MOUNTING, WALL BRACKET, OR EQUAL.
  - 5 PROVIDE NEW 20/1 BREAKER IN PANEL 10E7.
  - 6 PROVIDE WEATHER PROOF SURFACE MOUNT RECEPTACLE WITH CAST ALUMINUM IN USE COVER. RECEPTACLE TO BE MOUNTED 18 INCHES ABOVE FINISH GRADE ON EXISTING RETAINING WALL. FIELD COORDINATE EXACT LOCATIONS WITH NEW SLAB AND RETAINING WALL ELEVATIONS.