



three inches = one foot
one and one-half inches = one foot
one inch = one foot
three-quarters inch = one foot
one-half inch = one foot
three-eighths inch = one foot
one-quarter inch = one foot
one-eighth inch = one foot

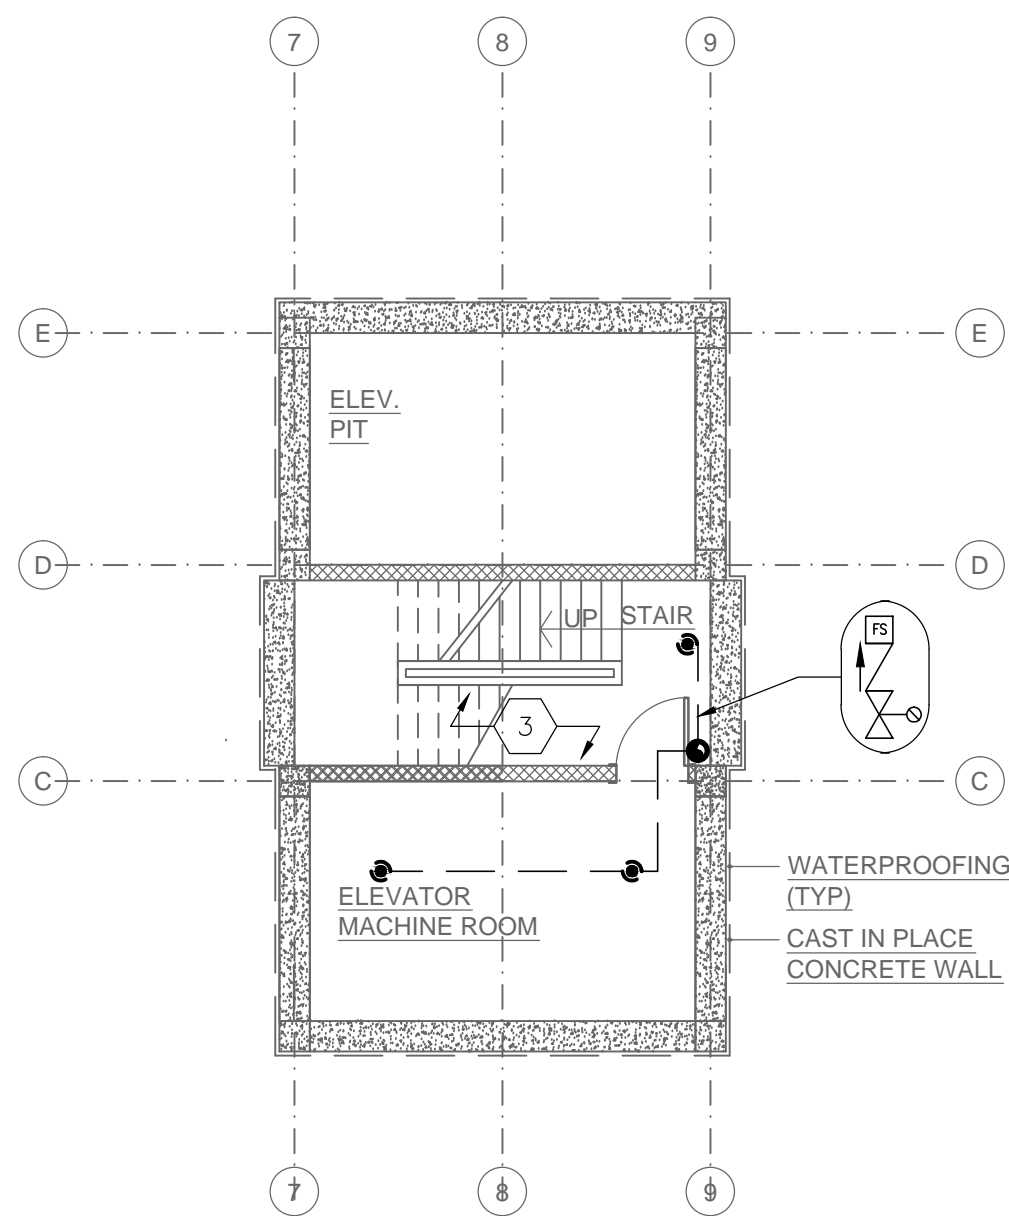


1 BASEMENT EXISTING FIRE SUPPRESSION PLAN
FP-204 SCALE 1/8" = 1'-0"

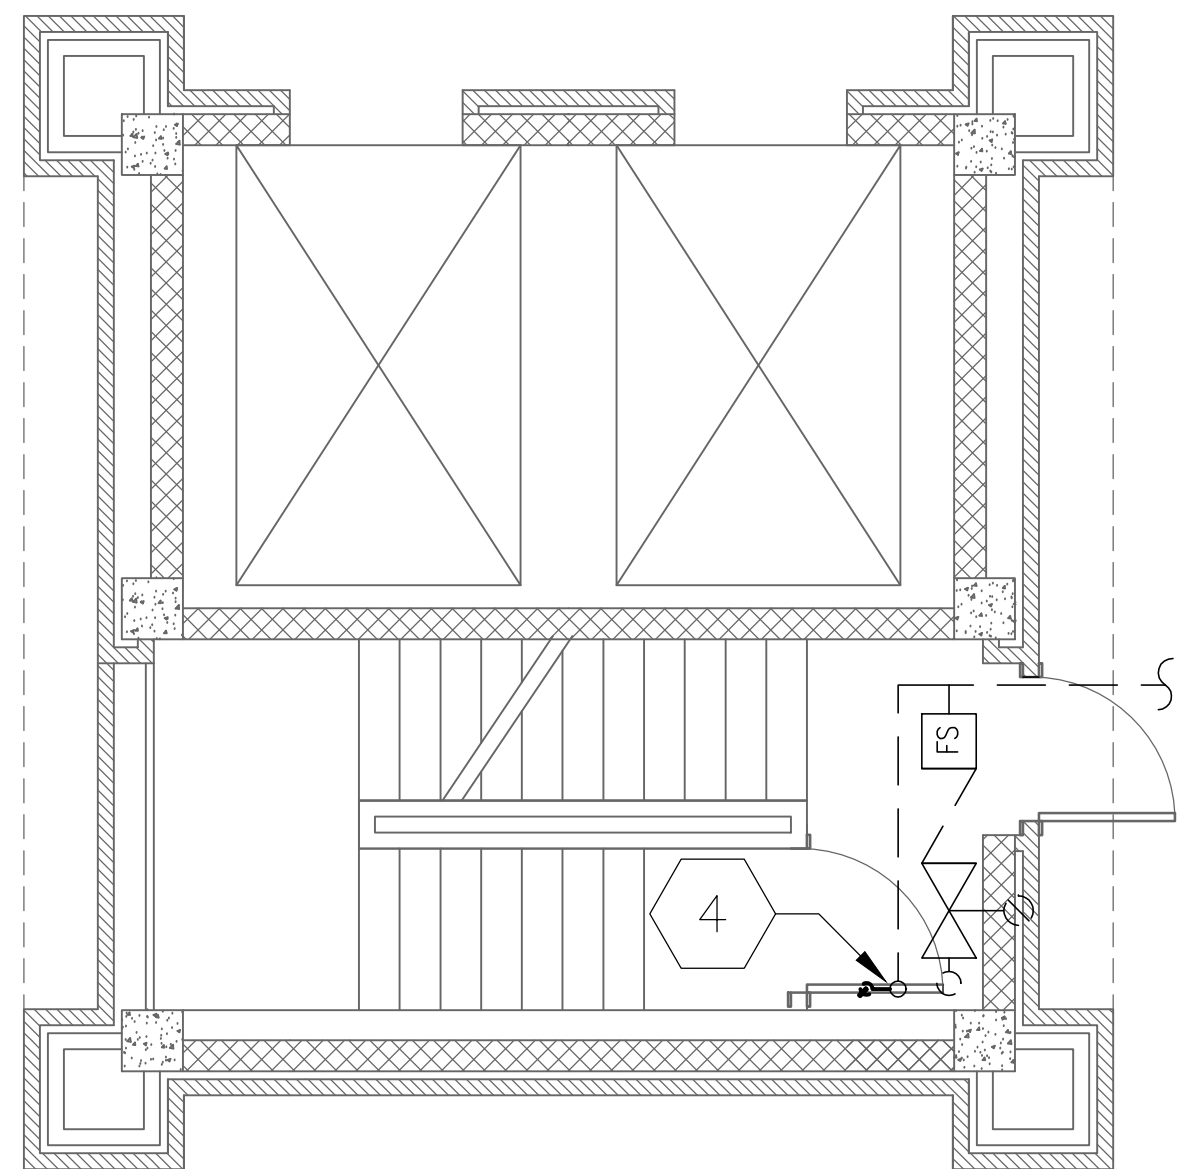

3 TYPICAL STAIR RISER AND ZCA ASSEMBLY
FP-204 SCALE NTS



- GENERAL NOTES:
- A. ALL PIPING IN PENTHOUSE 1 1/4" UNLESS NOTED OTHERWISE.
 - B. CONTRACTOR SHALL PROVIDE SPRINKLERS UNDERNEATH ALL OBSTRUCTIONS EQUAL TO AND GREATER THAN 4 FEET IN ACCORDANCE WITH NFPA 13.
 - C. CONTRACTOR SHALL PROVIDE METAL PROTECTIVE CASES ON ALL SPRINKLERS LESS THAN OR EQUAL TO 7 FEET ABOVE FINISHED FLOORS AND IN AREAS WHERE SUBJECT TO MECHANICAL DAMAGE.
 - D. ALL PIPING SCHEDULE 40.
 - E. ALL SPRINKLERS SHALL BE INSTALLED IN ACCORDANCE WITH SECTIONS 8.5 AND 8.6 OF NFPA 13.
 - F. ALL SPRIG UPS ARE 1" IN DIAMETER.

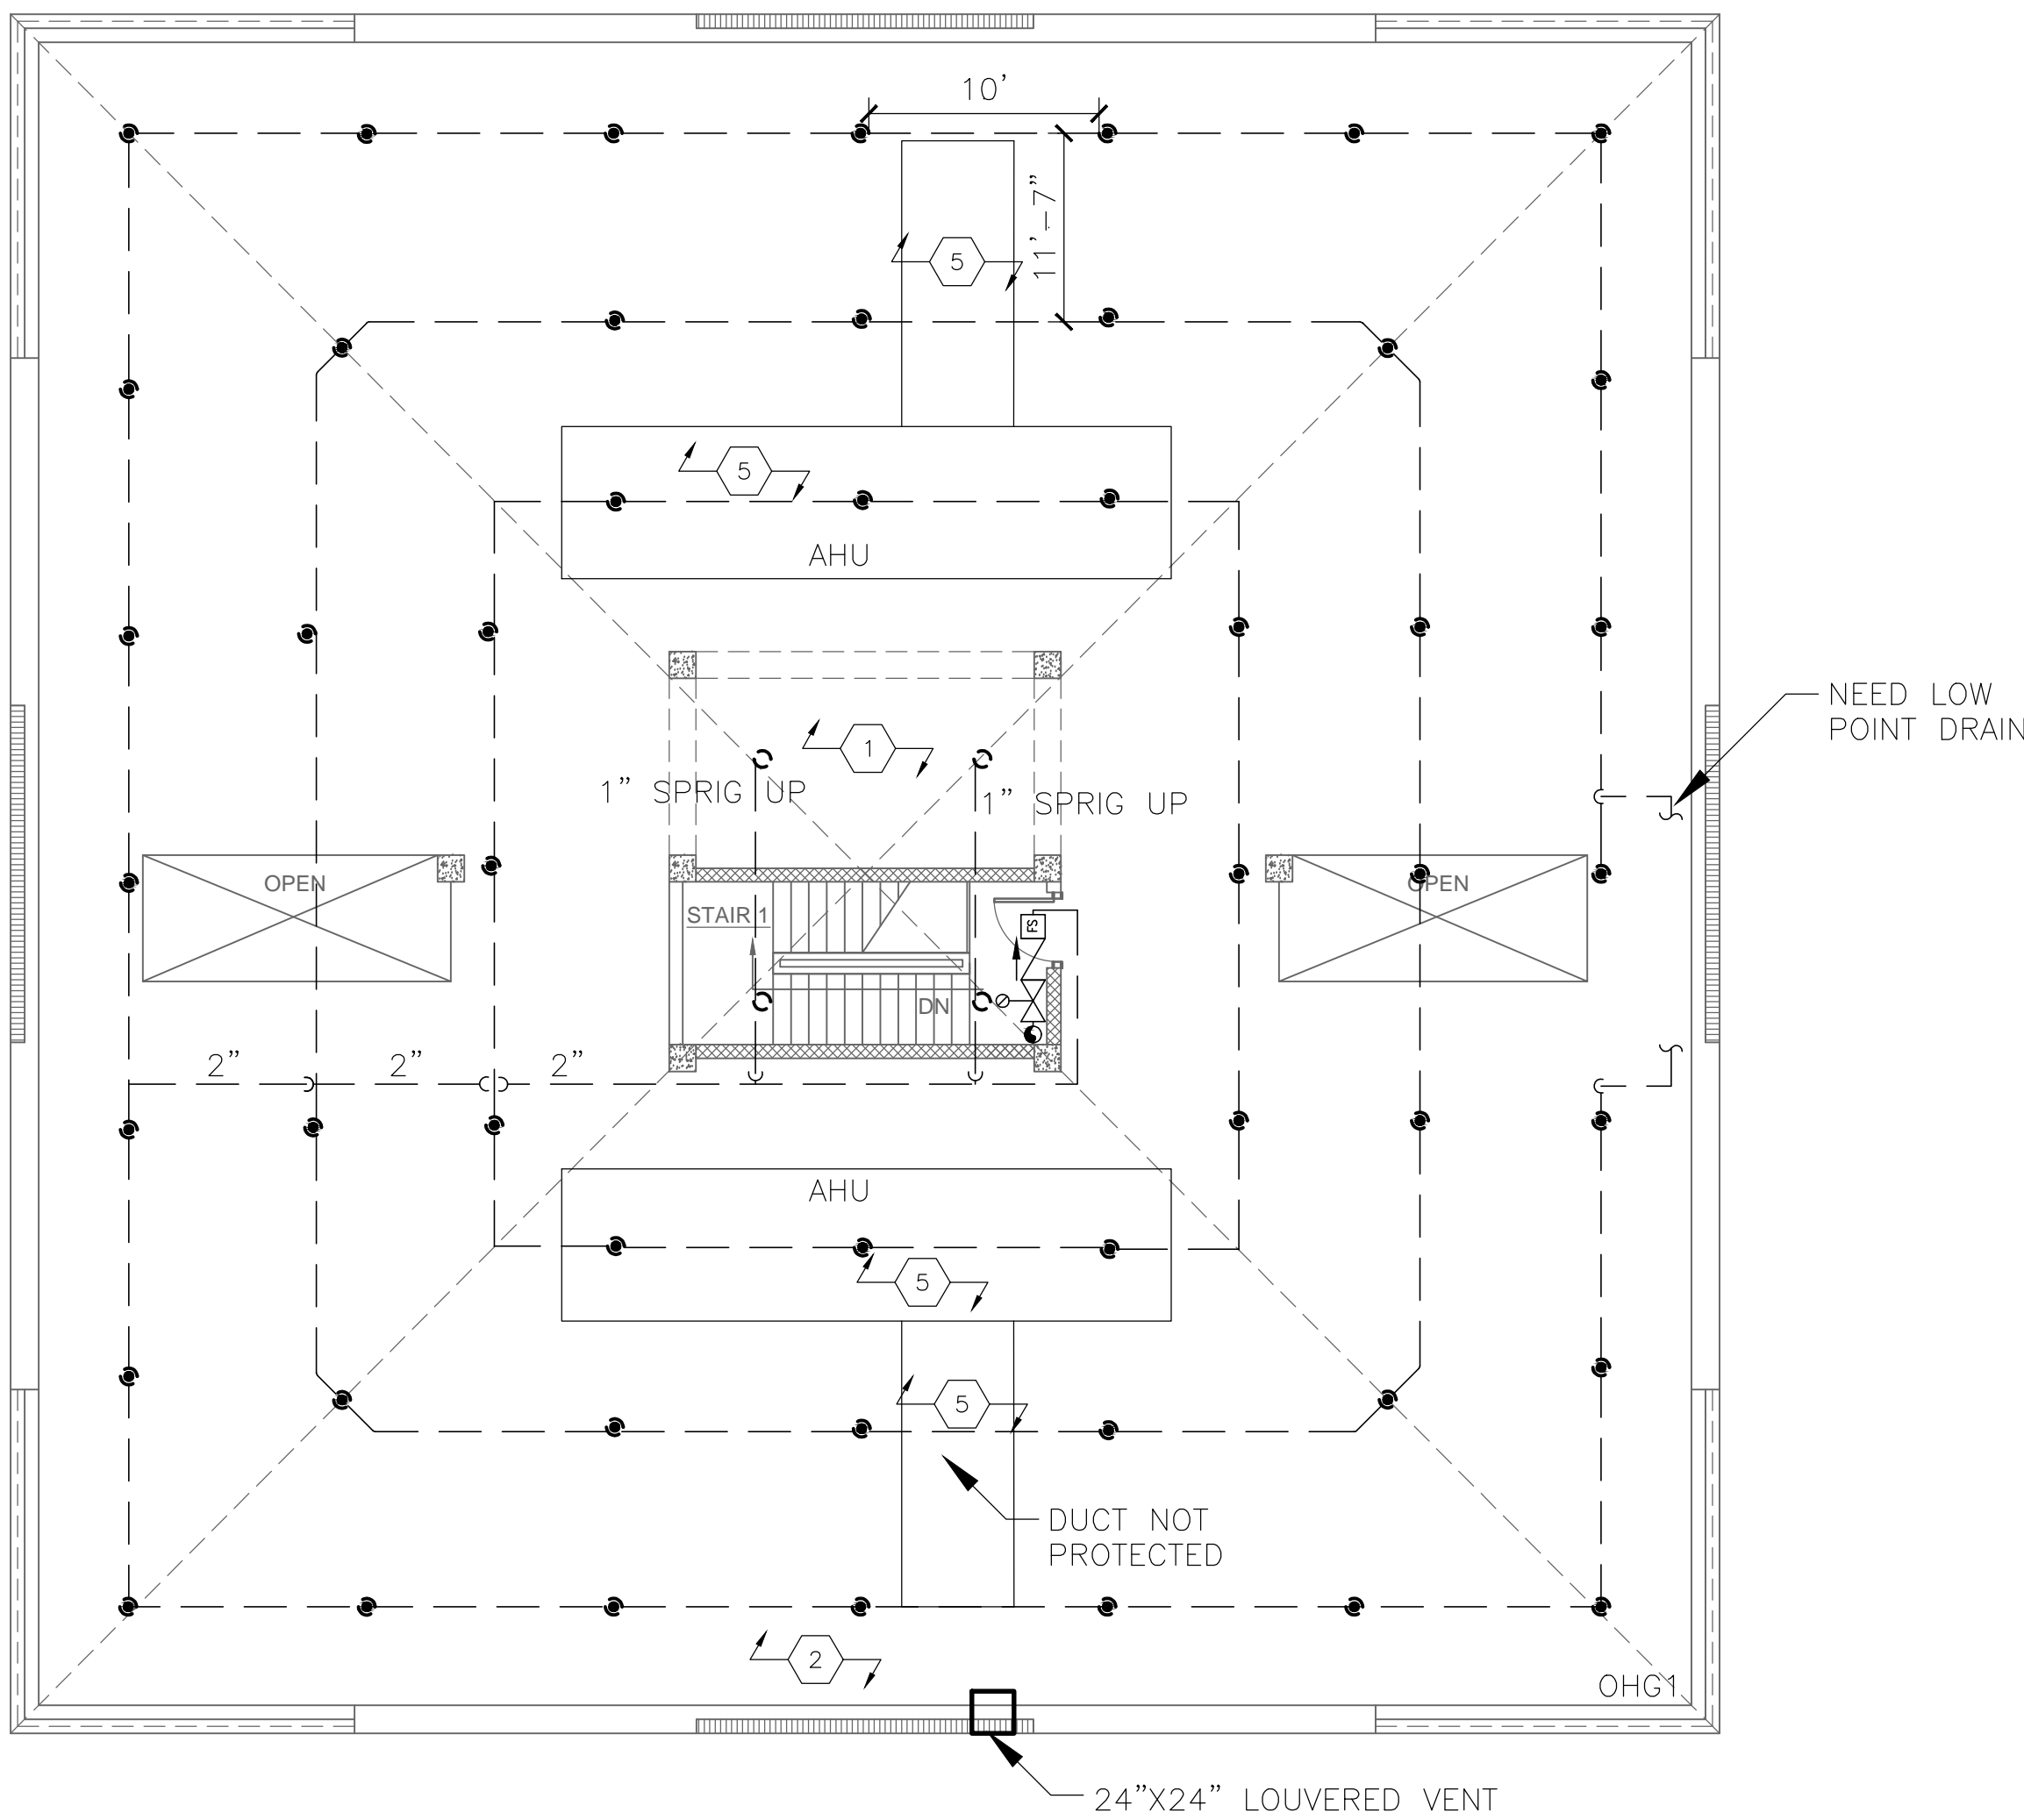- KEYED NOTES:
- 1. DEFICIENCY NUMBER 3 IN THE FIELD REPORT.
 - 2. DEFICIENCY NUMBER 5 IN THE FIELD REPORT.
 - 3. DEFICIENCY NUMBER 27 IN THE FIELD REPORT.
 - 4. DEFICIENCY NUMBER 10 IN THE FIELD REPORT.
 - 5. NO SPRINKLER PROTECTION UNDER MECHANICAL DUCT WORK.



2 PENTHOUSE EXISTING FIRE SUPPRESSION PLAN
FP-204 SCALE 1/8" = 1'-0"

ISSUED FOR CONSTRUCTION
FULLY SPRINKLERED

Revisions		Date		ENGINEERS:		Professional Stamp/Seal		ARCHITECT/CONSULTANT:		Drawing Title		Project Title		Date		Office of Facilities Management	
0	CONSTRUCTION DRAWINGS	06 MAY 11		<div><div><p>APOGEE Consulting Group, PA (919) 858-7420 Fax (919) 858-7423 Apogee Project # 2010-242 Alabama COA# CA-2180-E</p></div><div><p>STANTON ENGINEERING SERVICES, LLC FIRE PROTECTION ENGINEERS 10280 OLD COLUMBIA RD., STE. 275 COLUMBIA, MD 21046 (410) 296-9301 Fax (410) 296-9305</p></div></div>													