






- A. ALL AREAS ARE LIGHT HAZARD UNLESS OTHERWISE NOTED ON THIS PAGE.
- B. ALL DRYWALL CEILINGS (HARD CEILING) AT 8'-0".
- C. ALL ACOUSTICAL TILE CEILINGS AT 8'-6".
- D. ALL SPRINKLER LOCATIONS FIELD VERIFIED.
- E. ALL PIPING LOCATIONS AND SIZES ARE ESTIMATED FROM FIELD SURVEY. PRIOR TO START OF SHOP DRAWINGS, A DETAILED FIELD SURVEY SHALL BE PERFORMED TO DETERMINE ACCURATE LOCATION AND PIPE SIZES AND PROVIDE ACCURATE AS BUILT DRAWING SET.

1. DEFICIENCY NUMBER 30 IN FIELD REPORT.
2. DEFICIENCY NUMBER 31 IN FILED REPORT.

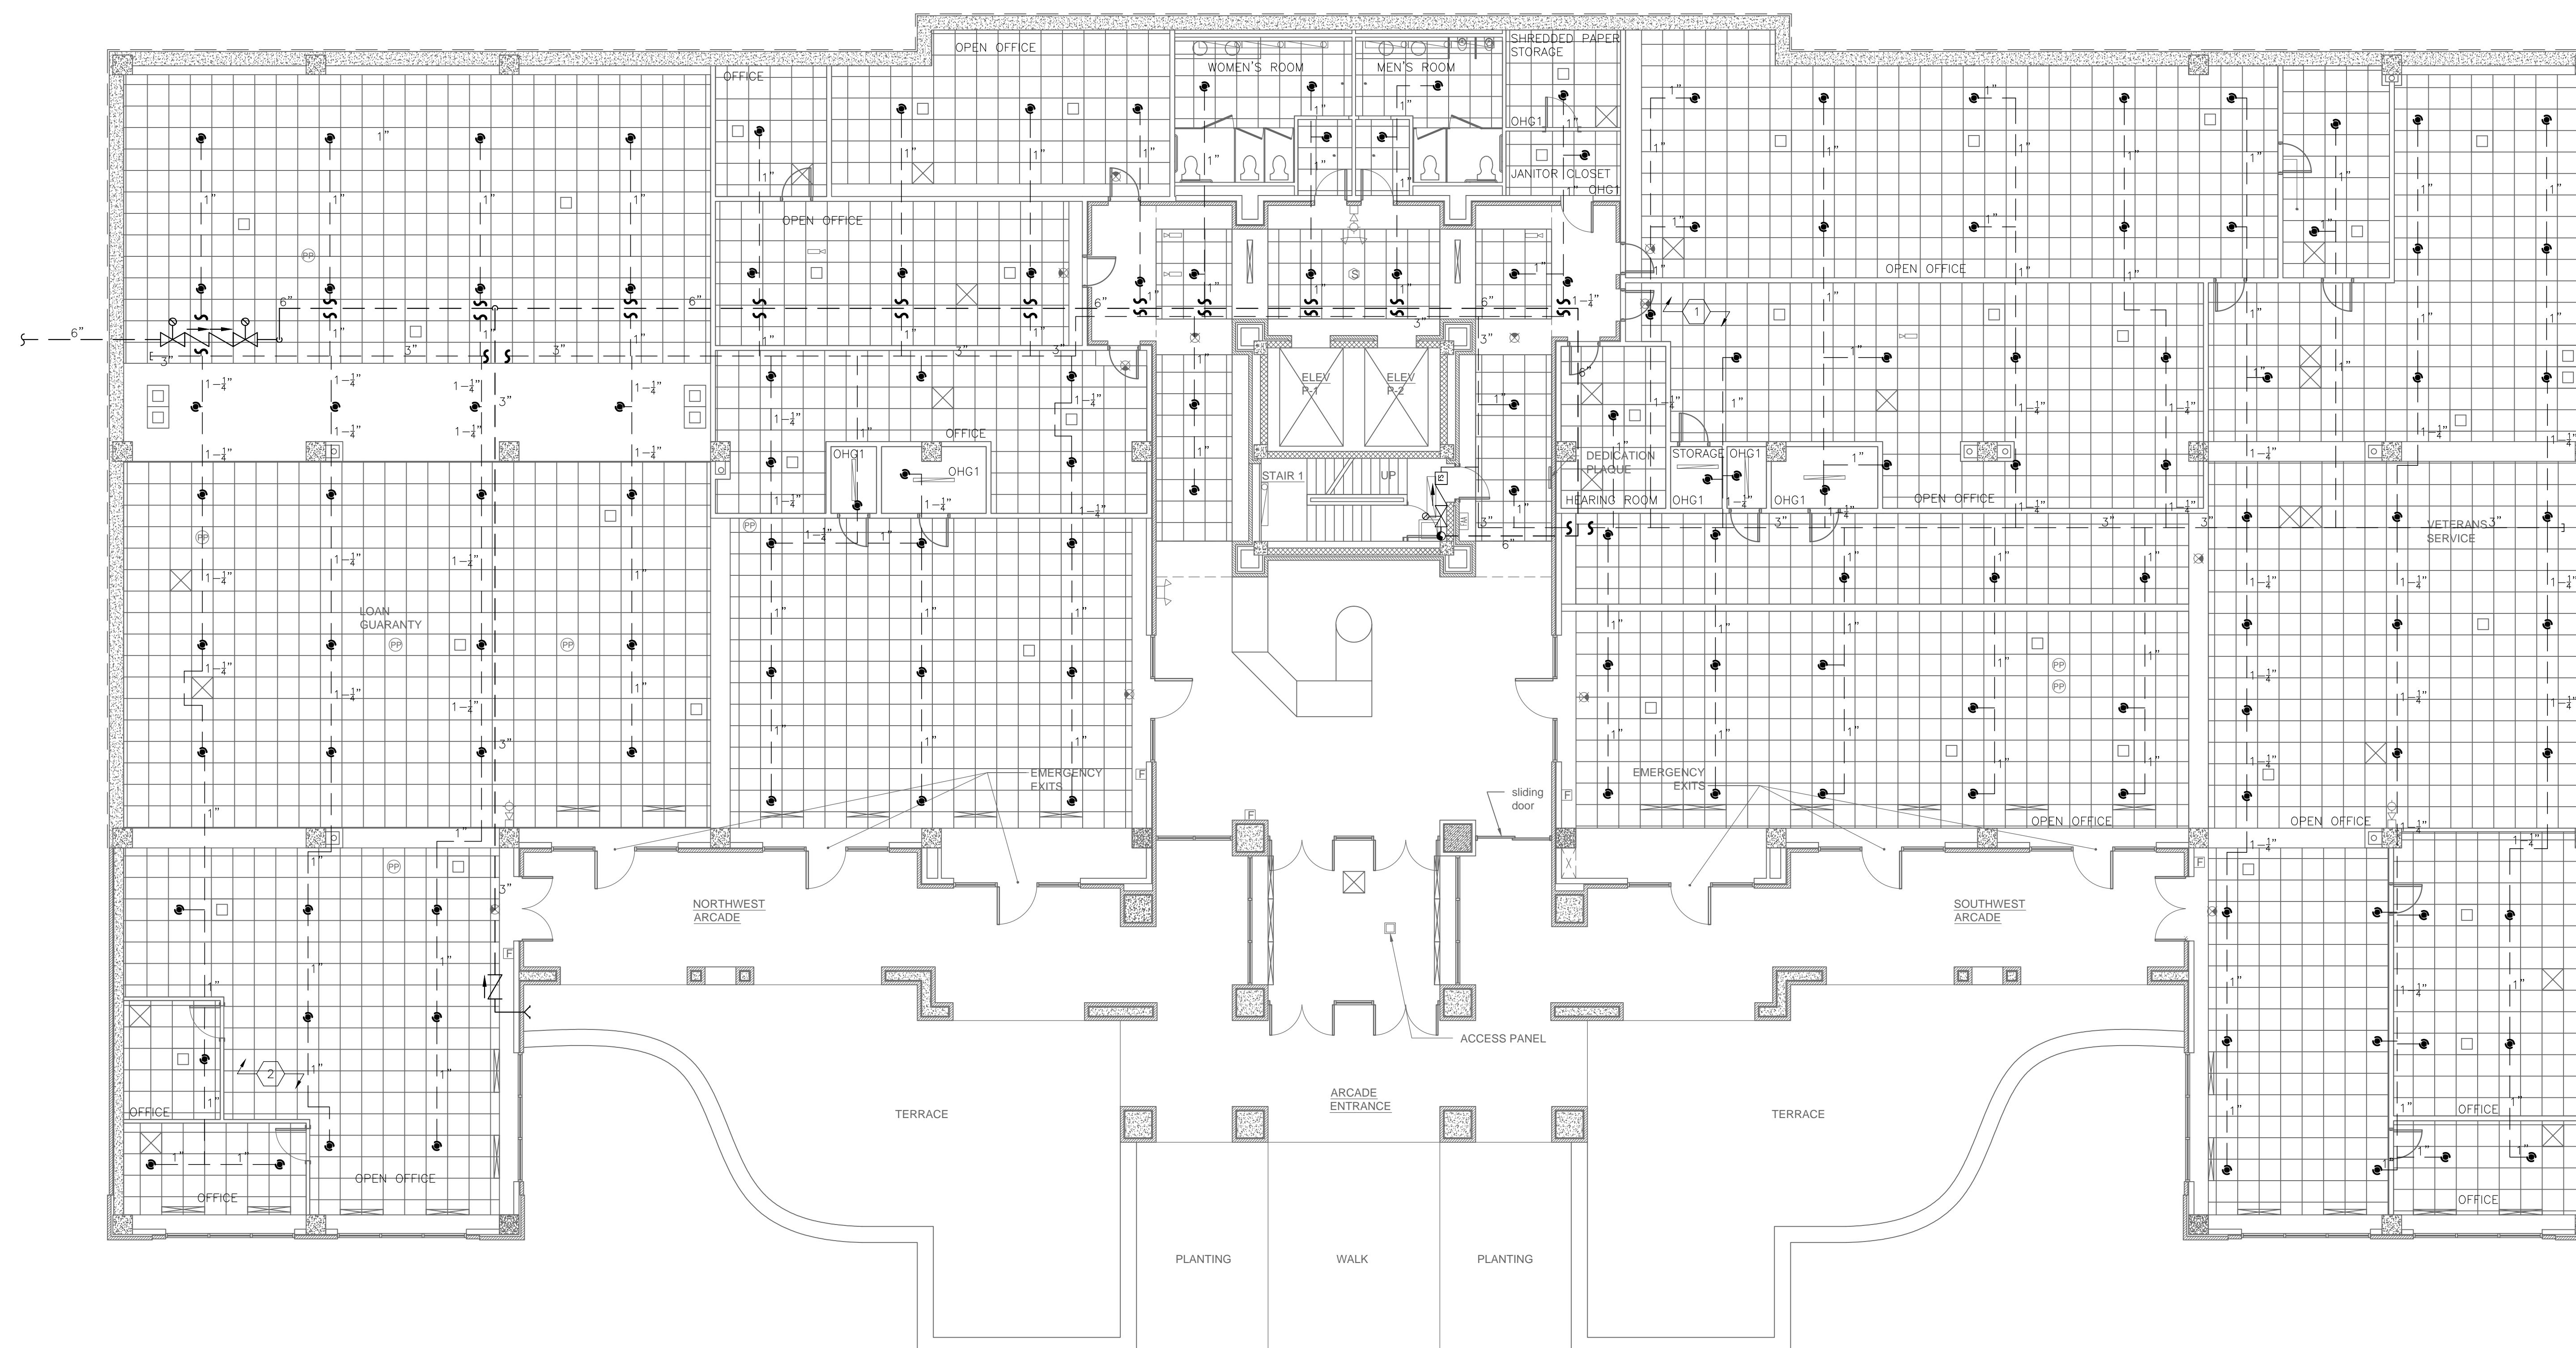

1 1ST FLOOR EXISTING FIRE SUPPRESSION PLAN
FP-201 SCALE: 1/8" = 1'-0"

ISSUED FOR CONSTRUCTION
FULLY SPRINKLERED

Revisions		Date	ENGINEERS:		Professional Stamp/Seal	ARCHITECT/CONSULTANT:			Drawing Title 1ST FLOOR EXISTING FIRE SUPPRESSION PLAN		Project Title FIRE ALARM & SPRINKLER HEAD REPLACEMENT		Date 05/06/11	Office of Facilities Management  Department of Veterans Affairs
0	CONSTRUCTION DRAWINGS	06 MAY 11	 APOGEE Consulting Group, PA 17330 Chapel Hill Road Suite 202 Raleigh, N.C. 27607 (919) 858-7420 Fax (919) 858-7423 Apogee Project #: 2010 242 Alabama COM# CA-2180-E		 STANTON ENGINEERING SERVICES, LLC FIRE PROTECTION ENGINEERS 10289 OLD COLUMBIA RD., STE. 275 COLUMBIA, MD 21046 (410) 296-5931 FAX 410-296-5930				Approved: Mariano Roman, CO Approved: Priscilla Humphrey-Parker, COTR		Building No. --- Scale AS SHOWN Drawn/Checked DML		Project No. VA322-P-0006 DRAWING NO. FP-201 Dwg. 12 of 19	