
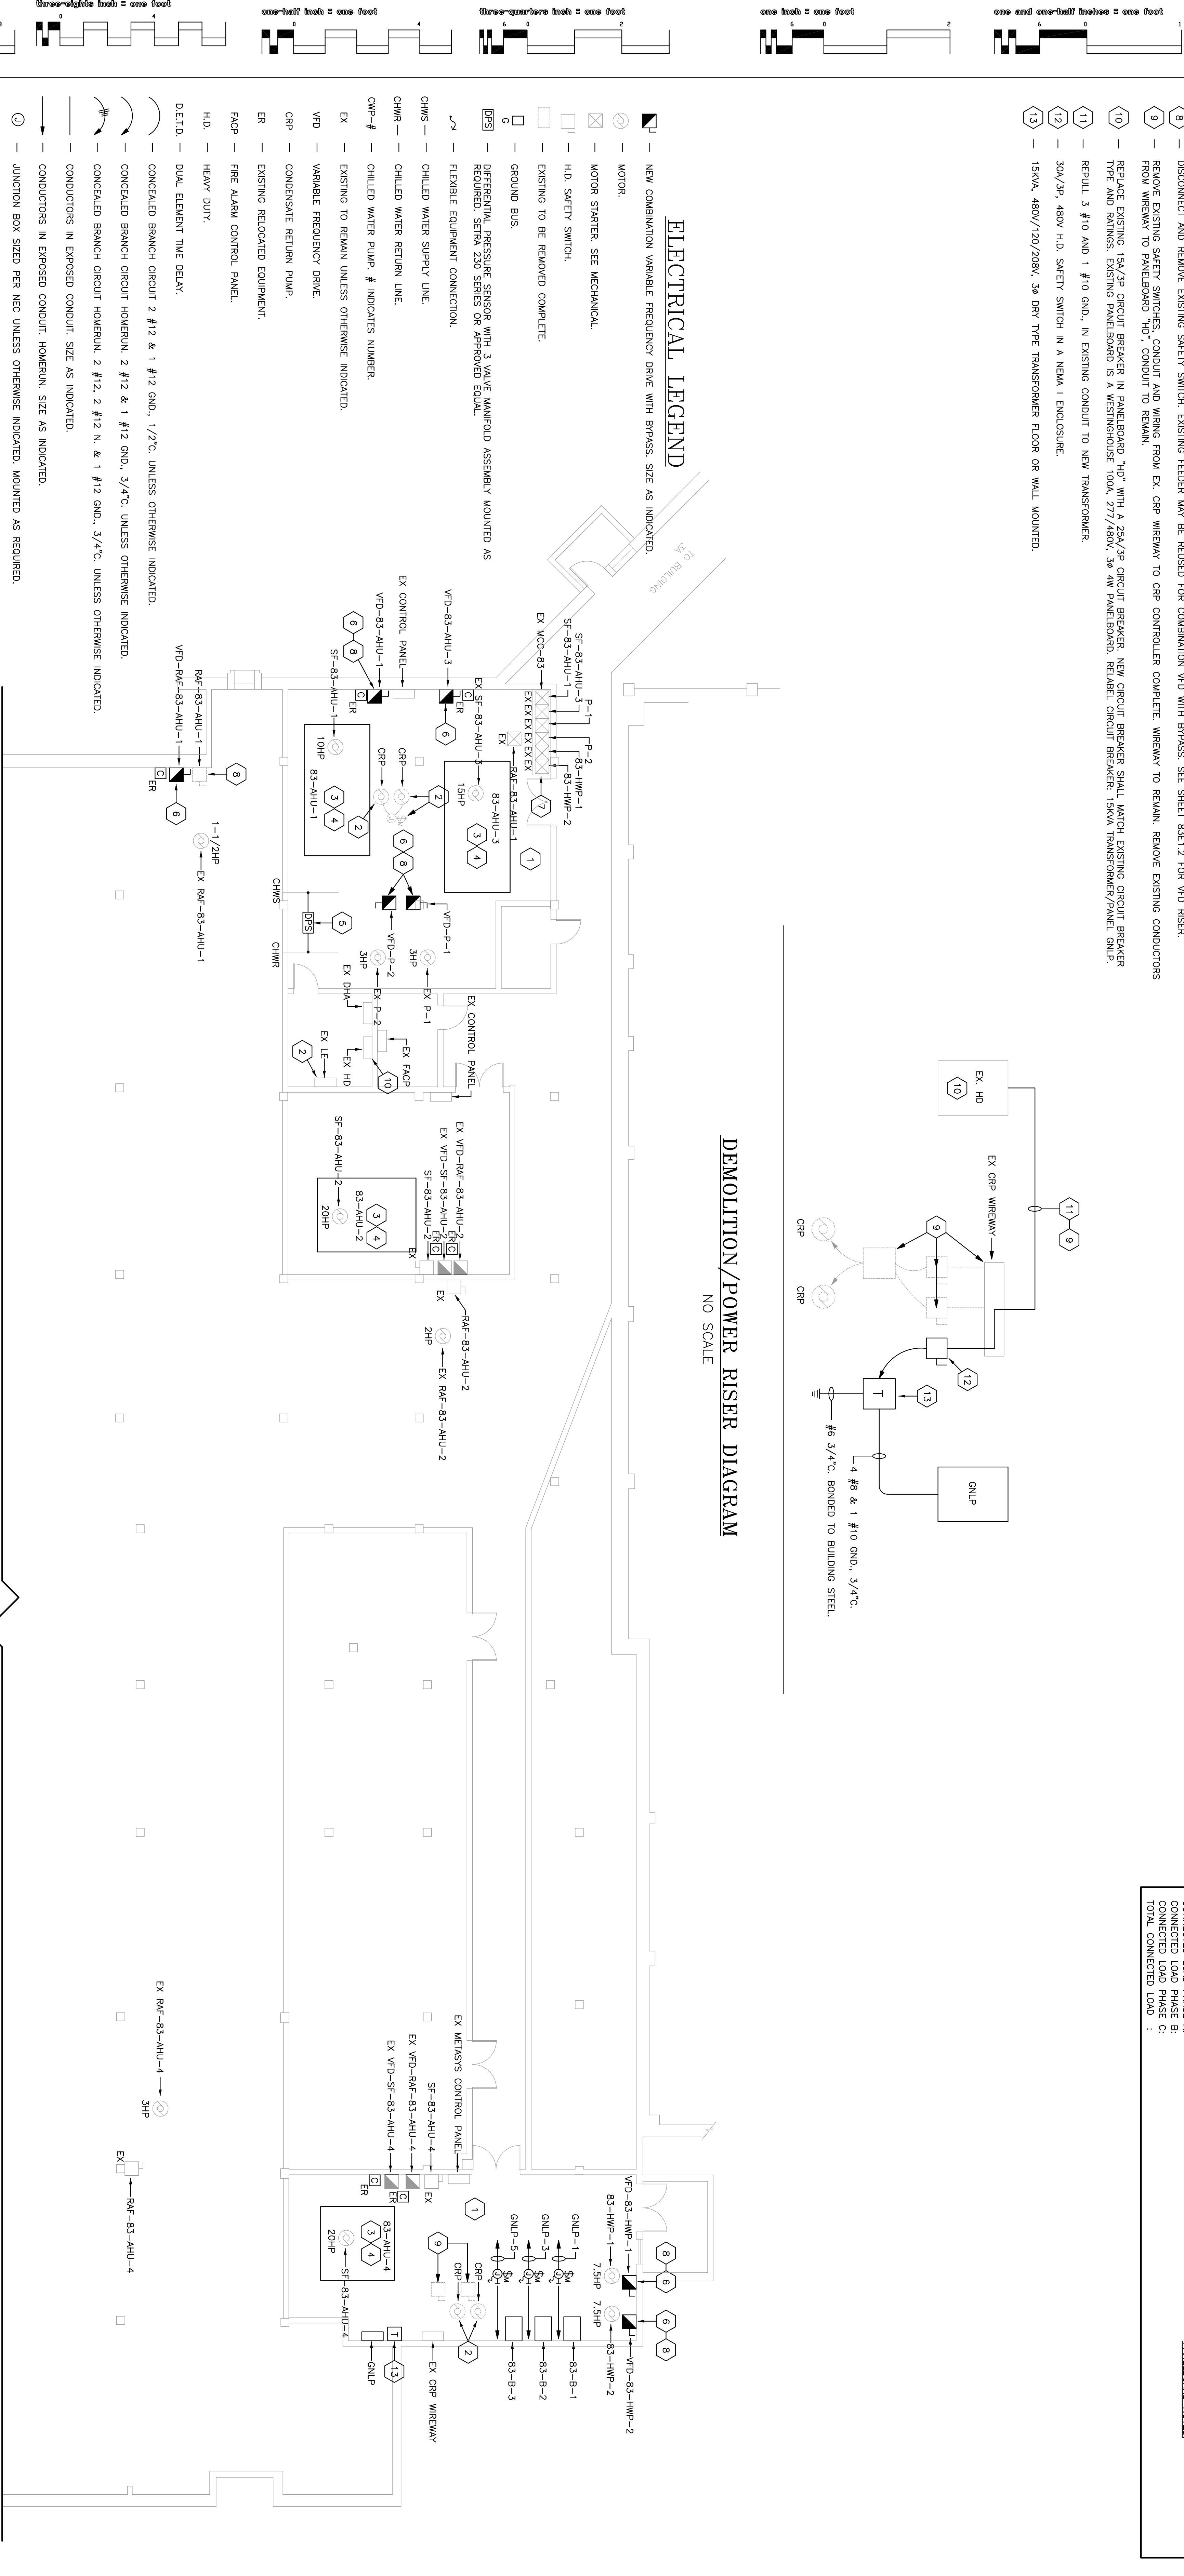


GENERAL NOTES:

1. CONTRACTOR SHALL VISIT SITE PRIOR TO BIDDING TO DETERMINE EXISTING AS-BUILT CONDITIONS.
2. IF ANY EXISTING UTILITY IS DAMAGED DURING CONSTRUCTION, THE CONTRACTOR SHALL REMEDY IMMEDIATELY AT NO ADDITIONAL COST TO THE GOVERNMENT.
3. CONTRACTOR SHALL COORDINATE THIS WORK WITH STATION ENGINEERING DEPARTMENT. A MINIMUM OF FIVE DAYS WRITTEN NOTICE SHALL BE REQUIRED PRIOR TO ANY SHUTDOWNS.
4. CONTRACTOR SHALL BE PROHIBITED FROM WORKING ON ENERGIZED ELECTRICAL SYSTEMS OR CONDUCTORS IN ACCORDANCE WITH WA POLICY.
5. NEW FIRE ALARM SYSTEM COMPONENTS SHALL BE PROVIDED BY SUPPLIER. EXISTING COMPONENTS, WHERE EXISTING COMPONENTS SHOWN ON DRAWINGS ARE NOT IDENTICAL TO MATCH EXISTING COMPONENTS, SHALL BE IDENTICAL TO MATCH EXISTING COMPONENTS. EXISTING COMPONENTS SHOWN ON DRAWINGS ARE NOT IDENTICAL TO MATCH EXISTING COMPONENTS, SHALL BE IDENTICAL TO MATCH EXISTING COMPONENTS. EXISTING COMPONENTS SHOWN ON DRAWINGS ARE NOT IDENTICAL TO MATCH EXISTING COMPONENTS, SHALL BE IDENTICAL TO MATCH EXISTING COMPONENTS.
6. DISCONNECT EXISTING VAW BOXES AND LIGHTING FIXTURES AS INDICATED. MODIFY OR EXTEND EXISTING CIRCUITRY AS REQUIRED AND RECONNECT NEW VAW BOXES AND LIGHTING FIXTURES TO EXISTING CIRCUITRY FOR REPLACEMENT. SEE ELECTRICAL AND MECHANICAL PLANS FOR EXACT LOCATION AND QUANTITIES.
7. NEW CIRCUIT BREAKERS ADDED TO EXISTING PANELBOARDS OR MCC SHALL MATCH EXISTING BREAKER TYPE AND RATINGS. PANELBOARD SCHEDULES SHALL BE REVISED TO REFLECT CIRCUIT MODIFICATIONS.
8. CONTROL PANELS SHOWN ARE APPROXIMATE. VERIFY EXACT LOCATION WITH MECHANICAL AND PROVIDE POWER CONNECTIONS AS REQUIRED.


PANELBOARD SCHEDULE														
PANEL: GMP			MANS: 50A MB			SERVICE: 208/120V 3Ø 4W								
TYPE: NODD 41BL CU			A.I.C.: 18 KA			MOUNTED: SURFACE								
			CIRCUIT BREAKERS											
			VOLT-AMP LOAD						VOLT-AMP LOAD					
DESCRIPTION			PHASE A	PHASE B	PHASE C	TRIP	POLE	CIR	TRIP	POLE	PHASE A	PHASE B	PHASE C	DESCRIPTION
83-8-1			360			20	1	2	20	1	0			SPARE
83-8-2			360			20	1	5	20	1	0			SPARE
83-8-3			360			360	2	4	20	1	0			SPARE
SPARE			0			20	1	7	8	20	1	0		SPARE
SPARE			0			20	1	9	10	20	1	0		SPARE
SPARE			0			20	1	11	12	20	1	0		SPARE
SPARE			0			20	1	13	14	20	1	0		SPARE
SPARE			0			20	1	15	16	20	1	0		SPARE
SPARE			0			20	1	17	20	1	0			SPARE
SUB TOTAL			0	0	0	0	0	1	17	20	1	0	0	SUB TOTAL
CONNECTED LOAD PHASE A														
CONNECTED LOAD PHASE B														
CONNECTED LOAD PHASE C														
TOTAL CONNECTED LOAD :														
PANELBOARD NOTES														

### DEMOLITION/POWER RISER DIAGRAM

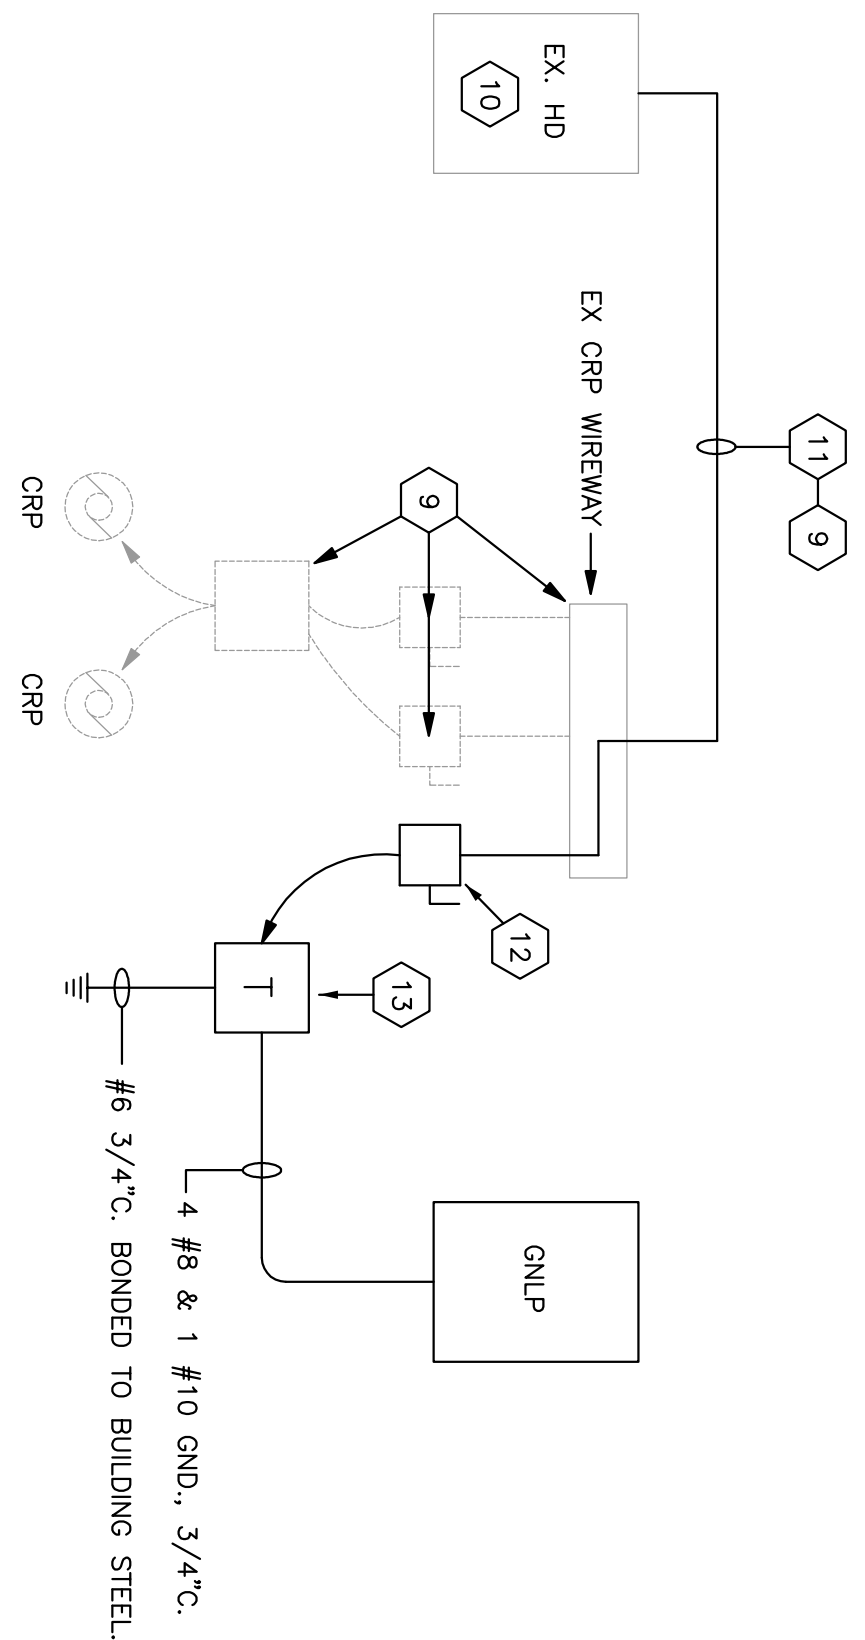

BUILDING 83, PARTIAL GROUND FLOOR PLAN

SCALE: 1/8" (0.32CM) = 1'-0" (30.5CM)

[illegible]