


**INSTALLATION:**

1. DETAILED AND MAINTAINED SCHEDULE IS REQUIRED AND MUST BE COORDINATED WITH VA MC.
  2. DRAWING IS CONCEPT ONLY. ALL DIMENSIONS AND EXISTING CONDITIONS MUST BE FIELD VERIFIED.
- WORK TO BE PERFORMED MONDAY THROUGH FRIDAY.
3. POUR TWO (2) 4-INCH HIGH HOUSEKEEPING PADS - ONE FOR PUMP BASES AND ONE FOR TANK BASES.
    - 3.1. PIN EACH WITH QUANTITY OF SIX (6), SIZE 1/2-INCH ANCHORS AND HILTI HIT-HY-150 ADHESIVE.
    - 3.2. USE #4 REBAR AT 12-INCH CENTERS IN BOTH DIRECTIONS AND MINIMUM 3,000 PSI CONCRETE.
    - 3.3. CHAMFER 1/2-INCH ALL AROUND.
  4. INSTALL WIRING/CONDUIT FROM PULL-BOX TO NEW CONTROL PANEL.
  5. INSTALL NEW VACUUM PUMPS, NEW SEPARATOR TANKS, ASSOCIATED PIPING, AND ELECTRICAL SERVICE.
  6. RUN DRAIN LINE FROM SEPARATORS TO EXISTING FLOOR DRAIN.
  7. CLEANUP REQUIRED BY CONTRACTOR TO REMOVE ANY CONSTRUCTION MATERIALS, AND DUST AND DEBRIS FROM CONSTRUCTION.
  8. CONTRACTOR WILL BE RESPONSIBLE FOR REMOVING ALL DEBRIS FROM VA PREMISES. CONTRACTOR MAY USE VA MC DUMPSTERS.

NEW

MECHANICAL EQUIPMENT ROOM LL528  
MECHANICAL SYSTEM RISER No. 0010

Revision	Description

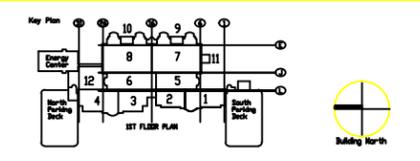

Drawing Title <b>NEW EQUIPMENT PLAN</b> Scale: 1/4"=1'-0" Approved: Chief Engineer	Project Title <b>FCA REPLACE DENTAL EVAC</b> Building Number 100 Location Detroit, Michigan	Date 3/7/2011 Project No. 553-11-120 DRAWING NO. <b>SHEET 3</b> Dep. or
---	--	---

Department of Veterans Affairs