

1. REFER TO SHEET A001 FOR GENERAL ARCHITECTURAL INFORMATION.
2. ALL DRAWING REFERENCES REFER TO DRAWINGS ON BLDG #1, PUBLIC INFORMATION CENTER, UNLESS NOTED OTHERWISE.
3. ALL DIMENSIONS ARE TO FACE OF STUD / CMU.
4. SEE SPECIFICATIONS FOR EQUIPMENT SCHEDULE.



1. GALVALUME STANDING SEAM ROOF ON 60 MILL HIGH TEMPERATURE ICE AND SNOW BARRIER ON 5/8" CDX PLYWOOD DECK.
2. GALVALUME BUTTER.
3. PT 2X8 AND 2X10 WRAPPED WITH 24 GA GALVALUME.
4. METAL TRUSS, SEE STRUCTURAL.
5. COAT STUCCO W SYNTHETIC FINISH ON WIRE MESH ON 3" LAYERS BUILDING UP TO 12" TOTAL.
6. 5/8" STRUCTURAL SHEATHING.
6. 6" STRUCTURAL STUD.
8. RUNNER TRACK.
9. 5/8" PT 1" X 1" GYP BD.
10. R19 BATT INSULATION WITH VAPOR BARRIER.
11. R40 BATT INSULATION WITH VAPOR BARRIER.
12. WOOD BEADBOARD CEILING W 1X2 TRIM AT ENDS. SEE FINISH SPECIFICATIONS ON A101 AND A102.
13. 1/2" X 16" X 16" TUBE, SEE STRUCTURAL. MITER ALL CORNERS AND WELD SOLID AND GRIND SMOOTH.
14. 16 GA DECORATIVE CAP. CLOSE TOP WITH 16 GAGE MATERIAL. MITER ALL CORNERS AND WELD SOLID AND GRIND SMOOTH.
15. 6X6X1/4" STL TUBE COLUMN, SEE STRUCTURAL.
16. ALUMINUM GUARDRAIL, EQUAL TO RAILING WORKS "TRADITIONAL RAILINGS" SPANNING UP TO 8" AND SUPPORT A 200 LB LOAD IN ANY DIRECTION. ATTACH TO COLUMNS WITH CLIP ANGLES TOP AND BOTTOM.
17. 1X2 TRIM, PAINT.
18. ALUMINUM FLOOR REGISTER, SEE MECHANICAL.
19. 4" CONCRETE SLAB.
20. 5/8" FIBERGLASS REINFORCED SPOFF BOARD.
21. 1 1/2" METAL DECK, SEE STRUCTURAL.
22. 16 GA 4 X 4 STEEL ANGLE.
23. 16 GA STEEL HAT CHANNEL, 24" OC.
24. SOFFIT VENT, SEE DETAIL DS/AS01.
25. 1/2" WALKER, PAINTED BLACK.
26. BLACK DUCT LINER.
27. ASPEN CEILING, 1X6 W 1/2" GAP BETWEEN PLANKS, ATTACHED TO WALKERS.
28. 4" METAL STUD, 20 GA, INSTALL 2" -0" OC.
29. 4" METAL STUD.
30. 1" PERIMETER INSULATION.
31. SLOPE PORCH 1/8" IN 1'-0", SEE GRADING PLAN.
32. ENCASE STEEL COLUMN IN 3" OF CONCRETE ALL FOUR SIDES AND SEAL COLUMNS TO CONCRETE.
33. 6" CONCRETE STEEL WALL. SEE STRUCTURAL.
34. CONCRETE FOOTING, SEE STRUCTURAL.
35. UNDERGROUND DUCT.
36. 12" EXPANSION JOINT, TYPICAL AT ALL SLAB EDGES.
37. ENCASE DUCT IN CONCRETE. SEE UNDERSLAB DUCT DETAIL ON SHEET H-501.
38. SUSPENDED GYP BOARD CEILING.
39. CONCRETE BASE FOR COLUMNS. SEE STRUCTURAL.
40. 8" X 6" STEEL TUBE BEAM. SEE STRUCTURAL.
41. 6" STUDS AT 24" OC.

IN THE EVENT THAT BONES OR HISTORIC ARCHAEOLOGICAL MATERIAL ARE UNCOVERED DURING CONSTRUCTION OR EARTH-DISTURBING ACTIVITIES, CEASE WORK IMMEDIATELY AND PROTECT THE REMAINS FROM FURTHER DISTURBANCE. NOTIFY THE OWNER, THE DIRECTOR OF FORT BLISS NATIONAL CEMETERY AT (915) 564-0201. THE OWNER WILL CONTACT THE NEW MEXICO HISTORIC PRESERVATION DIVISION (SHPO). THE OWNER AND SHPO MAY DISCUSS THE APPROPRIATE WAY TO PROCEED. DIRECTION TO THE CONTRACTOR WILL BE PROVIDED BY THE OWNER.



SCALE: 1/2" = 1'-0"

SUB-CONSULTANTS

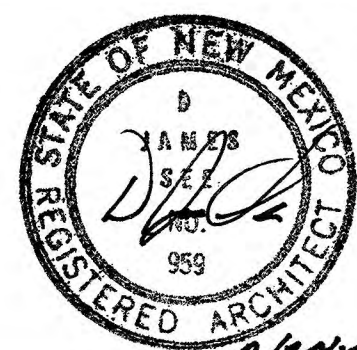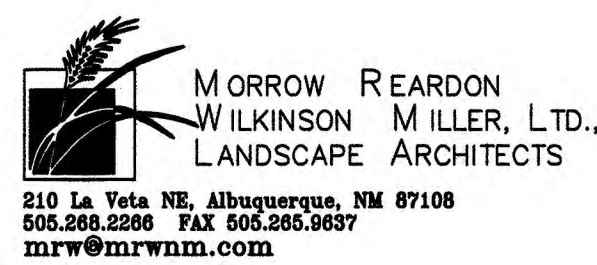

PRIME CONSULTANT

URS

2020 K STREET, SUITE 300
WASHINGTON, DC 20006
TELEPHONE: (202)872-0277 FAX:
(202)872-0282.

Drawing Title	PIC WALL SECTIONS AND DETAILS
---------------	-------------------------------

Approved: Director Office of Construction Management

Project Title

**CEMETERY IMPROVEMENTS AND
NEW MAINTENANCE BUILDING**

Location	FORT BAYARD, NEW MEXICO
----------	-------------------------

Checked	Drawn
---------	-------

Project Number
885CM3007

Building Number
BLDG #1

Drawing Number
A-301

NATIONAL CEMETERY
ADMINISTRATION
OFFICE OF DESIGN
AND CONSTRUCTION

