


DEMOLITION KEYNOTES

- ① MAKE-UP WATER PIPING LOCATED BELOW GRADE MAY BE ABANDONED IN PLACE PROVIDED IT DOES NOT INTERFERE WITH NEW PIER LOCATIONS. CONTRACTOR IS RESPONSIBLE FOR ESTABLISHING EXACT LOCATION OF EXISTING BELOW GRADE PIPING.
- ② EXISTING SUMP PUMP SHALL BE REMOVED AND BASIN SHALL BE BACK FILLED AND CAPPED WITH MINIMUM OF 8" CONCRETE TO MATCH EXISTING PIT FLOOR. EXISTING SUMP SANITARY VENT PIPING SHALL BE REMOVED AND ROOF PENETRATION SHALL BE PATCHED TO MATCH EXISTING ROOF. SUMP PUMP DISCHARGE PIPING SHALL BE CAPPED WITH A PIPE CAP TO PREVENT BACKFLOW FROM SEWER.
- ③ EXISTING FLOOR DRAIN SHALL BE REMOVED. AND PIPING CAPPED WITH CONCRETE TO MATCH EXISTING PIT FLOOR.
- ④ REMOVE DOMESTIC WATER PIPING TO EXISTING AIR PURGER (AIR PURGER TO BE REMOVED) AS SHOWN. SEE MECHANICAL NEW WORK PLANS FOR PIPING TO NEW AIR AND DIRT SEPARATOR.
- ⑤ REMOVE EXISTING 1/2" DOMESTIC COLD WATER TO EMERGENCY EYE WASH. SEE NEW WORK PLANS FOR ADDITIONAL REQUIREMENTS.
- ⑥ REMOVE AND CAP EXISTING MAKE-UP WATER PIPING TO A DEPTH OF 1'-0" BELOW TOP OF CONCRETE PAD. FILL OPENING WITH CONCRETE.
- ⑦ REMOVE EXISTING WATER METER PIPING ASSEMBLY. TURN METER OVER TO OWNER.
- ⑧ REMOVE CHEMICAL FEED PIPING BACK TO BALL VALVES AT THIS POINT. SEE CONDENSER WATER CONTROL SCHEMATIC FOR ADDITIONAL REQUIREMENTS.
- ⑨ CONTRACTOR SHALL REMOVE CONCRETE AROUND EXISTING FLOOR DRAIN AND VERIFY THERE IS ENOUGH INVERT TO CONNECT NEW FLOOR SINK AT THIS LOCATION. SEE NEW WORK PLANS FOR NEW FLOOR SINK LOCATION.


GENERAL DEMOLITION NOTES

1. NOT ALL EXISTING PIPING IS NECESSARILY SHOWN ON THIS DRAWING BUT WHAT WAS DEEMED NECESSARY TO SHOW THE INTENT OF WORK INVOLVED IN THIS PROJECT.
2. CONTRACTOR SHALL FIELD VERIFY EXISTING CONDITIONS PRIOR TO START OF ANY WORK, AND SHALL NOTIFY ARCHITECT IMMEDIATELY OF ANY DISCREPANCY BETWEEN THE DRAWINGS AND THE ACTUAL FIELD CONDITIONS.
3. CONTRACTOR SHALL REMOVE ALL MATERIALS AS REQUIRED AND SHALL GIVE THE OWNER THE OPPORTUNITY TO INSPECT SUCH MATERIALS FOR POTENTIAL SALVAGE. CONTRACTOR SHALL REMOVE FROM THE SITE ALL MATERIALS DEEMED "NON-SALVAGEABLE" BY THE OWNER. CONTRACTOR SHALL TURN OVER TO THE OWNER ALL MATERIALS DEEMED "SALVAGEABLE" BY THE OWNER.
4. REMOVE COOLING TOWERS, CONDENSER WATER PUMPS, AND ASSOCIATED PIPING, SUPPORTS, AND OTHER APPURTENANCES.
5. PATCH ALL WALL AND ROOF PENETRATIONS ASSOCIATED WITH DEMOLITION WORK (I.E. CONDENSER WATER PIPING, STEAM PIPING, MAKE-UP WATER PIPING, AND VENTS THRU ROOF, ETC.). PATCH WALLS AND ROOF TO MATCH EXISTING.

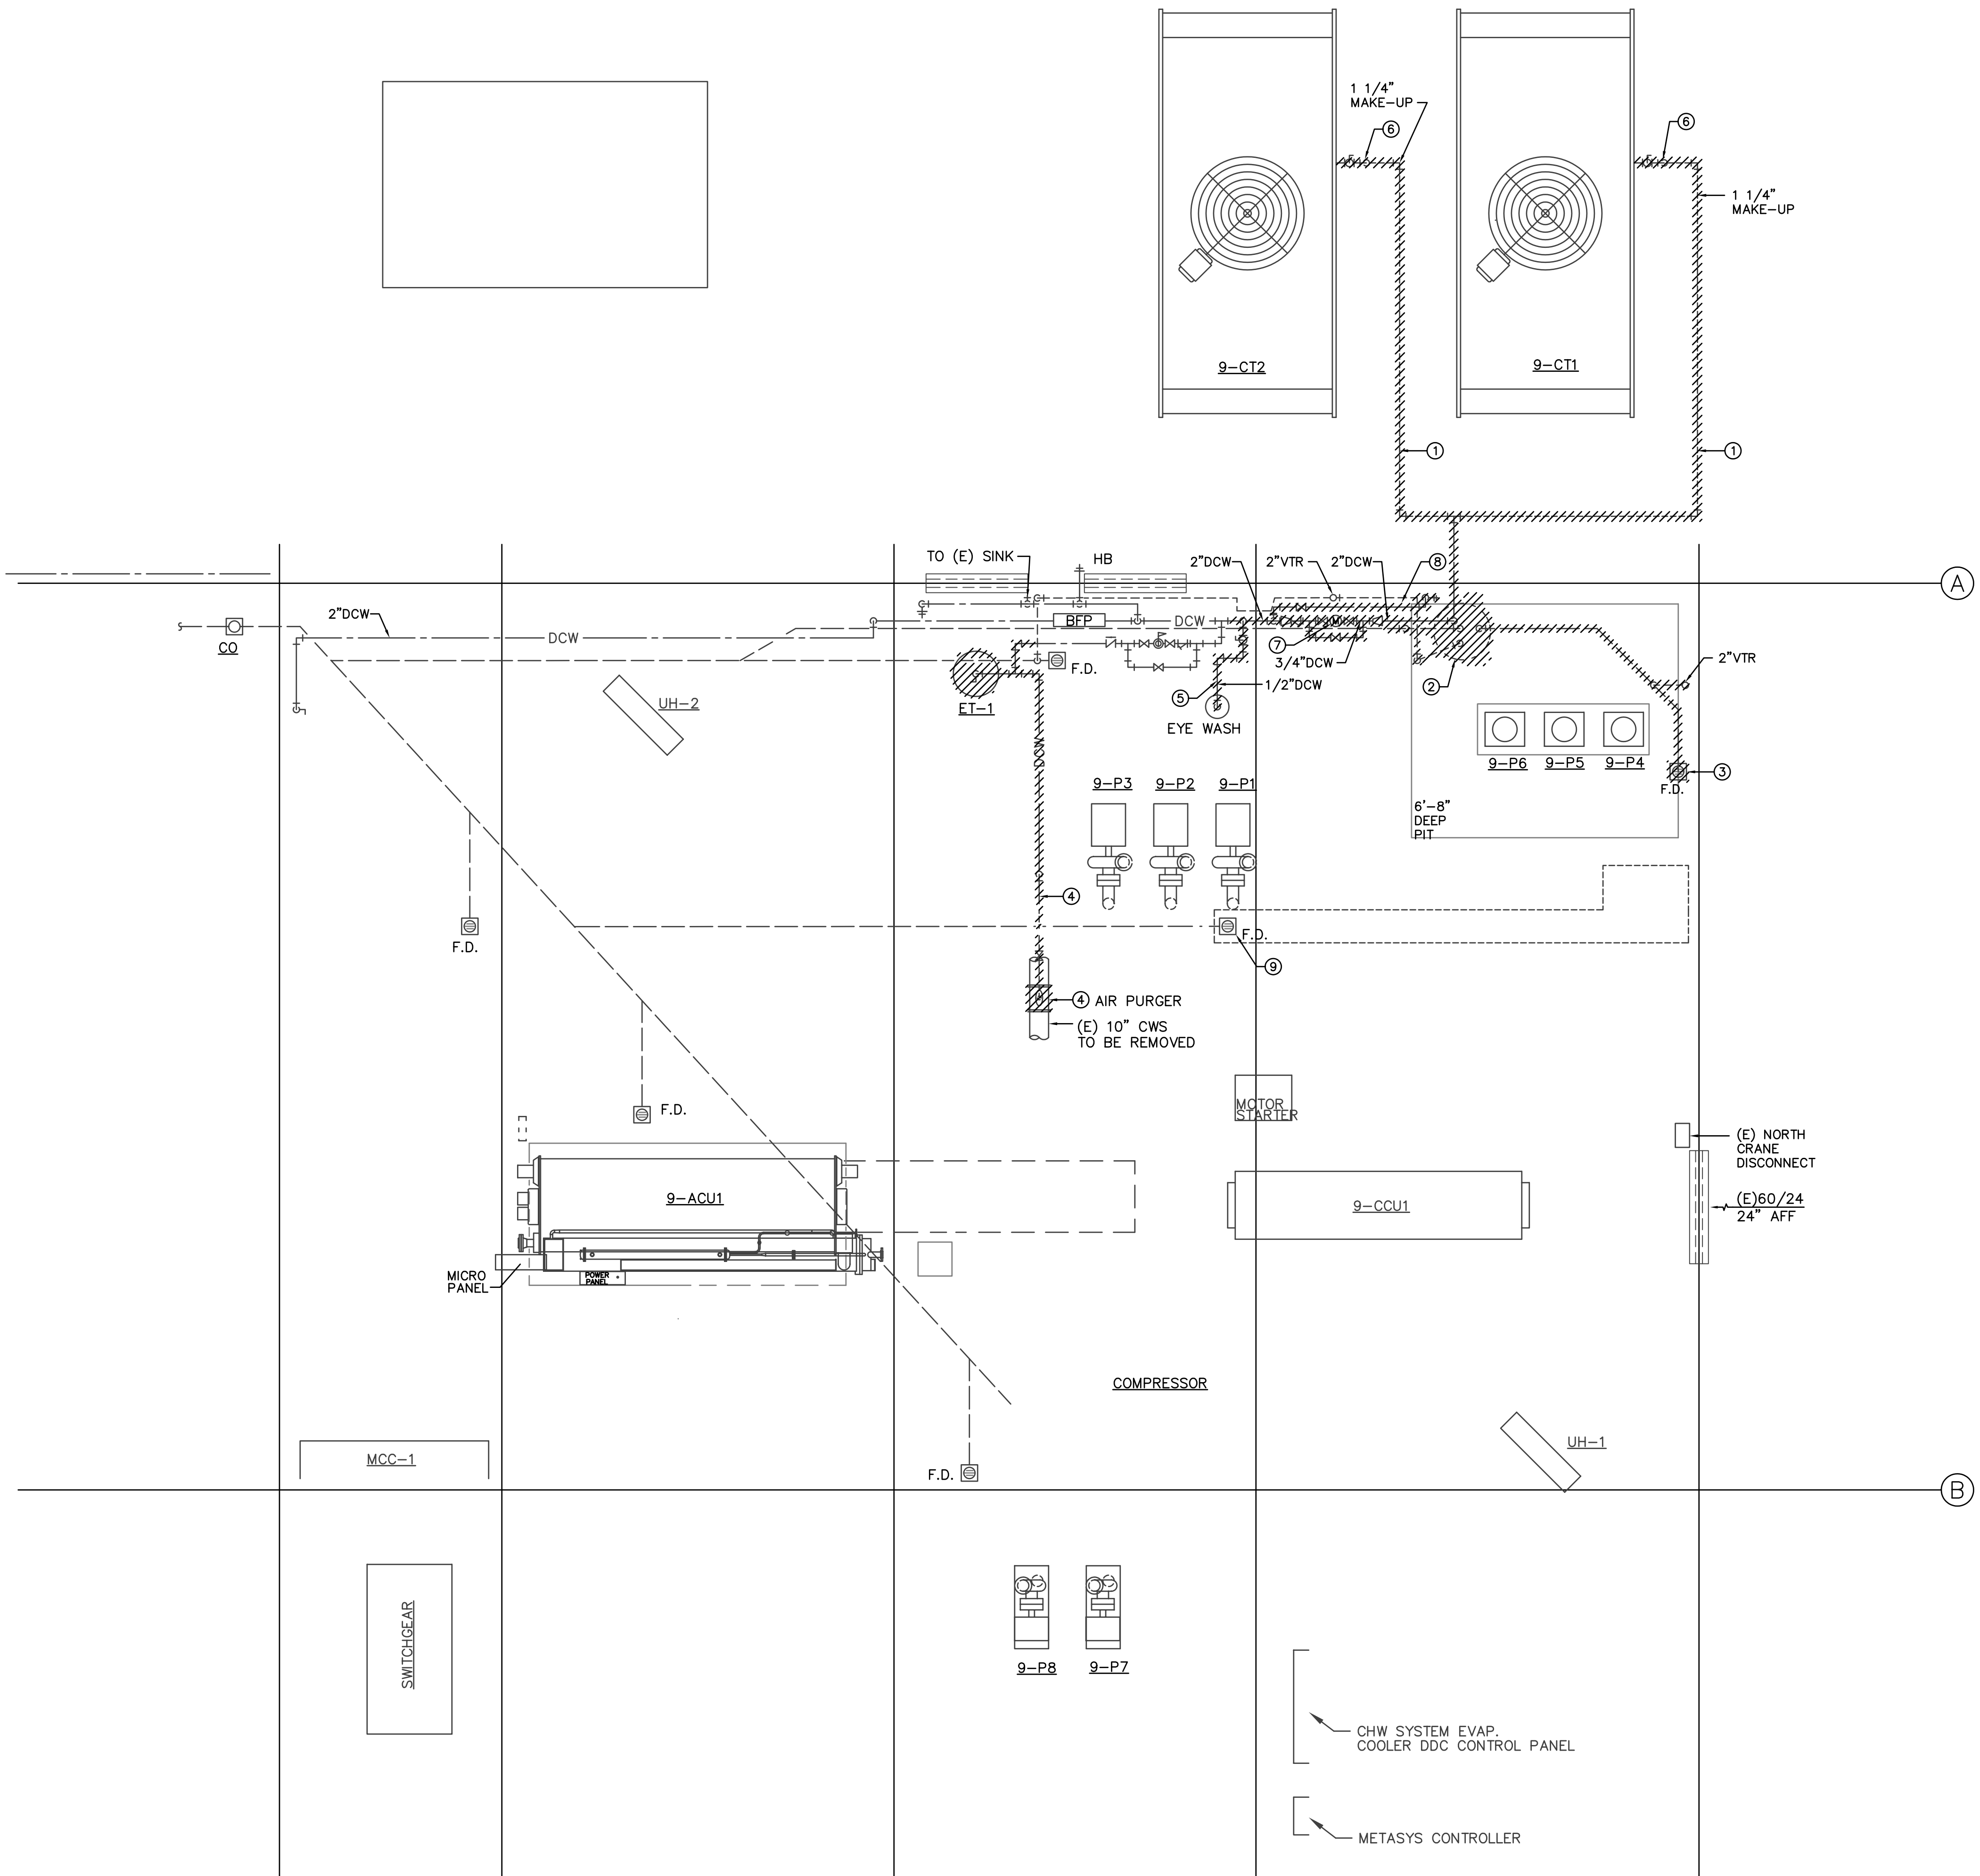

CHILLER PLANT DEMOLITION PLAN
SCALE: 1/4" = 1'-0"

CONSTRUCTION DOCUMENTS 95 % SUBMITTAL	08/12/2005 02/07/2005
Revisions	Date

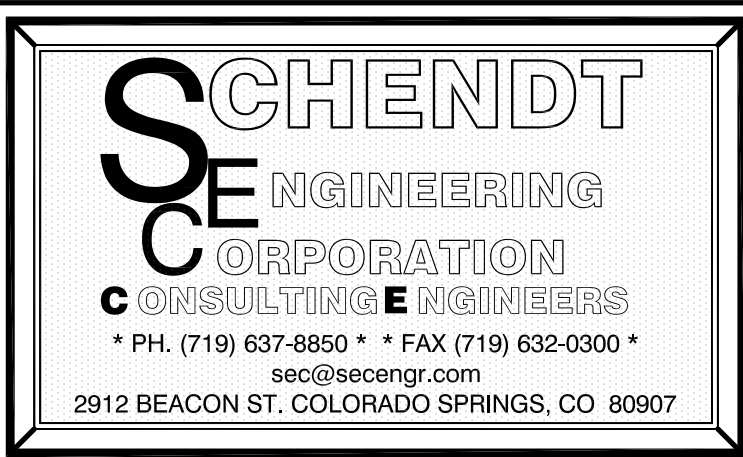

Drawing Title PLUMBING DEMOLITION PLAN
Approved: Medical Center Director -
Approved: Assistant Administrator, Engineering Department

Project Title REPLACE COOLING TOWERS
Location 2121 NORTH AVENUE GRAND JUNCTION, CO 81505
Date 08/05/2005
Checked TBS
Drawn DJS

Project Number 575-05-103
Building Number BUILDING NO. 9
Drawing Number P1
Dwg. 12 of 16

OFFICE OF
FACILITIES
MANAGEMENT

