

NOTES:

1. VERIFY DIMENSIONS IN FIELD PRIOR TO INSTALLATION.
2. ELECTRICAL EQUIPMENT NOT TO SCALE.
3. REFER TO SHEET E-203 FOR CONDUIT SCHEDULE.
4. X AT 3 MODULE LOCATIONS INDICATES THAT NO PV MODULE IS INSTALLED AT THIS LOCATION.
5. THE TWO SPURS IN THIS LOCATION WILL BE CUT OFF 6" OUTBOARD OF THE TILT BRACKET TO INCREASE CLEARANCE AROUND VENTILATOR.

NOTE:

FREE STANDING GUARD RAIL SYSTEM TO BE INSTALLED ALONG THE PERIMETER

ROOF HATCH GUARDRAIL:

1. SHALL BE BY KEE SAFETY OR EQUIVALENT.
2. SHALL COMPLY W/ OSHA 29 CFR 1910.23 & 29 CFR 1910.56
3. GATE SHALL HAVE SPRING HINGES.
4. SUBMIT PRODUCT DATA & SHOP DRAWINGS.
5. COMPLY W/ SPECIFICATIONS

C	CONSTRUCTION SET	THB	JLC	11.10.10
B	100% SUBMITTAL	THB	JLC	10.13.10
A	50% SUBMITTAL	THB	JLC	08.02.10
REV	DESCRIPTION	BY	CHK	DATE

SunWize
 1155 Flatbush Rd. Kingston, NY 12401
 Tel: 845-336-0146 Fax: 845-336-0457
 WWW.SUNWIZE.COM
 THIS DRAWING IS THE CONFIDENTIAL PROPERTY OF SUNWIZE TECHNOLOGIES


PROJECT NAME:
SAMUEL S. STRATTON VAMC

PROJECT / CUSTOMER INFORMATION:
 SAMUEL S. STRATTON VAMC
 113 HOLLAND AVENUE
 ALBANY, NY 12208
 PHONE: 518-626-5500

SHEET TITLE:
ROOF AND EQUIPMENT LAYOUT

PROJECT NUMBER: **523A8-12-0415L**
 DRAWING NUMBER: **00000000000000000000**
 PAPER SIZE: **ANSI A (36" X 48")**
 SHEET NO:

A-200

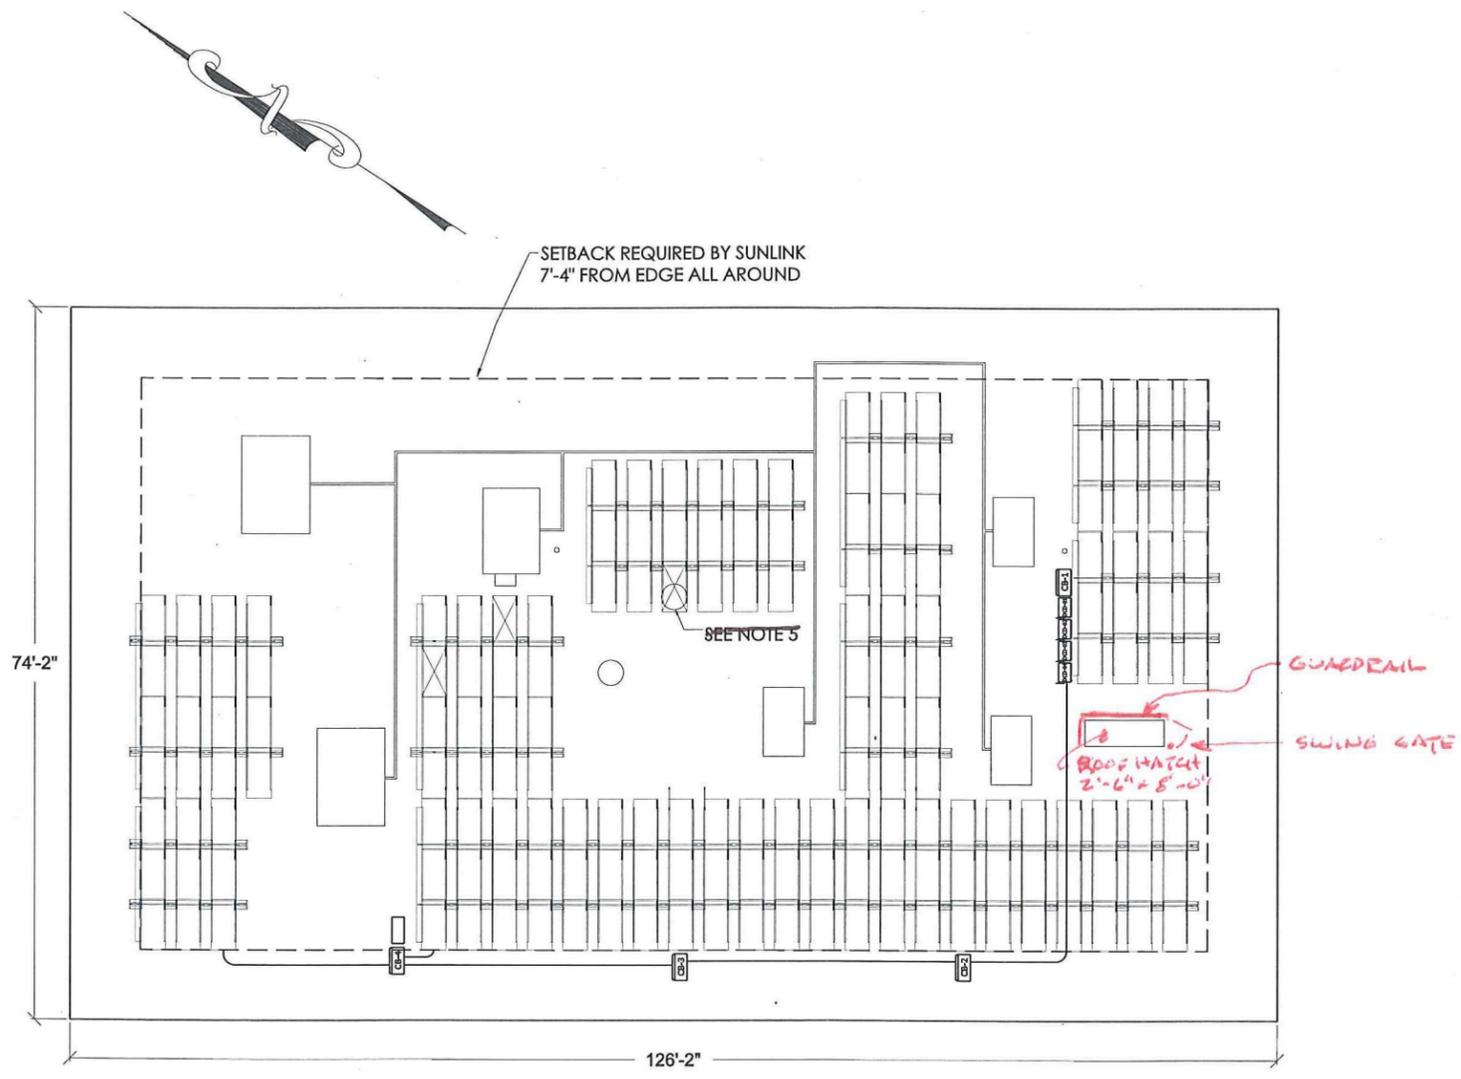

1 ROOF, PV ARRAY AND EQUIPMENT LAYOUT
 PLAN VIEW - SCALE: 1/8" = 1'-0"