

REQUEST FOR INFORMATION (RFI)

VA250-16-B-0621

PROJECT NUMBER:	506-15-101	Please ensure that before submitting questions or requests for clarification that you thoroughly read the solicitation, specifications, drawings and other pertinent documents. When submitting questions on this project the Government requires contractors to specifically identify the specification and/or solicitation section(s) or drawing number(s) in reference to the question or request for clarification submitted. No question or request for clarification will be answered by the Government unless the above requirements are met. Failure to comply may prevent the Government from responding in a timely manner.
PROJECT TITLE:	Renovate Endoscopy	
PROJECT LOCATION:	Department of Veterans Affairs Ann Arbor VAMC 2215 Fuller Rd. Ann Arbor, MI 48105	

SUBMITTED BY:	Boone & Darr, Inc.	City/State: Ann Arbor	Michigan
PHONE NO.:	734-665-0648		

TO: Contracting Specialist Richmond McCloud
Richmond.McCloud@va.gov

RFI NO.: 1	DATE: 11/16/16	REFERENCE:
REPLY NEEDED BY: Prior to Bid Date		


INFORMATION NEEDED:

Please reference Drawing M-601 and the Vacuum Pump Detail - Drawing refers to a vent detail. We are unable to find this detail and the routing of the vent piping. Please provide detail and pipe routing.

REPLY:

REFER TO THE INCLUDED PDF'S:
- SK-1 FOR WAGD EXHAUST DETAIL
- SK-2 FOR WAGD VENT PIPE ROUTING


REPLY FROM: PETER BASSO ASSOCIATES, INC.	DATE: 11/17/16
ATTACHMENTS:	COPY TO:

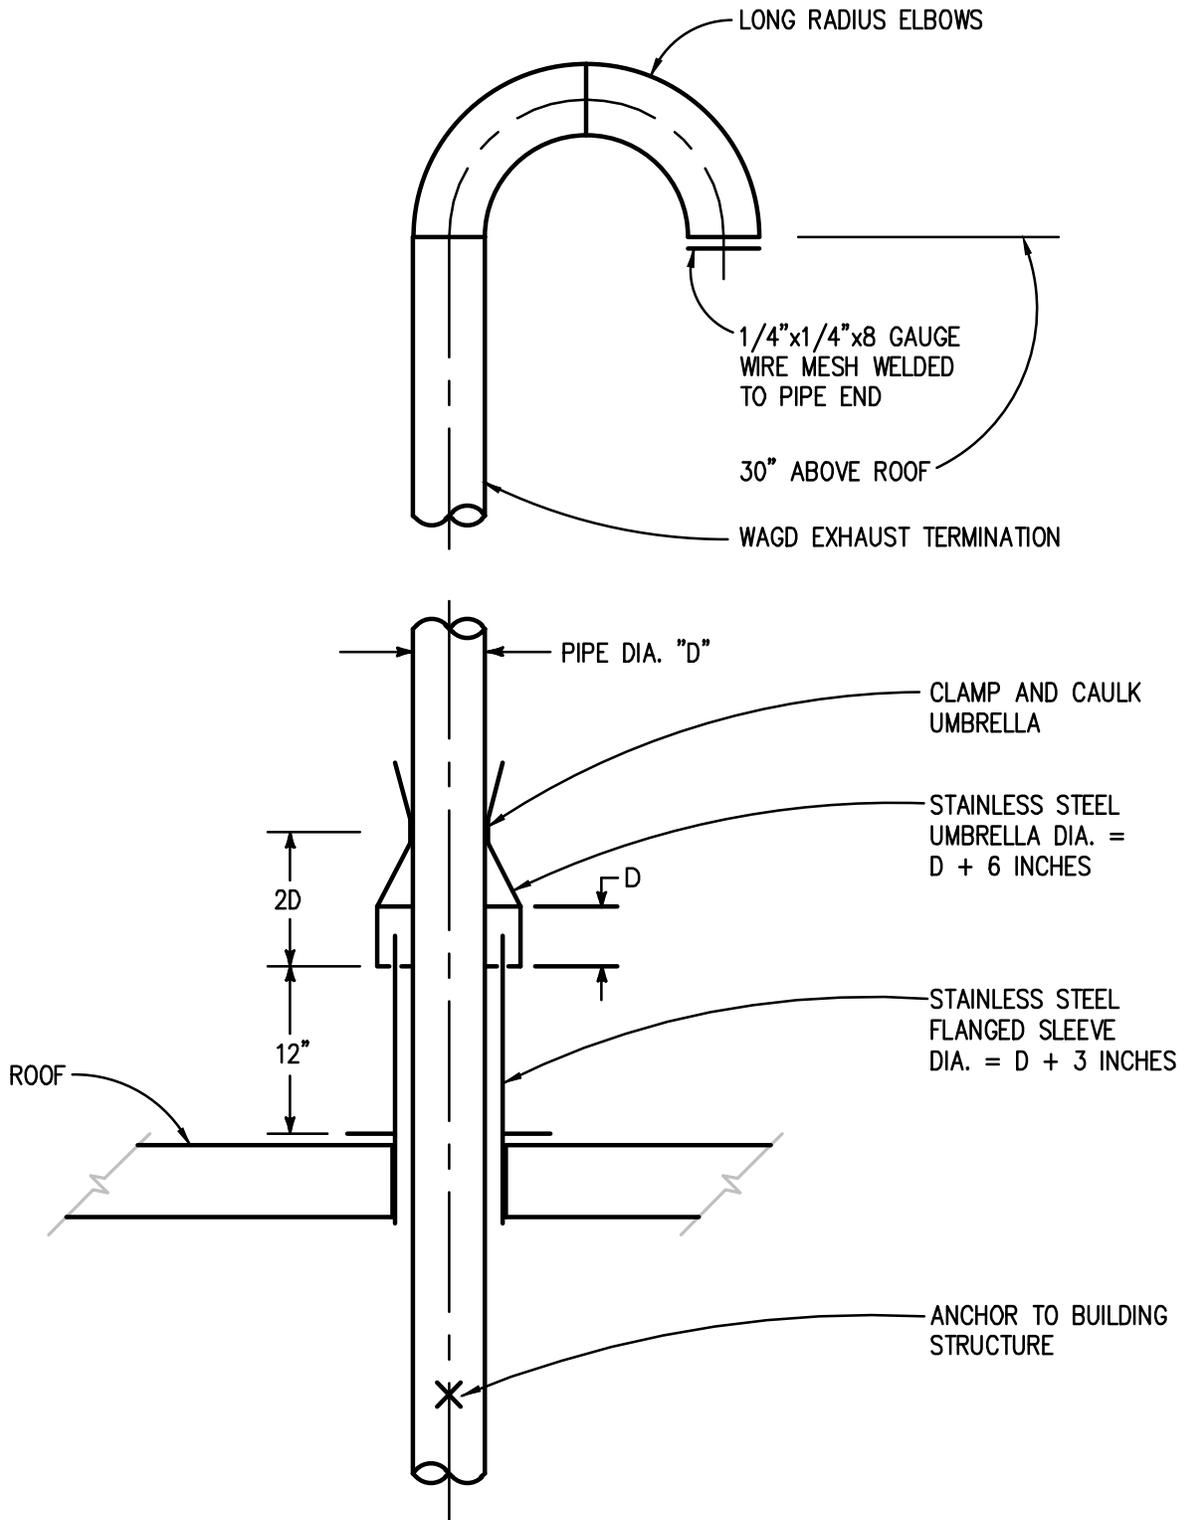

WAGD EXHAUST PIPE TERMINATION DETAIL

NO SCALE

REFER TO SHEET M-601

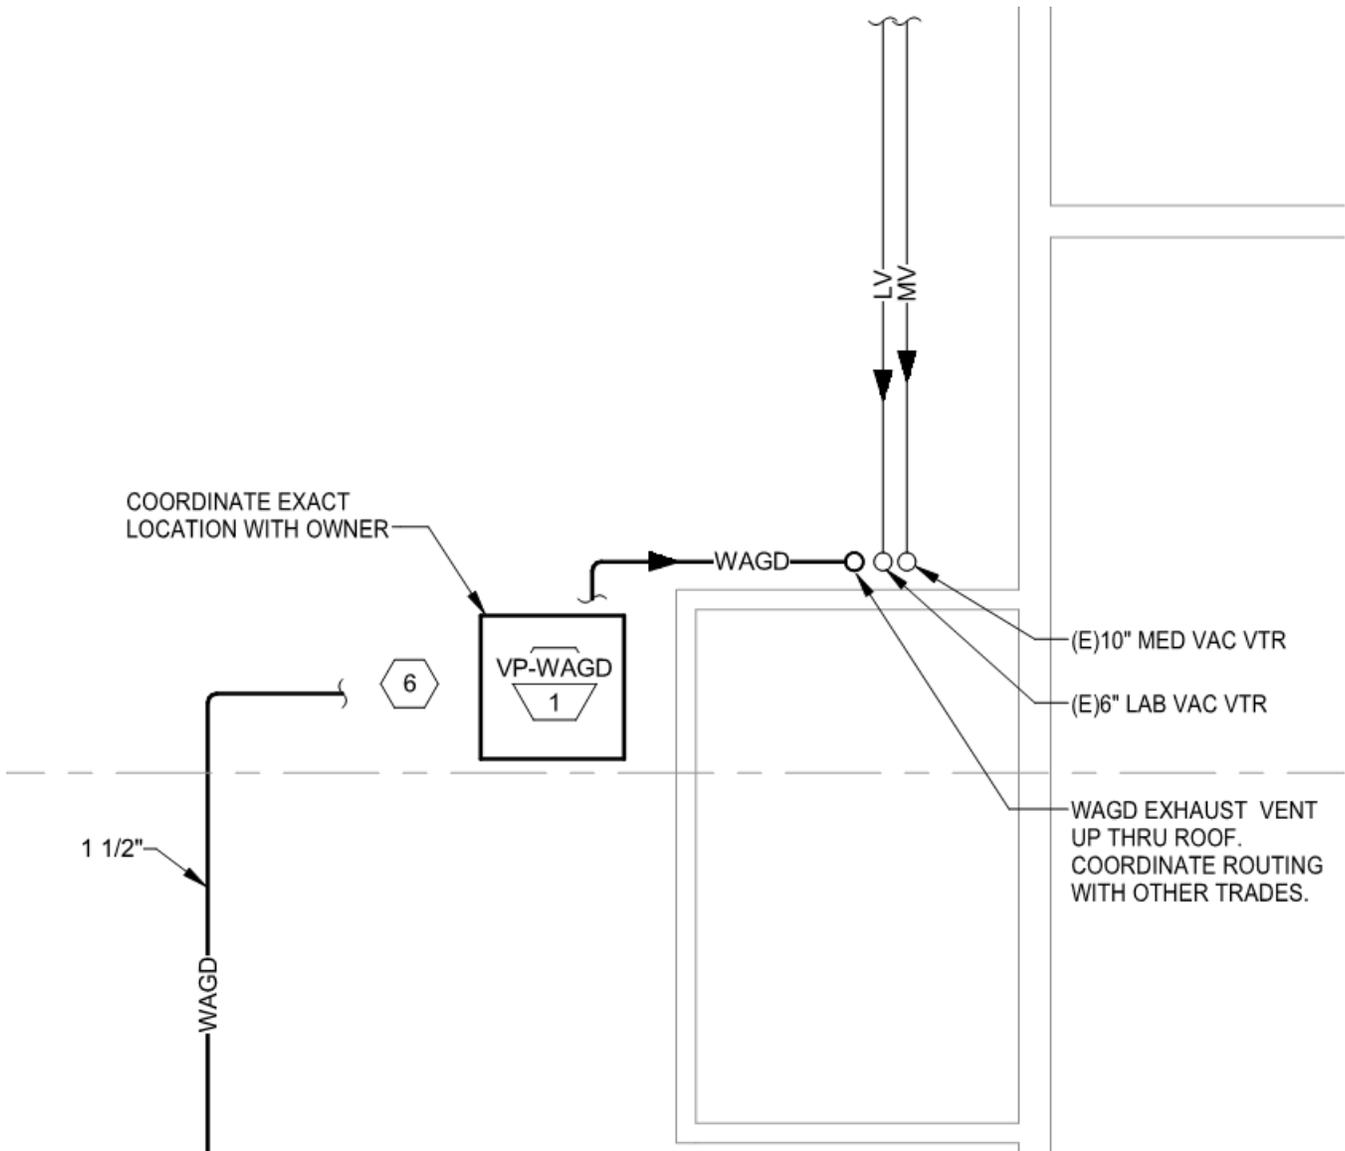

REFER TO SHEET M-971