

SHEET NOTES:

- A. SELECTIVE DEMOLITION INCLUDES, BUT IS NOT LIMITED TO, REMOVAL AND DISPOSAL OF EQUIPMENT AND SYSTEMS MADE OBSOLETE AND/OR REPLACED BY NEW WORK AND FOR EXISTING EQUIPMENT AND SYSTEMS WHICH ARE TO REMAIN.
- B. THE DEMOLITION WORK INDICATED ON THE DRAWINGS IS INTENDED TO BE COMPLETED BY THE CONTRACTOR USING INFORMATION PRIOR TO SUBMITTING BID. THE CONTRACTOR SHALL VISIT THE PROJECT SITE, REVIEW ORIGINAL DRAWINGS IF AVAILABLE, AND PROVIDE THE RESPONSE TO THE LISTED WORK. THE EXTENT OF SELECTIVE DEMOLITION, AND INCLUDE ALL REQUIRED SELECTIVE DEMOLITION WORK IN THE BID, WHETHER OR NOT SPECIFICALLY INDICATED ON THE DRAWINGS. THE CONTRACTOR IS GRANTED FOR SELECTIVE DEMOLITION, LEGAL DISPOSE OF ALL ITEMS AND MATERIALS, EXCEPT ANY ITEMS SPECIFICALLY DESIGNATED BY THE OWNER TO BE SALVAGED. THE CONTRACTOR SHALL BE RESPONSIBLE FOR SALVAGING EQUIPMENT IN A LOCATION DIRECTED BY THE OWNER.
- C. REFER TO GENERAL CONSTRUCTION TRADE DRAWINGS FOR EXTENT OF AREA TO BE DEMOLISHED.
- D. CONTRACTOR TO VERIFY ALL EXISTING FIRE PROTECTION IN FIELD PRIOR TO ANY REMOVAL OR INSTALLATION.

KEYED NOTES:


1. NEW SUSPENDED CEILING. RELOCATE EXISTING SPRINKLER HEADS IN CENTER OF CEILING TILE.

SPRINKLER NOTE:


FIRE PROTECTION CONTRACTOR SHALL REVISE THE LOCATIONS OF THE EXISTING SPRINKLER HEADS AS NEEDED PER UPDATED MODIFICATIONS. THE UPDATED SPRINKLER HEAD LOCATIONS SHALL BE SUBMITTED TO THE FIRE CODES, THE FIRE MARSHAL'S OFFICE, AND THE OWNERS APPROVING INSURANCE AGENCY. SPRINKLER CONTRACTOR SHALL COORDINATE THE LOCATION OF ALL CEILING SPRINKLER HEADS TO AVOID INTERFERENCE WITH OTHER TRADES. IF CONFLICTS DO OCCUR SUCH THAT LIGHTS, DUCTS, DIFFUSERS, GRILLES OR OTHER CEILING DEVICES ARE IN THE WAY OF SPRINKLER LOCATIONS DUE TO SPRINKLER PIPING INTERFERENCE, THE PIPING SHALL BE RELOCATED OR ROUTED AT NO ADDITIONAL EXPENSE TO THE PROJECT. SPRINKLER CONTRACTOR SHALL PROVIDE ALL NECESSARY MATERIALS, EXTRA PIPING FITTINGS, AND NECESSARY TOOLS TO MAKE FIELD MODIFICATIONS WITHOUT DELAY. AN APPROVED SPRINKLER PIPING AND HEAD LOCATIONS SHALL BE SUBMITTED TO THE FIRE MARSHAL'S OFFICE AND THE ARCHITECT/ENGINEER.

LEGEND:

 - SHADED AREA INDICATES
CEILING AREA TO BE
MODIFIED

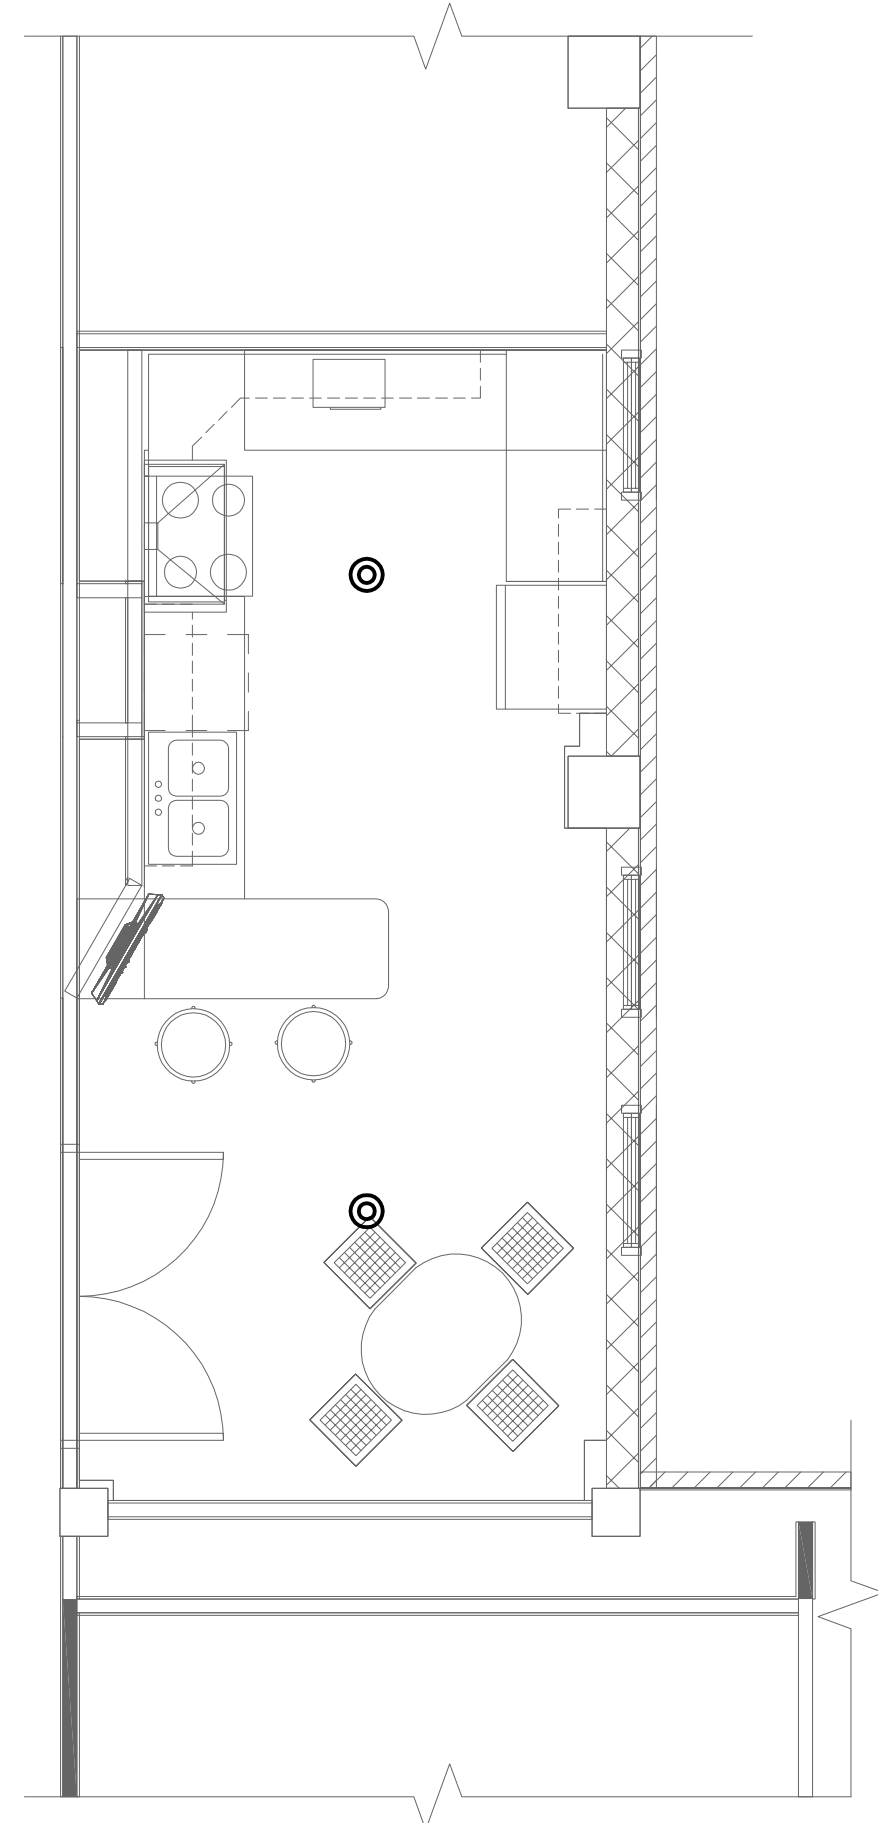

EXISTING
FIRE PROTECTION FLOOR PLAN
1 SCALE: 1/4" = 1'-0"

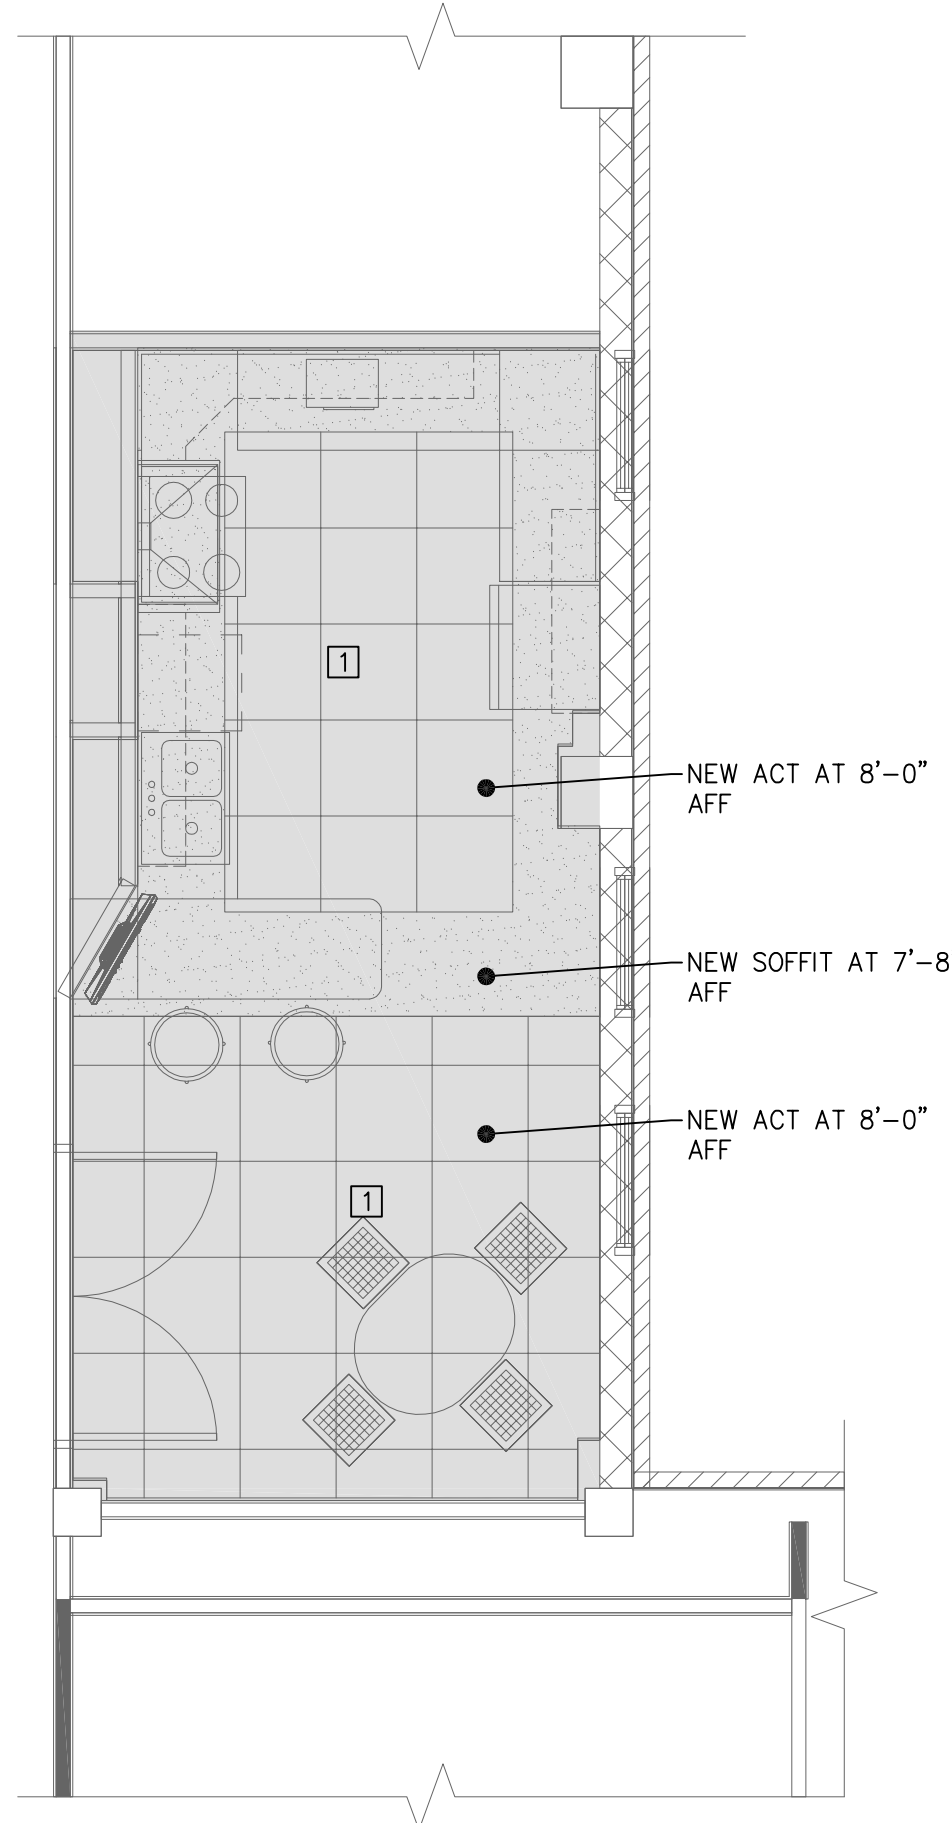



2 FIRE PROTECTION FLOOR PLAN
SCALE: 1/4" = 1'-0"



KEY PLAN
SCALE: NOT TO SCALE



		CONSULTANTS:				ARCHITECT/ENGINEERS:		Drawing Title FIRE PROTECTION PLAN		Project Title KITCHEN RENOVATIONS		Project Number 6944-001		<div>Office of Construction and Facilities Management</div>			
		 AJH DESIGN						Larson Design Group • Architects Engineers Surveyors 1000 Commerce Park Drive • Suite 201 Williamsport, PA 17701 PHONE 570.323.6603 TOLL FREE 877.323.6603 FAX 570.323.9902 • www.larsondesigngroup.com		Location BUILDING #7 ROOM 132		Building Number #7				Drawing Number 7-FP 1	
Revisions: ISSUED FOR CONSTRUCTION		2/24/2012		2-24-2012		Larson Design Group						Date 2-24-2012				Checked MPN	