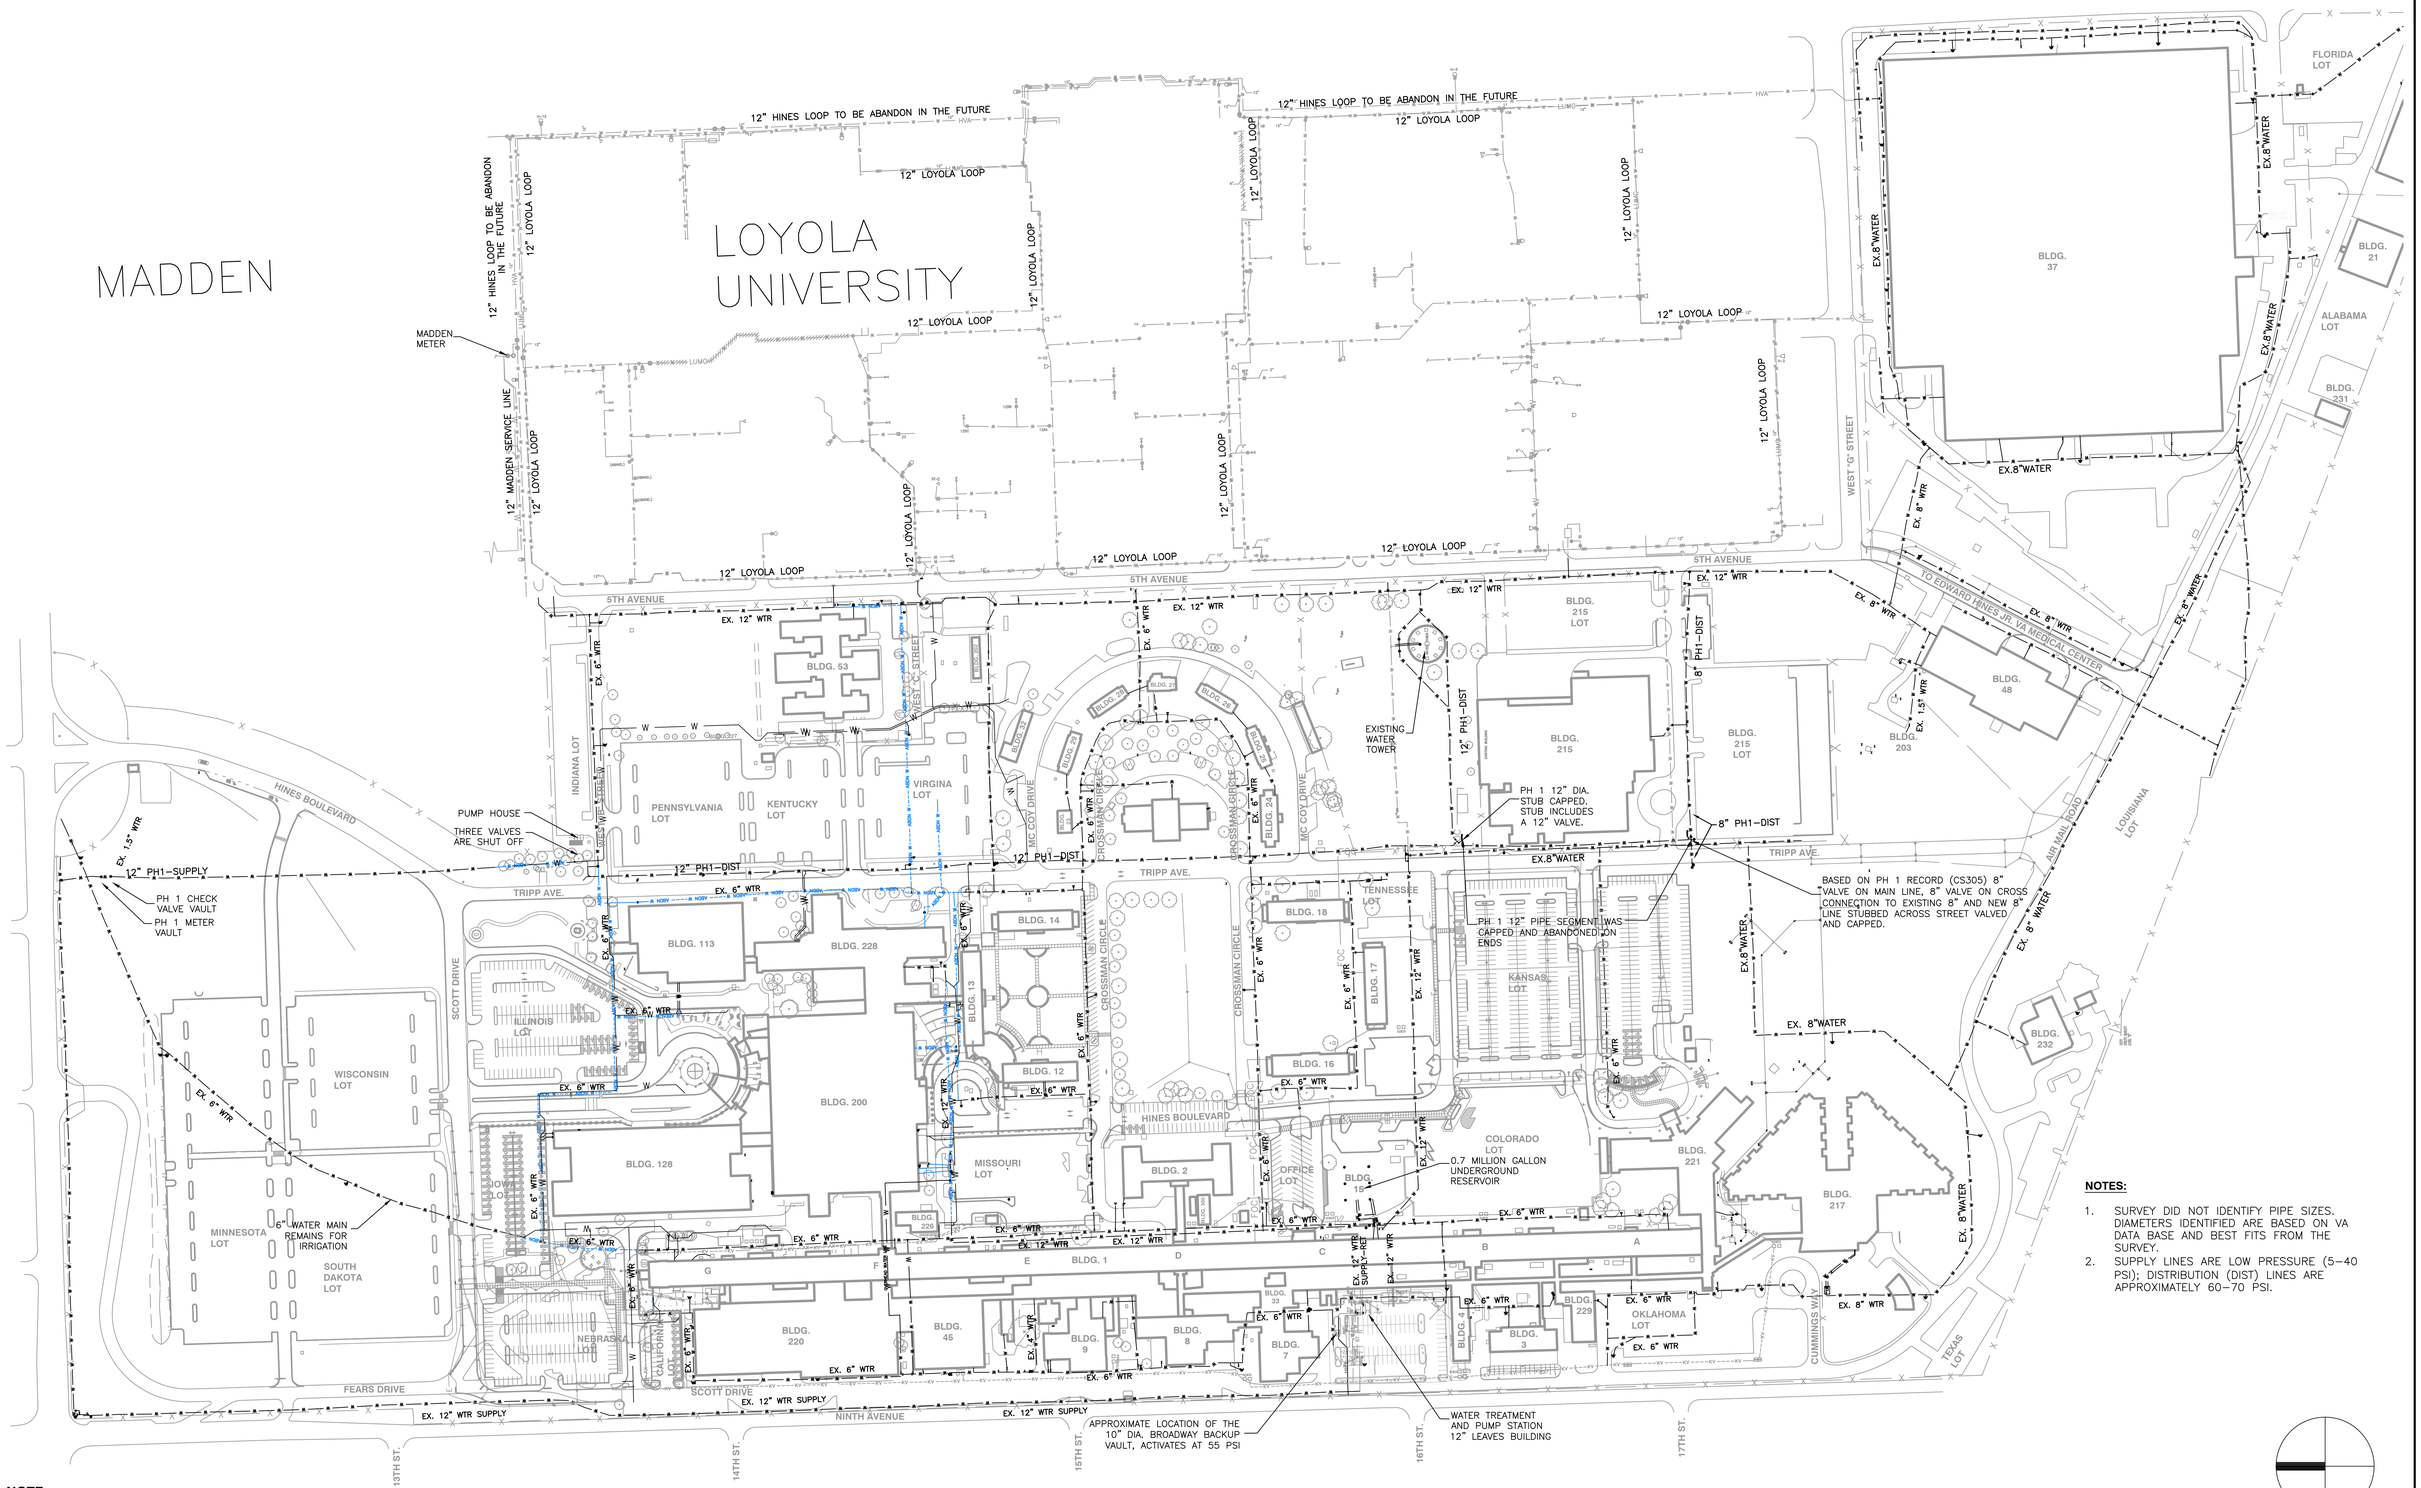

NOTES:

1. SURVEY DID NOT IDENTIFY PIPE SIZES. DIAMETERS IDENTIFIED ARE BASED ON VA DATA BASE AND BEST FITS FROM THE SURVEY.
2. SUPPLY LINES ARE LOW PRESSURE (5–40 PSI); DISTRIBUTION (DIST) LINES ARE APPROXIMATELY 60–70 PSI.

GRAPHIC SCALE

0 1' 2'

NOTE:

1. EXISTING SITE TOPOGRAPHY, FEATURES AND UTILITIES SHOWN ON THE DRAWINGS ARE A COMPILATION OF DRAWINGS, DATABASES AND SURVEY'S PREPARED BY, CARDNO TBE, DYNASTY GROUP INC., MELVIN COHEN, SIGMA AND ASSOCIATES, AND HGA.
2. SITE CONDITIONS MAY HAVE CHANGED SINCE THE BASE PLAN WAS PREPARED. CONTRACTORS SHALL FAMILIARIZE THEMSELVES WITH SITE TO DETERMINE CURRENT CONDITIONS.
3. THE BASE PLAN IS BASED ON CONDITIONS PRIOR TO PHASE 2 CONSTRUCTION.

Revisions	Date

THE SIGMA GROUP
Single Source. Sound Solutions.
www.thesigmagroup.com
1300 West Canal Street
Milwaukee, WI 53233
Phone: 414-643-4200
Fax: 414-643-4210

HGA
Architecture | Engineering | Planning
Hammel, Green and Abrahamson, Inc.
333 East Erie Street
Milwaukee, Wisconsin USA 53202
Telephone 414.278.8200 Facsimile 414.278.7734

PHASE 3A - 100% CONSTRUCTION DOCUMENTS: JULY 29, 2016

Drawing Title: EXISTING WATER MAIN NETWORK

Project Title: VA HINES MEDICAL CENTER REPLACE EXISTING WATER MAINS PROJECT

Date: JULY 29, 2016

Project No.: VA# 578-15-032 HGA#3931-001-00

Approved: Division Chief

Approved: Service Director

Building Number | Checked: JBL | Drawn: TPM

Location: HINES, ILLINOIS

DRAWING NO.: CU004

Office of Facilities Management

Department of Veterans Affairs