
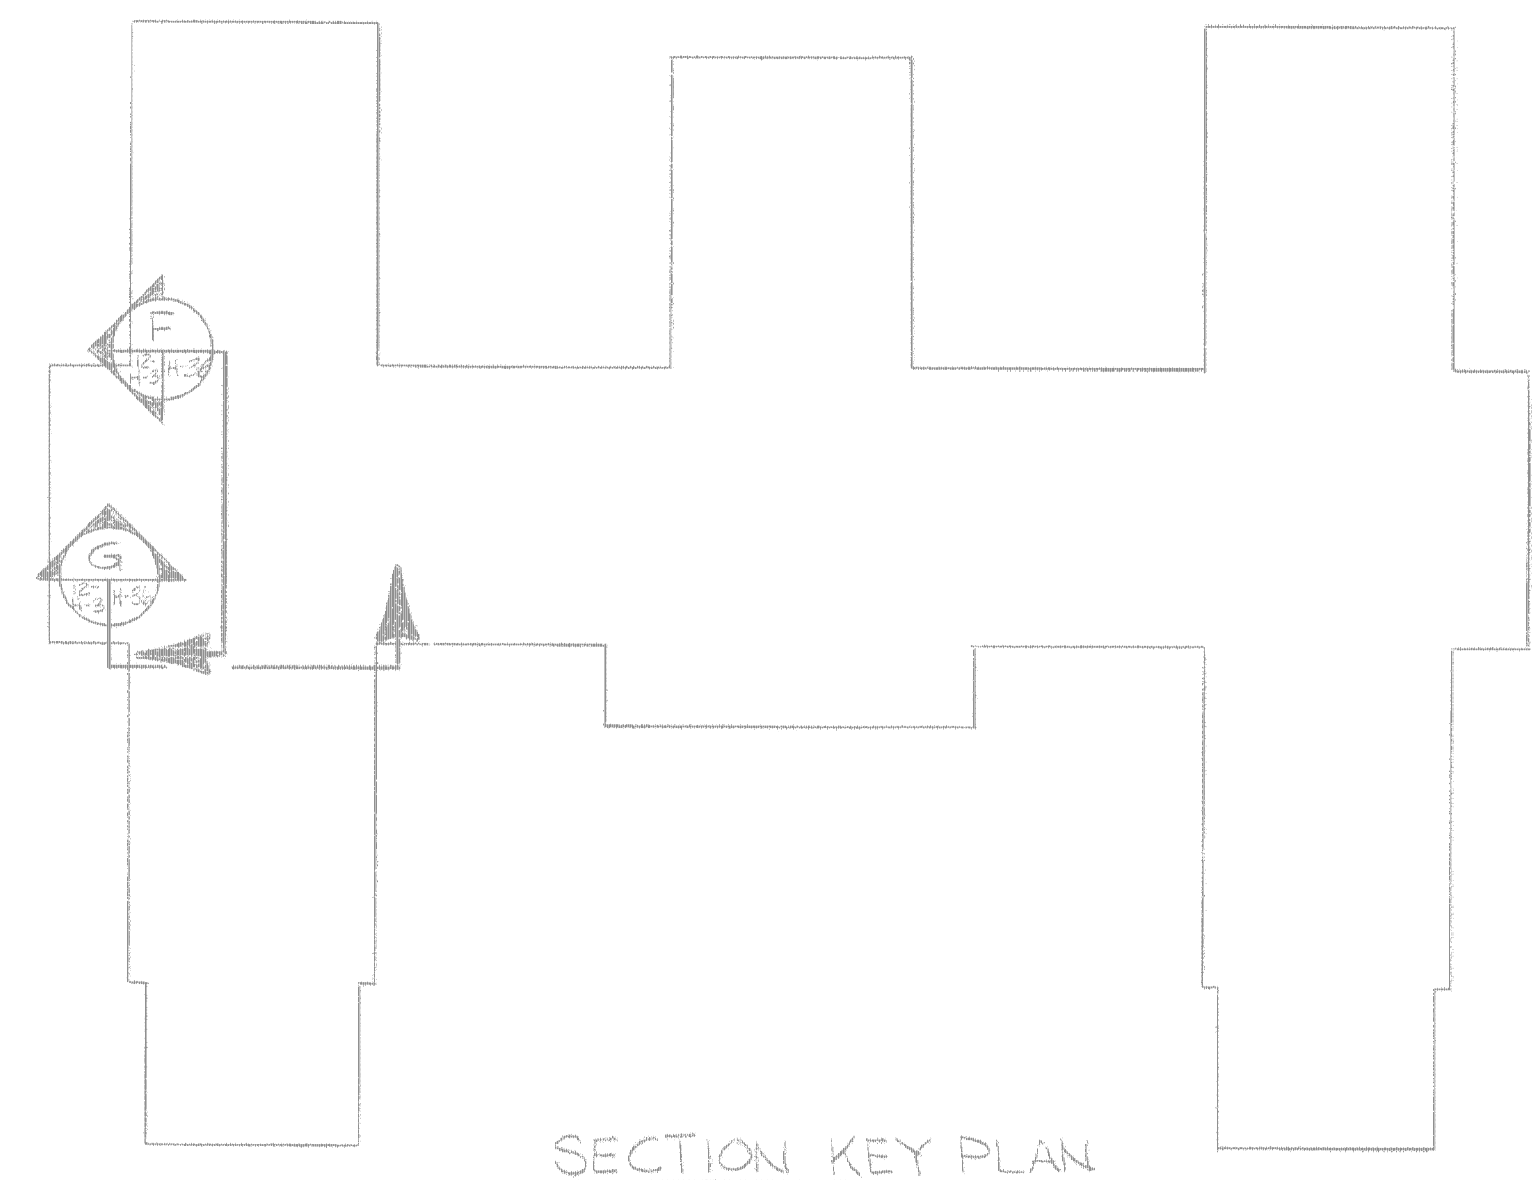
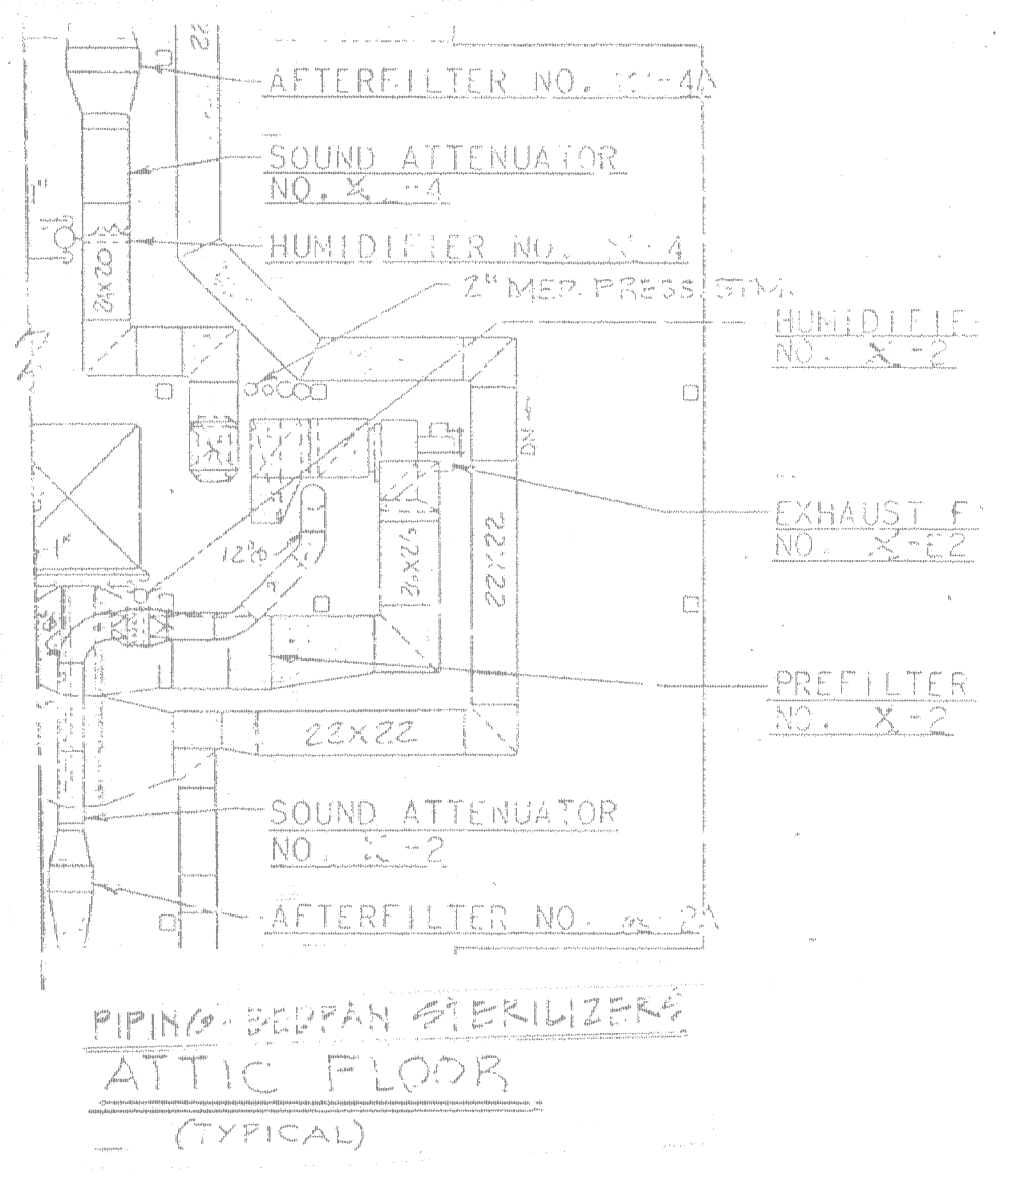


three inches = one foot
one and one-half inches = one foot
one inch = one foot
three-quarters inch = one foot
one-half inch = one foot
three-eighths inch = one foot
one-quarter inch = one foot
one-eighth inch = one foot

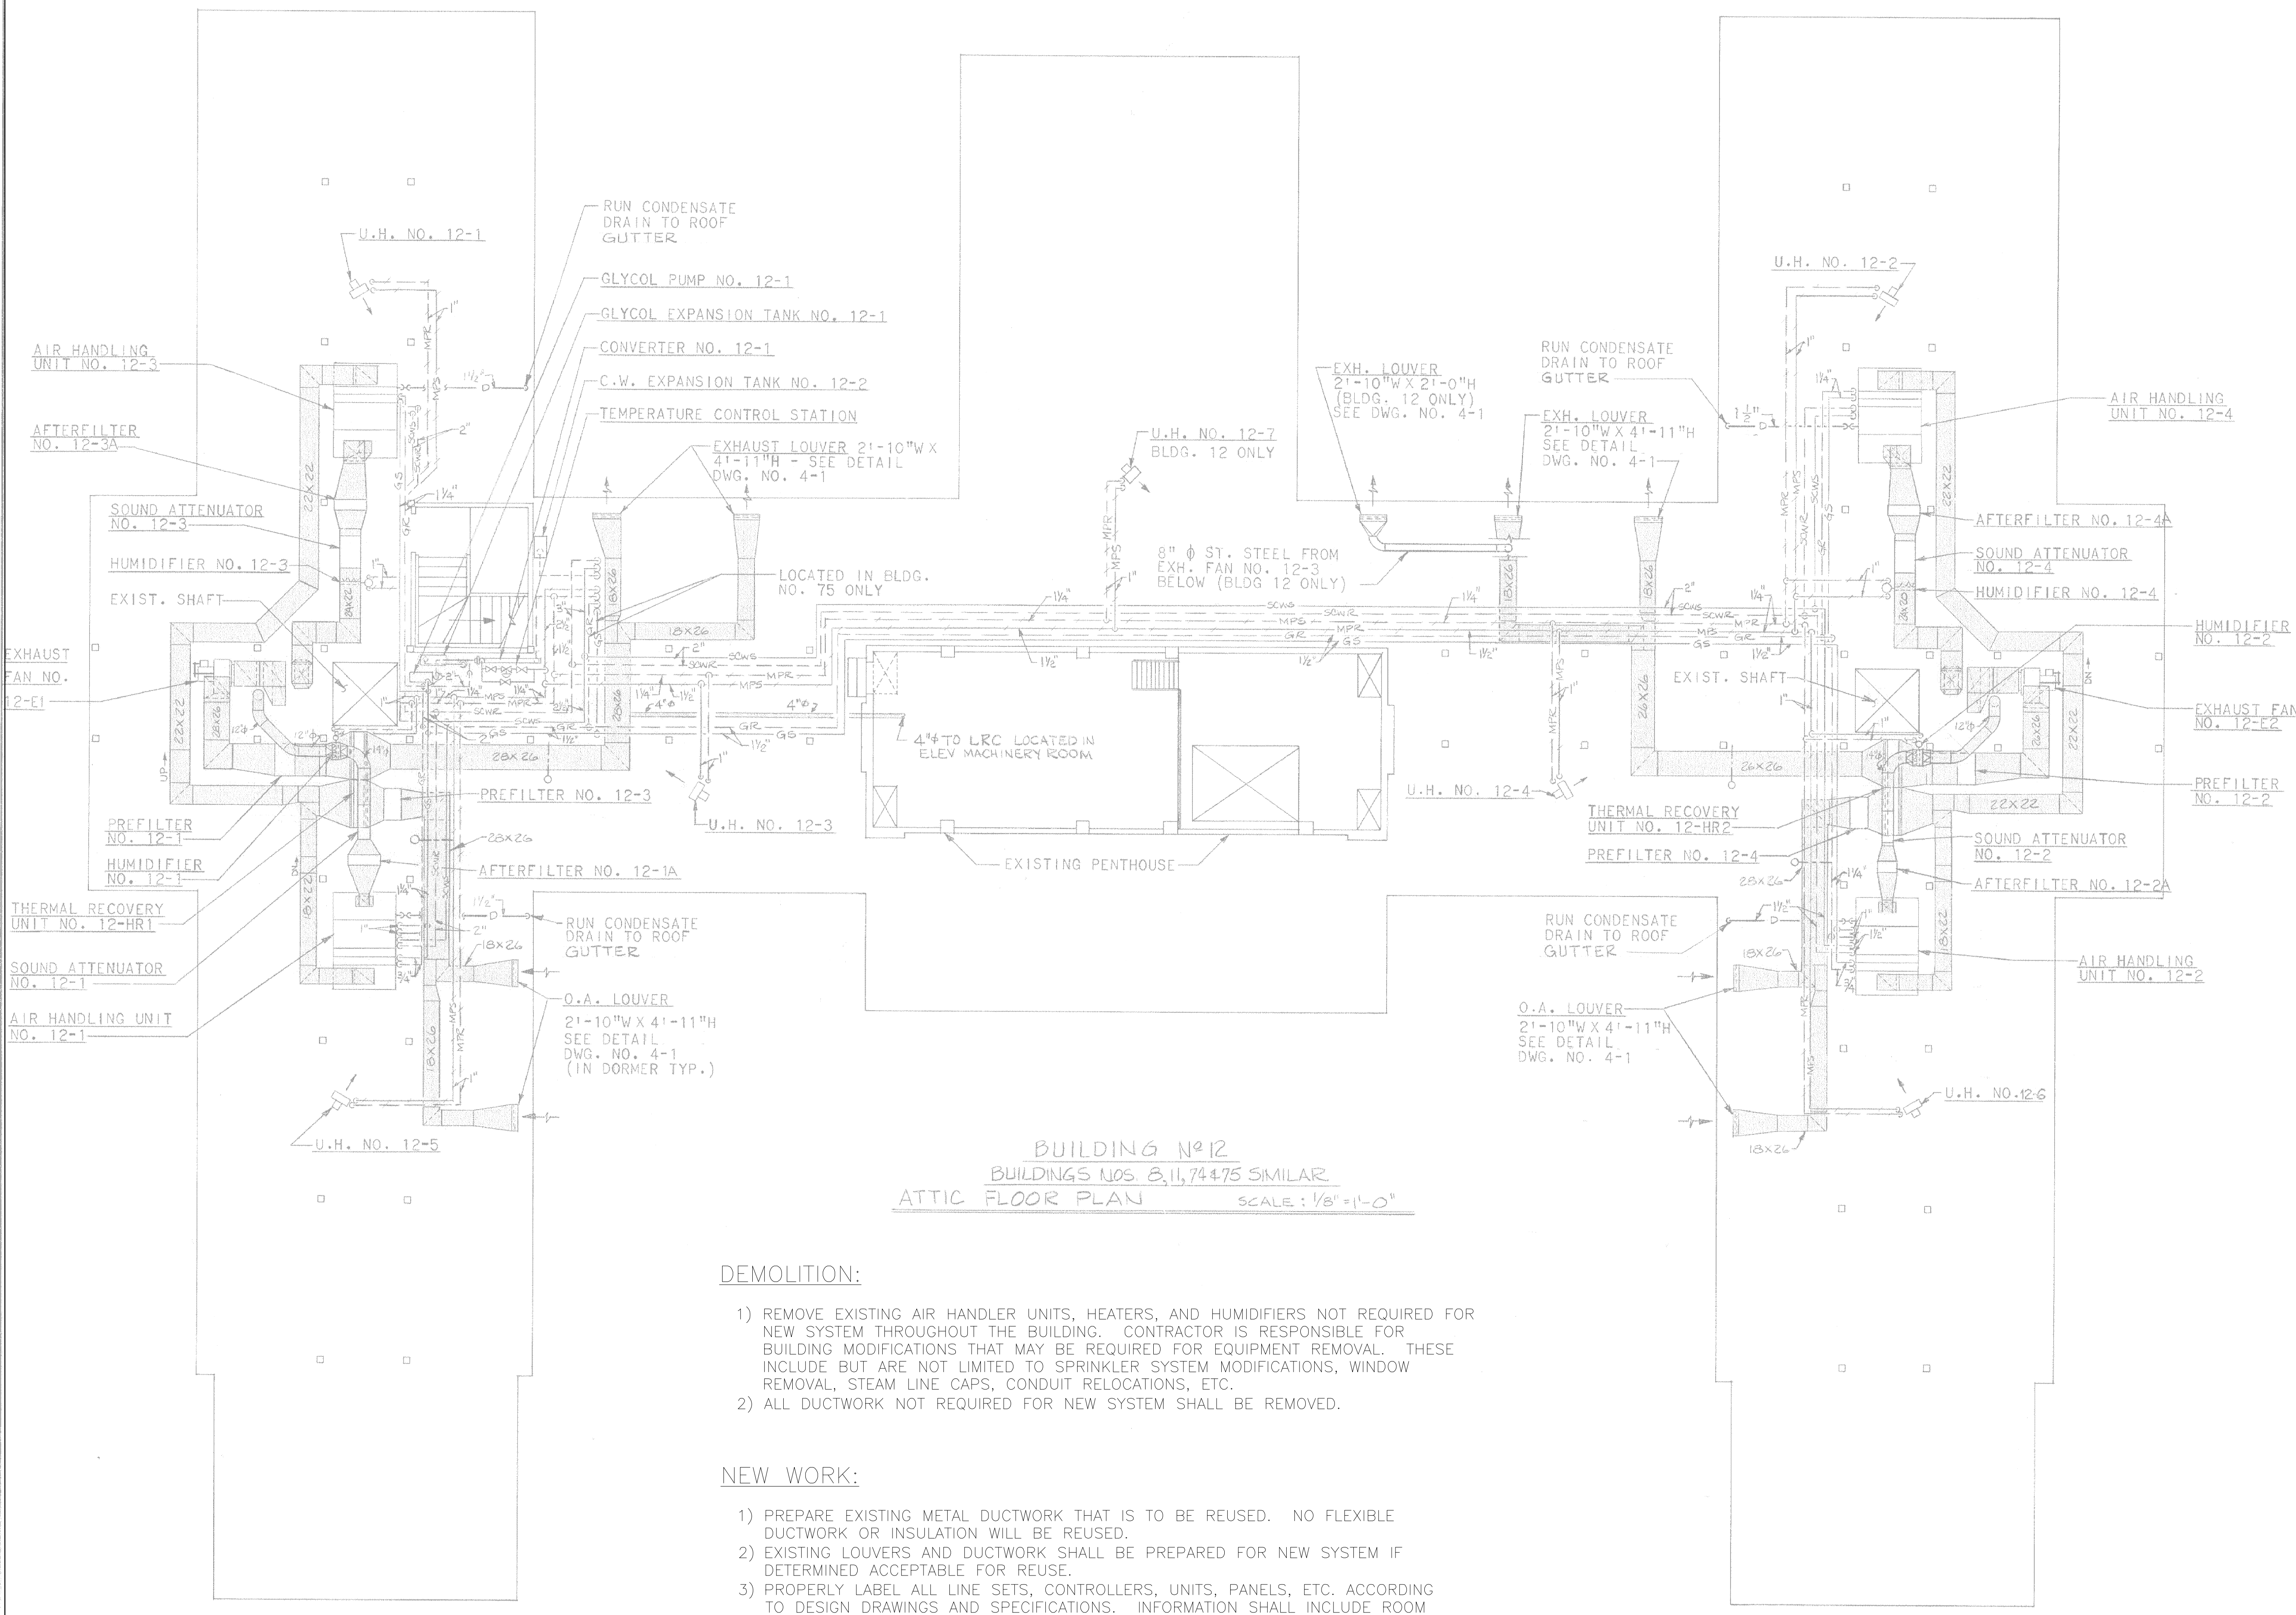

- DEMOLITION:**
- 1) REMOVE EXISTING AIR HANDLER UNITS, HEATERS, AND HUMIDIFIERS NOT REQUIRED FOR NEW SYSTEM THROUGHOUT THE BUILDING. CONTRACTOR IS RESPONSIBLE FOR BUILDING MODIFICATIONS THAT MAY BE REQUIRED FOR EQUIPMENT REMOVAL. THESE INCLUDE BUT ARE NOT LIMITED TO SPRINKLER SYSTEM MODIFICATIONS, WINDOW REMOVAL, STEAM LINE CAPS, CONDUIT RELOCATIONS, ETC.
 - 2) ALL DUCTWORK NOT REQUIRED FOR NEW SYSTEM SHALL BE REMOVED.
- NEW WORK:**
- 1) PREPARE EXISTING METAL DUCTWORK THAT IS TO BE REUSED. NO FLEXIBLE DUCTWORK OR INSULATION WILL BE REUSED.
 - 2) EXISTING LOUVERS AND DUCTWORK SHALL BE PREPARED FOR NEW SYSTEM IF DETERMINED ACCEPTABLE FOR REUSE.
 - 3) PROPERLY LABEL ALL LINE SETS, CONTROLLERS, UNITS, PANELS, ETC. ACCORDING TO DESIGN DRAWINGS AND SPECIFICATIONS. INFORMATION SHALL INCLUDE ROOM NUMBERS, PORT ASSIGNMENTS, GOVERNMENT-PROVIDED PANEL NAMES, UNIT NUMBERS, ETC.
 - 4) INSTALL NEW ENERGY RECOVERY UNITS. ALTERNATE LOCATIONS MAY BE SUBMITTED TO COTR FOR CONSIDERATION AND APPROVAL.

Revisions		Date		Approved: Energy Engineer	Approved: Safety Manager	Approved: Service Chief	Drawing Title Bldg. # 74 ATTIC FLOOR HVAC.	Project Title REPLACE AIR CONDITIONING SYSTEM, BLDG. # 74 DB.			Date 12/16/11	Veterans Affairs
					Approved: Infection Control Officer	Approved: Chief of Staff					Project No. 658-12-103	
					Approved: GEMS Coordinator	Approved: Associate Director					DRAWING NO. M4 2588	
											Dwg. 5 Of 5	
							Approved: Chief of Engineering Svc.	Building Number 74	Checked WGJ	Drawn TAW		
							Approved: Medical Center Director	Location				