


NOTE:

1. THE PRECASTER SHALL DESIGN THE WALL TO HANDLE TEMPORARY LATERAL FORCES FOR EA. LIFT BASED ON THE WEIGHT OF WATER 62.4 PSF TIMES THE LIFT HEIGHT.
2. THE PRECASTER SHALL APPLY 100PSF SURCHARGE AT THE TOP OF FLOWABLE FILL.
3. THE SOIL PROVIDED IN THE GEOTECHNICAL REPORT SHALL BE APPLIED TO THE WALL ABOVE LEAN CONCRETE FILL.

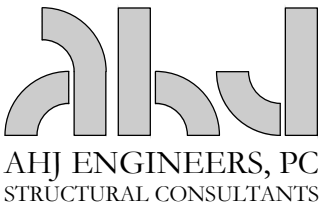

AHJ NO. 15021.00

PROJECT: VA PARKING GARAGE

BOISE, ID

2 ADDENDUM #2 12/28/2016

DATE: 12/28/2016

BY: CH/GV

SHEET NO.

1 OF 1