

Recirculation Pipe Layout


1/4" = 1'-0"

POOL DATA	
POOL CAPACITY (MAIN POOL)	13,680 GALLONS
POOL AREA (MAIN POOL)	601 SQ. FT.
WHIRLPOOL CAPACITY	1621 GALLONS
WHIRLPOOL AREA	100 SQ. FT.
TURNOVER RATE (MAIN POOL)	5 HRS AT 45.6 GPM
TURNOVER RATE (WHIRLPOOL)	30 MIN AT 54 GPM

POOL EQUIPMENT	
HYDRO PUMP	1 1/2" HP 208 VOLTS 3 PHASE PUMP
FILLSPOUT	1/2" CHROME R FILLSPOUT
HANDRAILS	1 1/2" ALUMINUM

GEN. NOTES

1. ALUMINUM PLATE & SHEET SHALL BE 5050-H34 ALLOY ALUM PIPE SCHED 40 6063-T6 PVC SCHED 40 AND 80
2. WELD JOINTS ON POOL BOTTOM & SIDEWALLS SHALL BE GROUND AND TESTED BY VACUUM SEAM AND DYE PENETRANT METHOD.
3. PERIMETER JOINT SEALANT FURNISHED AND INSTALLED BY GEN. CONTR.
4. PROTECTION OF SWIMMING POOL AFTER INSTALLATION AND PRIOR TO PAINTING BY GEN. CONTR.

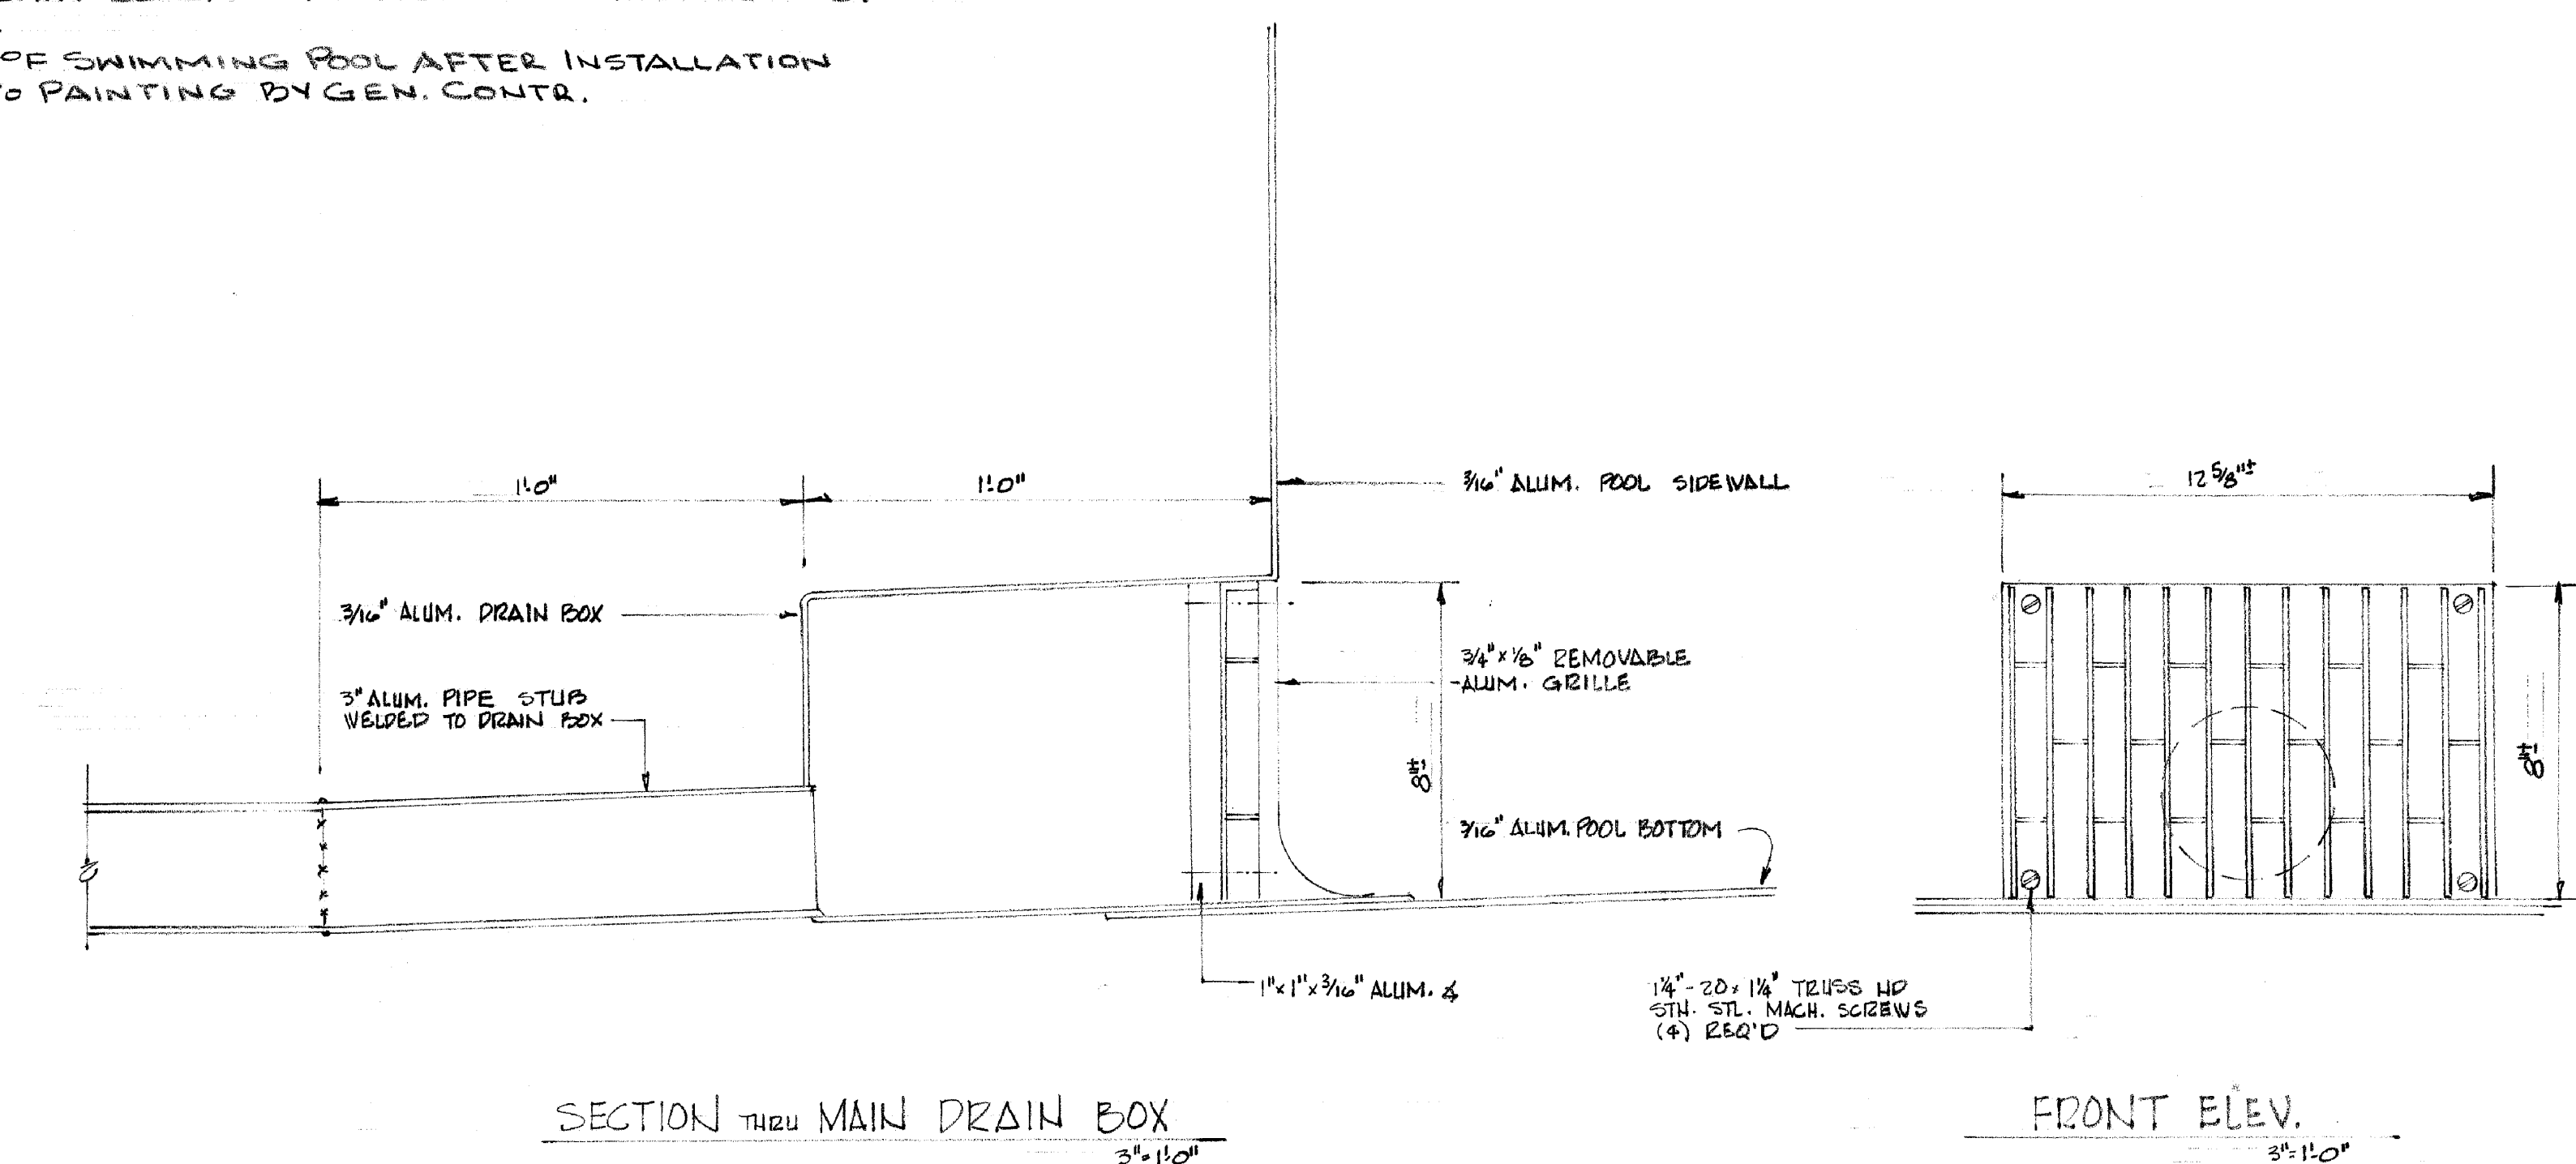

<p>THIS DRAWING WAS SCAN FROM THE ORIGINAL DRAWING AND THE SCALES MIGHT NOT BE ACCURATE.</p>		<p>Mullinax/Wash Architects, P.A.</p> <p>SUITE 1480 UCS BUILDING CHARLOTTE, NORTH CAROLINA 28281 TEL (704) 333-9951</p>		<p>Drawing Title</p> <p>Plumbing/Mechanical</p>		<p>Project Title</p> <p>Therapeutic Pool Renovations</p>		<p>Date</p> <p>7/2/84</p>	
				<p>Approved: Division Chief</p> <p>Drawn</p> <p>FW</p>		<p>Building Number</p> <p>Six</p>		<p>Project No.</p> <p>459037</p>	
<p>Revisions</p>		<p>Date</p>		<p>Approved: Service Director</p> <p>Checked</p> <p>TJM</p>		<p>Location</p> <p>Salisbury, N.C.</p>		<p>DRAWING No.</p> <p>P-3</p> <p>Dwg. Of 3</p>	