


**CHILLED WATER PIPING REVISION
 CORRECT MECHANICAL
 DEFICIENCIES BUILDING 26
 589A7-16-101
 1-18-2017**

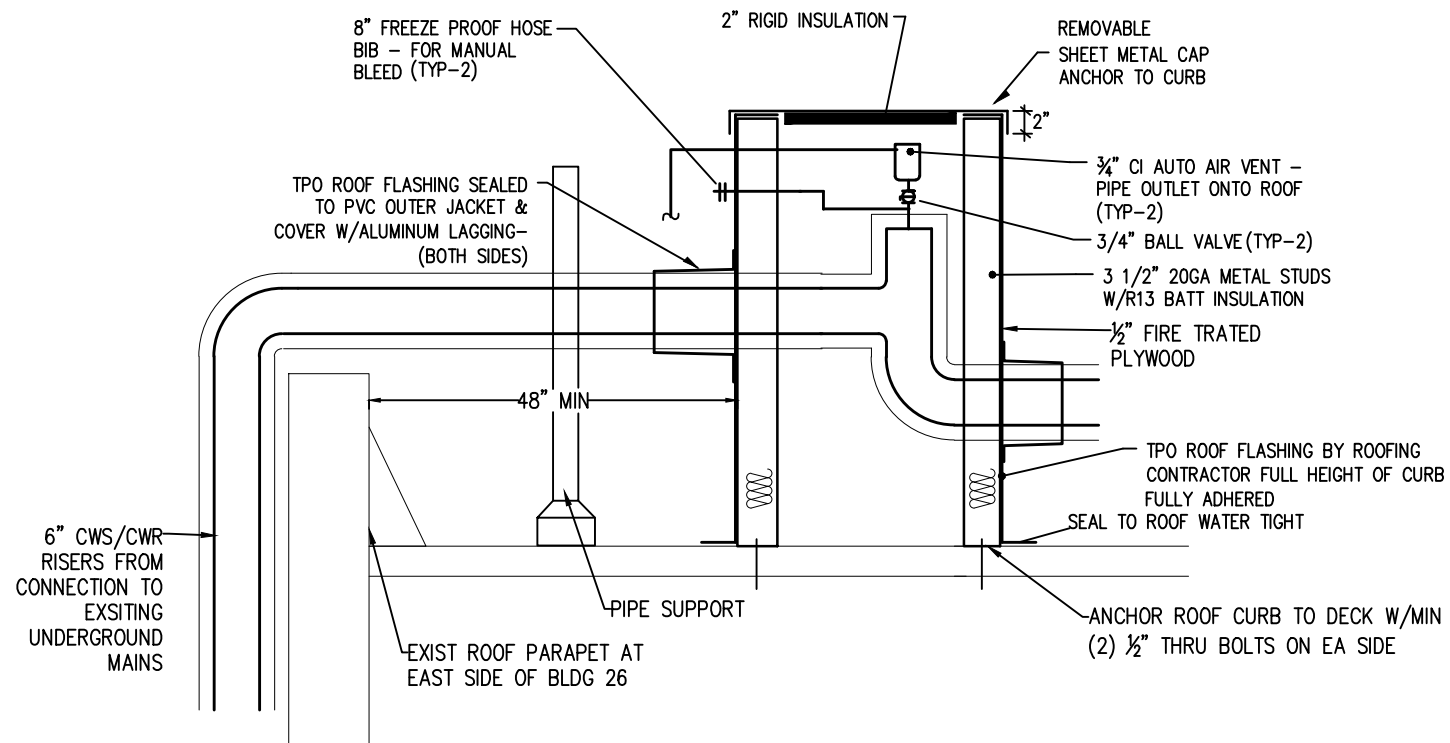

PIPE CURB DETAIL

- AIR REMOVAL FITTINGS REQ'd FOR BOTH LINES
- INSULATE ALL CHILLED WATER COMPONENTS VAPOR TIGHT