
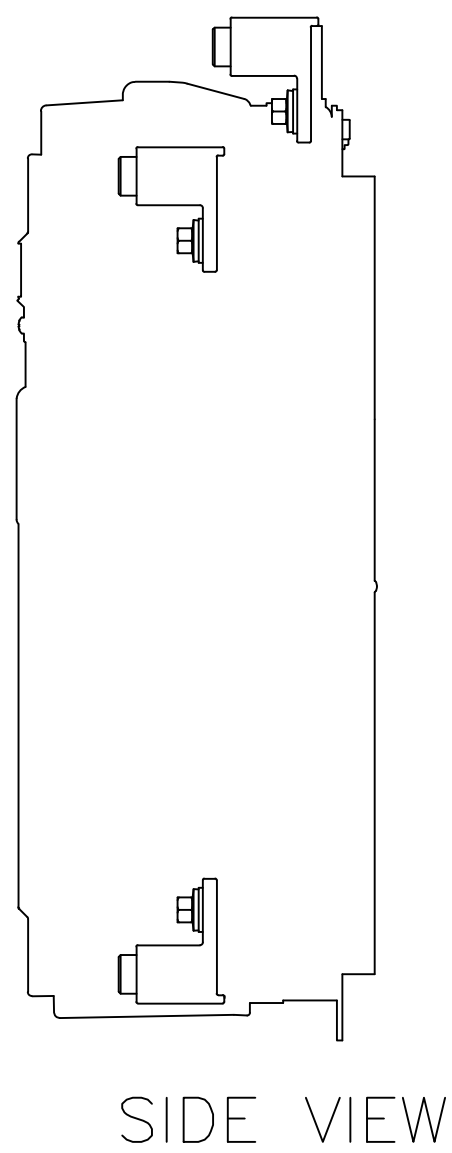
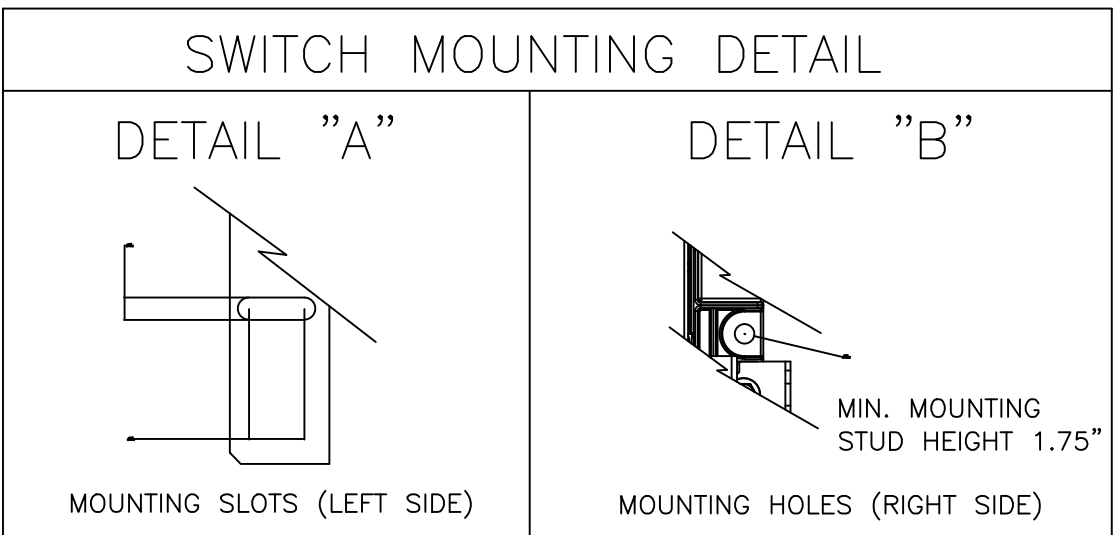
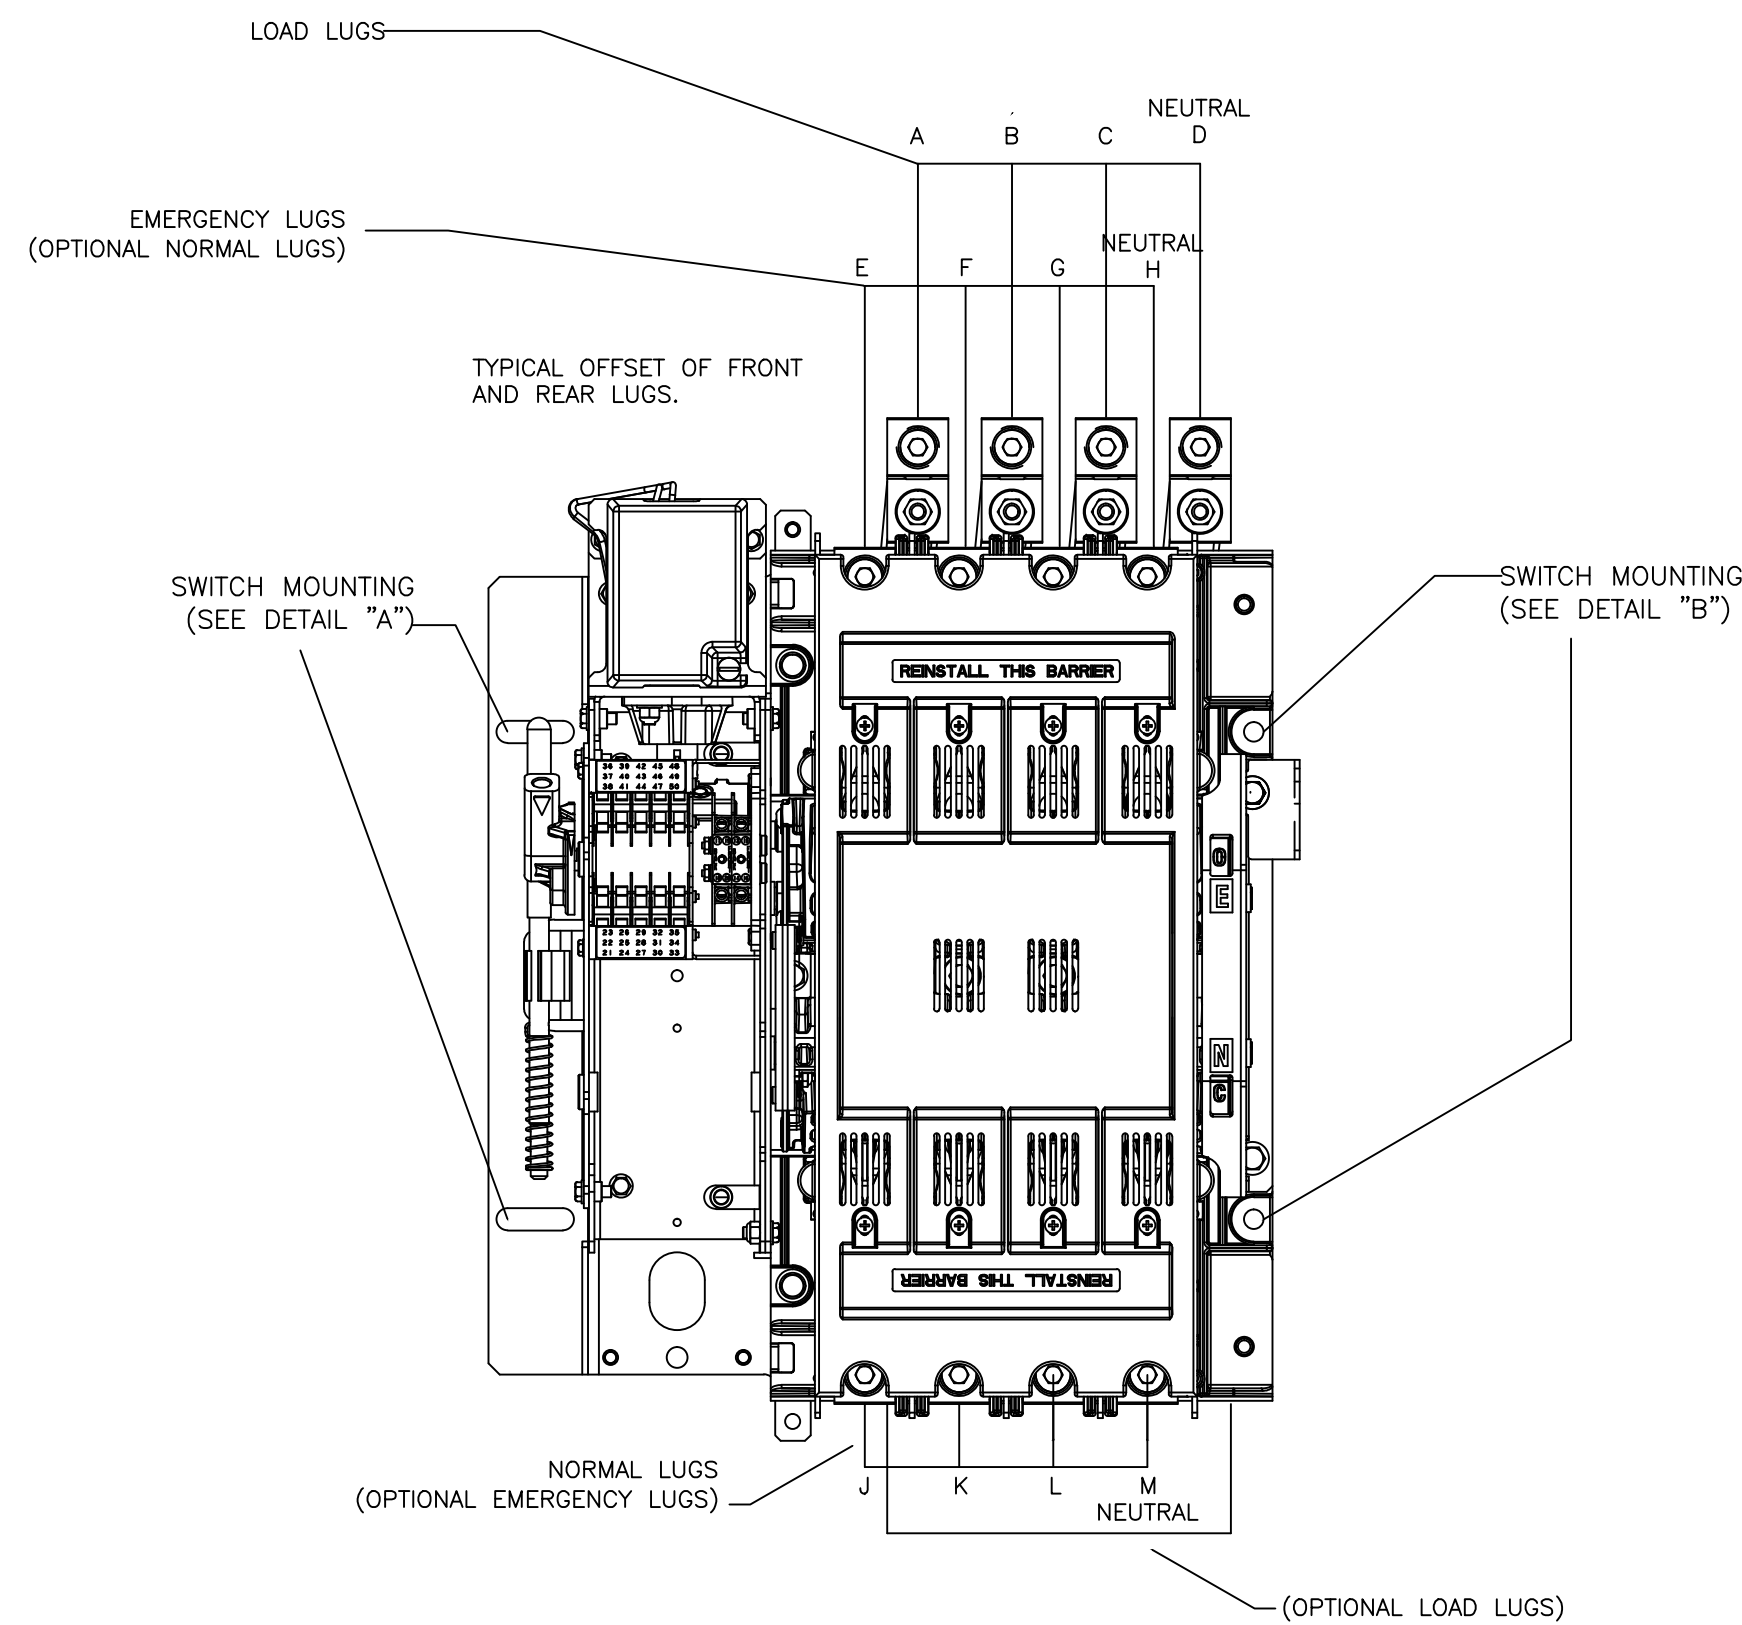





three inches = one foot
one and one half inches = one foot
one inch = one foot
three quarters inch = one foot
one half inch = one foot
three eighths inch = one foot
one quarter inch = one foot
one eighth inch = one foot
Date: _____

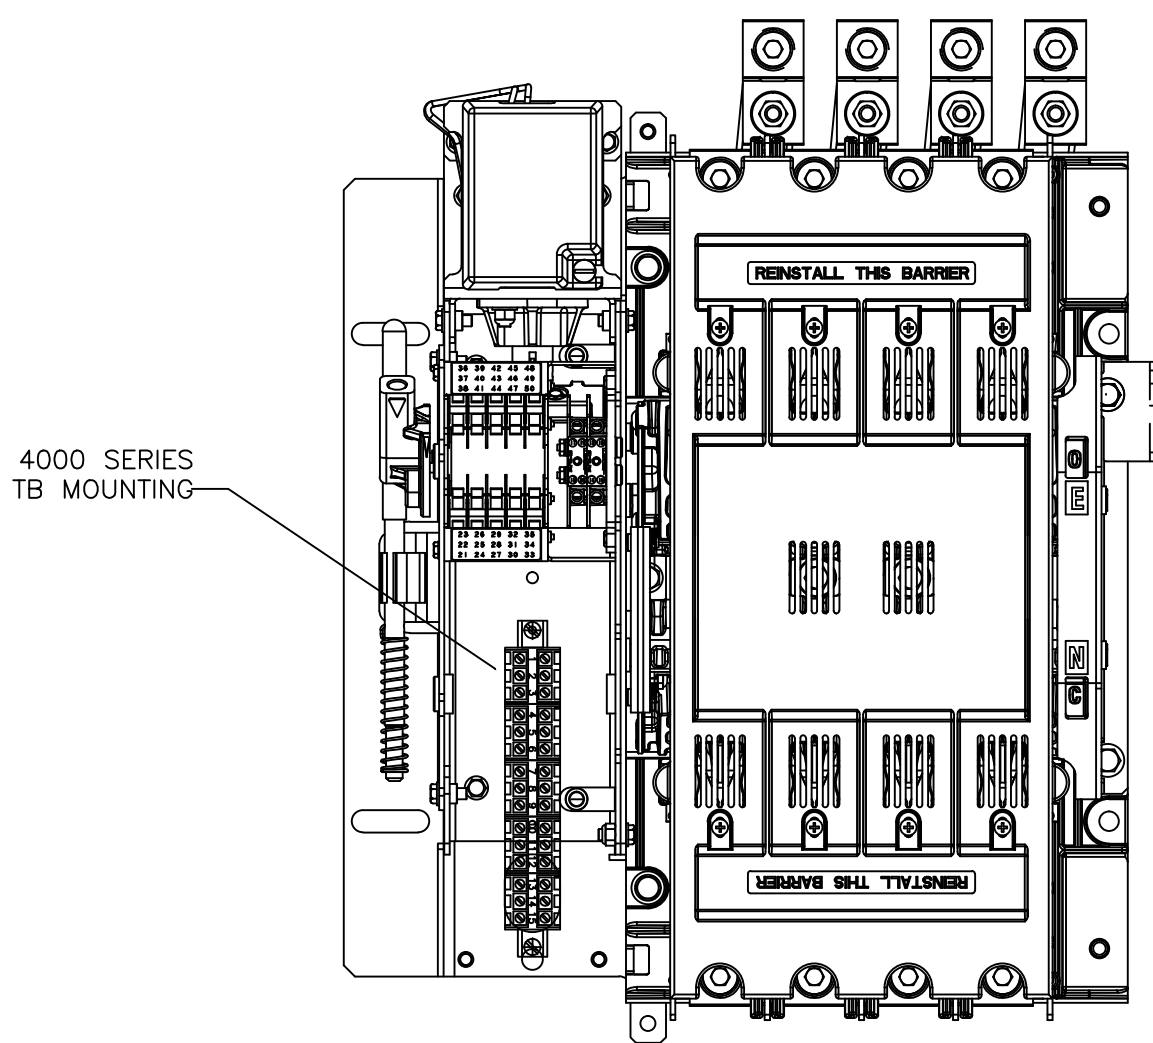

- ### GENERAL NOTES
1. DETAILS SHOWN ARE TYPICAL, AND BASED ON ASCO EQUIPMENT. CONSULT WIRING AND TERMINATION DIAGRAMS FROM SUPPLIED SWITCHES FOR ACTUAL TERMINATIONS, RACEWAY ENTRIES, SIZES AND CONFIGURATIONS.
 2. MAINTAIN A MINIMUM OF 48" CLEARANCE IN FRONT OF SWITCHES.
 3. THE CONTRACTOR SHALL FIELD VERIFY ACTUAL EXISTING POWER AND CONTROL CABLE LENGTHS PRIOR TO BEGINNING SWITCH CHANGE-OUT. IF EXISTING LENGTHS ARE NOT ADEQUATE, CONTACT ARCHITECT AND ENGINEER PRIOR TO BEGINNING ANY WORK.
 4. FIELD VERIFY EXACT LOCATIONS FOR TERMINAL BLOCK LOCATIONS.

1 260A-400A OPEN TYPE - TYPICAL FIELD CONNECTION TERMINAL BLOCK LOCATION
NTS

2 TYPICAL FRONT CONNECTED 150A-400A ATS OPEN TYPE
NTS

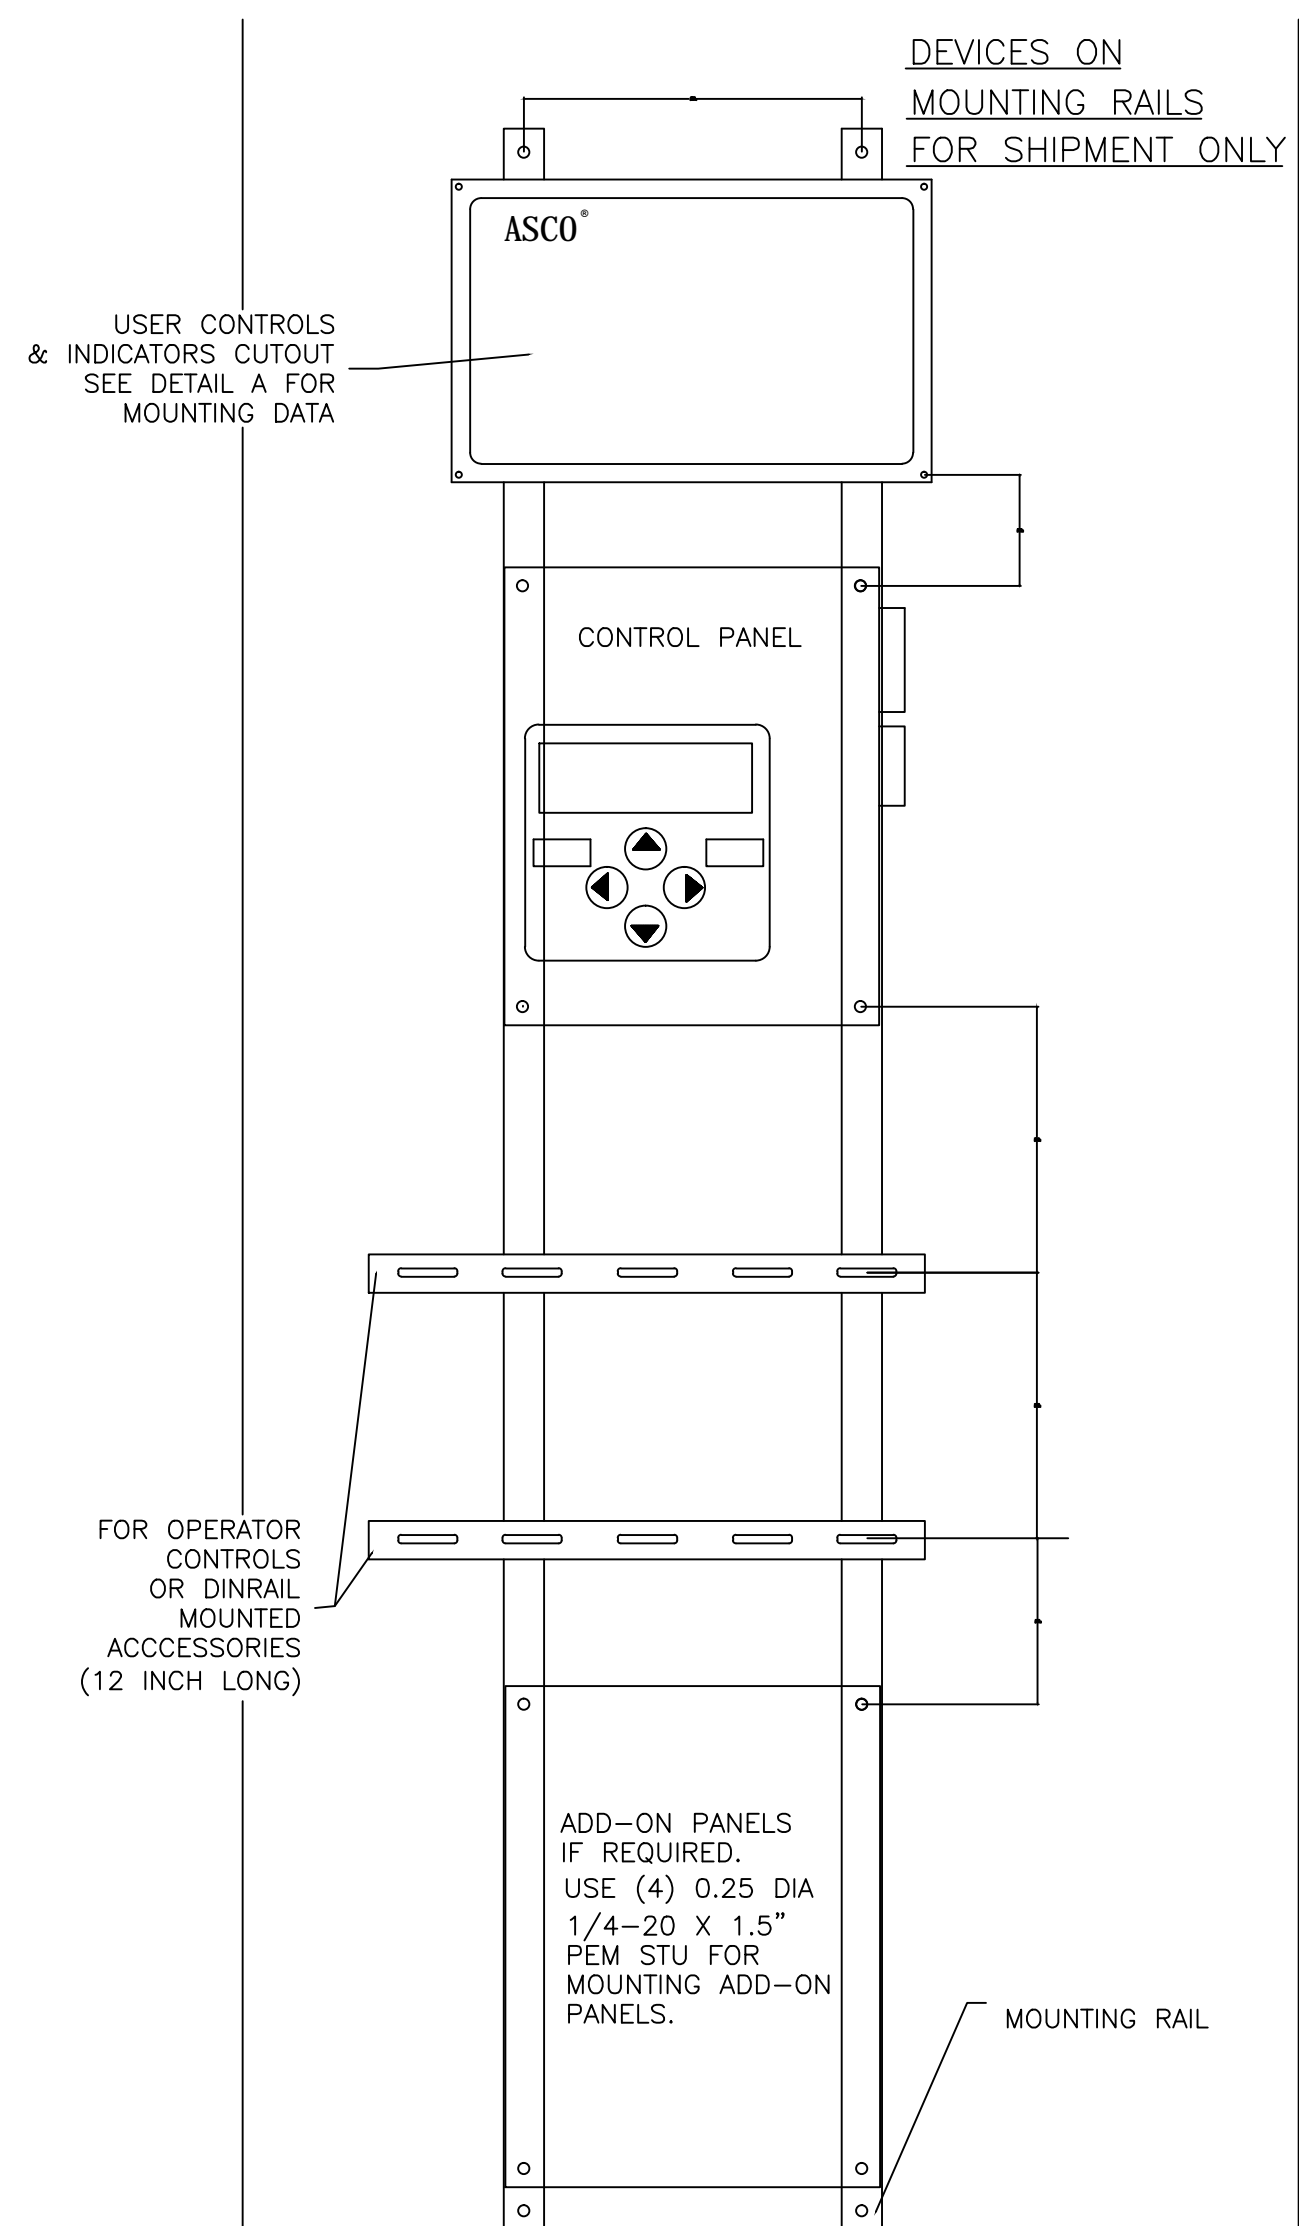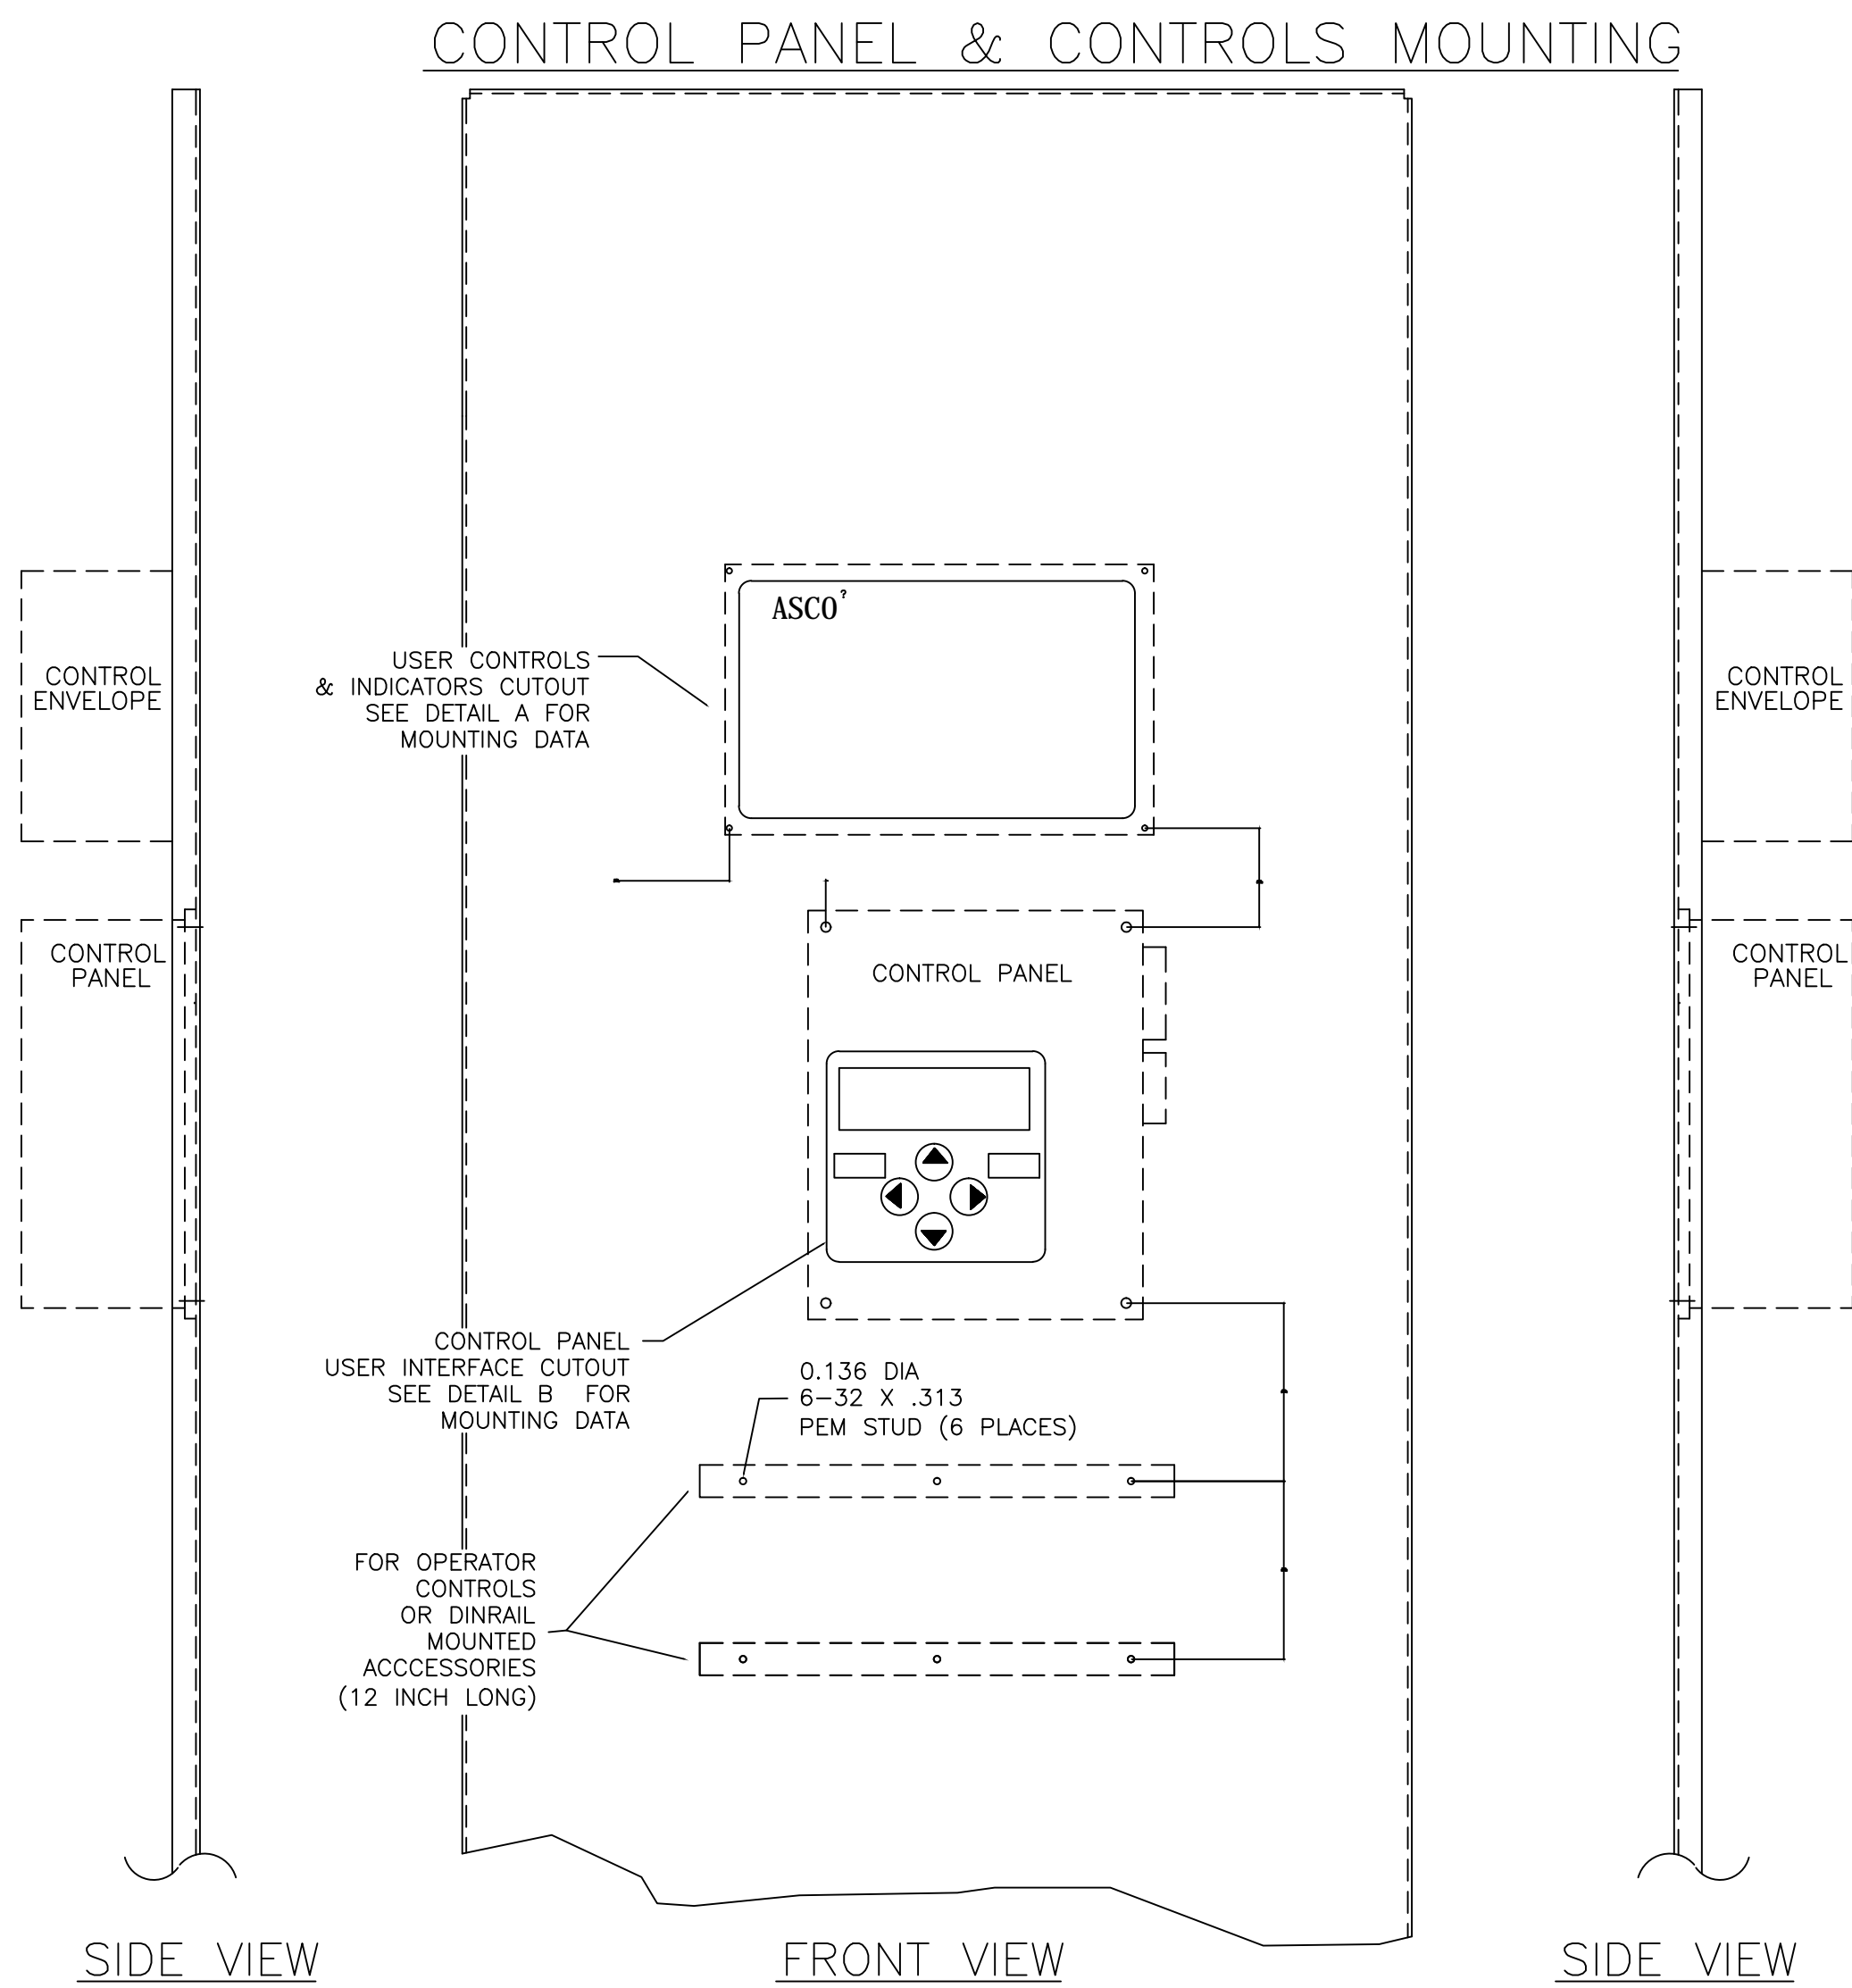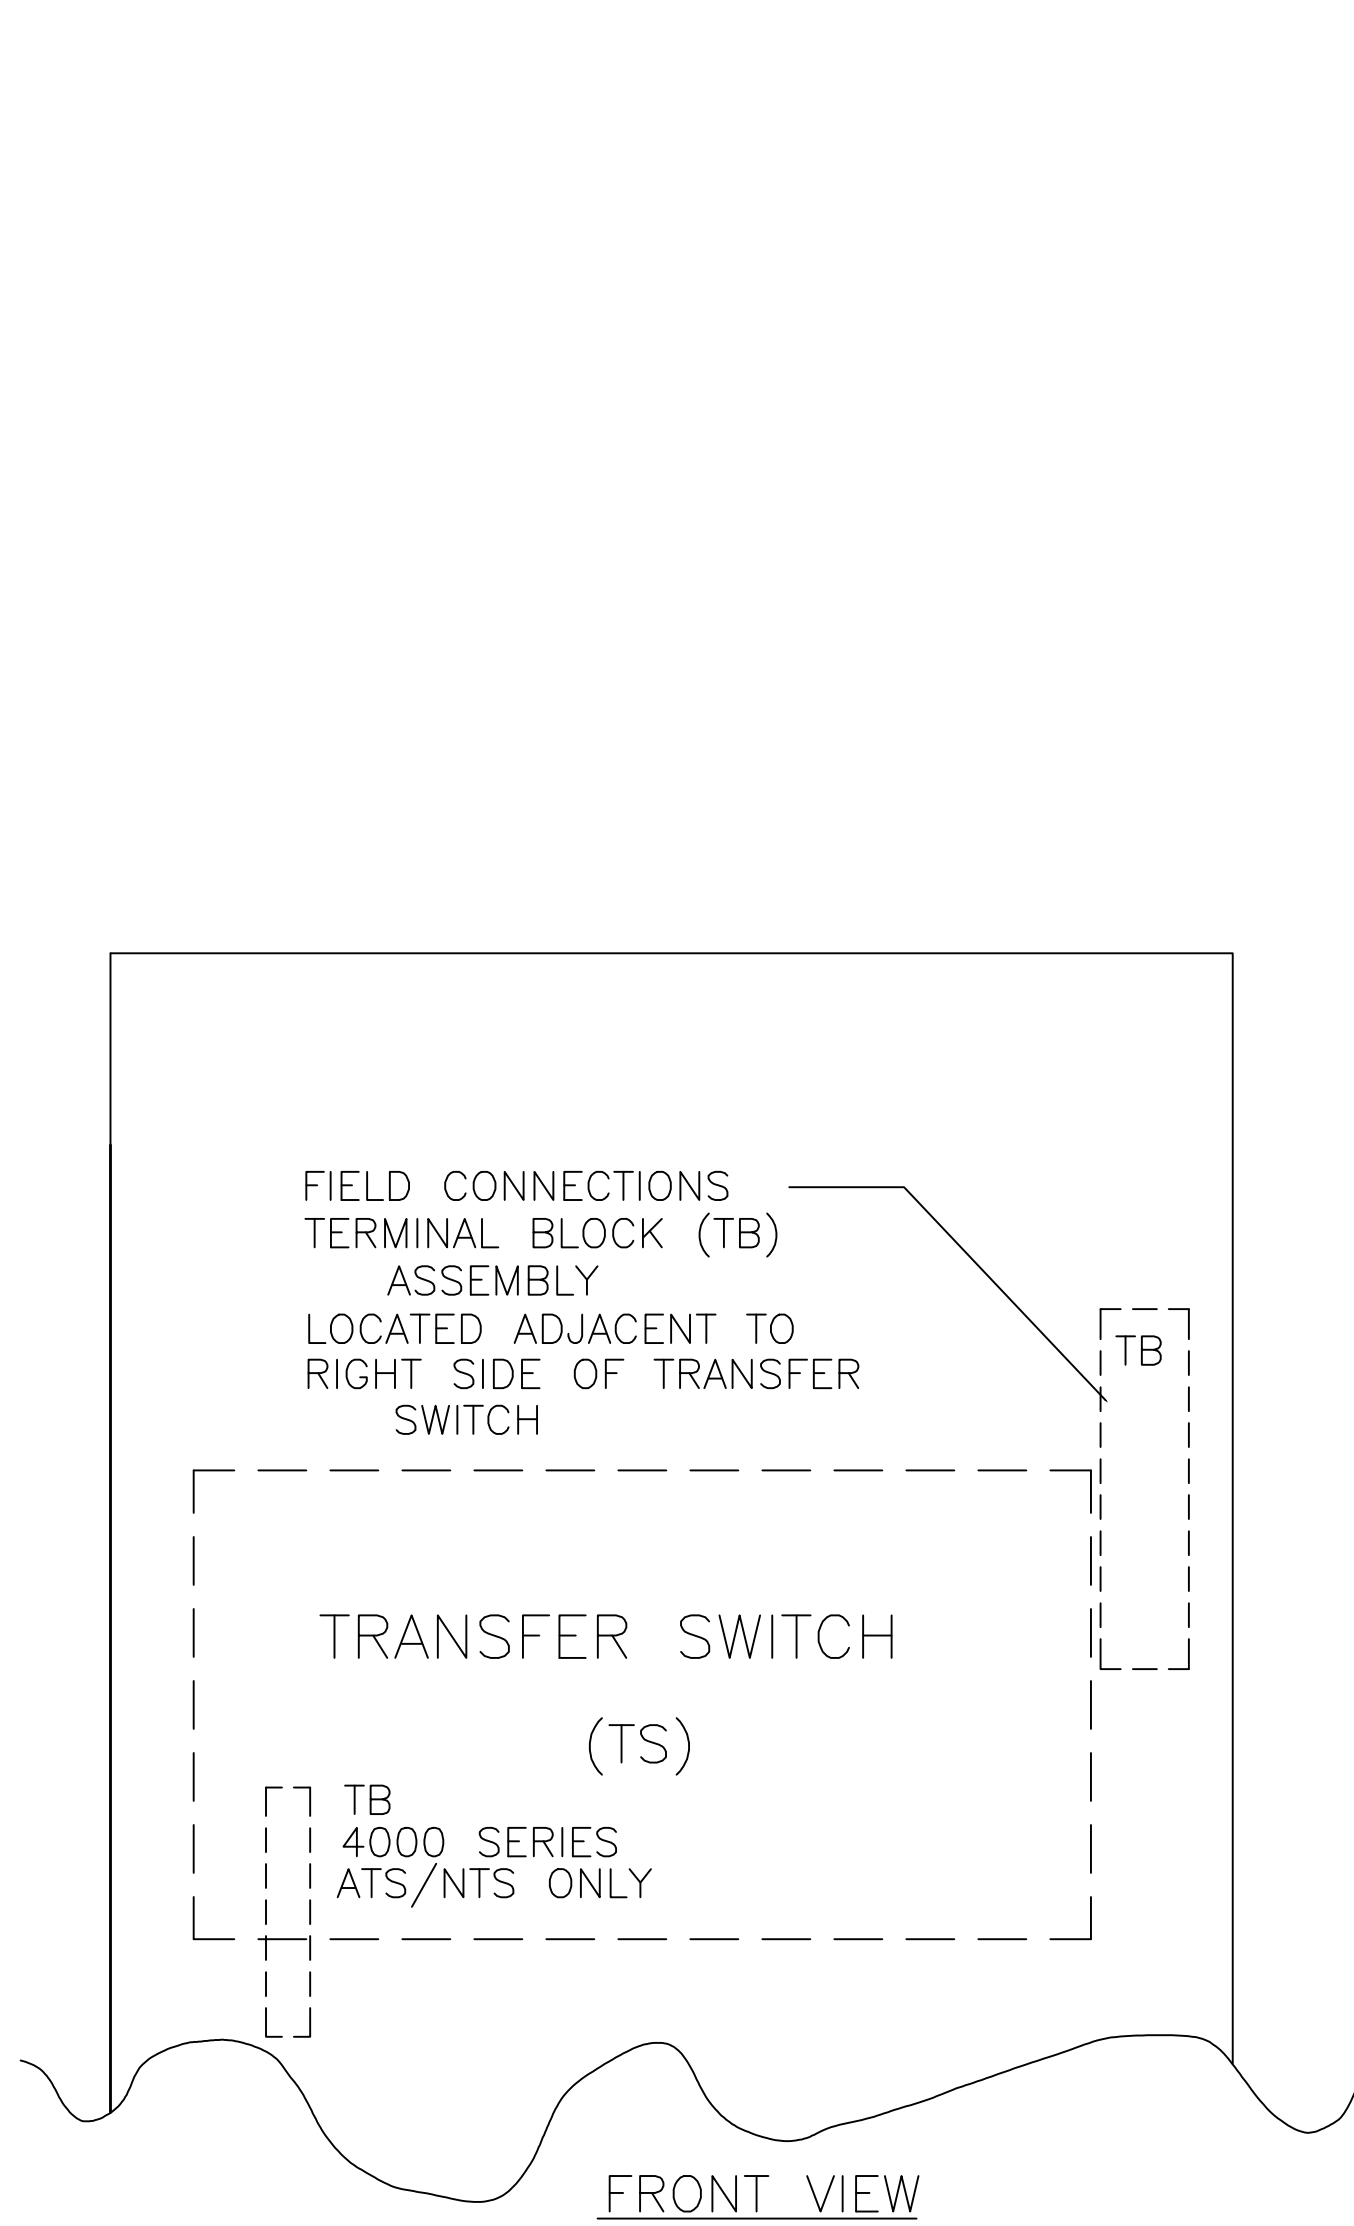

3 260A-400A OPEN TYPE - TYPICAL COMPONENT LOCATIONS
NTS

APPROVED BY:		ARCHITECT/ENGINEERS:		Drawing Title		Project Title		Project Number		Office of Construction and Facilities Management Department of Veterans Affairs	
DIRECTOR		CHIEF OF SERVICES		ELECTRICAL DETAILS		RAYMOND G. MURPHY VA MEDICAL CENTER - REPLACE AUTOMATIC TRANSFER SWITCHES		501-11-130			
ASSOCIATE DIRECTOR		CHIEF OF PROJECT SECTION		Approved Project Director		Location		Building Number		Drawing Number	
ASSISTANT DIRECTOR						VA ALBUQUERQUE, NM		41, 42, 43, 45, 46			
Revisions		Date		CHIEF OF ENGINEERING		Date		Checked		Drawn	
						12/07/11		TJC		TJC	

VA FORM 08-6231