



three inches = one foot  
 one and one half inches = one foot  
 one inch = one foot  
 three quarters inch = one foot  
 one half inch = one foot  
 three eighths inch = one foot  
 one quarter inch = one foot  
 one eighth inch = one foot

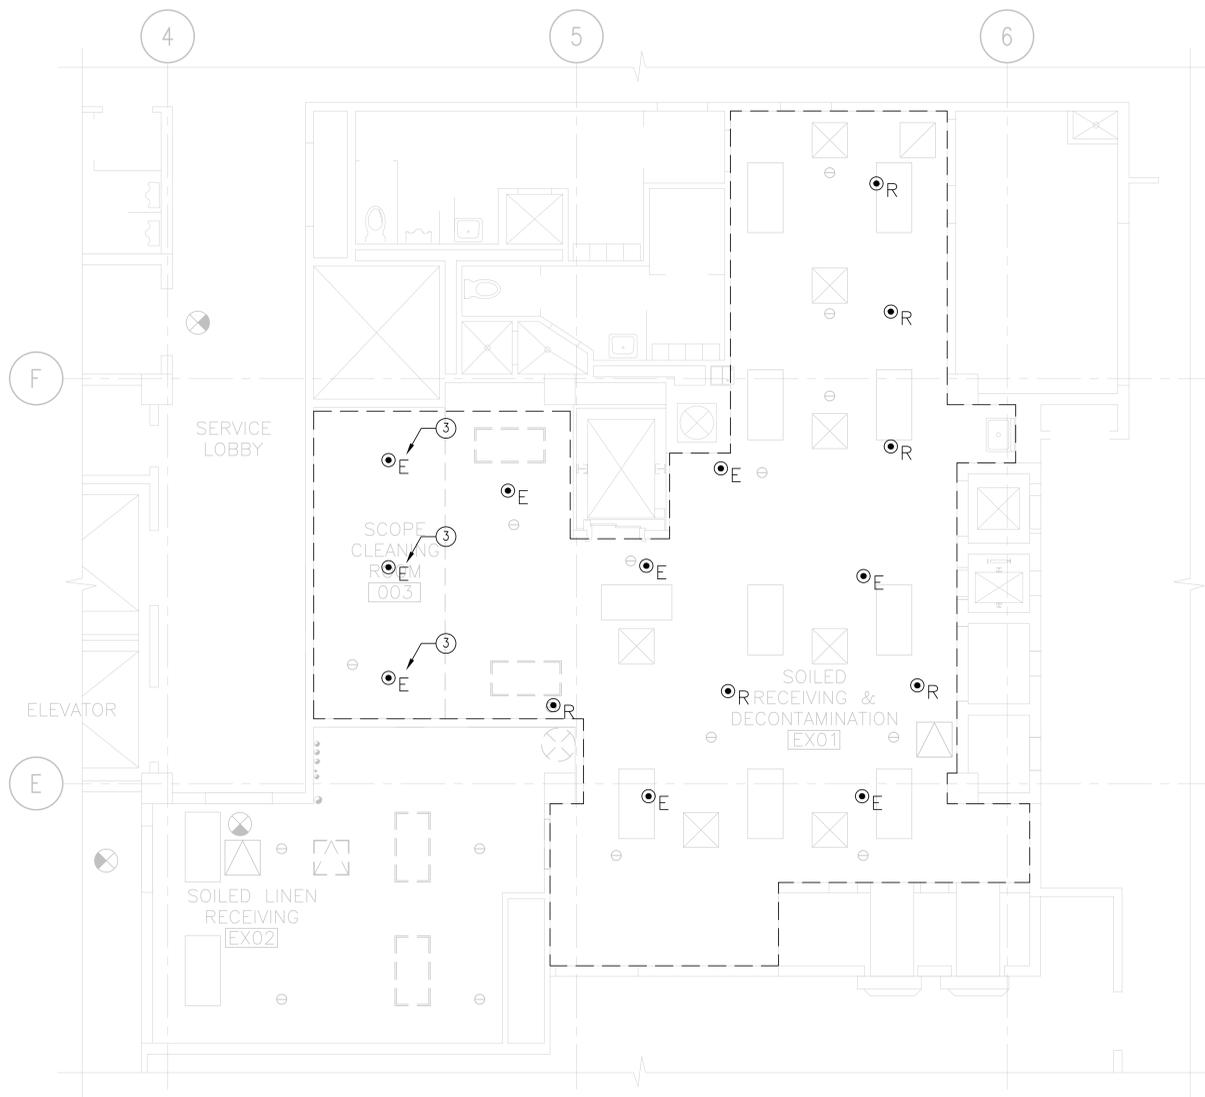

1 EXISTING FIRE SPRINKLER - CEILING PLAN  
 1/4" = 1'-0"

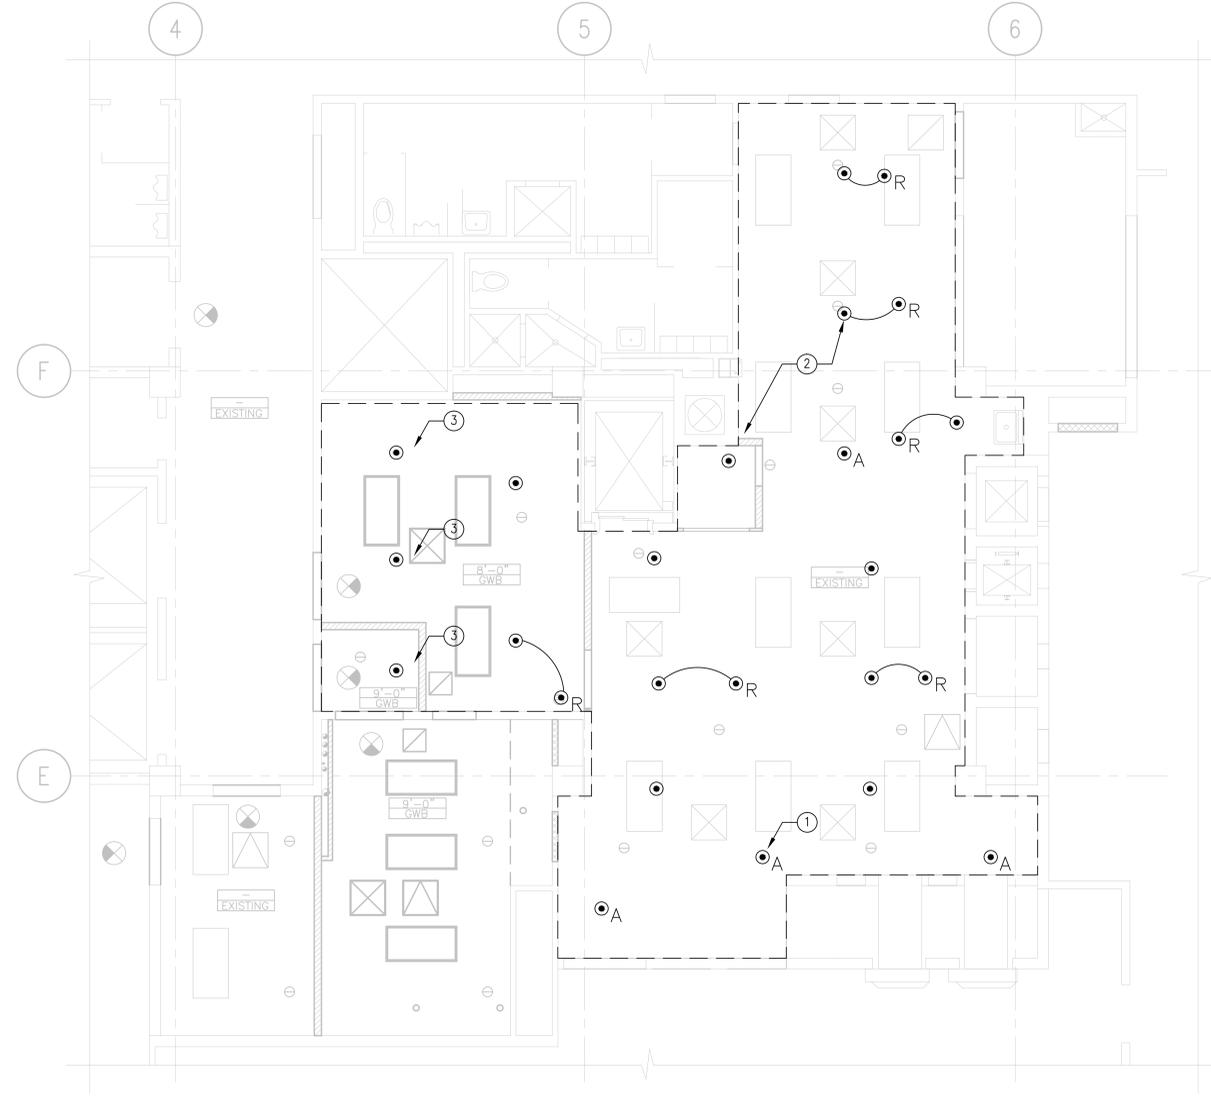

2 NEW FIRE SPRINKLER - CEILING PLAN  
 1/4" = 1'-0"

**GENERAL NOTES:**

1. THESE PLANS ARE CONCEPTUAL IN NATURE. EXISTING SPRINKLER LOCATIONS ARE BASED ON AVAILABLE INFORMATION. CONTRACTOR IS RESPONSIBLE TO FIELD-VERIFY ALL EXISTING AND PROPOSED RELOCATED SPRINKLER LOCATIONS. FINAL SPRINKLER SPACING SHALL NOT EXCEED 130 SQUARE FEET AS REQUIRED FOR AN ORDINARY HAZARD GROUP 1 OCCUPANCY.
2. NEW PENDENT SPRINKLERS PROVIDED AS PART OF THIS RENOVATION SHALL BE OF THE SAME RESPONSE CHARACTERISTIC AND TEMPERATURE RATING AS THE EXISTING SPRINKLERS IN THIS SPACE UNLESS A HIGHER TEMPERATURE RATING IS APPROPRIATE FOR SPRINKLERS LOCATED ADJACENT TO HEAT SOURCES.
3. ALL SPRINKLERS SHALL BE INSTALLED ON RETURN BENDS. HANGERS ARE REQUIRED ON THE RETURN BEND PIPING WHEN THE HORIZONTAL DISTANCE EXCEEDS TWO FEET.
4. PIPING SHALL BE A MINIMUM OF ONE-INCH SCHEDULE 40 BLACK STEEL.
5. COORDINATE SPRINKLER AND ESCUTCHEON FINISHES WITH EXISTING FINISHES AND THE ARCHITECTURAL FINISHES PLAN.

**SHEET NOTES:**

1. ENSURE THAT SPRINKLERS ARE NOT LOCATED CLOSER THEN SIX FEET IN THE FINAL INSTALLED CONDITION.
2. THE RELOCATED SPRINKLER SHALL BE WITHIN 10.5 FT. OF THE CORNER, MEASURED DIAGONALLY.
3. COORDINATE SPRINKLER LOCATIONS WITH NEW GYPSUM WALLBOARD CEILINGS TO BE INSTALLED.

**LEGEND: DEMO**

- E EXISTING SPRINKLER TO REMAIN
- R SPRINKLER TO BE RELOCATED
- - - EXTENT OF WORK

**LEGEND: NEW WORK**

- FINAL SPRINKLER LOCATION
- R RELOCATED SPRINKLER
- A SPRINKLER TO BE ADDED
- - - EXTENT OF WORK

100% ISSUED FOR CONSTRUCTION  
 COMPLETION ITEM NO. 3  
 FULLY SPRINKLERED

Revisions:	Date



Dept. of Veterans Affairs  
 Medical Center  
 1670 Clairmont Road  
 Decatur, Georgia 30033

PROFESSIONAL SEAL:

ARCHITECT/ENGINEERS:

VETERAN ENGINEERING GROUP, INC.  
 4411 Suwanee Dam, Ste 230, Suwanee, GA. 30024  
 ARCHITECTURE ENGINEERING PLANNING  
 1123 Zonolite Road, Suite 25, Atlanta, GA 30306

Drawing Title  
**FIRE SPRINKLER DEMOLITION AND  
 NEW WORK CEILING PLANS**

Approved Project Director

Project Title  
**RENOVATION OF EXISTING  
 STERILE PROCESSING AND  
 STERILE DISTRIBUTION (SPD)**

Location  
**VAMC, DECATUR, GA.**

Date  
 JAN 31, 2012

Checked  
 JC

Drawn  
 JL

Project Number  
 508-10-113

Building Number  
 1

Drawing Number  
**F101**

Dwg. XX of --

Office of  
 Facilities  
 Management

