



three inches = one foot
 one and one half inches = one foot
 one inch = one foot
 one inch = one foot
 three quarters inch = one foot
 one half inch = one foot
 one quarter inch = one foot
 three eighths inch = one foot
 one quarter inch = one foot
 one eighth inch = one foot
 one eighth inch = one foot

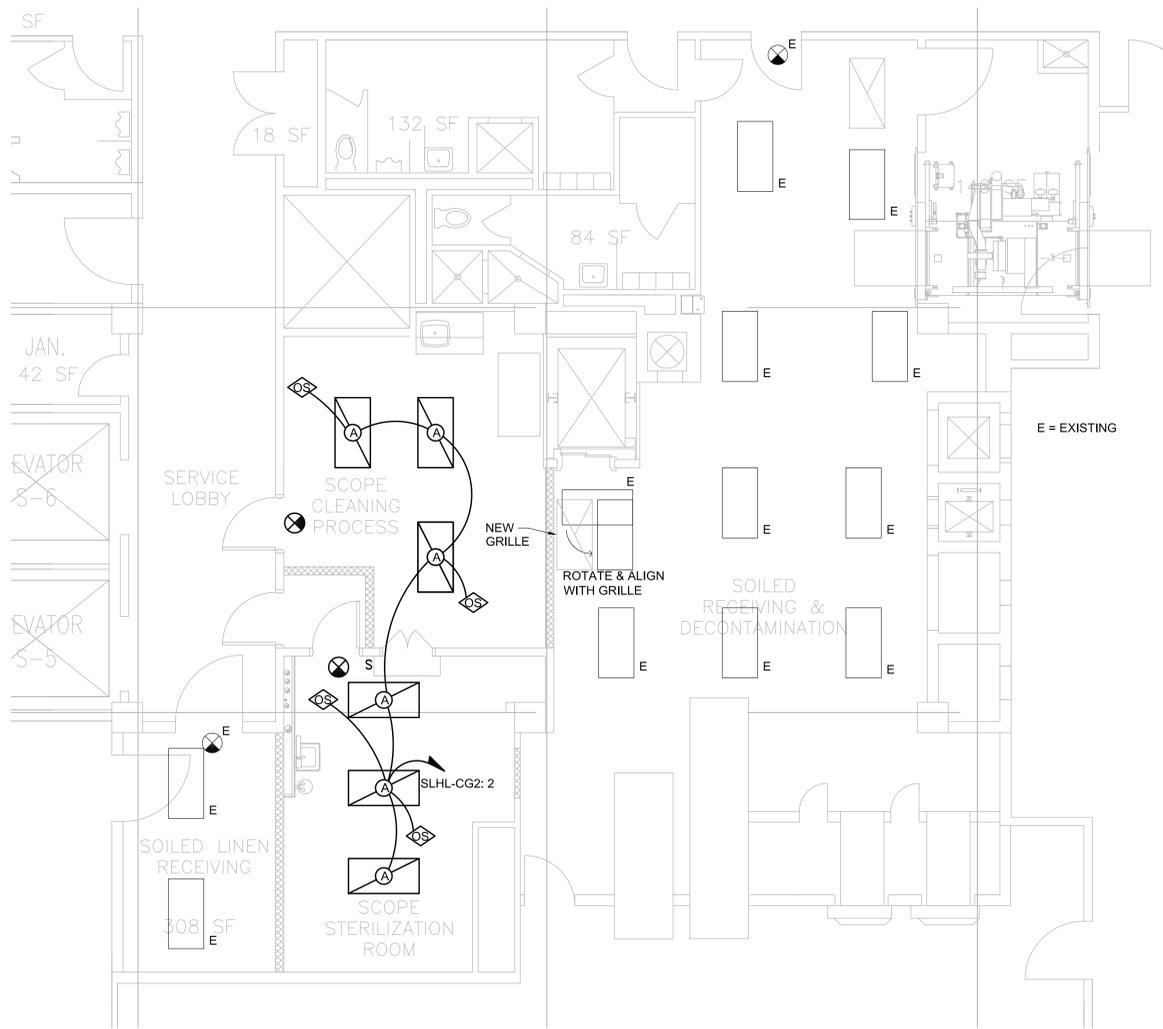

E1 GROUND FLOOR PART PLAN - LIGHTING - NEW WORK
 1/4" = 1'-0"

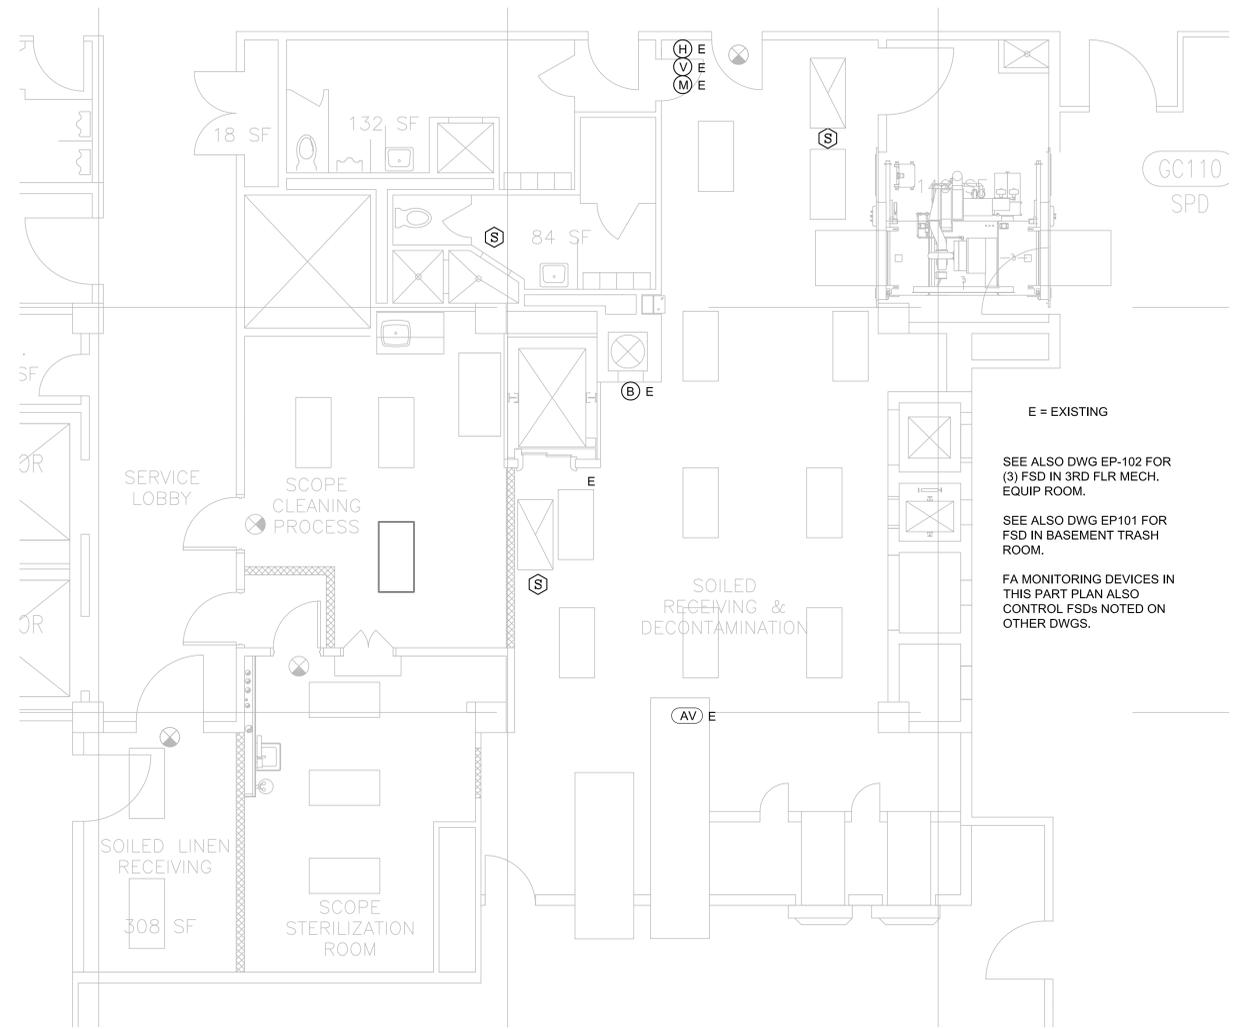

E2 GROUND FLOOR PART PLAN - FIRE ALARM - NEW WORK
 1/4" = 1'-0"

E = EXISTING
 SEE ALSO DWG EP-102 FOR (3) FSD IN 3RD FLR MECH. EQUIP ROOM.
 SEE ALSO DWG EP101 FOR FSD IN BASEMENT TRASH ROOM.
 FA MONITORING DEVICES IN THIS PART PLAN ALSO CONTROL FSDs NOTED ON OTHER DWGS.

GENERAL NOTES:

1 OCCUPANCY SENSORS SHALL BE ULTRASONIC AND PIR COMBINATION TYPE SENSORS. SENSOR SHALL BE CEILING MOUNTED. COORDINATE LOCATION WITH EXISTING EQUIPMENT. REFER TO DETAIL E7 FOR WIRING DETAIL. SENSOR SHALL CONTROL ALL LIGHTS WITHIN THE SAME ROOM.

SHEET NOTES:

LEGEND:

100% ISSUED FOR CONSTRUCTION
 COMPLETION ITEM NO. 3
 FULLY SPRINKLERED

Dept. of Veterans Affairs Medical Center 1670 Clairmont Road Decatur, Georgia 30033	ARCHITECT/ENGINEERS: VETERAN ENGINEERING GROUP, INC. 4411 Suwanee Dam, Ste. 230, Suwanee, GA 30024 ARCHITECTURE ENGINEERING PLANNING 1123 Zonolite Road, Suite 25, Atlanta, GA 30306	Drawing Title GROUND FLOOR PART PLAN - LIGHTING / FIRE ALARM - NEW WORK	Project Title RENOVATION OF EXISTING STERILE PROCESSING SERVICE (SPS)	Project Number 508-10-113 Building Number 1	Office of Facilities Management Department of Veterans Affairs
		Approved Project Director	Location VAMC, DECATUR, GA.	Drawing Number EL101 Dwg. 26 of 27	
Revisions:	Date	Date FEBRUARY 24, 2012	Checked RL	Drawn CM	