



three inches = one foot  
 one and one half inches = one foot  
 one inch = one foot  
 three quarters inch = one foot  
 one half inch = one foot  
 one quarter inch = one foot  
 three eighths inch = one foot  
 one eighth inch = one foot  
 one sixteenth inch = one foot

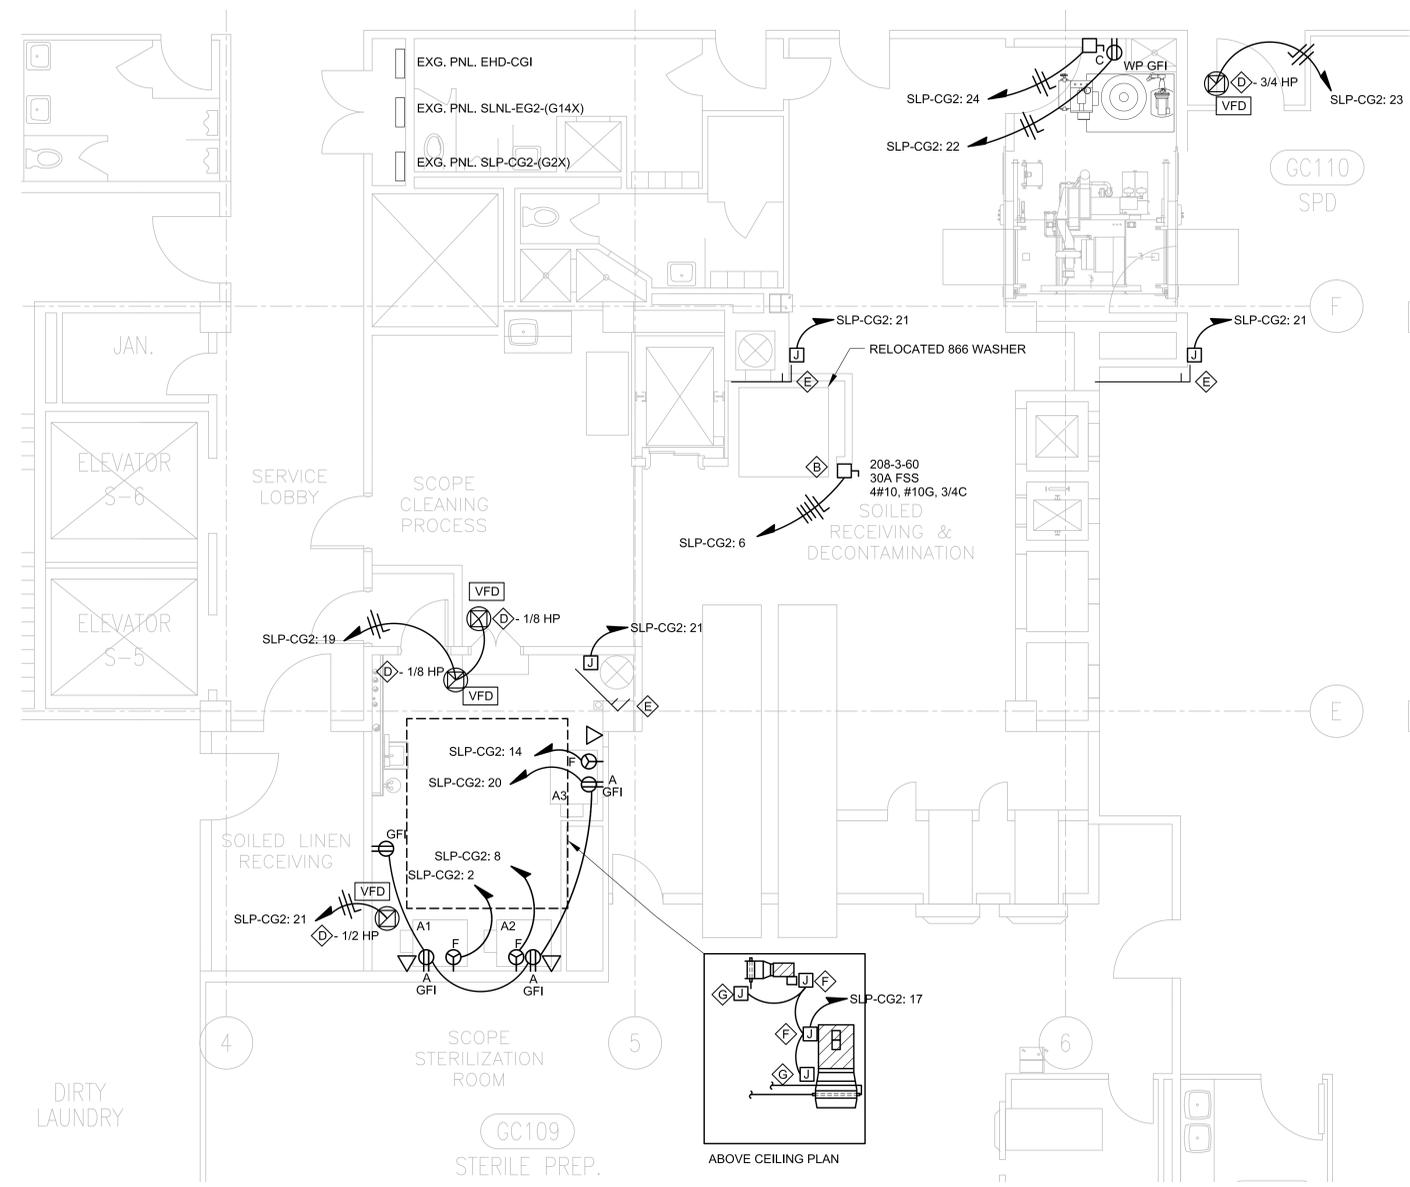

E1 GROUND FLOOR PART PLAN - POWER - NEW WORK  
 1/4" = 1'-0"

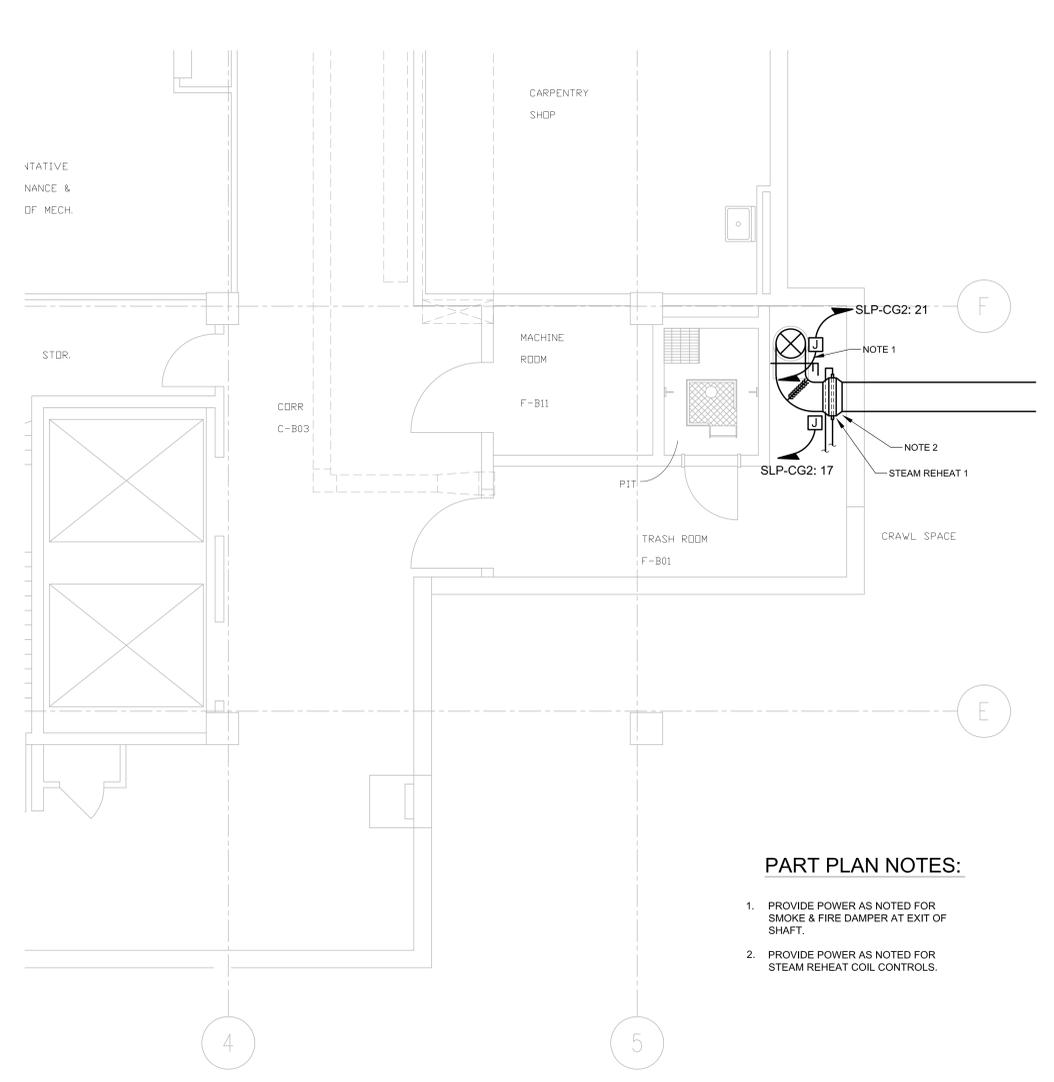

E2 BASEMENT PART PLAN - POWER - NEW WORK  
 1/4" = 1'-0"

- PART PLAN NOTES:**
1. PROVIDE POWER AS NOTED FOR SMOKE & FIRE DAMPER AT EXIT OF SHAFT.
  2. PROVIDE POWER AS NOTED FOR STEAM REHEAT COIL CONTROLS.

**GENERAL NOTES:**

- 1 OCCUPANCY SENSORS SHALL BE ULTRASONIC AND PIR COMBINATION TYPE SENSORS. SENSOR SHALL BE CEILING MOUNTED. COORDINATE LOCATION WITH EXISTING EQUIPMENT. REFER TO DETAIL E7 FOR WIRING DETAIL. SENSOR SHALL CONTROL ALL LIGHTS WITHIN THE SAME ROOM.

- SHEET NOTES:**
- Ax Ax - EVOTECH ENDOSCOPIC CLEANER AND REPROCESSOR (ECR); TYP OF (3). EACH NEMA L15-30, 23A, @ 208V-3Ø. ADDITIONALLY, (1) RJ45 WITH 1ØBASE-T; WITH CAT-6 TO DEMARK ROOM.
  - B. GETINEE WASHER - 208V-3Ø, 26A WITH 3ØA FUSE, 6.5 KW, NEMA 5-20L & 15A @ 115VAC GFI PROVIDED FOR ALL POWER CIRCUITS.
  - C. NEW REVERSE OSMOSIS WATER TREATMENT SYSTEM, NEMA 5-20R GFI AND MOTOR RATED SWITCH FOR CONTROL PANEL. EXISTING DISCONNECT SWITCH SHALL REMAIN.
  - D. EXHAUST FAN CONTROLS - VFD CONTROL CIRCUIT TO PANEL SPACE AS NOTED. EXACT CONTROL LOCATION TO BE DETERMINED BY HVAC CONTRACTOR.
  - E. FIRE AND SMOKE DAMPER LOCATION. PROVIDE 120V DROP.
  - F. AIR VALVE. PROVIDE 120V DROP.
  - G. STEAM COIL. PROVIDE 120V DROP.

**LEGEND:**

100% ISSUED FOR CONSTRUCTION  
 COMPLETION ITEM NO. 3  
 FULLY SPRINKLERED

<p>Revisions:</p> <table border="1" style="width: 100%; border-collapse: collapse;"> <tr> <th style="width: 5%;">No.</th> <th style="width: 15%;">Description</th> <th style="width: 10%;">Date</th> </tr> <tr> <td> </td> <td> </td> <td> </td> </tr> </table>	No.	Description	Date				<p><b>Dept. of Veterans Affairs          Medical Center          1670 Clairmont Road          Decatur, Georgia 30033</b></p>	<p>Professional Seal</p>	<p><b>ARCHITECT/ENGINEERS:</b></p> <p> <b>VETERAN ENGINEERING GROUP, INC.</b>          4411 Suwanee Dam, Ste. 230, Suwanee, GA 30024</p> <p><b>Smith Carter</b> ARCHITECTURE ENGINEERING PLANNING          1123 Zonolite Road, Suite 25, Atlanta, GA 30306</p>	<p>Drawing Title  <b>GROUND FLR / BSMT PART PLANS -          POWER - NEW WORK</b></p> <p>Approved Project Director</p>	<p>Project Title  <b>RENOVATION OF EXISTING          STERILE PROCESSING SERVICE (SPS)</b></p> <p>Location  <b>VAMC, DECATUR, GA.</b></p> <p>Date  <b>FEBRUARY 24, 2012</b></p> <p>Checked  <b>FH</b></p> <p>Drawn  <b>JW</b></p>	<p>Project Number  <b>508-10-113</b></p> <p>Building Number  <b>1</b></p> <p>Drawing Number  <b>EP101</b></p> <p>Dwg. 24 of 27</p>	<p><b>Office of          Facilities          Management</b></p> <p> Department of Veterans Affairs</p>
No.	Description	Date											