


1.0
5
DEMOLITION HVAC
SCALE: 1/8" = 1'-0"

- (DH1) REMOVE DIFFUSER
- (DH2) REMOVE DUCT WORK AND ASSOCIATED HANGERS
- (DH3) DISCONNECT AND CAP TO BE RECONNECTED DURING CONST.
- (DH4) CAP AT CEILING
- (DH9) REMOVE VAV AND SAVE FOR REUSE
- (DH8) REMOVE DRYER VENT IN ITS ENTIRETY

DEM. HVAC TO LINE - - - - -

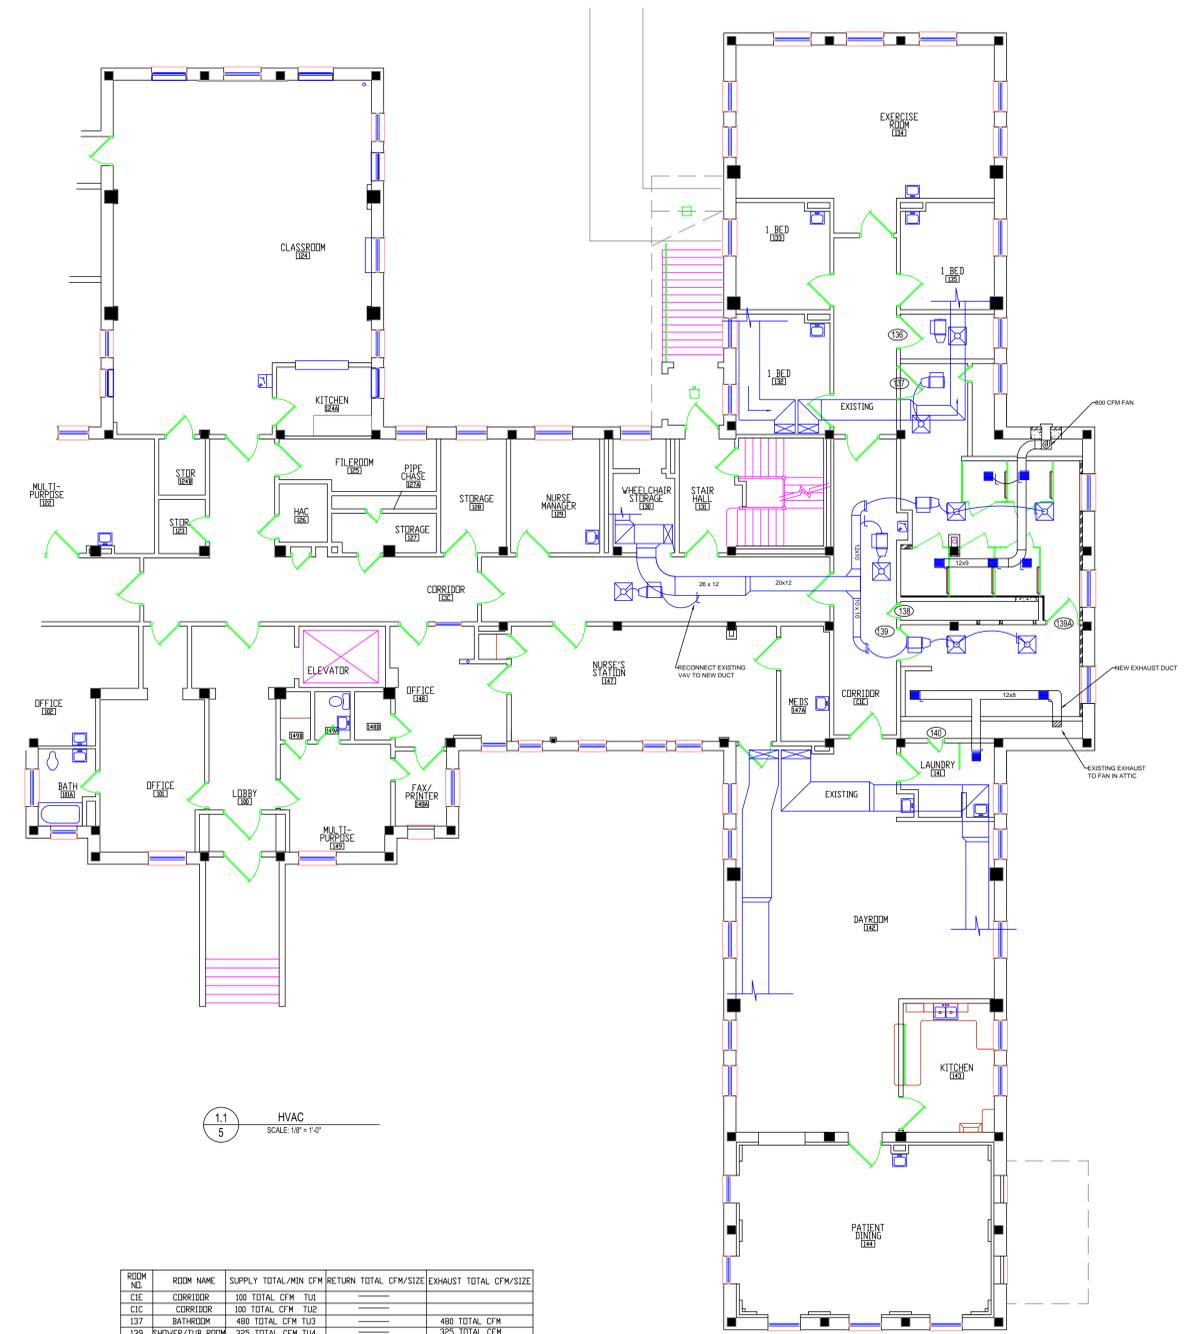

1.1
5
HVAC
SCALE: 1/8" = 1'-0"

ROOM NO.	ROOM NAME	SUPPLY TOTAL/MIN CFM	RETURN TOTAL CFM/SIZE	EXHAUST TOTAL CFM/SIZE
C1E	CORRIDOR	100 TOTAL CFM TLJ	---	---
C1C	CORRIDOR	100 TOTAL CFM TLJ	---	---
127	BATHROOM	480 TOTAL CFM TLJ	---	480 TOTAL CFM
139	SHOWER/TUB ROOM	325 TOTAL CFM TLJ	---	325 TOTAL CFM

RENOVATE BUILDING 48 ADHC BATHROOMS

No.	REVISION	DATE

APPROVED SERVICE LINE DIRECTOR	DATE	APPROVED INFECTION CONTROL NURSE	DATE	DRAWING TITLE	BUILDING 48 HVAC
APPROVED GRAB COORDINATOR	DATE	APPROVED PATIENT SAFETY	DATE	PROJECT TITLE	BUILDING 48 ADULT DAY HEALTHCARE BATHROOM RENOVATION
APPROVED PROJECTS SECTION MANAGER	DATE	APPROVED CHIEF OF POLICE	DATE	DATE	06/21/11
APPROVED DIRECTOR I&E	DATE	APPROVED SAFETY MANAGER	DATE	SCALE	1/8" = 1'-0"
				PROJECT NO.	656-12-215
				ISSUE NO.	0021
				ISSUE DATE	05/15/11
				ISSUE BY	ms/5sr7

St. Cloud VA
Health Care System
Brainerd | Montevideo | Alexandria