


GENERAL DEMOLITION NOTES:


1. PROTECT EXISTING EQUIPMENT AND PIPING WHICH IS TO REMAIN IN PLACE FOR REUSE WITH TEMPORARY CAPS, COVERS, SHORING, BRACING AND SUPPORTS.
2. ALL EQUIPMENT TO BE REMOVED SHALL BE INSPECTED AND REVIEWED BY THE OWNER FOR POSSIBLE REUSE, EXCEPT WHERE INDICATED OTHERWISE. ALL MATERIALS AND EQUIPMENT REMOVED AND NOT REUSED SHALL BECOME THE PROPERTY OF THE CONTRACTOR AND SHALL BE REMOVED FROM THE OWNERS PROPERTY.
3. DO NOT INTERRUPT OR CONNECT INTO ANY SERVICE PIPING, ELECTRICAL, OR INSTRUMENTATION WORK WITHOUT PRIOR APPROVAL FROM THE OWNERS REPRESENTATIVE.
4. CONTRACTOR SHALL FIELD VERIFY LOCATION(S) OF EXISTING PIPING AND EQUIPMENT TO BE REMOVED.
5. CONTRACTOR SHALL BE RESPONSIBLE FOR THE COORDINATION OF THEIR WORK WITH OTHER TRADES, AND WITH THE CONSTRUCTION MANAGER IN REGARDS TO PROJECT "PHASING".
6. REFER TO RENOVATION PLAN TO CONFIRM PIPING AND EQUIPMENT THAT WILL NEED TO BE REMOVED.

FIRE PROTECTION DEMOLITION NOTES:


1. REMOVE EXISTING FIRE PROTECTION SPRINKLER HEADS AND ASSOCIATED PIPING.
2. REMOVE EXISTING FIRE PROTECTION PIPING.
3. REMOVE EXISTING DRY PIPE AIR COMPRESSOR AND ALL ASSOCIATED WIRING AND CONTROLS.
4. REMOVE EXISTING DRY PIPE RISER AND ALL ASSOCIATED VALVES AND PIPING AND RECONNECT PIPING.
5. REMOVE EXISTING FIRE PROTECTION PIPING BACK TO MAN AND CAP.
6. EXISTING FIRE PROTECTION MAN TO REMAIN.
7. EXISTING FIRE PROTECTION SPRINKLER HEAD TO REMAIN.
8. REMOVE ALL EXISTING SMOKE DETECTORS ON CEILING AND UNDER RAISED FLOORS. FIELD VERIFY NUMBER AND LOCATIONS.

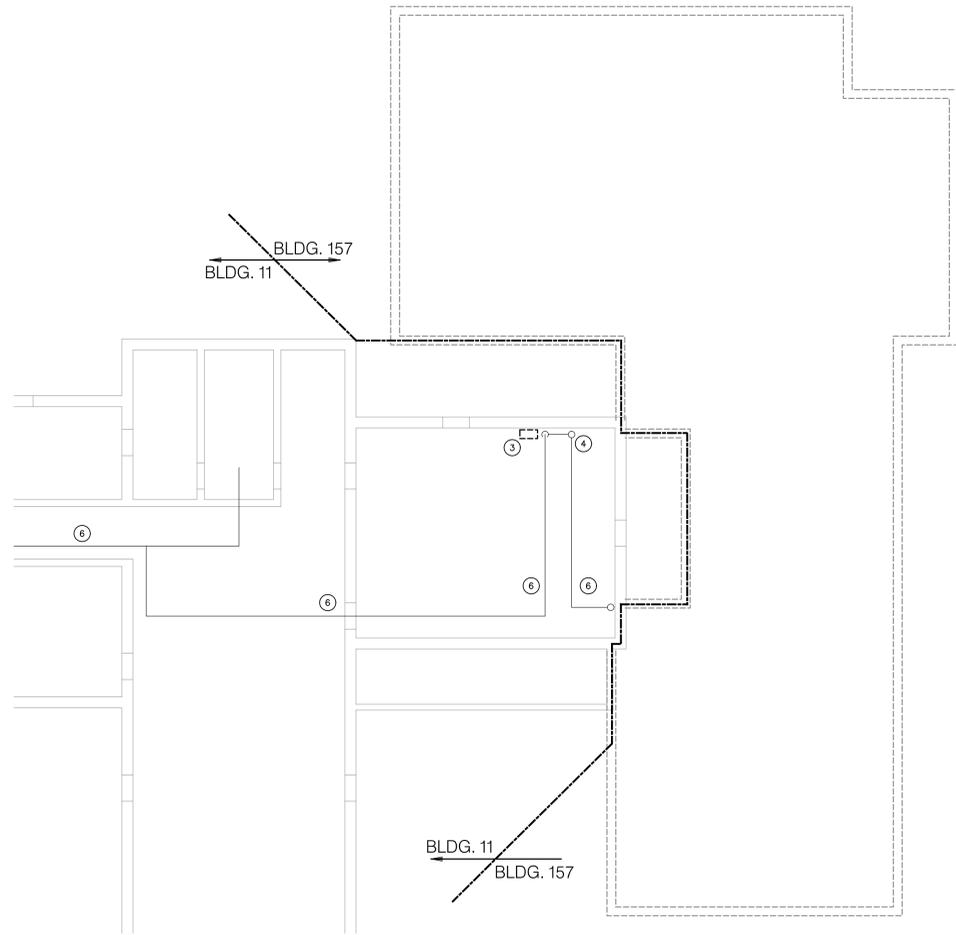

FIRE PROTECTION DEMOLITION PLAN
BUILDING 11 BASEMENT
SCALE: 1/8" = 1'-0"

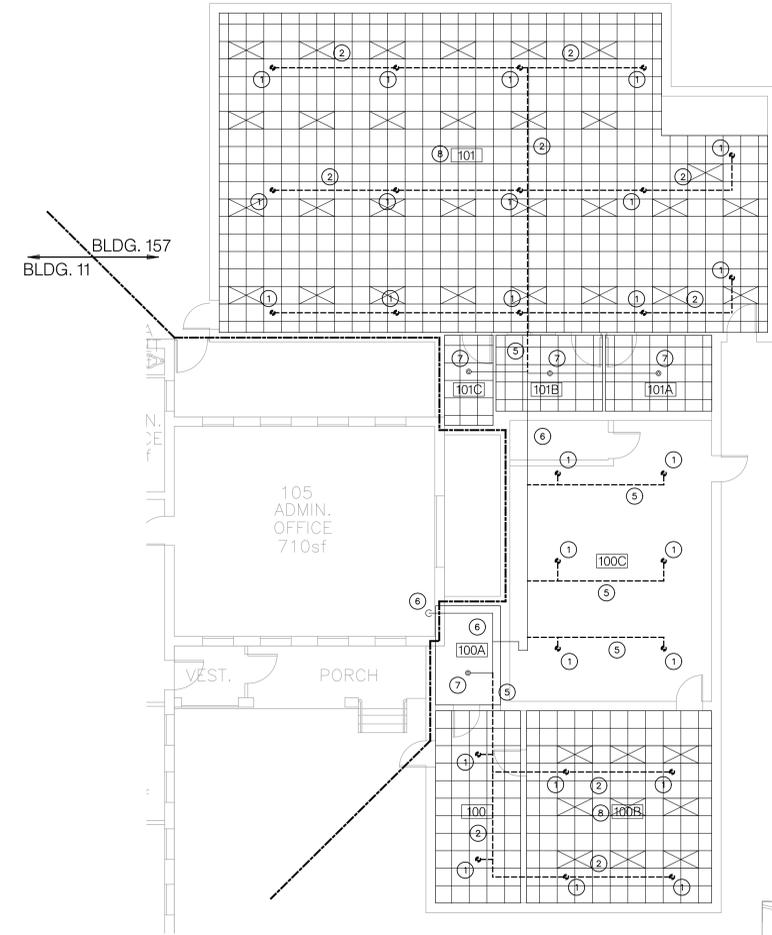

FIRE PROTECTION DEMOLITION PLAN
BUILDING 157 IT AREA
SCALE: 1/8" = 1'-0"

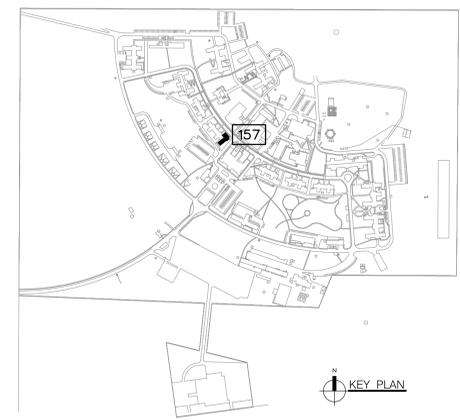

KEY PLAN

100% SUBMISSION

COMPREHENSIVE ENGINEERING
4653 Plainfield Avenue, NE
Grand Rapids, MI 49505
Phone: (616) 365-9933
FAX: (616) 365-9937
CE #10087

APPROVED: DIRECTOR	APPROVED: CHIEF, SPD	APPROVED: CHIEF, PROJECT SECTION
APPROVED: ASSOCIATE DIRECTOR	APPROVED: PROTECTIVE SERVICE	APPROVED:
APPROVED: CHIEF OF STAFF	APPROVED: INDUSTRIAL HYGIENIST	APPROVED:
APPROVED: CHIEF, FACILITIES MANAGEMENT SERVICE	APPROVED: SAFETY MANAGER	APPROVED:

VA PROJECT NAME: Information Management Safety & Security Upgrades		DRAWING TITLE: FIRE PROTECTION DEMOLITION PLANS	
DATE: 15 FEB 2011		VA PROJECT NUMBER: 515-10-120	A/E PROJECT NUMBER: 10087
LOCATION: BATTLE CREEK VAMC	PLOT SCALE: 1/8" = 1'-0"	BUILDING NUMBER: 157	DRAWING NUMBER: DWG F1 OF 11

DEPARTMENT OF VETERANS AFFAIRS