

PART VI

SCHEDULE E

PART VI: SCHEDULE E--ROOM FINISH, DOORS & HARDWARE

SECTION 1	ROOM FINISH, DOOR AND HARDWARE SCHEDULE--GENERAL	3
1.1	ROOM FINISHES, DOOR AND HARDWARE SCHEDULE	3
1.1.1	USE OF SCHEDULE E	3
1.1.2	OTHER REQUIREMENTS	5
1.1.3	WALLCOVERING PROTECTIVE (WP), RIGID PVC SHEET	5
1.1.4	STAIRWAYS	5
1.2	DOORS	5
1.2.1	DOORS	5
1.2.2	DOOR TYPES	7
1.2.3	DOOR SIZES	8
1.2.4	LEAD LINED DOORS AND FRAMES	9
1.3	FINISH HARDWARE	10
1.3.1	GENERAL	10
1.3.2	BUTT HINGES	10
1.3.3	CONTINUOUS HINGES – Required as Necessary	11
1.3.4	DOOR CLOSING DEVICES	12
1.3.5	DOOR STOPS	12
1.3.6	LOCKS AND LATCHES	12
1.3.7	ELECTROMAGNETIC LOCKS	13
1.3.8	CARD READERS	14
1.3.9	ELECTRIC STRIKES	14
1.3.10	KEYS	14
1.3.11	ARMOR PLATES, COMBINATION KICK-MOP PLATES AND DOOR EDGING	15
1.3.12	EXIT DEVICES	15
1.3.13	WEATHERSTRIPS (FOR EXTERIOR DOORS)	16
1.3.14	MISCELLANEOUS HARDWARE	16
1.3.15	PADLOCKS FOR VARIOUS DOORS, GATES AND HATCHES	16
1.3.16	HARDWARE SETS	16

SECTION 2 SCHEDULE E

PART VI SCHEDULE E--ROOM FINISH, DOORS & HARDWARE

SECTION 1 ROOM FINISH, DOOR AND HARDWARE SCHEDULE--GENERAL

Schedule E lists each type of space or room required in the outpatient clinic. The following information is listed for each space in the Schedule:

Department, Area and Function

Floor, Wall and Ceiling Finishes

Door Symbol and Hardware Set

If the Lessor believes that there are spaces or conditions not included in this Schedule, the question shall be referred to the Contracting Officer.

Note: Common areas or building service areas that are indicated in Schedule E and are not included in the NUSF leased by VA are specifically excluded from the quantities listed in Schedule C.

1.1 ROOM FINISHES, DOOR AND HARDWARE SCHEDULE

1.1.1 USE OF SCHEDULE E

THE REQUIREMENTS IN THIS SCHEDULE APPLY TO ALL SPACES TO BE OCCUPIED BY VA IN THE OUTPATIENT CLINIC. LESSOR SHALL PROVIDE MATERIALS, FINISHES, DOORS, FRAMES, AND HARDWARE IN ACCORDANCE WITH THIS SCHEDULE AND THE REQUIREMENTS SPECIFIED IN THIS SFO.

Lessor shall provide each space with door(s) of the type and size as listed in Schedule E with hardware as noted. Doors and hardware requirements are indicated by their respective door symbols and hardware set numbers in this Schedule. Additional requirements are defined in Paragraph 1.3, "Doors and Hardware".

The Lessor shall provide room finishes in each room in accordance with Schedule E. Finishes are shown in the schedule for the floor, base, wainscot, wall, and ceiling surfaces for each room or space. The following are abbreviations used for materials and codes throughout the room finishes, door, and hardware schedule. The Lessor shall coordinate abbreviations used in the construction documents prepared by the Lessor with the abbreviations and symbols used in this SFO.

ADO	Automatic Door Operator
AF	Access Flooring
AT	Acoustical Ceiling (Tile)
AT(SP)	Acoustical Ceiling (with Sprayed Plastic Finish)
AT(TG)	Acoustical Ceiling (with Tegular Edge)
AWF	Acoustical Wall Fabric (Tackable)
AWP	Acoustical Wall Panel
BP	Brick Pavers (Unit Pavers)

BR	Brick (Unit Masonry)
C	Concrete
CMU	Concrete Masonry Units (Unit Masonry)
CP	Carpet (without Cushion Broadloom)
CPT	Carpet Tile
CT	Ceramic Tile (Floor, Base, and Wall)
EFTR	Existing Finish to Remain
EPY	Epoxy (Coatings)
ERF	Epoxy Resinous Flooring
EX	Existing
EXP	Exposed
GL	Glass (Glazing)
GWB	Gypsum Wallboard Systems
HW	Hardware Set (Finish or Builders Hardware)
LM	Latex Mastic Flooring
MAT	Material
MC	Multi-Color Coating
NF	Natural Finish
NO	Number
P	Paint (Exterior, Interior, Transparent Finishes)
PC	Precast (Architectural Precast Concrete Panels)
PCP	Portland Cement Plaster
PFW	Polypropylene Fabric Wallcovering
PL	Plaster
PUT	Polyurethane
QT	Quarry Tile
RAF	Resilient Athletic Flooring
RB	Resilient Base (Rubber, Vinyl)
RF	Raised Rubber Flooring
RSF	Resilient Sheet Flooring
RT	Resilient Flooring (Cork)
SC	High Build Glazed Coating (Special Coating)
SCB	Seamless Coved Base
SP	Special Faced
SPEC	Special (Architect's Choice)

Part VI: Schedule E – Room Finish, Door & Hardware
Section 1 -- Page 4

ST	Stone (Cast)
SVT	Solid Vinyl Floor Tile (Luxury Vinyl Tile)
TT	Terrazzo Tile (Plastic Matrix)
VCT	Resilient Tile Flooring (Vinyl Composition Tile)
VP	Veneer Plaster
W	Wallcovering (Vinyl Coated Fabric)
WB	Wall Border
WD	Wood
WM	Walk Off Mat
WP	Wallcovering Protective (Rigid PVC Sheet)
WSF	Welded Seam Sheet Flooring

1.1.2 OTHER REQUIREMENTS

A. All safety glass shall be laminated.

B. Laminated Fire Glass shall be used in fire rated assemblies.

C. Wall Protection at Drinking Fountains and Lavatories

Provide vinyl wall covering behind Drinking Fountain Alcoves where wallboard or plaster finish occur and behind lavatories and end walls in examination rooms, treatment rooms, etc. at a minimum 50 inches wide (or terminating at the nearest inside corner). The vinyl wall covering shall go from base to ceiling.

1.1.3 WALLCOVERING PROTECTIVE (WP), RIGID PVC SHEET

Install rigid PVC sheet wall protection at locations indicated in Schedule E over primed GWB substrate. Provide impact-resistant GWB under wallcovering of 0.060-inch or greater thickness. Do not seam within 24 inches of internal or external corners. Install covering before installation of bases, cabinets, hardware, or items attached to or spaced slightly from wall surface. Do not install covering more than 1/4 inch below top of resilient base. Terminate top of wallcovering at handrail or 48" inches above finished floor.

1.1.4 STAIRWAYS

In stairways use Molded Rubber Treads on stairs and Resilient Tile (VCT) on floor landings and rubber tile on intermediate landings except for stairs exposed to the weather or those in strictly utilitarian areas such as shops, building service equipment rooms, etc.

1.2 DOORS**1.2.1 DOORS**


The Door Symbol column in Schedule E identifies the type, size and special features of doors for use in a room or space. The number and letters used for the Door Symbol have the

following meaning; the first number indicates door type and door material (odd nos. wood and even nos. steel), e.g., "1, 2, 4, etc.". The first letter (or letters) indicate door size e.g. "S, UU, V, etc." The letter after a dash (e.g., "-A") indicates a modification to a door. Use these symbols and designations at door openings on floor plan drawings.

For additional door requirements see Architectural Criteria in Sections 6 and 7 in Part I of the SFO.

Door Swing: Doors to Housekeeping Aids Closets (HAC) shall open out. HAC doors shall swing out 180° where possible.

1.2.2 DOOR TYPES

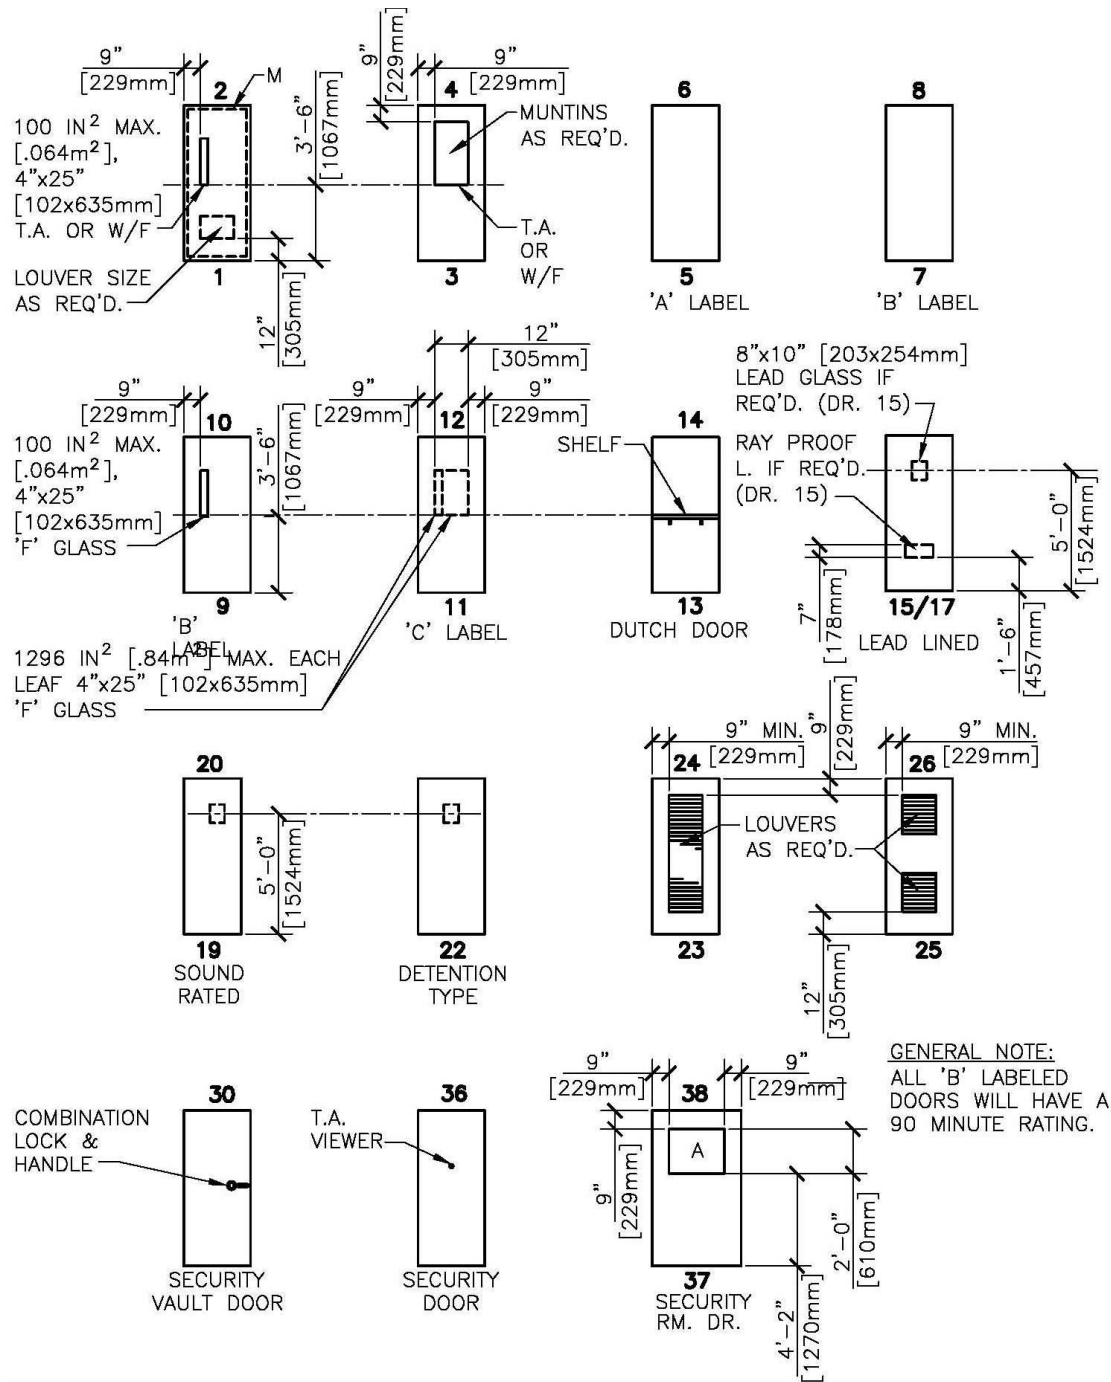


1.2.3 DOOR SIZES

DOOR SIZES									
MK	WIDTH		HEIGHT		MK	WIDTH		HEIGHT	
	IN	[mm]	IN	[mm]		IN	[mm]	IN	[mm]
A	1'-6"	[457]	6'-8"	[2032]	N	2'-0"	[610]	7'-0"	[2134]
B	2'-0"	[610]	6'-8"	[2032]	O	2'-2"	[660]	7'-0"	[2134]
C	2'-2"	[660]	6'-8"	[2032]	P	2'-4"	[711]	7'-0"	[2134]
D	2'-4"	[711]	6'-8"	[2032]	Q	2'-6"	[762]	7'-0"	[2134]
E	2'-6"	[762]	6'-8"	[2032]	R	2'-8"	[813]	7'-0"	[2134]
F	2'-8"	[813]	6'-8"	[2032]	S	3'-0"	[914]	7'-0"	[2134]
G	2'-10"	[864]	6'-8"	[2032]	T	3'-4"	[1016]	7'-0"	[2134]
H	3'-0"	[914]	6'-8"	[2032]	U	3'-6"	[1067]	7'-0"	[2134]
I	3'-2"	[965]	6'-8"	[2032]	V	3'-8"	[1118]	7'-0"	[2134]
J	3'-4"	[1016]	6'-8"	[2032]	W	3'-10"	[1168]	7'-0"	[2134]
K	3'-8"	[1118]	6'-8"	[2032]	X	4'-0"	[1219]	7'-0"	[2134]
L	3'-10"	[1168]	6'-8"	[2032]	Y	3'-0"	[914]	8'-0"	[2438]
M	1'-6"	[457]	7'-8"	[2337]	Z	UNASSIGNED			

DOOR MODIFICATIONS

A LAMINATED GLASS
D DOUBLE GLAZED
TEMPERED GLASS
H ELECTRIC HOLD
L LOUVER
LP LIGHT PROOF LOUVER
M MECH. SEAL FOR LIGHT
PROOF & SOUND
RETARDING DOOR
T TEMPERED GLASS
U UNDERCUT 1" [25mm]
V LEAD GLASS
F FIRE RATED GLAZING

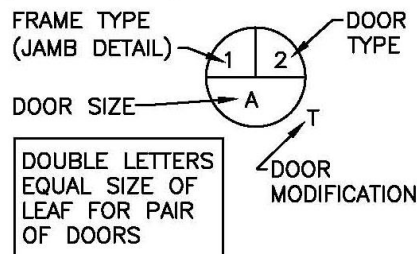DOOR SYMBOLLEGEND (SEE ELEVATIONS)

[] GLASS OR LOUVER
[] REQUIRED BY
MODIFICATION

[] GLASS OR LOUVER
REQUIRED BY
ELEVATION TYPE

NOTES:

1. ALL DOORS SHALL BE FLUSH – 1 3/4" [44mm] THICK UNLESS NOTED OTHERWISE.
2. TOP & SIDE RAILS SHALL BE 9" [229mm] MIN. BOTTOM RAILS SHALL BE 12" MIN. [305mm].
3. DOOR TYPES 7, 8, & 9 SHALL NOT BE USED FOR OPPOSING DOORS.
4. EVEN NUMBERS ARE METAL; ODD NUMBERS ARE WOOD.



Department of
Veterans Affairs


DETAIL TITLE / DOOR SCHEDULE

Part VI: Schedule E – Room Finish, Door & Hardware
Section 1 -- Page 8

Lessor _____ Gov't. _____

_____ of _____ Pages

1.2.4 LEAD LINED DOORS AND FRAMES

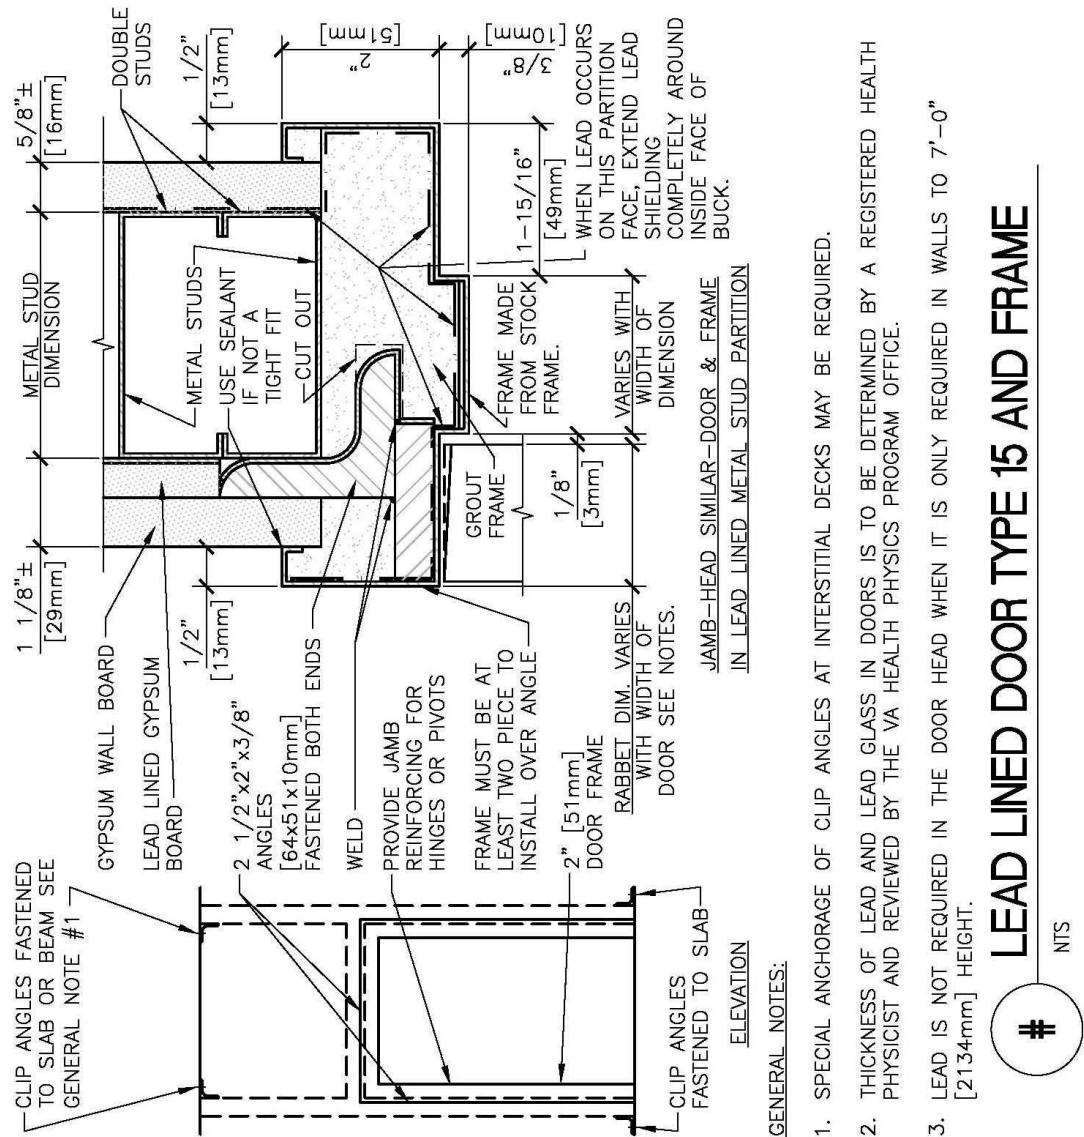

Department of Veterans Affairs

DETAIL TITLE / LEAD LINED DOOR
TYPE 15 AND FRAME

1.3 FINISH HARDWARE**1.3.1 GENERAL****A. Hardware Set Numbers on Schedule**

Except for protective plates, door stops, mutes, thresholds and the like specified herein, hardware requirements for each door are indicated in the Room Finish and Door Schedule by numbers that correspond to the following hardware sets listed in this SFO.

B. Manufacturers' Catalog Number References

Where manufacturers' products are specified herein, products of other manufacturers which are considered equivalent to those specified may be used. Manufacturers whose products are specified are identified by abbreviations as follows:

Adams-Rite	Adams Rite Mfg. Co.	Glendale, CA
Glynn Johnson	Glynn Johnson Co.	Chicago, IL
LCN	LCN Closers	Princeton, IL
Firemark	Rixon-Firemark Co.	Chicago, IL
Hager	Hager Hinge Company	Saint Louis, MO
Stanley	The Stanley Works	New Britain, CT
Trimco	Triangle Brass Mfg. Co.	Los Angeles, CA
Unican	Simplex Security Systems	Collinsville, CT
Von Duprin	Von Duprin Hardware Co.	Indianapolis, IN
Zero	Zero Weather Stripping Co.	New York, NY

C. Keying

All cylinders shall be keyed into Grand Master Key System. Provide removable core cylinders that are removable only with a special key or tool without disassembly of knob or lockset. Cylinders shall be 7 pin type. Keying information shall be furnished at a later date by the Resident Engineer.

1.3.2 BUTT HINGES**A. ANSI A156.1.**

The following types of butt hinges shall be used for the types of doors listed, except where otherwise specified:

(1) Exterior Doors

Type A2112 for doors 900 mm (3 feet) wide or less and Type A2111 for doors over 900 mm (3 feet) wide. Hinges for exterior doors shall have non-removable pins.

(2) Interior Doors

Type 8112 for doors 900 mm (3 feet) wide or less and Type A8111 for doors over 900 mm (3 feet) wide.

(3) Automatic doors hung on butts

Type A2111 for exterior doors and aluminum doors, and Type A8111 for other doors.

(4) *Labeled Wood Fire Doors*

Type 8411 or Type 8412; these hinges shall be thru bolted to door with hex nuts and bolts.

1.3.3 CONTINUOUS HINGES – Required as Necessary

A. ANSI/BHMA A156.26

Grade 1-600.

(1) *Listed under Category N in BHMA's "Certified Product Directory."*

B. General

Minimum 0.120-inch- (3.0-mm-) thick, hinge leaves with minimum overall width of 4 inches (102 mm); fabricated to full height of door and frame and to template screw locations; with components finished after milling and drilling are complete:

(1) *Fire Pins*

Steel pins to hold labeled fire doors in place if required by tested listing.

C. Continuous, Barrel-Type Hinges

Hinge with knuckles formed around a pin that extends entire length of hinge.

(1) *Base Metal for Exterior Hinges*

Stainless steel.

(2) *Base Metal for Interior Hinges*

Stainless steel

(3) *Base Metal for Hinges for Fire-Rated Assemblies*

Stainless steel

(4) *Manufacturers*

Hager Companies.

Markar Architectural Products, Inc.; a Subsidiary of Adams Rite Manufacturing Co.

McKinney Products Company; an ASSA ABLOY Group company.

Stanley Commercial Hardware; Division. of the Stanley Works and Zero International.

D. Continuous, Gear-Type Hinges

Extruded-aluminum, pinless, geared hinge leaves; joined by a continuous extruded-aluminum channel cap; with concealed, self-lubricating thrust bearings.

(1) *Manufacturers*

Bommer Industries, Inc.

Hager Companies.

McKinney Products Company; an ASSA ABLOY Group company.

Pemko Manufacturing Co.

Select Products Limited.

Zero International.

1.3.4 DOOR CLOSING DEVICES

Closing devices shall be products of one manufacturer for each type required. Closing devices must also be in compliance with current NFPA 101 and ADA Accessibility Guidelines.

The closer shall have 50 percent adjustable closing force over minimum value for that closer and have adjustable hydraulic back check effective between 60 degrees and 85 degrees of door opening.

Where specified, closer shall have hold-open feature.

Size Requirements: Size closers in accordance with manufacturer's recommendations or provide multi-size closers, sizes 1 through 6.

1.3.5 DOOR STOPS

A. Conform to ANSI A156.16.

B. Provide door stops wherever an opened door or any item of hardware thereon would strike a wall, column, equipment or other parts of building construction. For concrete, masonry or quarry tile construction, use lead expansion shields for mounting door stops.

C. Substitute floor stops Type L02141 or L02161 as appropriate, when wall bumpers would not provide an effective door stop.

D. Where drywall partitions occur, use floor stops, Type L02141 or L02161.

E. Provide stop Type L02011 or L02181, as applicable for exterior doors.

F. Omit stops where floor mounted door holders are required and where automatic operated doors occur.

G. Provide appropriate roller bumper for each set of doors (except where closet doors occur) where two doors would interfere with each other in swinging.

H. Provide appropriate door mounted stop on doors in individual toilets where floor or wall mounted stops cannot be used.

I. Provide overhead surface applied stop Type C02541, ANSI A156.8 on patient toilet doors in bedrooms where toilet door could come in contact with the bedroom door.

J. Provide door stops on doors where combination closer magnetic holders are specified.

1.3.6 LOCKS AND LATCHES

A. Conform to ANSI A156.2. Locks and latches for doors 45 mm (1-3/4 inch) thick or over shall have beveled fronts. Lock cylinders shall have not less than seven pins. Cylinders for all locksets shall be removable core type. Cylinders shall be furnished with construction removable cores and construction master keys. Cylinder shall be removable by special key or

tool. Construct all cores so that they will be interchangeable into the core housings of all mortise locks, rim locks, and any other type lock included in the Great Grand Master Key System. Disassembly of lever or lockset shall not be required to remove core from lockset. All locksets or latches on double doors with fire label shall have latch bolt with 19 mm (3/4 inch) throw. Provide temporary keying device or construction core of allow opening and closing during construction and prior to the installation of final cores.

B. In addition to above requirements, locks and latches shall comply with following requirements:

1. Mortise Lock and Latch Sets: Conform to ANSI/BHMA A156.13. Mortise locksets shall be series 1000, minimum Grade 1. All locksets and latchsets shall have lever handles similar to BEST 3S lever Design. Lever handle shall be fabricated from wrought stainless steel. No substitute lever design or material shall be accepted. All locks and latchsets shall be furnished with curved lip strike and wrought box. Furnish armored fronts for all mortise locks.

2. Auxiliary locks shall be as specified under hardware sets and conform to ANSI A156.5.

1.3.7 ELECTROMAGNETIC LOCKS

A. ANSI/BHMA A156.23

Electrically powered, of strength and configuration indicated; with electromagnet attached to frame and armature plate attached to door. Listed under Category E in BHMA's "Certified Product Directory."

(1) *Type*

Full exterior or full interior, as required by application indicated.

(2) *Strength Ranking*

1000 lbf (4448 N)

(3) *Inductive Kickback Peak Voltage*

Not more than 0 V.

(4) *Residual Magnetism*

Not more than 0 lbf (0 N) to separate door from magnet.

B. Delayed-Egress Locks

BHMA A156.24. Listed under Category G in BHMA's "Certified Product Directory".

(1) *Means of Egress Doors*

Lock releases within 15 seconds after applying a force not more than 15 lbf (67 N) for not more than 3 seconds, as required by current NFPA 101.

(2) *Security Grade*

Activated from secure side of door by initiating device.

(3) *Movement Grade*

Activated by door movement as initiating device.

C. Manufacturers

Door Controls International.

Doorguard Systems, Inc.

Dortronics Systems, Inc.

DynaLock Corp.

Locknetics; an Ingersoll-Rand Company.

Rutherford Controls Int'l. Corp.

SARGENT Manufacturing Company; an ASSA ABLOY Group company.

Securitron Magnalock Corporation; an ASSA ABLOY Group company.

Security Door Controls.

1.3.8 CARD READERS

Provide and install card readers where indicated. Integrate card readers with other specified systems and systems that are in place.

1.3.9 ELECTRIC STRIKES

A. ANSI/ BHMA A156.31 Grade 1.

B. General: Use fail-secure electric strikes with fire-rated devices.

C. Manufacturers:

1. Adams Rite Manufacturing Co.

2. Folger Adam Security Inc.; an ASSA ABLOY Group company.

3. HES, Inc.; an ASSA ABLOY Group company.

4. Locknetics; an Ingersoll-Rand Company.

5. Precision Hardware, Inc.

6. Von Duprin; an Ingersoll-Rand Company.

1.3.10 KEYS

A. Stamp all keys with change number and key set symbol. Furnish keys in quantities as follows:

Locks/Keys	Quantity
Cylinder locks	2 keys each
Cylinder lock change key blanks	100 each different key way
Master-keyed sets	6 keys each
Grand Master sets	6 keys each

Control key	1 key
-------------	-------

1.3.11 ARMOR PLATES, COMBINATION KICK-MOP PLATES AND DOOR EDGING

- A. Conform to ANSI Standard A156.6.
- B. Provide protective plates and door edging as specified below:
 1. Kick-mop plates and armor plates plastic or metal, Type J100 series, color as required.
 2. Provide kick-mop plates for both sides of each door, except where noted as not required. Kick-mop plates shall be 125 mm (5 inches) high. On push side of doors where jamb stop extends to floor, make combination kick-mop plates 38 mm (1-1/2 inches) less than width of door, except pairs of metal doors which shall have plates 25 mm (1 inch) less than width of each door. Extend all other combination kick-mop plates to within 6 mm (1/4 inch) of each edge of doors. Kick mop plates shall butt astragals. For jamb stop requirements, see specification sections pertaining to door frames.
 3. Kick-mop plates are not required on following door sides:
 - a) Armor plate side of doors;
 - b) Both Sides of Sliding Exam Room Doors
 - c) Exterior side of exterior doors;
 - d) Closet side of closet doors;
 - e) Storage side of doors to or from storage spaces; and
 - f) Both sides of aluminum entrance doors.
 4. Armor plates for doors are listed under "Hardware Sets". Armor plates shall be 875 mm (35 inches) high and 38 mm (1-1/2 inches) less than width of doors, except on pairs of metal doors. Plates on pairs of metal doors shall be 25 mm (1 inch) less than width of each door. Where top of intermediate rail of door is less than 875 mm (35 inches) from door bottom, extend armor plates to within 13 mm (1/2 inch) of top rail. On doors equipped with panic devices, extend armor plates to within 13 mm (1/2 inch) of panic bolt cross bar.
 5. Where louver or grille occurs in lower portion of doors, substitute stretcher plate and kick-mop plate in place of armor plate. Size of stretcher plate and kick-mop plate shall be 125 mm (5 inches) high.

1.3.12 EXIT DEVICES

- A. Conform to ANSI Standard A156.3. Exit devices shall be Grade 1; type and function are specified in hardware sets. Provide rim or LBR vertical rod exit devices in interior of building. Trim shall have lever handles similar to locksets, unless otherwise specified.
- B. Exit devices for fire doors shall comply with current NFPA 80 standards and Underwriters Laboratories, Inc., requirements for Fire Exit Hardware. Submit proof of compliance.

1.3.13 WEATHERSTRIPS (FOR EXTERIOR DOORS)

Conform to ANSI A156.22. Air leakage shall not to exceed 0.50 CFM per foot of crack length (0.000774m³/s/m).

1.3.14 MISCELLANEOUS HARDWARE

A. Cylinders for Various Partitions and Doors: Key cylinders same as entrance doors of area in which partitions and door occur. Provide cylinders to operate locking devices where specified for following partitions and doors:

1. Folding doors and partitions.
2. Slide-up doors.

D. Mutes: Conform to ANSI A156.16. Provide door mutes or door silencers Type L03011, of white or light gray color, on each steel door frame, except lead-lined frames and frames for sound-resistant, lightproof and electromagnetically shielded doors. Furnish 3 mutes for single doors and 2 mutes for each pair of doors, except double-acting doors. Provide 4 mutes or silencers for frames for each Dutch type door. Provide 2 mutes for each edge of sliding door which would contact door frame.

1.3.15 PADLOCKS FOR VARIOUS DOORS, GATES AND HATCHES

A. ASTM E883, size 50 mm (2 inch) wide chain; furnish extended shackles as required by job conditions. Provide padlocks, with key cylinders, for each door in following areas as noted.

B. Key padlocks as follows:

1. Chain Link Fence Gates for Electrical Substation and other Fenced Buildings or Areas: Engineer's set, except as otherwise specified.
2. Roof Access and Scuttles: Engineer's set.

1.3.16 HARDWARE SETS

Following sets of hardware correspond to hardware numbers shown in Room Finish and Door Schedule. Where hardware set for a single door is specified for a pair of doors; equip each leaf of such pair of doors with set noted. Only those hardware sets that are referenced in the Schedule will be required. Disregard breaks in hardware set numbering sequence. **Disregard hardware sets listed below but not shown in Schedule.**

HARDWARE SETS

HARDWARE SETS	
<u>HW 1</u> 3 Butt Hinges 1 Door pull plate 1 Push plate 1 Wall stop 1 Kick plate 1 Closer C02011	<u>HW 2</u> 3 Butt Hinges 1 Door pull plate 1 Push plate 1 Wall stop 1 Kick plate 2 activation switches 1 Door operator
<u>HW 3</u> 4 Butt Hinges 1 Mortise lock F04 1 Flush bolt 1 Wall stop 2 Kick plates	<u>HW 5</u> 3 Butt Hinges 1 Mortise lock F07 1 Magnetic lock 1 Door position switch 2 Card readers 1 Power supply 1 Wall stop 1 Kick plate 1 Closer C02011
<u>HW 7</u> 3 Butt Hinges (non-removable pin) 1 EPT (wire transfer) 1 Electric panic device with trim (Function 03) 1 Magnetic lock 1 Door position switch 2 Card readers 1 Power supply 1 Wall stop 1 Kick plate 1 Closer C02021	<u>HW 8</u> 3 Butt Hinges (non-removable pin) 1 EPT (wire transfer) 1 Electric panic device (Delay Egress Function 01) 1 Door position switch 1 Power supply 1 Wall stop 1 Kick plate 1 Closer C02021

HARDWARE SETS	
<u>HW 9</u> 3 Butt Hinges (non-removable pin) 1 Mortise lock F07 1 Card reader 1 Door position switch 1 Electric Strike 1 Power supply 1 Wall stop 1 Kick plate 1 Closer C02011	<u>HW 11</u> 3 Butt Hinges (non-removable pin) 1 deadbolt 2 Flush bolts 2 Card readers 1 Magnetic lock 1 Door position switch 1 Power supply 1 Wall stop 1 Kick plate 2 activation switches 1 Door operator
<u>HW 13</u> 3 Butt Hinges 1 Mortise lock F07 1 Wall stop 1 Kick plate 1 Closer C02011	<u>HW 15</u> 3 Butt Hinges (non-removable pin) 1 Mortise lock F07 1 Card reader 1 Electric Strike 1 Power supply 1 Door position switch 1 Wall stop 1 Kick plate 1 Door operator 1 activation switch
<u>HW 18</u> 3 Butt Hinges 1 Mortise lock F19 1 Wall stop 2 Kick plates	<u>HW 23</u> 3 Butt Hinges 1 Mortise lock F04 1 Wall stop 2 Kick plates
<u>HW 25</u> 3 Butt Hinges 1 Mortise lock F04 1 Card reader 1 Door position switch 1 Electric Strike 1 Power supply 1 Wall stop 2 Kick plates	<u>HW 42</u> 3 Butt Hinges 1 Mortise lock F04 1 Wall stop 1 Kick plate 1 Closer C02011

HARDWARE SETS	
<u>HW 106</u> 1 Offset pivot set C17111 1 Intermediate pivot C17311 1 Mortise lock F07 1 Card reader 1 Door position switch 1 Electric Strike 1 Power supply 1 Armor plate 1 Kick plate 1 Holder C22511 1 Closer C02011	<u>HW 99</u> Complete sliding door hardware to be provided by door manufacturer, including sound seals, standard pulls, and thumb turn lock.