


BUILDING 3 FOURTH FLOOR
BUSINESS OCCUPANCY

A

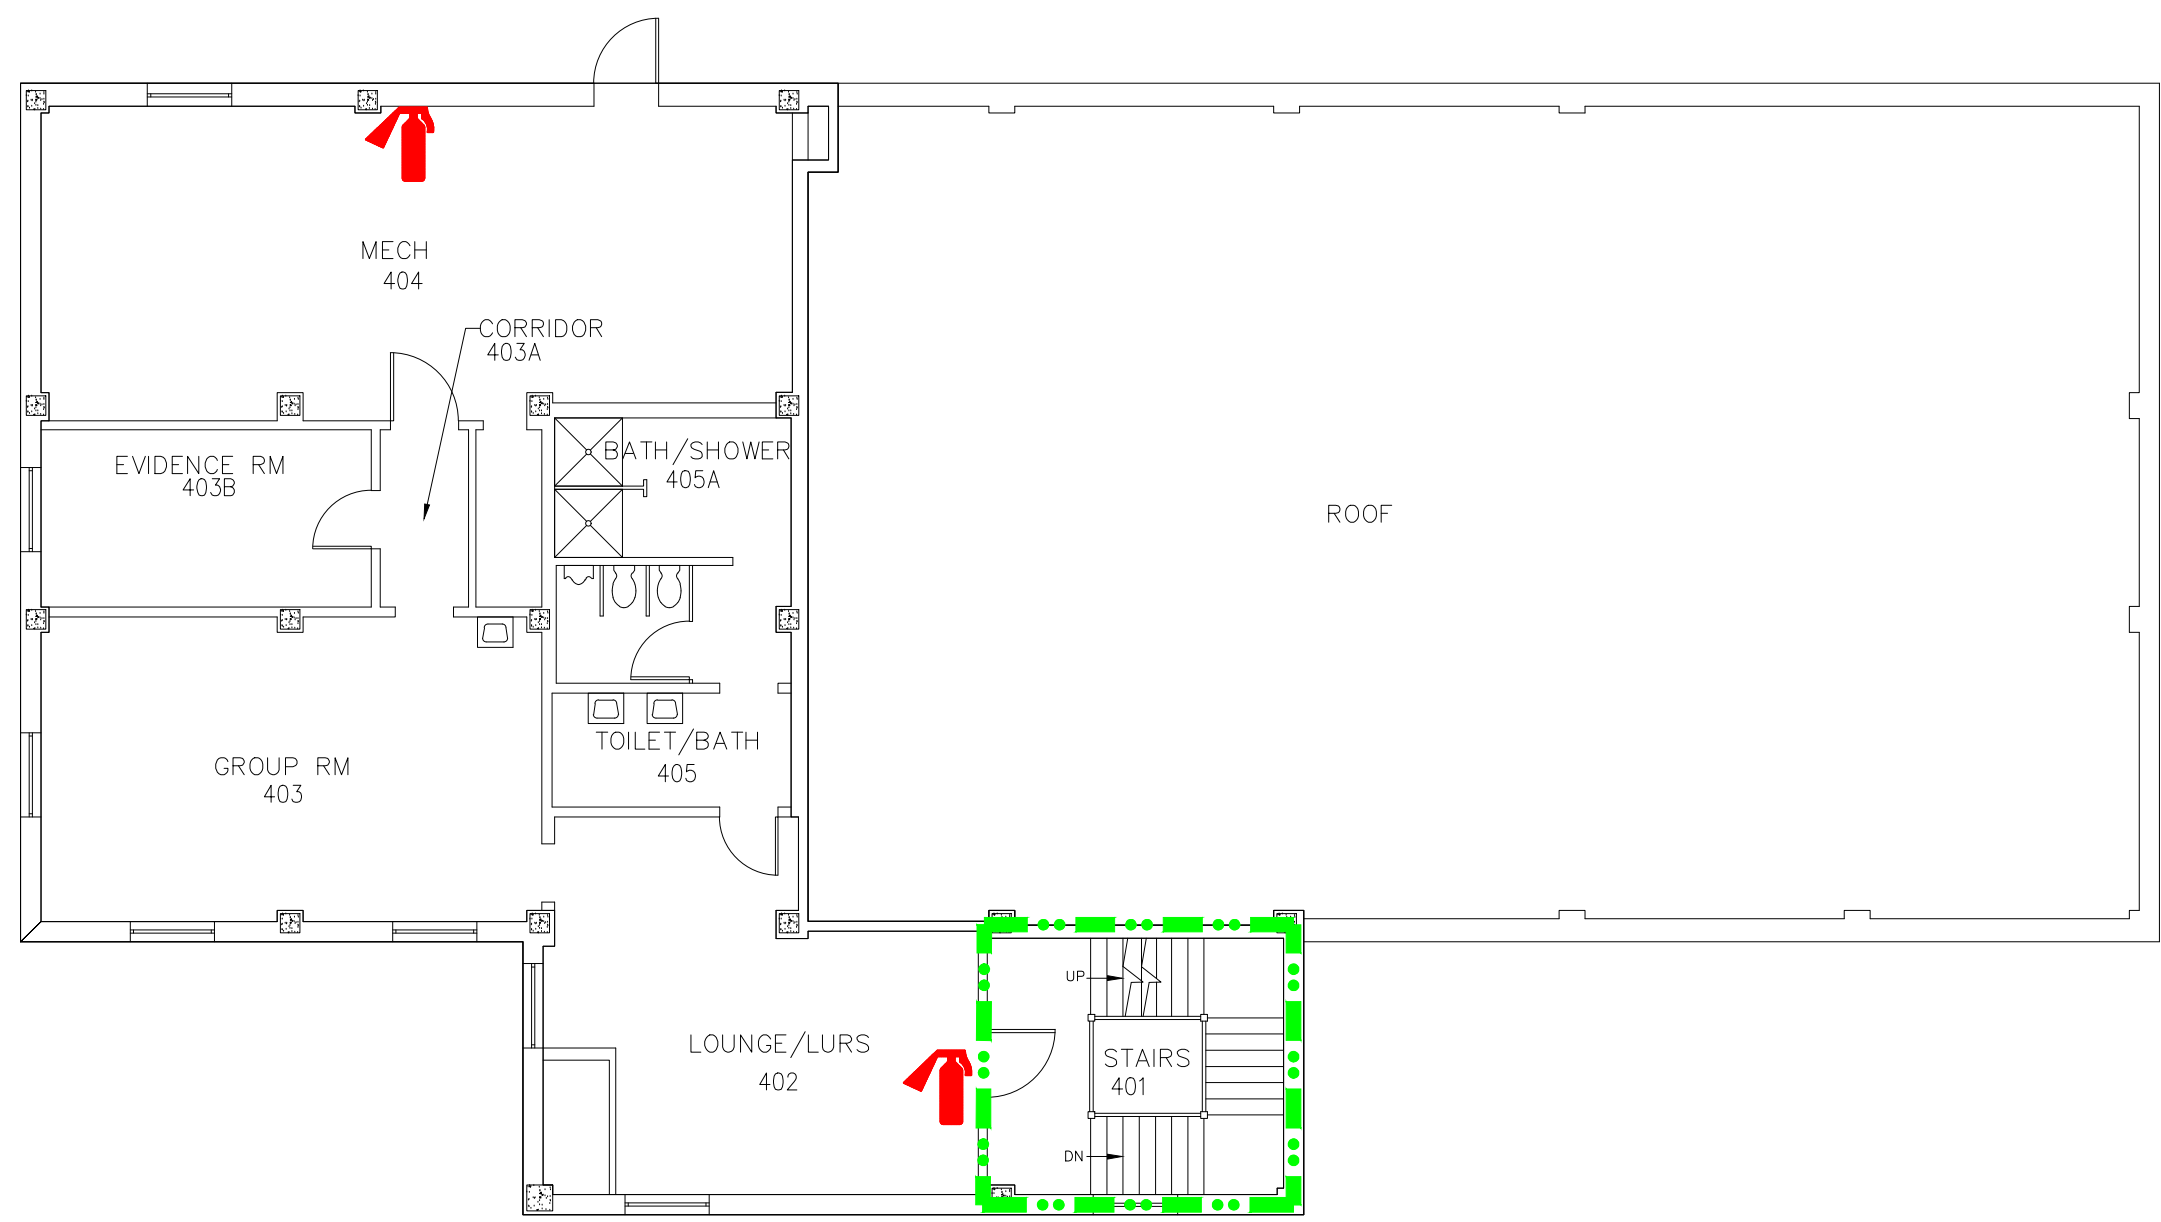


KEY NOTES:


- A MAXIMUM 10 OCCUPANTS WITH SINGLE EXIT.
- B FIRE RETARDANT TREATED WOOD PANELING.
- C STEAM UTILITY INSTALLATION WAS PRIOR TO THE CURRENT REQUIREMENTS NOW FOUND IN SECTION 7.1.3.2.1(9) OF NFPA 101-2009 EDITION AND FIRST ADOPTED IN 1985 EDITION.

SYMBOLS LIST


- 3 HOUR FIREWALL
- 2 HOUR FIREWALL
- 1 HOUR FIREWALL
- 2 HOUR FIRE/SMOKEWALL
- 1 HOUR FIRE/SMOKEWALL
- 30 MINUTE SMOKE BARRIER
- SMOKE RESISTIVE HAZARDOUS AREA
- NON RATED SMOKE PARTITION
- NON-RATED SMOKE BARRIER (COMMUNICATING SPACE)
- NON-FIRE-RATED PARTITION
- HE HORIZONTAL EXIT PASSAGEWAY
- EX EXIT
- EP EXIT PASSAGEWAY
- LC LINEN CHUTE
- SUITE DESIGNATIONS
- AREA OPEN TO CORRIDOR - WITH SMOKE DETECTION
- AREA OPEN TO CORRIDOR - NO SMOKE DETECTION REQUIRED
- EXIT STAIR OR PASSAGEWAY
- SPRINKLER/FIRE ALARM ZONE
- F MANUAL PULL STATION
- FIRE EXTINGUISHER

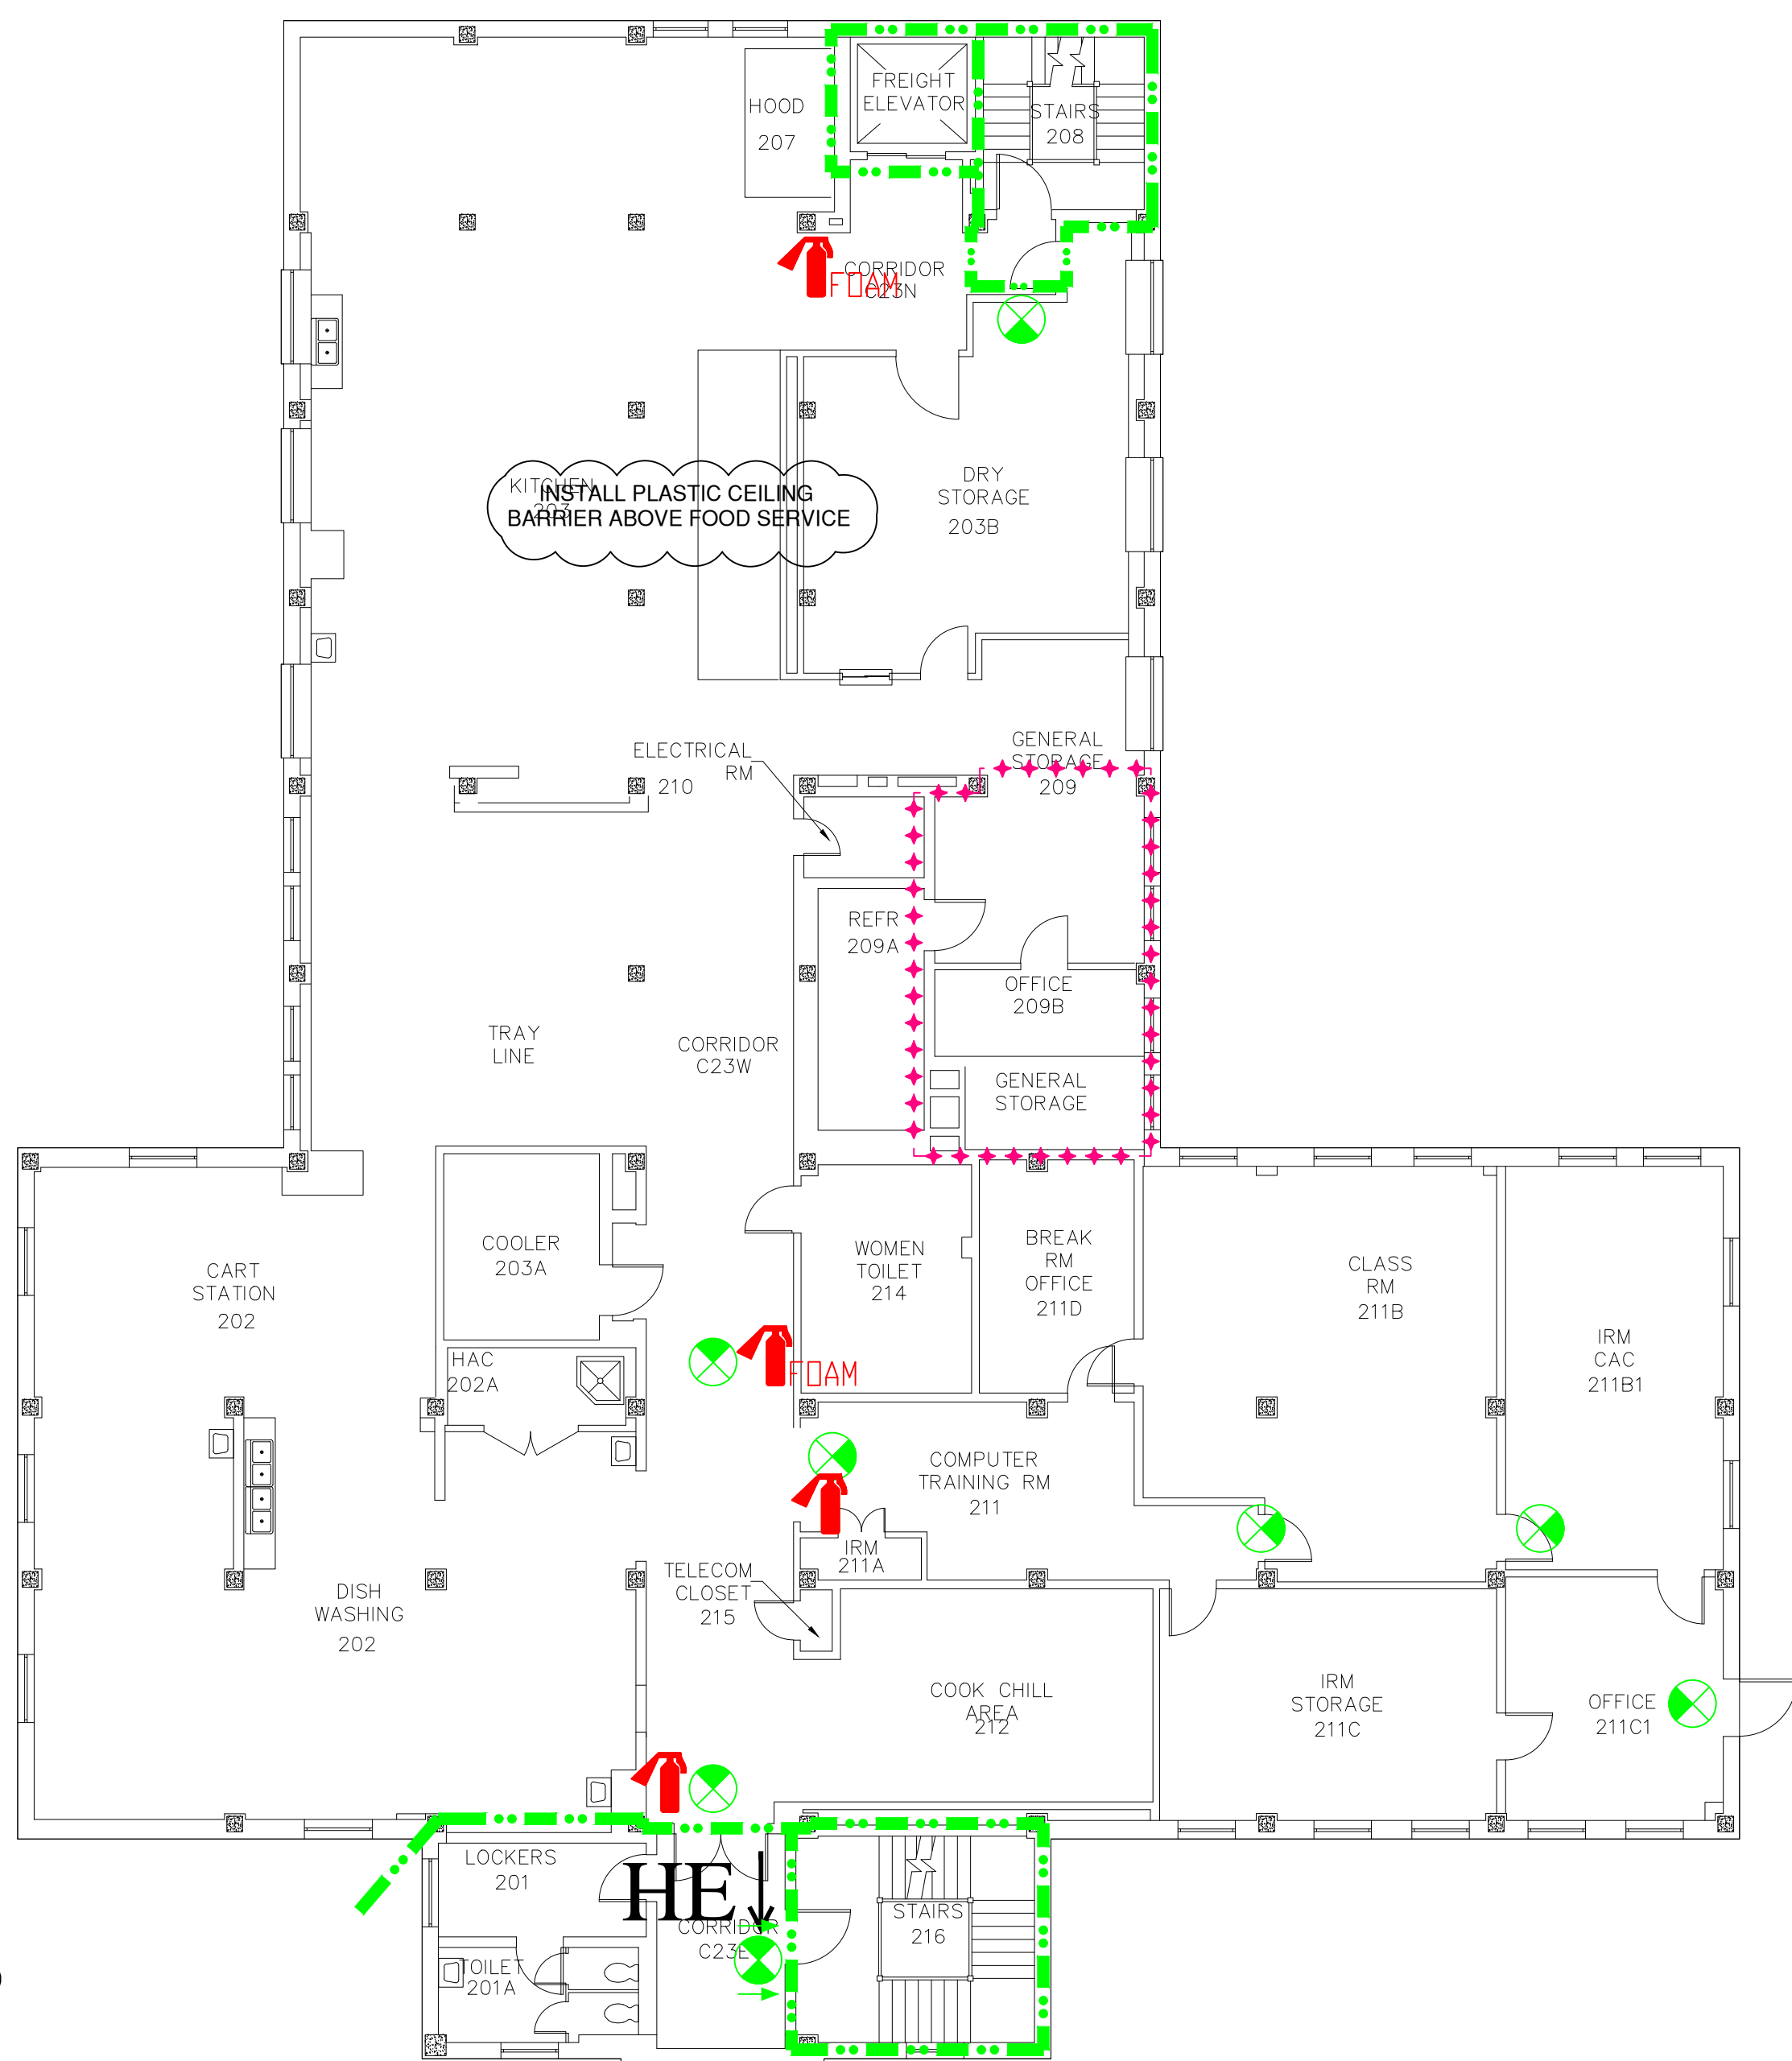



BUILDING 3 SECOND FLOOR
BUSINESS OCCUPANCY

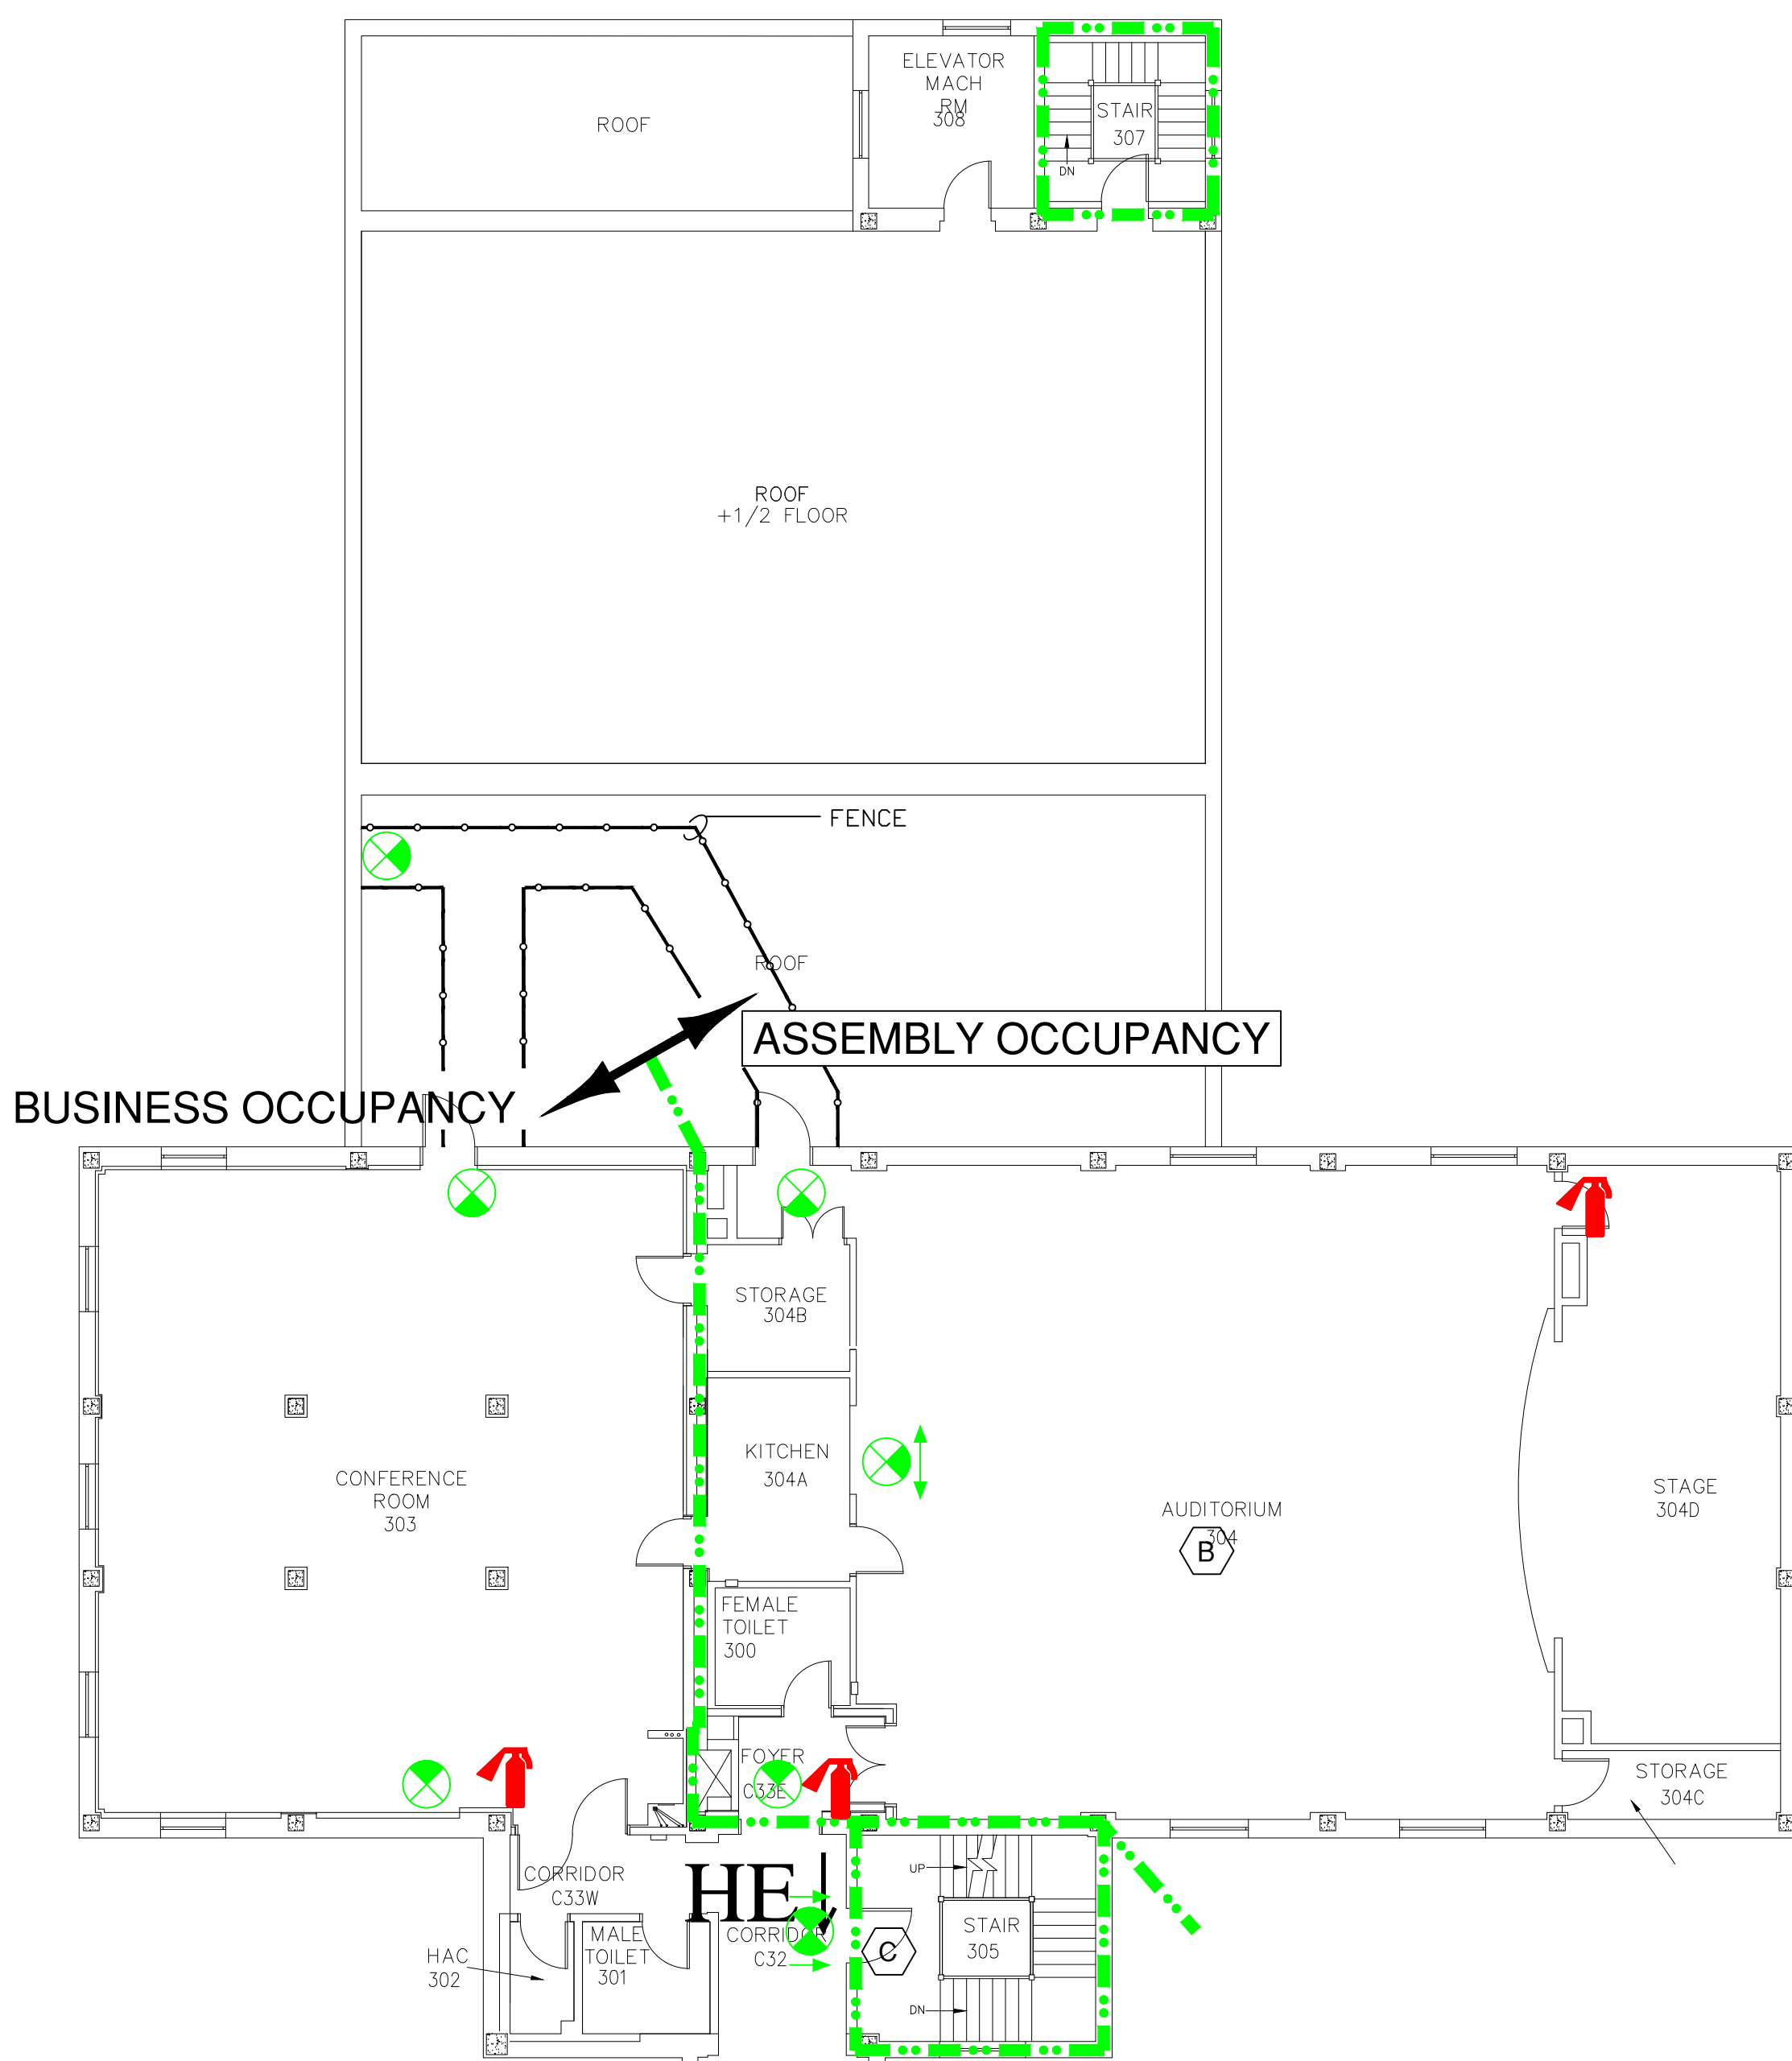

BUILDING 3 THIRD FLOOR

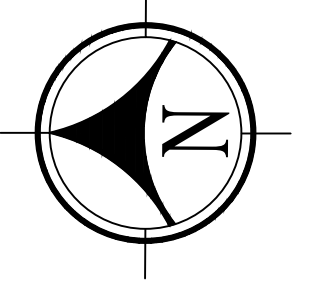

PARTIALLY SPRINKLERED
MIXED OCCUPANCY

Revisions		Date	 <div>Dept. of Veterans Affairs Health Care Center 2300 Ramsey St. Fayetteville, NC 28301</div>	 <div>FIRE PROTECTION & CODE CONSULTANTS, LLC 1520 MAIN STREET INDIANAPOLIS, IN 46224 (317)486-5188</div>	Drawing Title BUILDING 3 SECOND, THIRD & FOURTH FLOORS	Client Project No.	Contract No.	Project Title STATEMENT OF CONDITIONS	Designed By FVO	Checked By FVO	Drawn By DN	Date 12/27/16	Drawing No. SOC-2 Sht. 3 Of 3
FP&C Proj.#:		1694.14				Building No. MAIN	AutoCAD File Name SOC02 3-2, 3, 4		Location VA HEALTH CARE CENTER FAYETTEVILLE, NORTH CAROLINA	Scale: NO SCALE			