


TYPICAL ANTIFREEZE LOOP

NOTE: SEE SHEET FP4B FOR GENERAL NOTES AND DETAILS.

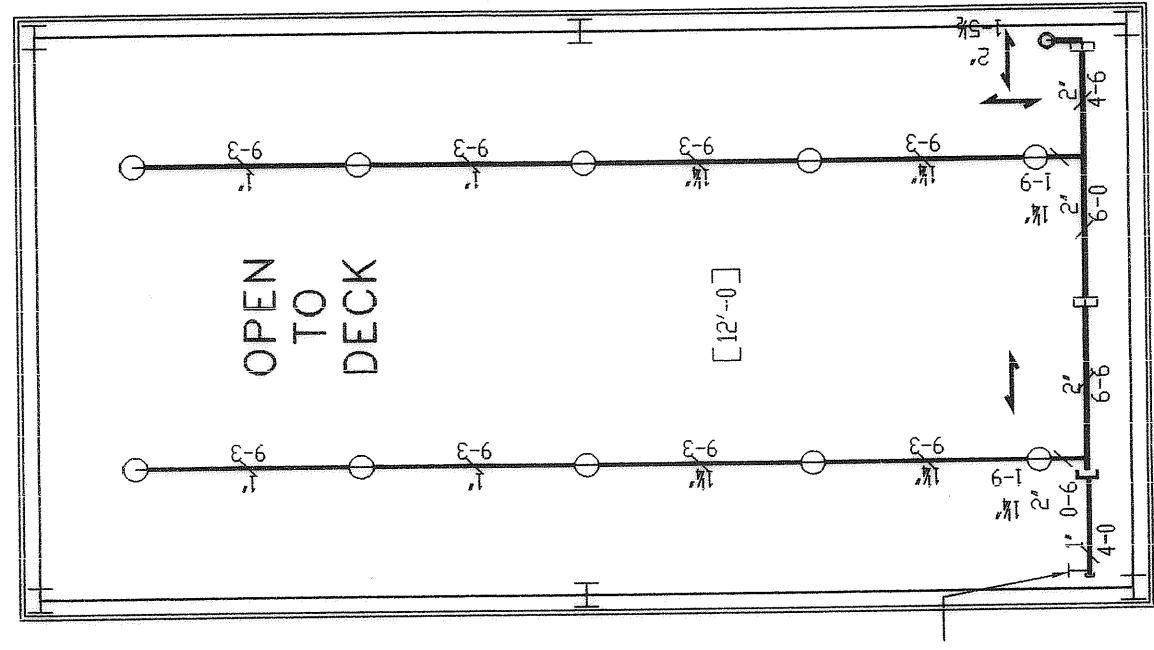


PENTHOUSE PLAN
(ABOVE 1st FLOOR)

4

—

SCALE: 1/8" = 1'-0"

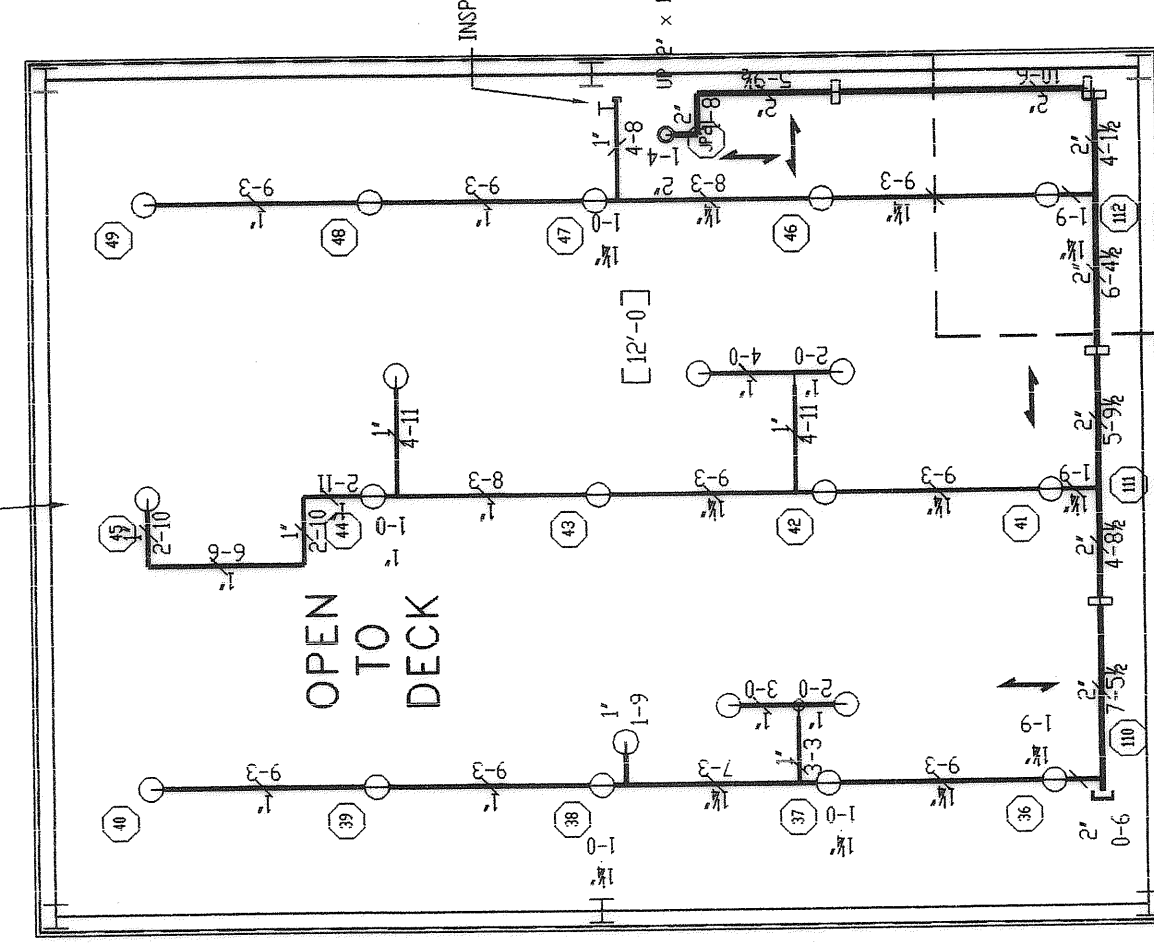


3
—

PENTHOUSE PLAN
(ABOVE 1st FLOOR)

SCALE: 1/8" = 1'-0"


NEW FIRE SPRINKLER SYSTEM BUILDING 801 - FIRST FLOOR ZONES 1B1 AND 1B2

SCALE: 1/8" = 1'-0"

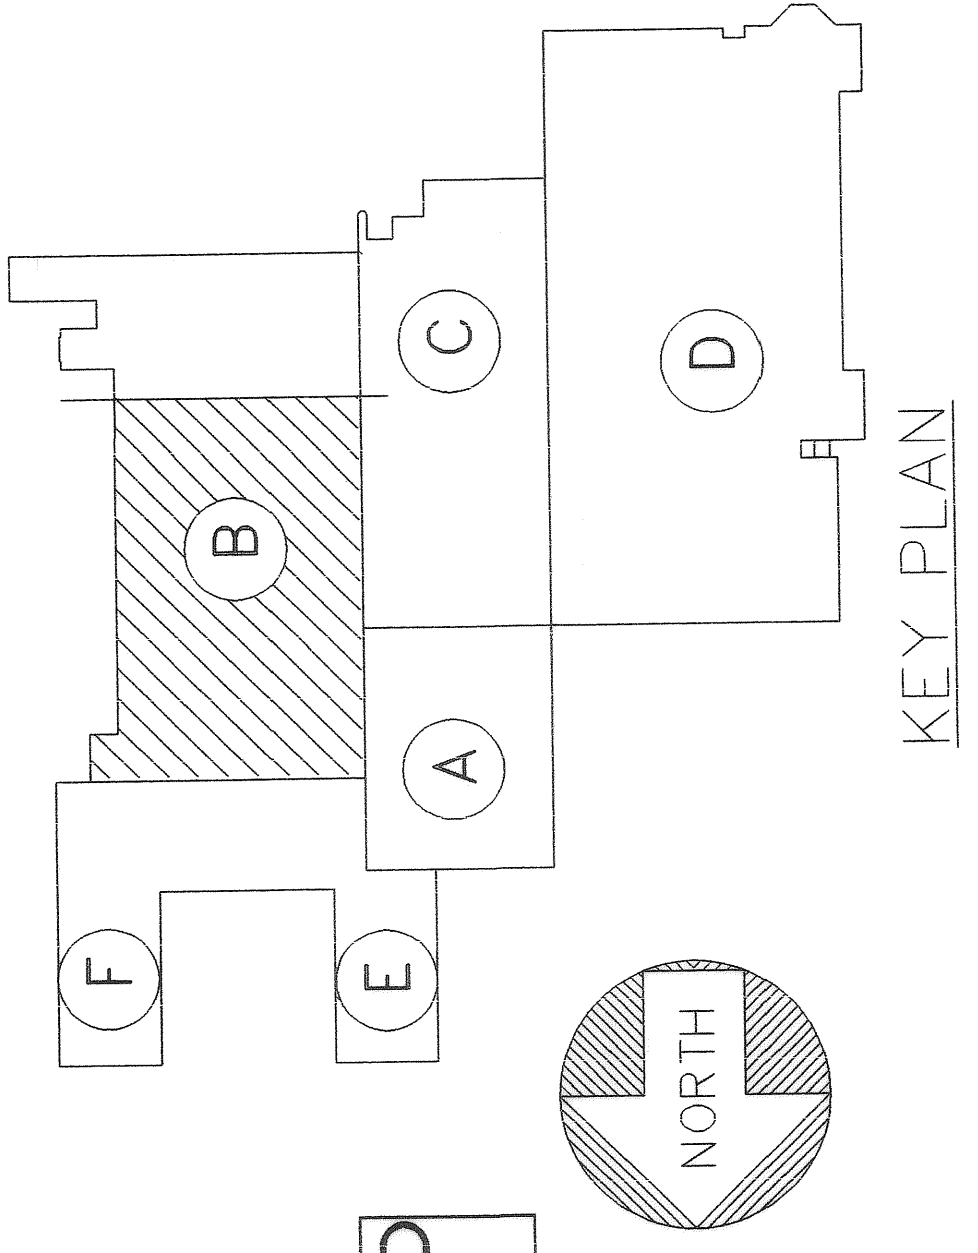

REFER TO SPRINKLER LEGEND
FOR SPRINKLER TYPE.

JOHN COLEMAN NICET LEVEL III #083893

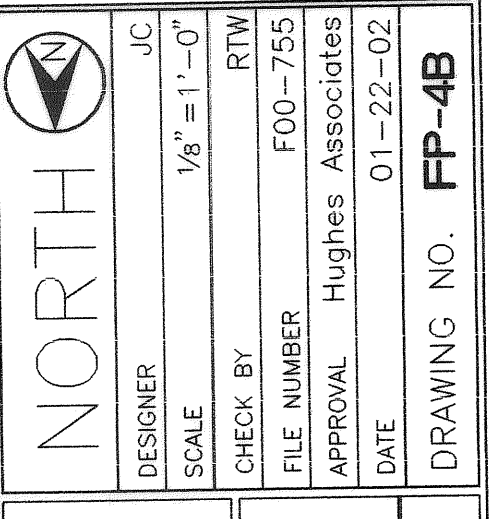


FIRE PROTECTION, INC.

Sunbelt

Dept. of Veterans Affairs Medical Center
Downtown Division, Building 801 (1st Flr-Zone 1B)

800 Bailie Drive Augusta, Georgia 30904-6285

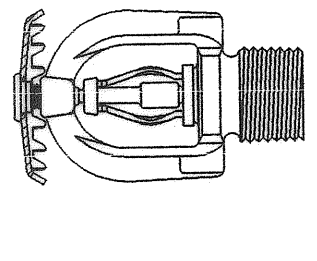

SPRINKLER SCHEDULE & LEGEND						
SYMBOL	SPRINKLER DESCRIPTION	TEMP.	TI	FINISH	QUANTITY	
○	IRVING MODEL M-GR PENDENT	1/2"	5.5	15S	CHR 295	
○	IRVING MODEL M-GR UPRIGHT	1/2"	5.5	200	BR 250	
○	IRVING M-MATIC UPRIGHT	1/2"	5.5	200	BR 1	
○	IRVING M-MATIC PENDENT	1/2"	5.5	200	BR 3	
○	IRVING MODEL M SSU	1/2"	5.5	200	BR 3	
○	IRVING MODEL M-GR FSW	1/2"	5.5	200	CHR 4	
○	IRVING MODEL M-GR FSW	1/2"	5.5	200	CHR 4	
1,2 READ CABT & WRENCHIES PROVIDED						TOTAL COUNT THIS SHEET = 373
FRANCOIS DAVID SHERMAN						

IMPORTANT
TO PREVENT FREEZING OF WATER IN WET PIPE SPRINKLER PIPING, OWNERS TO PROVIDE SUFFICIENT HEAT THROUGHOUT AREAS WHERE SPRINKLER PIPES ARE INSTALLED, UNLESS AN ANTI-FREEZE SYSTEM.

[illegible]