




NOTES:  
 1. AS AN ALTERNATE TO HLT CP 777 SPEED PLUS, MINERAL WOOL (MIN. 4 PCF DENSITY) COMPRESSED 20% MAY BE USED.  
 2. MINIMUM CURT THICKNESS TO MAINTAIN 1 1/2\"/>

14 2-HOUR FIRESTOPPING ASSEMBLY  
 SCALE: 3" = 1'-0"

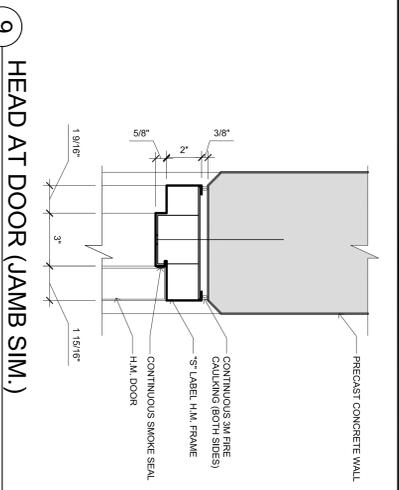



9 HEAD AT DOOR (JAMB SIM.)  
 SCALE: 3" = 1'-0"

10 DOOR SILL  
 SCALE: 3" = 1'-0"

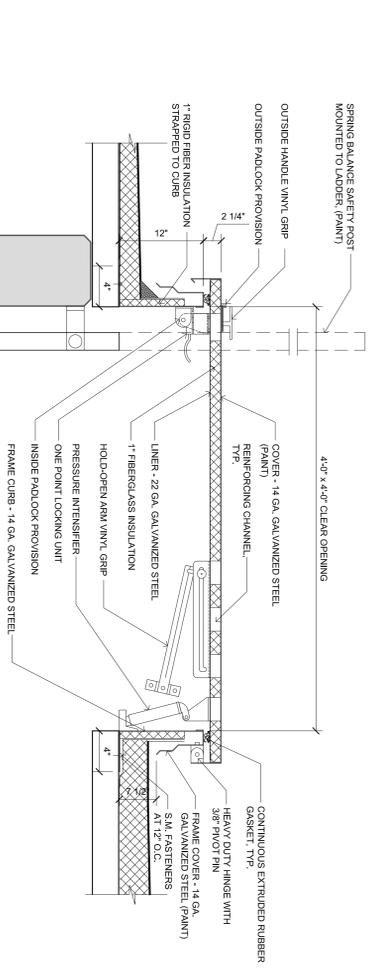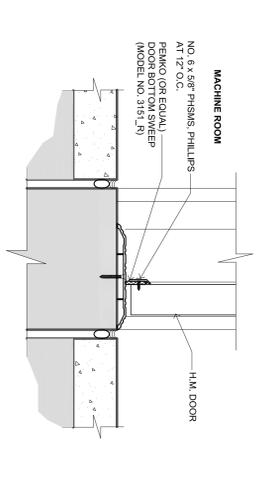



16 ROOF HATCH AND LADDER  
 SCALE: 1 1/2" = 1'-0"

MACHINE ROOM

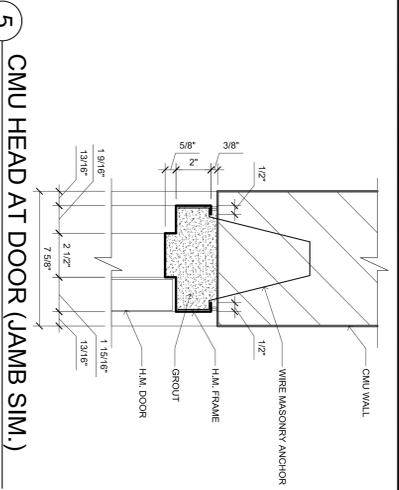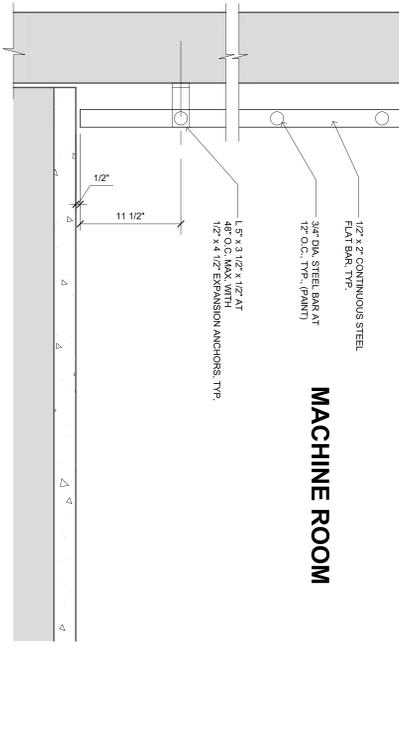



5 CMU HEAD AT DOOR (JAMB SIM.)  
 SCALE: 3" = 1'-0"

6 COILING DOOR GUIDES  
 SCALE: 3" = 1'-0"

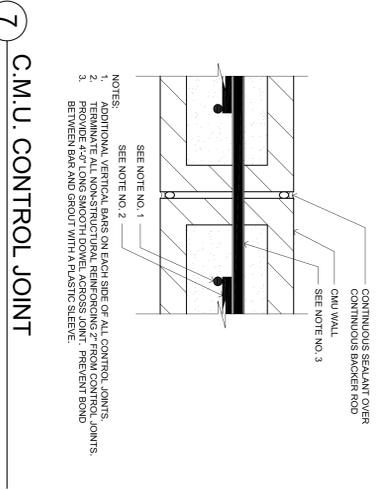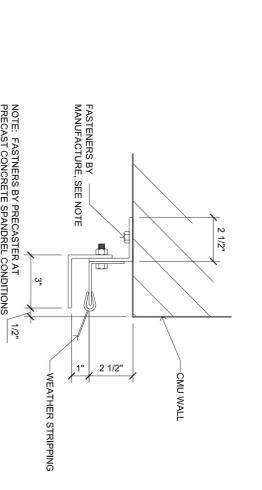


7 C.M.U. CONTROL JOINT  
 SCALE: 3" = 1'-0"

2 COILING DOOR HOOD  
 SCALE: 3" = 1'-0"

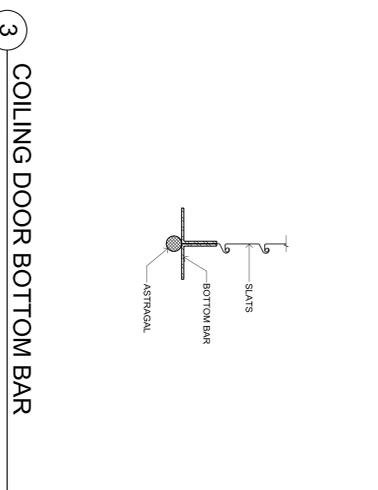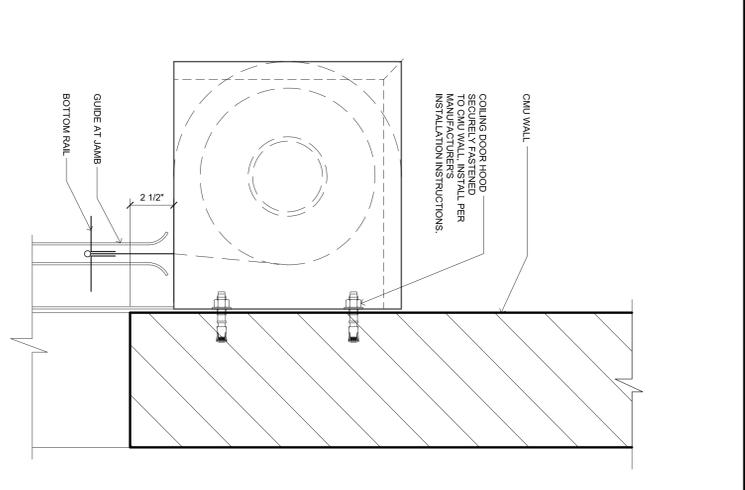

3 COILING DOOR BOTTOM BAR  
 SCALE: 3" = 1'-0"

8 COILING DOOR ELEVATION AND SECTION  
 NOT TO SCALE

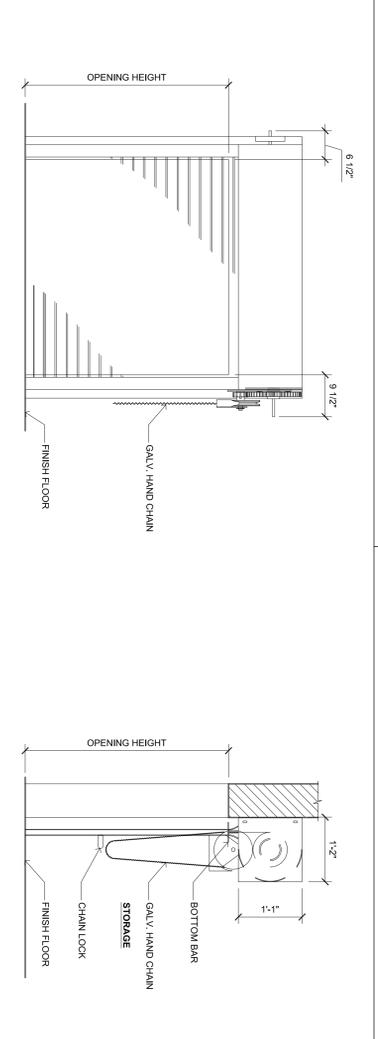

CONSTRUCTION DOCUMENTS - FINAL SUBMISSION

<b>CONSULTANTS:</b> Revisions: _____ Date _____			
<b>ARCHITECT/ENGINEERS:</b> 			
Project Title: VA Northern California Health Care System Building Number: 612-C8-102 Drawing Number: AS 414 Date: 06/16/2011 Checked: ECF Drawn: RAT		Location: 10353 Hospital Way, Mather, CA 95655 Project Number: 612-C8-102 Drawing Number: AS 414 Date: 06/16/2011 Checked: ECF Drawn: RAT	
Approved Project Director: _____		Department of Construction and Facilities Management Veterans Affairs	

VA FORM 08-6231 1 2 3 4 5 6 7 8 9