


- HVAC COORDINATION NOTES:**
- AIR HANDLING UNIT SHALL BE SELECTED AND ORIENTED TO FIT IN AVAILABLE MECHANICAL ROOM. PROVIDE MAINTENANCE PANO AND CLEARANCE TO PULL COILS, MAINTENANCE CLEARANCE REQUIREMENTS, AND CLEARANCE REQUIREMENTS FOR SURROUNDING ELECTRICAL PANELS AND EQUIPMENT.
  - ALL AIR HANDLING UNIT MODULAR SECTIONS SHALL FIT THROUGH THE EXISTING LOUVER. PROVIDE MAINTENANCE PANO AND CLEARANCE TO PULL COILS, MAINTENANCE CLEARANCE REQUIREMENTS, AND CLEARANCE REQUIREMENTS FOR SURROUNDING ELECTRICAL PANELS AND EQUIPMENT.
  - LOUVER SECTIONS SHALL BE FIELD VERIFIED BY CONTRACTOR PRIOR TO PURCHASE OF EQUIPMENT.

**NOTES:**

- FOR CLARITY, NOT ALL PIPING IS SHOWN. REFER TO FLOW DIAGRAM AND DETAILS FOR PROPER PIPING. ALL PIPING, INCLUDING BUT NOT LIMITED TO MAKEUP WATER CONNECTIONS TO RPZ (RPZ PROVIDED AND INSTALLED BY PLUMBING CONTRACTOR) AND CONDENSATE LINE CONNECTIONS ON ADJACENT FLOORS ARE REQUIRED.

Revisions	Date
100% Submission	7/02/10
90% Submission	6/27/10
60% Submission	4/22/10

VA WESTERN NEW YORK HEALTHCARE SYSTEM  
3495 BAILEY AVENUE  
BUFFALO, NEW YORK 14215

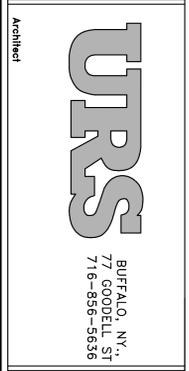

Architect  
atomp

SAFETY OFFICER	DATE	CHIEF OF STAFF	DATE	ASSOCIATE MEDICAL CENTER DIRECTOR	DATE
CARDIOLOGY	DATE	ENGINEERING MANAGER	DATE	MEDICAL CENTER DIRECTOR	DATE
INFECTION CONTROL	DATE	CARELINE MANAGER	DATE	ASSOCIATE MEDICAL CENTER DIRECTOR	DATE

Drawing Title  
**ENLARGED PLANS,  
SECTION, AND DETAILS**

Project Title  
**RENOVATION OF BLDG #1,  
2ND FLOOR, B-WARD**

Date	Station No.
JULY 2, 2010 (UPDATED 10/07/10)	528
09-352	MH-601

