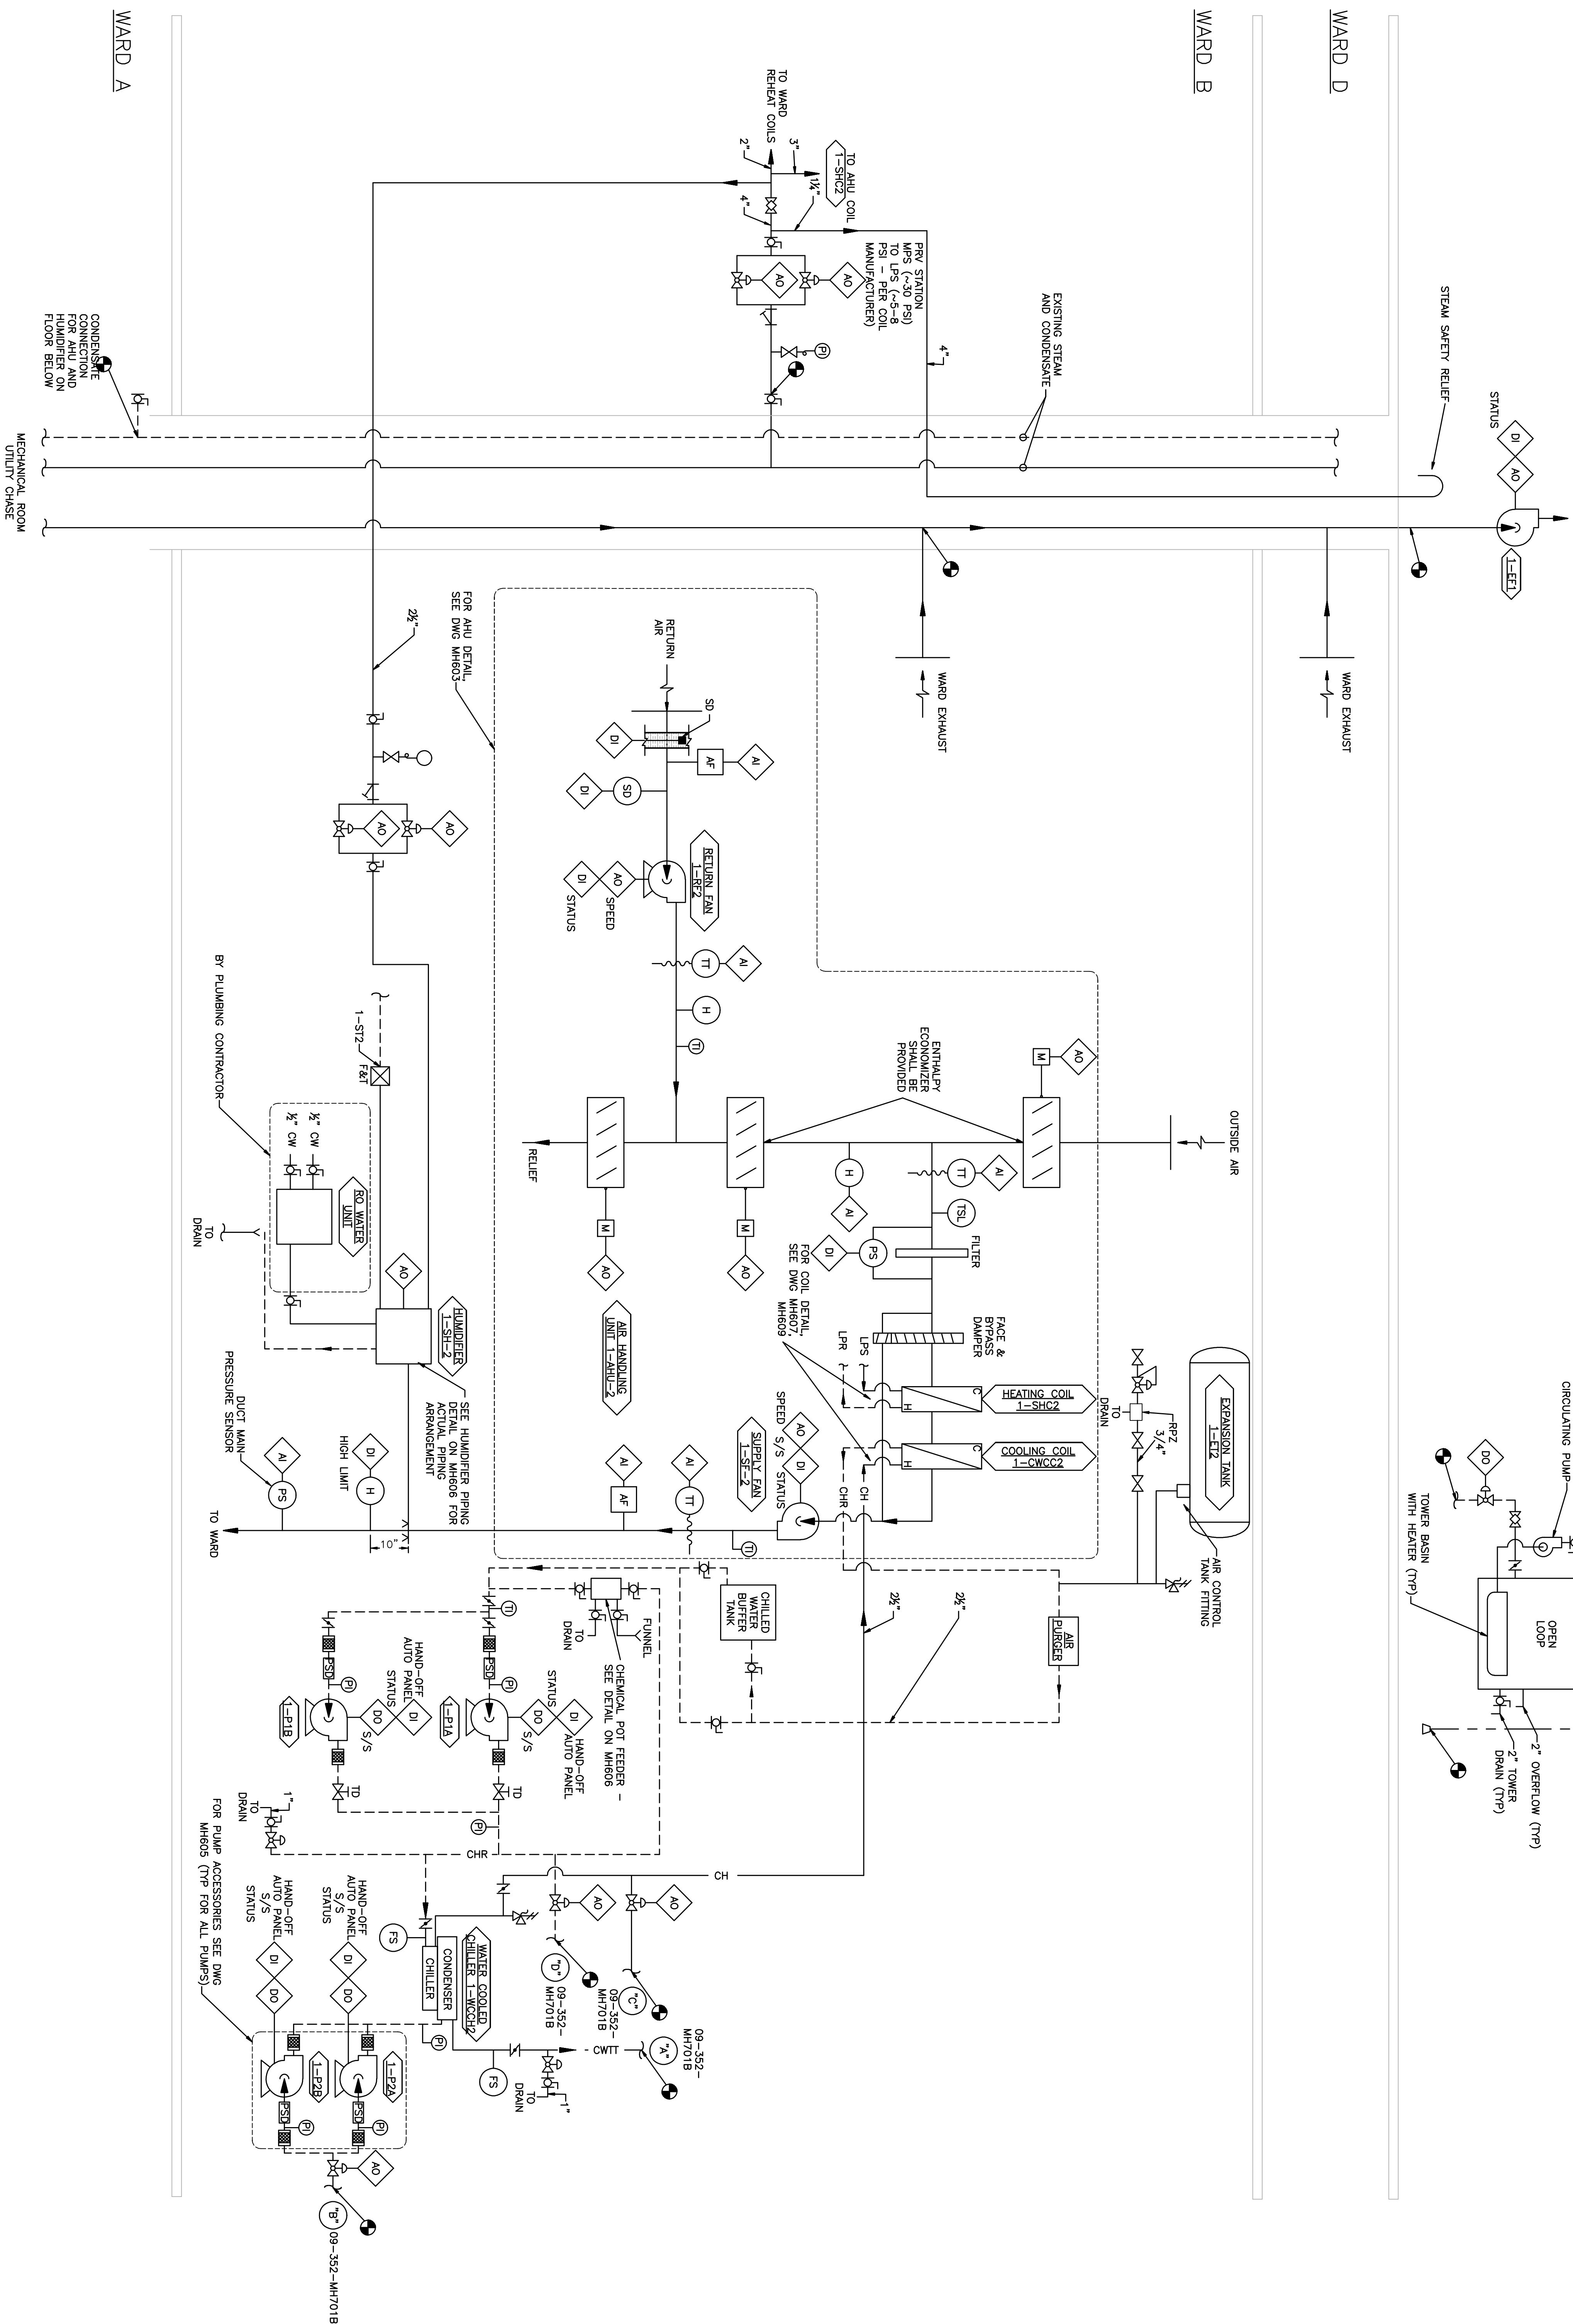


- NOTE:**
1. ALL POINTS SHOWN SHOW DESIGN INTENT BASED ON SEQUENCE OF OPERATIONS. PROVIDE ALL POINTS NECESSARY FOR COMPLETE OPERATIONAL SYSTEM.
 2. ALL CONTROLS SHALL BE ELECTRONIC, NOT PNEUMATIC.
 3. FOR MAKEUP WATER AND COOLING TOWER WATER TREATMENT SEE DWG MH606

[illegible]

VA WESTERN NEW YORK HEALTHCARE SYSTEM
3495 BAILEY AVENUE
BUFFALO, NEW YORK 14215

URS
BUFFALO, N.Y.,
77 GOODELL ST
716-856-5636

Architect

stan

SAFETY OFFICER

DATE	CHIEF OF STAFF
------	----------------

DATE _____

ASSOCIATE MEDICAL CENTER DIRECTOR

ATE

V.A.M.C. BAJAVIA, NEW YORK

5

Y7T01 TTTT

2



Department of
Veterans Affairs