



three inches = one foot
one and one half inches = one foot
one inch = one foot
three quarters inch = one foot
one half inch = one foot
one quarter inch = one foot
one eighth inch = one foot
one sixteenth inch = one foot

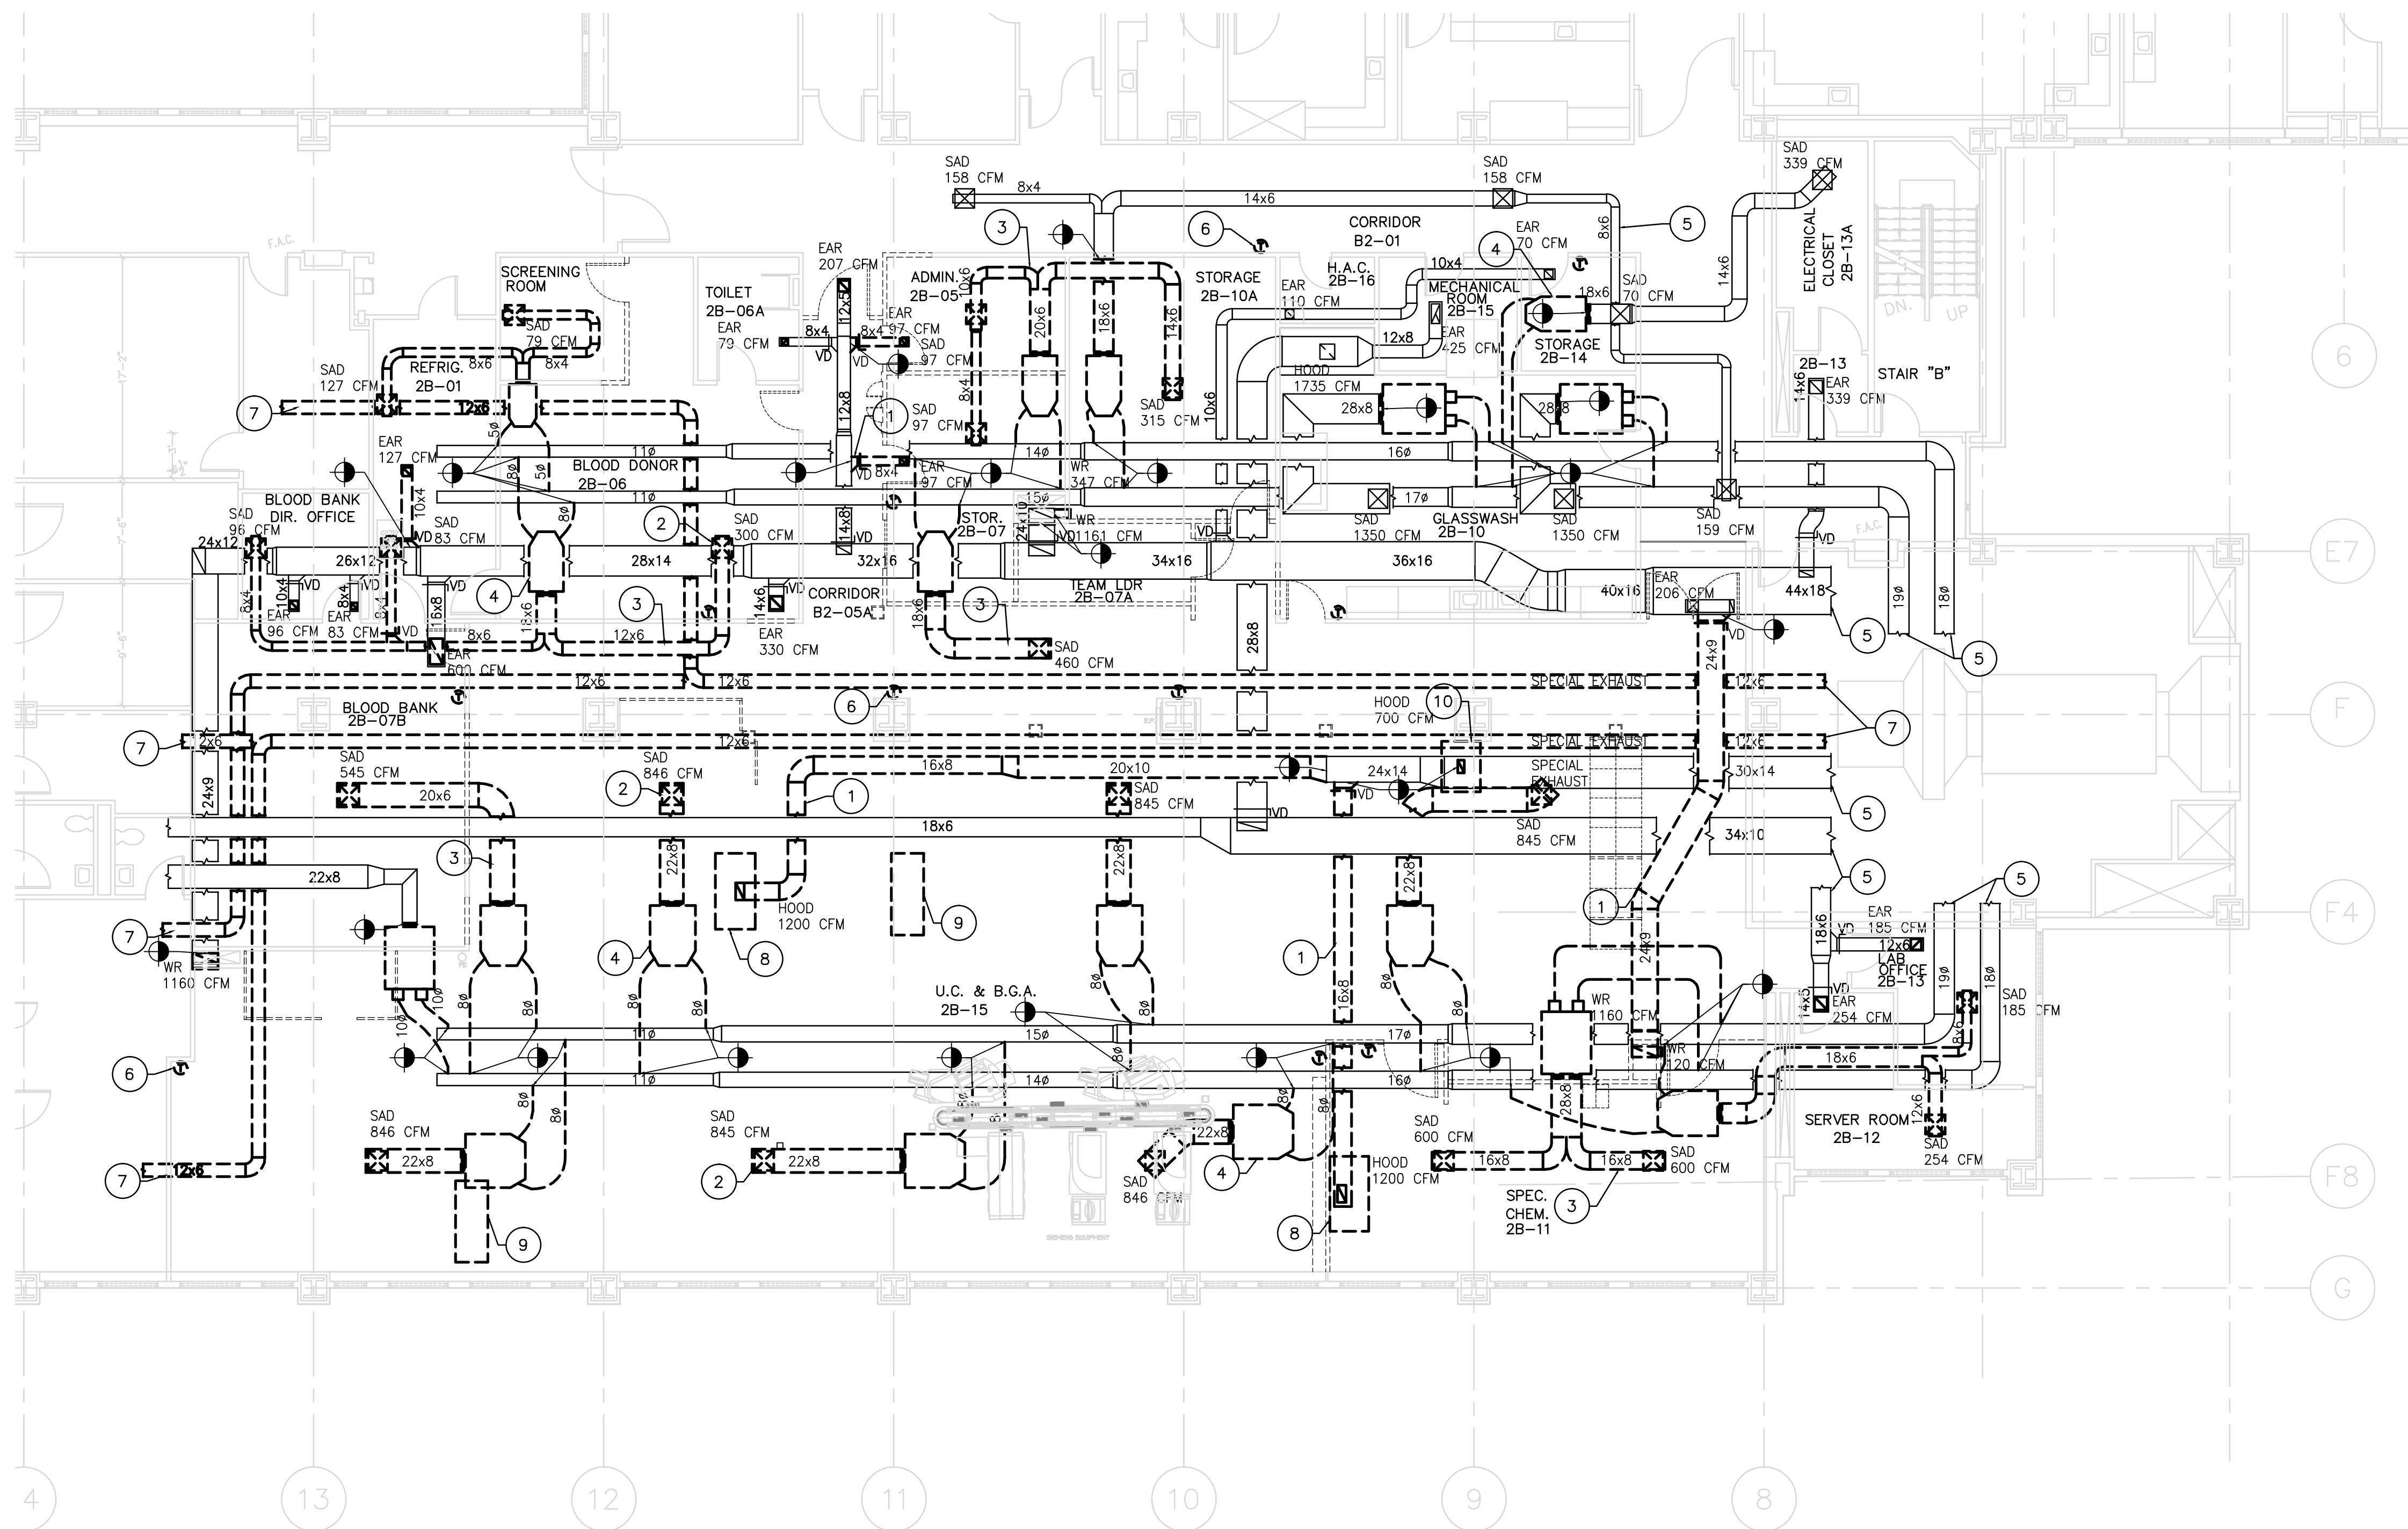

- MECHANICAL DEMOLITION NOTES
1. DASHED LINES AND HATCHED INDICATE ITEMS TO BE REMOVED, UNLESS OTHERWISE NOTED.
 2. ALL CONTROLS RELATED TO EQUIPMENT BEING REMOVED SHALL BE REMOVED.
 3. ALL ELECTRICAL RELATED TO EQUIPMENT BEING REMOVED SHALL BE PROPERLY TERMINATED IN ACCORDANCE WITH NEC.
 4. IF ANY EXISTING CEILING ETC IS DAMAGED DURING THIS PROJECT, CONTRACTOR IS RESPONSIBLE FOR REPLACING WITH NEW, AND TO MATCH EXISTING TYPE & FINISH.
 5. CONTRACTOR TO NOTE THAT THE LOCATIONS OF EXISTING DUCTWORK AND PIPING ARE APPROXIMATED (BASED ON EXISTING BLUEPRINTS AND FIELD OBSERVATIONS). CONTRACTOR SHALL BE RESPONSIBLE FOR VERIFYING LOCATIONS OF ALL DUCTWORK AND PIPING IN FIELD.
 6. HVAC EQUIPMENT, CONTROLS, ELECTRICAL, DUCTWORK, PIPING, AIR OUTLET/INLET, ETC IN CLOS. & WALLS WHICH ARE NOT TO BE USED SHALL BE REMOVED IN ENTIRETY, WHETHER OR NOT SHOWN ON PLANS, UNLESS OTHERWISE INFORMED BY OWNER. CHECK IN FIELD.
 7. CONTRACTOR SHALL BE RESPONSIBLE FOR VERIFYING THE LOCATIONS OF ALL EQUIPMENT, DUCTWORK & RELATED OUTLETS/INLETS BEING REMOVED.
 8. PATCH AND PAINT FLOOR OPENINGS/PENETRATIONS AFTER DEMOLITION TO MATCH EXISTING.
 9. CONTRACTOR TO NOTE ALL DUCTWORK AND MIXING BOXES ARE IN INTERSTITIAL SPACE ON FLOOR ABOVE.

- MECHANICAL KEY NOTES
- 1 EXISTING EXHAUST DUCTWORK TO BE REMOVED. CAP EXISTING TO REMAIN (TYP.)
 - 2 EXISTING AIR OUTLETS/INLETS & ALL RELATED DAMPERS, ETC. TO BE REMOVED (TYP.)
 - 3 EXISTING DUCTWORK & ALL RELATED INSULATION, SUPPORTS, ETC. TO BE REMOVED (TYP.)
 - 4 EXISTING MIXING BOX & ALL RELATED INSULATION, SUPPORTS, CONTROLS, ETC. TO BE REMOVED. PNEUMATIC LINES SHALL BE CAPPED WHERE CUT TO MAINTAIN PRESSURE TO THE EXISTING SYSTEM (TYP.)
 - 5 EXISTING DUCTWORK TO REMAIN. (TYP.)
 - 6 EXISTING THERMOSTAT AND ALL RELATED TUBING, CONDUITS, ETC. TO BE REMOVED. PATCH & PAINT WALL (WHERE REQUIRED) TO MATCH EXISTING. PNEUMATIC LINES SHALL BE CAPPED WHERE CUT TO MAINTAIN PRESSURE TO THE EXISTING SYSTEM (TYP.)
 - 7 EXISTING 12x6 SPECIAL EXHAUST DUCTWORK IS NOT IN USE AND TO BE DEMOLISHED.
 - 8 EXISTING FUME EXHAUST HOOD TO BE REMOVED FOR RELOCATION. CAP DUCTWORK AT POINT OF DISCONNECT FROM SPECIAL EXHAUST DUCTWORK.
 - 9 EXISTING RECIRCULATION HOOD TO BE REMOVED FOR RELOCATION.
 - 10 EXISTING FUME EXHAUST HOOD TO BE REMOVED. CAP DUCTWORK AT POINT OF DISCONNECT FROM SPECIAL EXHAUST DUCTWORK. RETURN EXHAUST HOOD TO VA.

MECHANICAL SECOND FLOOR DEMOLITION PLAN
1/8" = 1'-0"

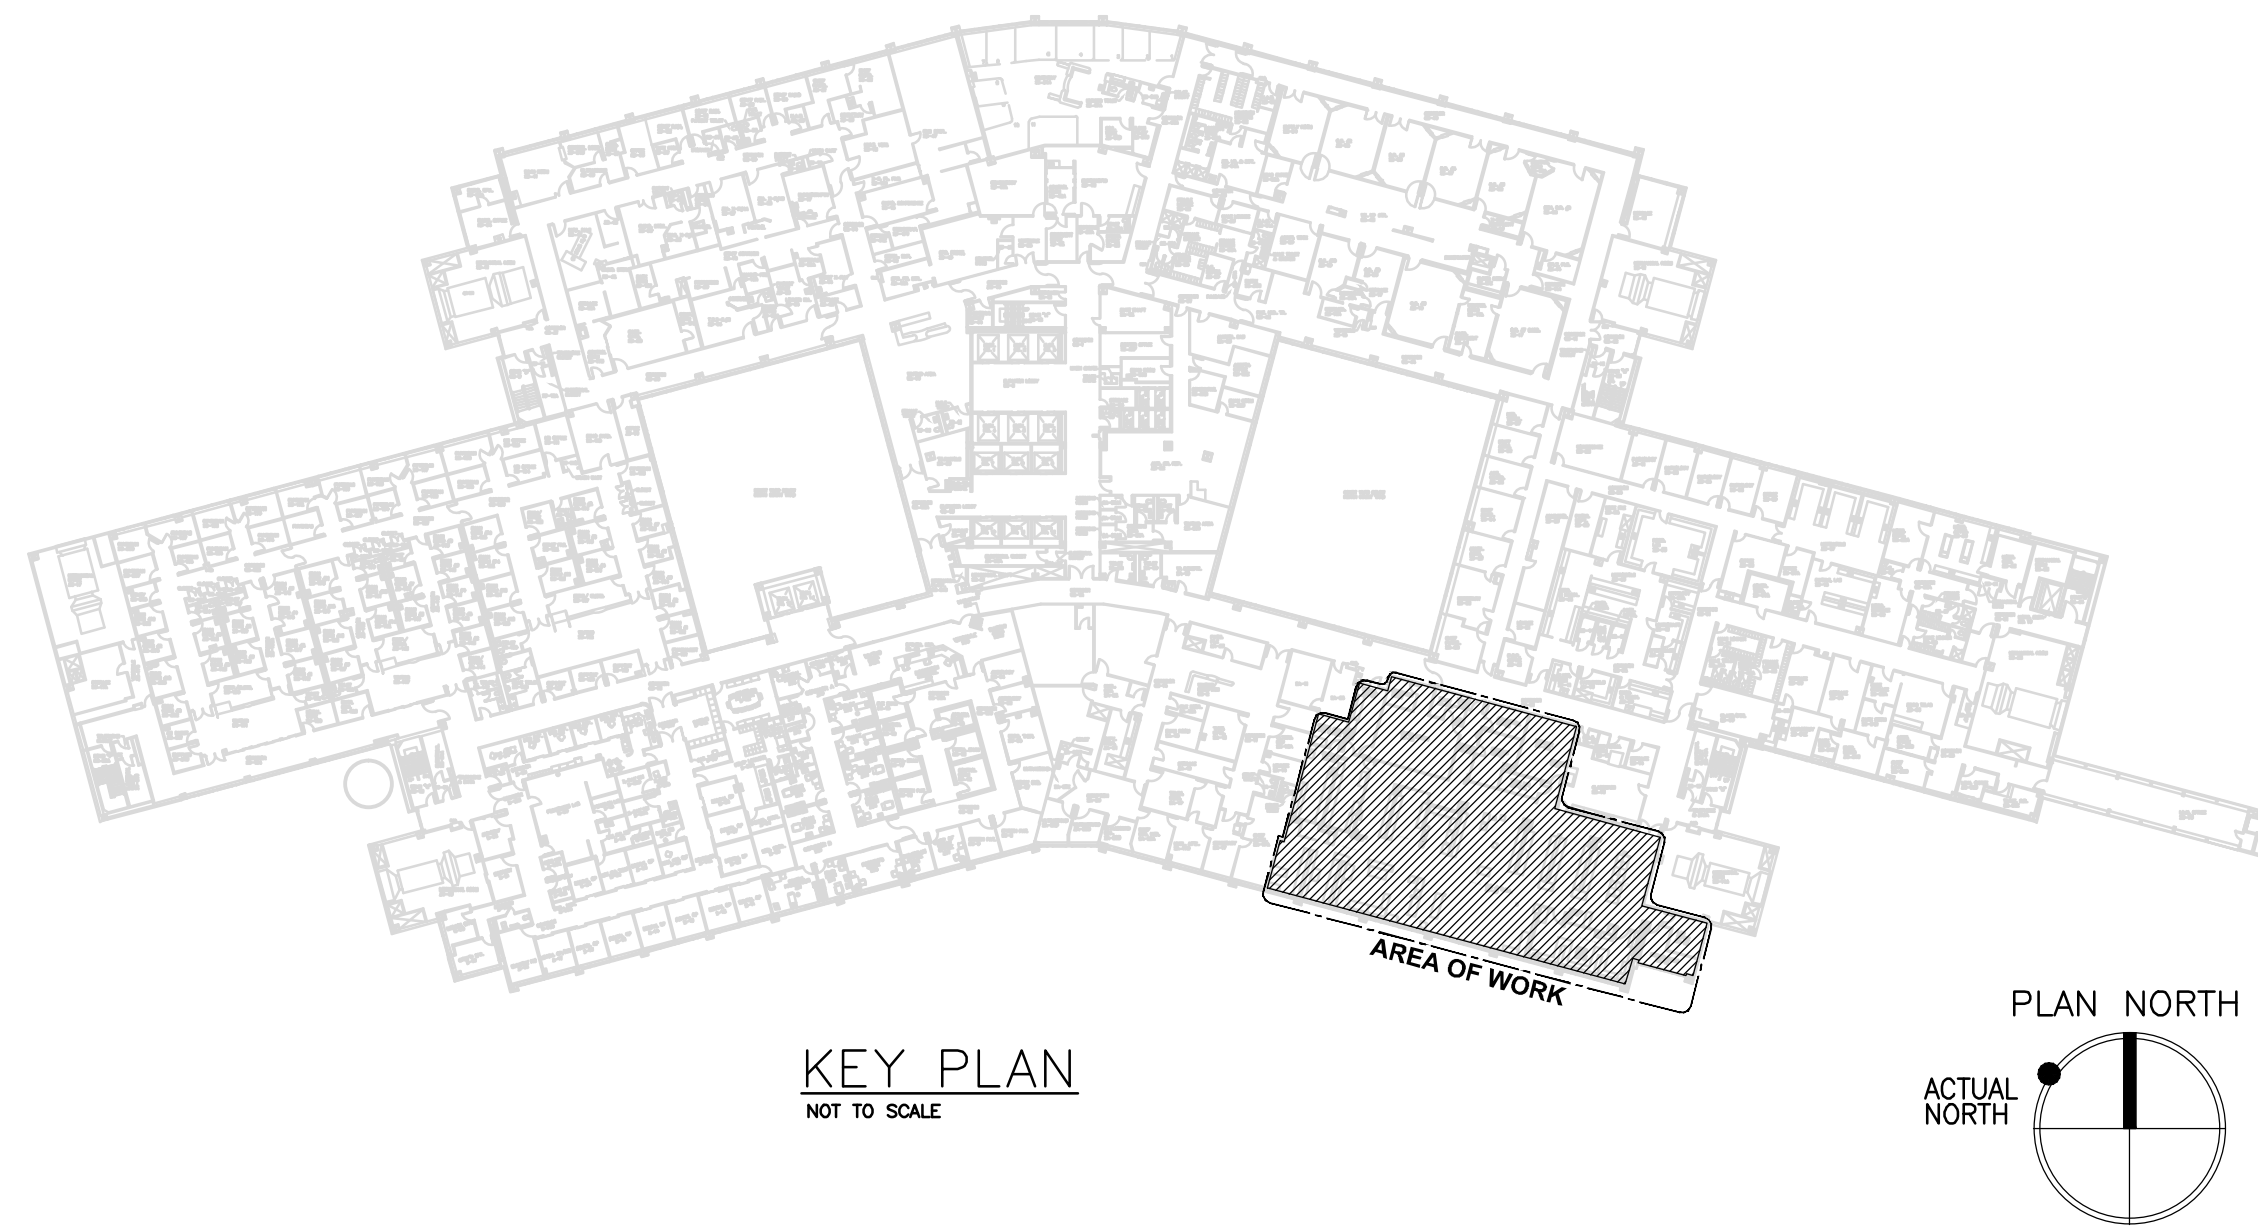

DESIGN APPROVED W/ COMMENT:

CONSULTANTS:

LAN ASSOCIATES
engineering • planning • architecture • surveying
252 MAIN STREET, GOSHEN, NEW YORK 10924 (845)615-0350

ARCHITECT/ENGINEERS:

NK
NADASKAY KOPELSON ARCHITECTS
ARCHITECTURE • ENGINEERING • PLANNING • INTERIORS
88 MADISON STREET, GOSHEN, NY 10924
T. (845) 615-0350 F. (845) 615-0351
114 JEROME STREET, NEW YORK, NY 10006
T. (212) 463-7880 F. (212) 463-8111

Drawing Title
MECHANICAL SECOND FLOOR
DEMOLITION PLAN

Approved Project Director

Project Title
LABORATORY RENOVATION
100% CD SUBMISSION
NK Job Number: 1925400 LAN Job Number 41160.03

Location
BRONX, NY

Date
03/09/11

Checked
SS

Drawn
EK

Project Number
526-09-122
Building Number
100

Drawing Number
MD 101
Dwg. of

Office of
Facilities
Management
Department of
Veterans Affairs