


1 SITE PLAN - ELECTRICAL - NEW WORK
SCALE: 1" = 20'-0"
GENERAL NOTES:
1. CONTRACTOR SHALL RELOCATE TEMPORARY POWER SERVICE FOR JOB TRAILER FROM BRECC BUILDING MECHANICAL ROOM TO NEW RESEARCH BUILDING PERMANENT ELECTRICAL SERVICE (BGE) AFTER THIS WORK COMPLETED.

- DRAWING NOTES:**
- EXISTING LIGHTING POLE SHALL BE REMOVED. EXISTING LIGHTING CIRCUIT WIRING TO BE REMOVED BACK TO SOURCE OR NEXT EXISTING DEVICE TO REMAIN. CONTRACTOR TO MAINTAIN CONTINUITY OF EXISTING LIGHTING CIRCUIT WHERE NECESSARY.
 - 6-4" CONDUITS ENCASED IN CONCRETE (24"x17") FOR BGE SECONDARY SERVICE MINIMUM 36" BELOW FINISHED GRADE.
 - PROPOSED LOCATION OF BGE PAD MOUNTED TRANSFORMER.
 - DISCONNECT EXISTING BRANCH CIRCUIT WIRING FROM EXISTING POLE AND RECONNECT TO NEW SITE LIGHTING BRANCH CIRCUIT WIRING.
 - 2 #8 + 1 #8 GRD IN 1" C. INSTALL BRANCH CIRCUIT WIRING FOR SITE LIGHTING IN DIRECT BURIED PVC SCHEDULE 80 CONDUIT, MINIMUM 24" BELOW FINISHED GRADE (TYPICAL).
 - EXTEND FOUNDATION FOR LIGHTING POLE 36" ABOVE FINISHED GRADE (TYPICAL).
 - RELOCATE EXISTING MANHOLE AND ASSOCIATED DUCT BANK SYSTEM TO ACCOMMODATE CONSTRUCTION OF NEW RETAINING WALL. COORDINATE POWER OUTAGES WITH OWNER.

Additions:	Date:	Consultants:	Seal:	Drawing Scale:	Drawing Title:	Project Title:	Date:
		POLT DESIGN GROUP, INC. ARCHITECTURE / INTERIORS / PLANNING 1301 ENTERPRISE COURT, SUITE 103-C2 BEL AIR, MARYLAND 21014-1847 410.803.2141 - FAX 410.858.1603	BURDETTE KOEHLER MURPHY & ASSOCIATES, INC. MECHANICAL / ELECTRICAL / FIRE PROTECTION / TELECOMMUNICATIONS 1423 CLARKVIEW ROAD, SUITE 500 BALTIMORE, MARYLAND 21209 410.323.0600 - FAX 410.377.2543		SITE PLAN ELECTRICAL NEW WORK	NEW RESEARCH BUILDING	4/10/09
Revisions:	09/15/10	BUILDING COST CONSULTANTS COST ESTIMATING 12917 - 30TH AVENUE PLATTSMOUTH, NEBRASKA 68048 402.298.8260 - FAX 402.298.8290	DUNLAP ENGINEERING, INC. STRUCTURAL ENGINEERING 14119 BLENHEIM ROAD PHOENIX, MARYLAND 21131-1827 410.817.9900 - FAX 410.817.9901	Drawing Start Date:	Approved: Associate Director for Operations:	Building No:	Project No:
"REVISED PER VA REQUEST"		CENTURY ENGINEERING CIVIL ENGINEERING 10710 GLOVEY ROAD HUNT VALLEY, MD 21031 410.823.8070 - FAX 410.823.2184				1	512-522
				Drawing Finish Date:	Approved: Director, Medical Center:	Checked:	Drawing No:
						RHM/YR	E-6
				Drawing Approved:		Drawn:	Dwg. 54 of 56
						IP	
						Location: VAMHCS MEDICAL CENTER BALTIMORE, MARYLAND	

DELLC
JOB NO. 070802D
PDC - 070109

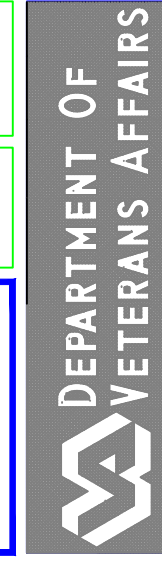

BKM# 070490.010