

1. ALL WORK SHALL CONFORM TO 2015 INTERNATIONAL BUILDING CODE AND IN ACCORDANCE WITH THE DEPARTMENT OF VETERANS AFFAIRS REQUIREMENTS.

2. DESIGN LOADS: BUILDING STRUCTURE IS DESIGNED FOR THE FOLLOWING LOADS AND CRITERIA: BUILDING OCCUPANCY CATEGORY: IV

Table with 2 columns: Category (A. DEAD, B. LIVE, C. SNOW, D. WIND, E. SEISMIC) and Load/Requirement details.

3. CONTRACTOR SHALL FIELD VERIFY ALL EXISTING DIMENSIONS PRIOR TO FABRICATION.

4. REFERENCE PROJECT SPECIFICATIONS FOR ADDITIONAL REQUIREMENTS.

5. IF DISCREPANCIES EXIST BETWEEN SPECIFICATIONS, CONTRACT DRAWINGS, AND/OR SHOP DRAWINGS NOTIFY THE ENGINEER OF RECORD.

6. THE CONTRACTOR SHALL REVIEW DRAWINGS FROM ALL OTHER DISCIPLINES FOR PERTINENT MISCELLANEOUS INFORMATION RELATED TO THE STRUCTURAL WORK AND COORDINATE AS REQUIRED.

7. THE BUILDING IS NOT STRUCTURALLY STABLE UNTIL ALL CONNECTIONS, FRAMING, SHEAR WALLS, PERMANENT BRACING AND EXTERIOR LOAD-BEARING WALLS ARE COMPLETE AND HAVE ACHIEVED THEIR DESIGN STRENGTH.

8. PROVIDE ADEQUATE SHORING DURING CONSTRUCTION TO RESIST FORCES SUCH AS WIND AND UNBALANCED LOADS DUE TO CONSTRUCTION. DO NOT BACKFILL UNTIL CONCRETE HAS CURED 14 DAYS.

9. FOUNDATIONS: A. FOUNDATIONS ARE DESIGNED TO BEAR ON SOIL WITH ALLOWABLE BEARING CAPACITY OF 2500 psf. B. CONTRACTOR SHALL REMOVE EXISTING FOOTINGS AND FOUNDATIONS THAT ARE LOCATED WITHIN THE FOOTPRINT OF THE NEW BUILDING.

10. CONCRETE: A. CAST-IN-PLACE CONCRETE CONSTRUCTION SHALL CONFORM TO LATEST APPLICABLE AMERICAN CONCRETE INSTITUTE DOCUMENTS, ACI-301, 305, 306, 315, 318 AND 347 UNLESS OTHERWISE NOTED IN THESE CONTRACT DOCUMENTS.

Table with 2 columns: Item (FOOTINGS, GRADE BEAMS, WALLS, BEAMS, COLUMNS, SLAB ON GRADE, ELEVATED SLAB) and Strength/Requirement details.

C. SLABS-ON-GRADE SHALL DEVELOP A 90 DAY COMPRESSIVE STRENGTH. D. IT IS THE INTENT OF THESE CONCRETE SPECIFICATIONS THAT THE CONTRACTOR SUPPLY CONCRETE MIXES WITH A MINIMUM AMOUNT OF WATER IN ORDER TO LIMIT PLASTIC SHRINKAGE CRACKING IN FRESHLY PLACED CONCRETE.

E. CONCRETE MIX DESIGNS SHALL INCLUDE ALL APPLICABLE ADMIXTURES. F. CONCRETE SLUMP SHALL BE A MAXIMUM OF 4" +/- 1" (ASTM C-143) AS DELIVERED IN THE FIELD.

G. A MAXIMUM OF 1 GALLON OF WATER PER CUBIC YARD OF CONCRETE MAY BE WITHHELD AT THE PLANT TO BE LATER ADDED ON SITE WITH THE USE OF AN EXTERNAL MEASURING DEVICE TO PROVIDE PROPER WORKABILITY.

H. CONCRETE EXPOSED TO WEATHER, PARKED VEHICLES, AND/OR DEICING CHEMICAL SHALL CONTAIN 6% (+/- 1%) ENTRAINED AIR BY VOLUME.

I. CHAMFER ALL EXPOSED CORNERS OF CONCRETE WALLS, 3/4" UNLESS NOTED OTHERWISE.

J. ALL CONTROL JOINTS IN CONCRETE SLABS-ON-GRADE SHALL BE CUT TO 1/3 OF DEPTH WHEN USING WET-CUTTING PROCESS AND 1/4 OF THE DEPTH WHEN USING EARLY-ENTRY DRY-CUT PROCESS.

K. CUT SLABS-ON-GRADE INTO AREAS OF APPROXIMATELY 225 SQUARE FEET MAINTAINING AS CLOSE TO SQUARE AREAS AS POSSIBLE. LENGTH TO WIDTH RATIOS OF JOINED PANELS SHALL NOT EXCEED 1.5:1.

L. CONTROL JOINTS IN WALLS SHALL BE PLACED AT 20'-0" O.C. MAXIMUM UNLESS NOTED OTHERWISE. LOCATE JOINTS BESIDE PIERS INTEGRAL WITH WALLS, NEAR CORNERS, AND IN CONCEALED LOCATIONS WHERE POSSIBLE.

M. PRIOR TO PLACING CONCRETE IN ANY LOCATION, IT IS THE RESPONSIBILITY OF THE GENERAL CONTRACTOR TO HAVE THOROUGHLY CHECKED AND COORDINATED ALL DIMENSIONS, ELEVATIONS, OPENINGS, RECESSES, AND BLOCKOUTS SHOWN ON ANY OF THE CONTRACT DRAWINGS.

N. EMBEDDED ITEMS ARE TO BE FURNISHED AND INSTALLED BY THE CONTRACTOR PRIOR TO PLACING CONCRETE.

O. ANCHOR RODS AND ANCHOR BOLTS SHALL BE HELD IN PLACE WITH A RIGID TEMPLATE.

P. HORIZONTAL JOINTS BEYOND THOSE SHOWN IN THE CONTRACT DOCUMENTS SHALL NOT BE CONSTRUCTED WITHOUT THE APPROVAL OF THE ARCHITECT AND ENGINEER.

11. REINFORCING STEEL: A. POST INSTALLED ANCHORS ARE NOT TO BE SUBSTITUTED FOR ANCHORS SHOWN ON DRAWINGS.

B. MECHANICAL ANCHORS SHALL BE SIMPSON TITEN HD ANCHORS UNLESS NOTED OTHERWISE. MINIMUM EMBEDMENT UNLESS NOTED OTHERWISE SHALL BE: a. 5 3/4" FOR 1/2" DIAMETER ANCHORS

C. EPOXY ANCHORS SHALL USE HILTI HIT HY 20 ADHESIVE WITH SCREEN TUBES IN HOLLOW MASONRY & HILTI HIT HY 10 ADHESIVE IN CONCRETE UNLESS NOTED OTHERWISE ON THE DRAWINGS.

D. MINIMUM EMBEDMENT FOR EPOXY ANCHORS IN NORMAL WEIGHT CONCRETE UNLESS NOTED OTHERWISE SHALL BE: a. 4-1/4" FOR 1/2" DIAMETER ANCHORS

Table with 3 columns: CONC. STRENGTH (PSI), NON-COATED, EPOXY COATED. Rows for 3000, 4000, 5000 psi.

H. REINFORCEMENT PARTIALLY EMBEDDED IN CONCRETE SHALL NOT BE FIELD BENT, EXCEPT AS SHOWN AND NOTED ON THE CONTRACT DRAWINGS OR PERMITTED BY THE ENGINEER OF RECORD.

I. ALL REINFORCEMENT AND EMBEDDED ITEMS (I.E. PLATES, ANCHOR RODS) SHALL BE ACCURATELY PLACED, ADEQUATELY SUPPORTED, AND SECURED AGAINST DISPLACEMENT BEFORE CONCRETE IS PLACED.

12. MASONRY A. MASONRY UNIT COMPRESSIVE STRENGTH (fm) = 1500 PSI. MORTAR - TYPE S.

B. LINTELS SHALL BE STEEL BEAMS OR MASONRY BOND BEAMS AS SHOWN ON THE PLANS. OTHER OPENINGS LESS THAN 4'-0" WIDE SHALL BE A BOND BEAM WITH (2) #5 CONTINUOUS EXTENDING PAST OPENINGS A MIN. OF 2'-0".

C. GROUT ALL REINFORCED CELLS AND CELLS BELOW GRADE SOLID.

D. BOND BEAM W/ (2) #5 CONTINUOUS AT THE TOP OF WALLS & 8'-0" O.C. VERTICALLY.

E. REINFORCE MASONRY WITH #5 AT 22" O.C. FOR 8' CMU & #5 AT 24" O.C. FOR 12" CMU UNLESS NOTED OTHERWISE.

F. BRACE THE TOPS OF PARTITION WALLS TO THE UNDERSIDE OF DECK.

13. STRUCTURAL STEEL: A. ALL STRUCTURAL STEEL SHALL BE DETAILED, FABRICATED AND ERRECTED IN ACCORDANCE WITH AISC SPECIFICATION FOR STRUCTURAL STEEL BUILDINGS, LATEST APPLICABLE EDITION AND AISC CODE OF STANDARD PRACTICE.

B. ALL STRUCTURAL STEEL FOR WIDE FLANGE SHALL BE A992 GRADE 50 UNLESS NOTED OTHERWISE ON THE PLANS. ALL ANGLES, PLATES, AND CHANNEL SHALL BE ASTM A36 UNLESS NOTED OTHERWISE.

C. ALL BOLTS SHALL BE 3/4" DIAMETER A-325 BOLTS WITH HEAVY HEX HEADS, UNLESS NOTED OTHERWISE ON THE PLANS. ALL CONNECTIONS SHALL HAVE A MINIMUM OF TWO 3/4" DIAMETER BOLTS, BEARING TYPE CONNECTIONS ONLY.

D. ALL STRUCTURAL STEEL WELDS IN THE SHOP OR THE FIELD SHALL BE PERFORMED BY A QUALIFIED WELDER AND SHALL CONFORM TO THE CURRENT REQUIREMENTS OF A.W.S. E. SHOP WELDED AND FIELD BOLTED CONNECTIONS ARE PREFERRED, UNLESS OTHERWISE SHOWN.

F. ALL STEEL EXPOSED TO EXTERIOR AREAS SHALL BE HOT-DIP GALVANIZED AND PAINTED PER ARCHITECT UNLESS NOTED OTHERWISE.

G. THE CONTRACTOR SHALL PROVIDE SHELF ANGLES, GLASS SUPPORTS, LINTELS AND OTHER MISCELLANEOUS STEEL, AS SHOWN ON THE DRAWINGS AND AS REQUIRED TO PROVIDE SUPPORT (STABILIZATION) AROUND AND THROUGHOUT THE BUILDING. SEE ARCHITECTURAL DRAWINGS FOR ADDITIONAL MISCELLANEOUS STEEL DETAILS.

H. ALL CONNECTIONS IN THE CONSTRUCTION DOCUMENTS SHALL BE DESIGNED PER THE AISC MANUAL OF STEEL CONSTRUCTION "FRAMED BEAM CONNECTIONS" FOR AT LEAST 0.4 x BEAM TOTAL SHEAR CAPACITY, Vp/OMEGA SHOWN IN THE SELECTION BY 2x TABLE 3.2. ALL CONNECTIONS MUST BE TWO BOLT MINIMUM. CONNECTION DESIGN CALCULATIONS SHALL BE PREPARED UNDER THE DIRECT SUPERVISION OF AND BEAR THE SEAL OF THE SAME PROFESSIONAL ENGINEER LICENSED IN THE STATE OF KANSAS.

14. STEEL BAR JOISTS AND JOIST GIRDERS: A. END SUPPORT AND END ANCHORAGE. 1. PROVIDE STANDARD DEPTH OF BEARING FOR ALL JOISTS AND JOIST GIRDERS AS SHOWN BELOW UNLESS DETAILS OTHERWISE ON THESE DRAWINGS:

2. PROVIDE FLAT BEARING FOR ALL JOISTS AND JOIST GIRDERS, UNLESS SHOWN OTHERWISE ON THESE DRAWINGS. INCREASE THE DEPTH OF THE SEAT ON THE HIGH END OF SLOPED JOISTS AS REQUIRED TO PROVIDE CLEARANCE FOR THE CONNECTION.

B. DESIGN 1. ALL JOISTS AND JOIST GIRDERS SHALL CARRY THE DESIGN LOADS AS SPECIFIED IN THE SJI LOAD TABLES AS THE MINIMUM REQUIREMENT. ADDITIONALLY, THE JOISTS AND JOIST GIRDERS SHALL BE DESIGNED TO CARRY ANY OTHER LOAD TYPES AND PATTERNS AS INDICATED ON THESE DRAWINGS.

2. STEEL JOISTS, JOIST GIRDERS, BRIDGING, AND THEIR CONNECTIONS SHALL BE DESIGNED BY THE MANUFACTURER FOR A NET UPLIFT AS INDICATED ON THESE DRAWINGS.

3. JOIST GIRDERS SHALL BE DESIGNED BY THE MANUFACTURER FOR THE CONCENTRATED LOADS SHOWN ON THESE DRAWINGS.

15. POST CONSTRUCTION ANCHORS: A. POST INSTALLED ANCHORS ARE NOT TO BE SUBSTITUTED FOR ANCHORS SHOWN ON DRAWINGS.

B. MECHANICAL ANCHORS SHALL BE SIMPSON TITEN HD ANCHORS UNLESS NOTED OTHERWISE. MINIMUM EMBEDMENT UNLESS NOTED OTHERWISE SHALL BE: a. 5 3/4" FOR 1/2" DIAMETER ANCHORS

C. EPOXY ANCHORS SHALL USE HILTI HIT HY 20 ADHESIVE WITH SCREEN TUBES IN HOLLOW MASONRY & HILTI HIT HY 10 ADHESIVE IN CONCRETE UNLESS NOTED OTHERWISE ON THE DRAWINGS.

D. MINIMUM EMBEDMENT FOR EPOXY ANCHORS IN NORMAL WEIGHT CONCRETE UNLESS NOTED OTHERWISE SHALL BE: a. 4-1/4" FOR 1/2" DIAMETER ANCHORS

Table with 3 columns: CONC. STRENGTH (PSI), NON-COATED, EPOXY COATED. Rows for 3000, 4000, 5000 psi.

H. REINFORCEMENT PARTIALLY EMBEDDED IN CONCRETE SHALL NOT BE FIELD BENT, EXCEPT AS SHOWN AND NOTED ON THE CONTRACT DRAWINGS OR PERMITTED BY THE ENGINEER OF RECORD.

I. ALL REINFORCEMENT AND EMBEDDED ITEMS (I.E. PLATES, ANCHOR RODS) SHALL BE ACCURATELY PLACED, ADEQUATELY SUPPORTED, AND SECURED AGAINST DISPLACEMENT BEFORE CONCRETE IS PLACED.

16. STRUCTURAL ENGINEER SITE OBSERVATIONS A. THE CONTRACT STRUCTURAL DRAWINGS AND SPECIFICATIONS REPRESENT THE FINISHED STRUCTURE AND EXCEPT WHERE SPECIFICALLY SHOWN, DO NOT INDICATE THE METHOD OR MEANS OF CONSTRUCTION.

B. THE ENGINEER SHALL NOT HAVE CONTROL NOR CHARGE OF, AND SHALL NOT BE RESPONSIBLE FOR, CONSTRUCTION MEANS, METHODS, TECHNIQUES, SEQUENCES, OR PROCEDURES, FOR SAFETY PRECAUTIONS AND PROGRAMS IN CONNECTION WITH THE WORK.

C. PERIODIC SITE OBSERVATION BY FIELD REPRESENTATIVES OF LEIGH & OKANE L.L.C. IS SOLELY FOR THE PURPOSE OF DETERMINING IF THE WORK OF THE CONTRACTOR IS PROCEEDING IN ACCORDANCE WITH THE STRUCTURAL CONTRACT DOCUMENTS.

D. CONTRACTOR SHALL SUBMIT STRUCTURAL SHOP DRAWINGS FOR THE FOLLOWING: a. CONCRETE MIX DESIGN AND MATERIALS

E. PROVIDE A FINAL "FOR CONSTRUCTION" SET OF ALL SHOP DRAWINGS TO THE ENGINEER OF RECORD PRIOR TO FABRICATION OR CONSTRUCTION OF THOSE ITEMS.

17. SUBMITTALS: A. ALL SHOP DRAWINGS AND SUBMITTALS MUST BE REVIEWED AND APPROVED BY THE CONTRACTOR PRIOR TO SUBMITTAL.

B. THE CONTRACTOR SHALL SUBMIT STRUCTURAL SHOP DRAWINGS FOR THE FOLLOWING: a. CONCRETE MIX DESIGN AND MATERIALS

E. PROVIDE A FINAL "FOR CONSTRUCTION" SET OF ALL SHOP DRAWINGS TO THE ENGINEER OF RECORD PRIOR TO FABRICATION OR CONSTRUCTION OF THOSE ITEMS.

18. SPECIAL INSPECTIONS A. THE FOLLOWING MINIMUM ITEMS REQUIRE SPECIAL INSPECTION IN ACCORDANCE WITH THE BUILDING CODE. LOCAL CITY MAY REQUIRE ADDITIONAL SPECIAL INSPECTION.

- a. CONCRETE REINFORCING
b. CONCRETE PLACING
c. STEEL BOLTING
d. STEEL WELDING
e. BOLTS EMBEDDED IN CONCRETE / POST INSTALLED ANCHORS
f. ANCHOR RODS
g. ROOF DIAPHRAGM ATTACHMENT
h. MASONRY
i. SOIL VERIFICATION

B. THE CONTRACTOR SHALL REQUEST SPECIAL INSPECTION OF THE ITEMS LISTED ABOVE PRIOR TO THOSE ITEMS BECOMING INACCESSIBLE AND UNOBSERVABLE DUE TO PROGRESSION OF THE WORK.

PLAN SYMBOL KEY table with symbols and descriptions: FOOTING TYPE, COLUMN TYPE, BEAM TYPE, BEAM OFFSET ELEVATION INDICATOR, SHEAR STUD COUNT, BRACED FRAME ELEVATION, MOMENT FRAME INDICATOR, CANTILEVERED BEAM CONNECTION, CONNECTION SHEAR LOAD, CONNECTION AXIAL LOAD, CONNECTION MOMENT LOAD.

WALL TYPES IN PLAN KEY table with symbols and descriptions: LOAD BEARING STUD WALL, LOAD BEARING STUD SHEAR WALL, MASONRY WALL, CONCRETE WALL.

HATCH PATTERN KEY table with symbols and descriptions: CONCRETE IN SECTION, EARTH IN SECTION, GRANULAR FILL IN SECTION, INSULATION IN SECTION, STEEL IN SECTION.

STD. ABBREVIATIONS table with symbols and descriptions: ALTERNATE ANCHOR BOLT, ARCHITECT, BEAM, BOTTOM, BOTTOM OF BUILDING, CENTER LINE, CLEAR, COLUMN, CONCRETE CONNECTION, CONTINUOUS CONTROL JOINT, DETAIL, DIAMETER, DIMENSION, DIMENSION(DRAWING(S)), EACH, ELEVATION, ELEVATION, EQUAL, EQUIP, EQUIPMENT, EXIST, EXISTING, EXTERIOR, FAR SIDE, FINISH, FLOOR, FOOTING, FOUNDATION, GALV, GALVANIZED, GYPSUM, HEADED STUD, HIGH, HORIZONTAL, INSULATION, INTERIOR, LOCATION, LONG LEG HORIZONTAL, LONG LEG VERTICAL, LOW, MASONRY, MAXIMUM, MECHANICAL, MEDIUM, MIRROR, NEAR SIDE, NOT APPLICABLE, NOT TO SCALE, ON CENTER, OPENING, PLATE, RADIUS, REFERENCE, REINFORCING, REQUIRED, SCHEDULE, SECTION, SHEET, SIMILAR, SQUARE, STAINLESS STEEL, STEEL, TOP & BOTTOM, TOP OF, TYPICAL, UNLESS NOTED OTHERWISE, VERTICAL, WITH, WITHOUT.

Vertical scale on the left side of the page with markings for 1/8 inch, 1/4 inch, 3/8 inch, 1/2 inch, 5/8 inch, 3/4 inch, 7/8 inch, 1 inch, 1 1/8 inch, 1 1/4 inch, 1 3/8 inch, 1 1/2 inch, 1 5/8 inch, 1 3/4 inch, 1 7/8 inch, 2 inches.

CONSULTANTS: LEIGH AND OKANE: STRUCTURAL ENGINEERS, INSITE GROUP: MECHANICAL, ELECTRICAL, AND PLUMBING ENGINEERS, FSC: FIRE PROTECTION AND CODE CONSULTANT, PROBALANCE: COMMISSIONING AGENT, CMR: ESTIMATING


ARCHITECT: WELLNER architects inc, 802 Broadway . 4th Floor . Kansas City . MO . 64105, p.816.221.0017 f.816.221.9456 e.wai@wellner.com

Drawing Title: GENERAL NOTES, Approved: [Signature]

Project Title: WOMEN'S CLINIC ADDITION, Project Number: 589A7-CSI-403, Building Number: B29, Drawing Number: S-001, Date: JUNE 29th, 2016, Checked: WNH, Drawn: CMS, Dwg 30 of 65

OFFICE OF CONSTRUCTION AND FACILITIES MANAGEMENT, Department of Veterans Affairs

6/28/2016 1:16:55 PM
 one eighth inch = one foot
 one quarter inch = one foot
 one half inch = one foot
 three eighths inch = one foot
 one inch = one foot
 three quarters inch = one foot
 one and one half inches = one foot
 three inches = one foot

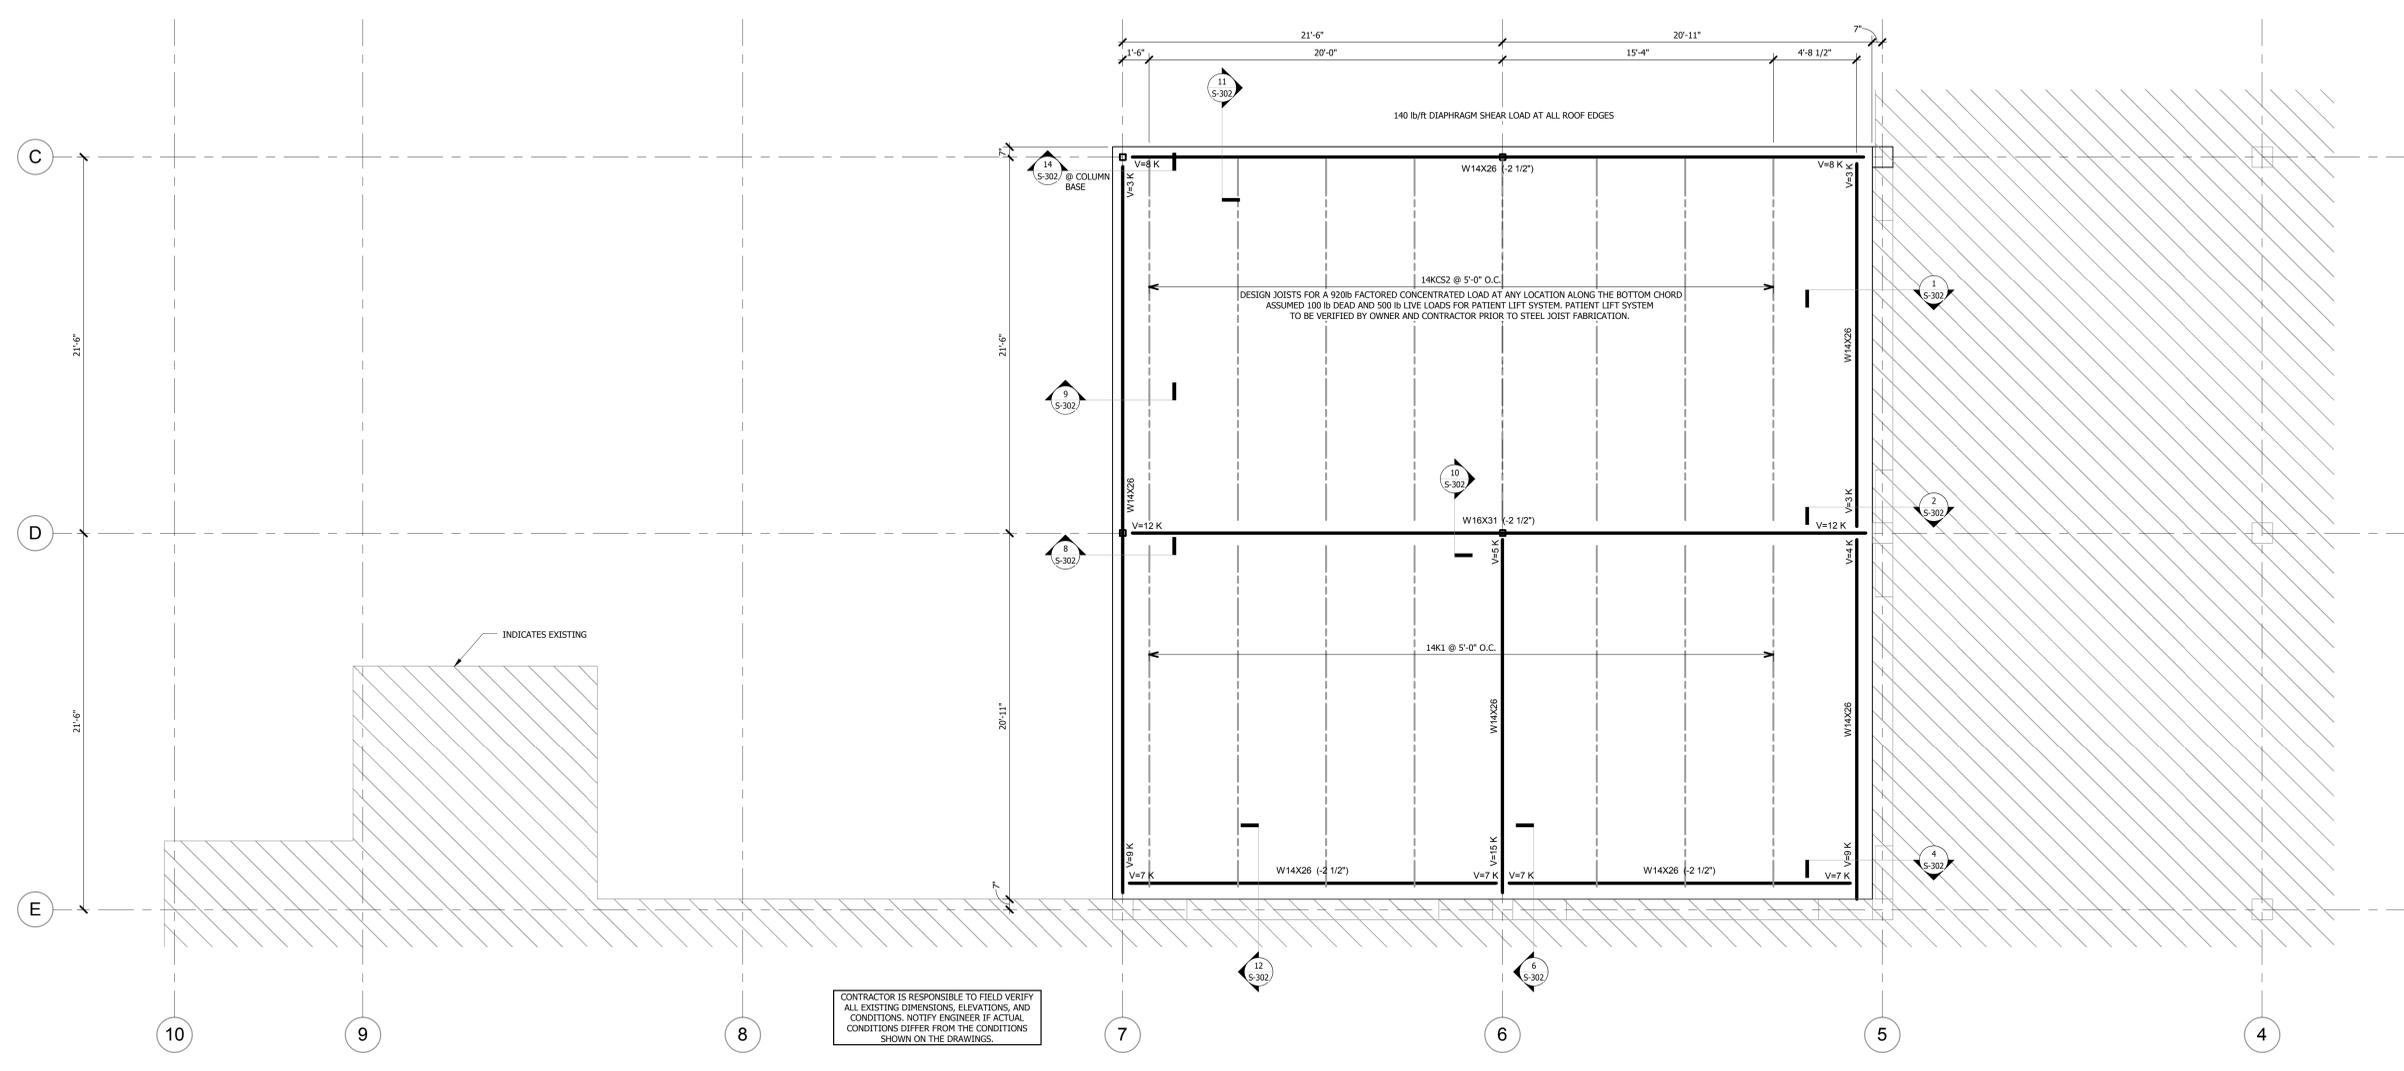

1 ROOF PLAN
 1/4" = 1'-0"



- ROOF FRAMING PLAN NOTES:**
- TOP OF STEEL ELEVATION = 123'-3 1/2" U.A.D.
 - ROOF DECK TO BE 1 1/2" 18GA. TYPE 8 MIN. 3 SPAN CONDITION TYP. ALL LOCATIONS. FASTEN DIAPHRAGM USING 36/4 PATTERN W/ #12 TEK SCREWS AND (3) #10 TEK AT SIDELAP.
 - OPENINGS IN THE ROOF TO BE COORDINATED WITH ALL OTHER DISCIPLINES.
 - REFER TO ARCHITECTURAL FOR ALL DIMENSIONS NOT SHOWN ON THESE PLANS.
 - END REACTIONS ARE FACTORED LOADS.

| Revisions: | Date |
|------------|------|
| | |
| | |
| | |
| | |
| | |

CONSULTANTS:
 LEIGH AND OKANE: STRUCTURAL ENGINEERS
 INSITE GROUP: MECHANICAL, ELECTRICAL, AND PLUMBING ENGINEERS
 FSC: FIRE PROTECTION AND CODE CONSULTANT
 PROBALANCE: COMMISSIONING AGENT
 CMR: ESTIMATING



ARCHITECT:

WELLNER architects inc
 802 Broadway . 4th Floor . Kansas City . MO . 64105
 p.816.221.0017 f.816.221.9456 e.wai@wellner.com

Drawing Title
ROOF FRAMING PLAN

Approved:

Project Title
WOMEN'S CLINIC ADDITION

Project Number
589A7-CSI-403

Building Number
B29

Drawing Number
S-102

Dwg. 33 of 55

Location
 5500 E. KELLOGG WICHITA KS

Date
 JUNE 29th, 2016


Checked
 WNH

Drawn
 CMS


OFFICE OF CONSTRUCTION AND FACILITIES MANAGEMENT

Department of Veterans Affairs


three eighths inch = one foot
 one eighth inch = one foot
 one quarter inch = one foot
 one half inch = one foot
 three quarters inch = one foot
 one inch = one foot
 one and one half inches = one foot
 two inches = one foot
 three inches = one foot
 four inches = one foot
 five inches = one foot
 six inches = one foot
 seven inches = one foot
 eight inches = one foot
 nine inches = one foot
 ten inches = one foot
 eleven inches = one foot
 twelve inches = one foot
 thirteen inches = one foot
 fourteen inches = one foot
 fifteen inches = one foot
 sixteen inches = one foot
 seventeen inches = one foot
 eighteen inches = one foot
 nineteen inches = one foot
 twenty inches = one foot
 twenty one inches = one foot
 twenty two inches = one foot
 twenty three inches = one foot
 twenty four inches = one foot
 twenty five inches = one foot
 twenty six inches = one foot
 twenty seven inches = one foot
 twenty eight inches = one foot
 twenty nine inches = one foot
 thirty inches = one foot
 thirty one inches = one foot
 thirty two inches = one foot
 thirty three inches = one foot
 thirty four inches = one foot
 thirty five inches = one foot
 thirty six inches = one foot
 thirty seven inches = one foot
 thirty eight inches = one foot
 thirty nine inches = one foot
 forty inches = one foot
 forty one inches = one foot
 forty two inches = one foot
 forty three inches = one foot
 forty four inches = one foot
 forty five inches = one foot
 forty six inches = one foot
 forty seven inches = one foot
 forty eight inches = one foot
 forty nine inches = one foot
 fifty inches = one foot
 fifty one inches = one foot
 fifty two inches = one foot
 fifty three inches = one foot
 fifty four inches = one foot
 fifty five inches = one foot
 fifty six inches = one foot
 fifty seven inches = one foot
 fifty eight inches = one foot
 fifty nine inches = one foot
 sixty inches = one foot
 sixty one inches = one foot
 sixty two inches = one foot
 sixty three inches = one foot
 sixty four inches = one foot
 sixty five inches = one foot
 sixty six inches = one foot
 sixty seven inches = one foot
 sixty eight inches = one foot
 sixty nine inches = one foot
 seventy inches = one foot
 seventy one inches = one foot
 seventy two inches = one foot
 seventy three inches = one foot
 seventy four inches = one foot
 seventy five inches = one foot
 seventy six inches = one foot
 seventy seven inches = one foot
 seventy eight inches = one foot
 seventy nine inches = one foot
 eighty inches = one foot
 eighty one inches = one foot
 eighty two inches = one foot
 eighty three inches = one foot
 eighty four inches = one foot
 eighty five inches = one foot
 eighty six inches = one foot
 eighty seven inches = one foot
 eighty eight inches = one foot
 eighty nine inches = one foot
 ninety inches = one foot
 ninety one inches = one foot
 ninety two inches = one foot
 ninety three inches = one foot
 ninety four inches = one foot
 ninety five inches = one foot
 ninety six inches = one foot
 ninety seven inches = one foot
 ninety eight inches = one foot
 ninety nine inches = one foot
 one hundred inches = one foot

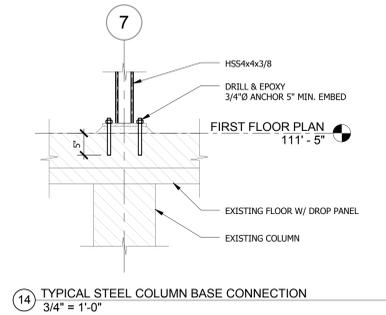


14 TYPICAL STEEL COLUMN BASE CONNECTION
 3/4" = 1'-0"

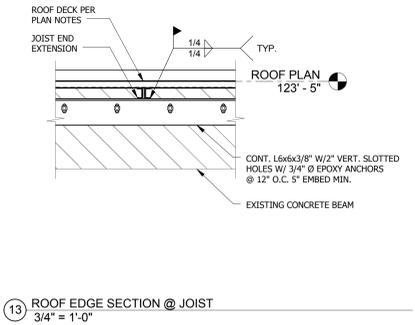


13 ROOF EDGE SECTION @ JOIST
 3/4" = 1'-0"

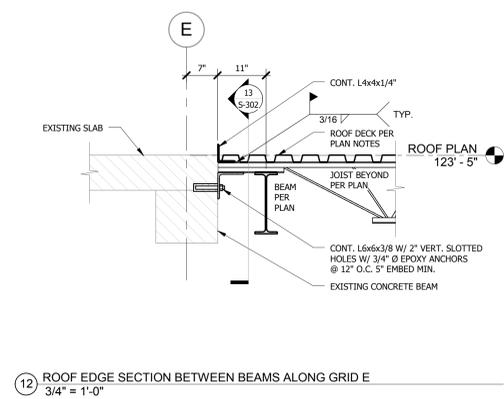


12 ROOF EDGE SECTION BETWEEN BEAMS ALONG GRID E
 3/4" = 1'-0"

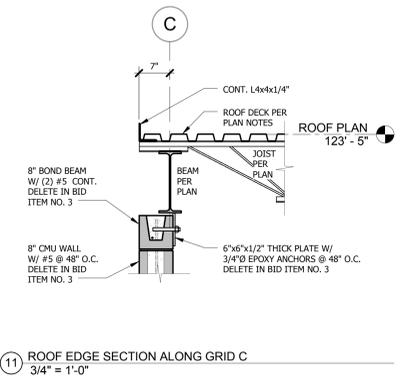


11 ROOF EDGE SECTION ALONG GRID C
 3/4" = 1'-0"

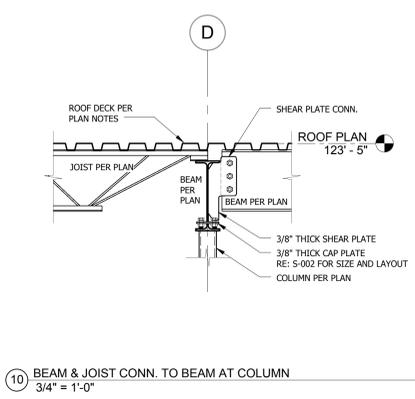


10 BEAM & JOIST CONN. TO BEAM AT COLUMN
 3/4" = 1'-0"

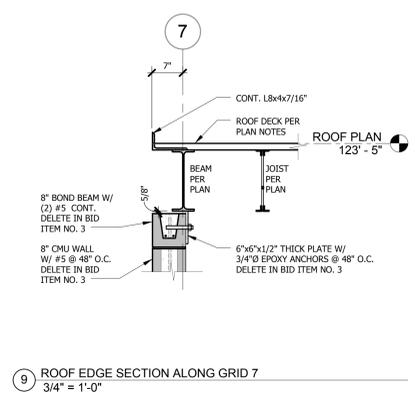


9 ROOF EDGE SECTION ALONG GRID 7
 3/4" = 1'-0"

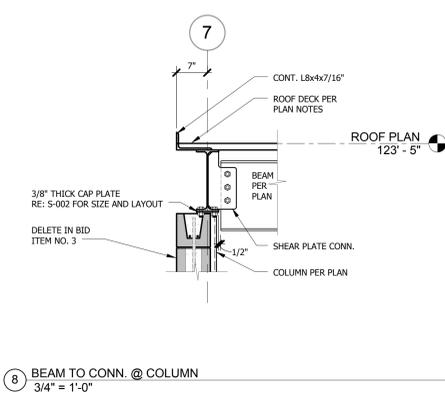


8 BEAM TO CONN. @ COLUMN
 3/4" = 1'-0"

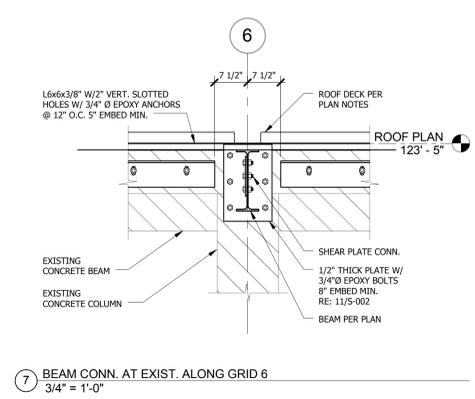


7 BEAM CONN. AT EXIST. ALONG GRID 6
 3/4" = 1'-0"

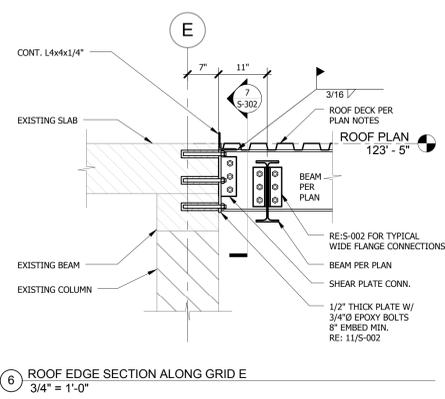


6 ROOF EDGE SECTION ALONG GRID E
 3/4" = 1'-0"

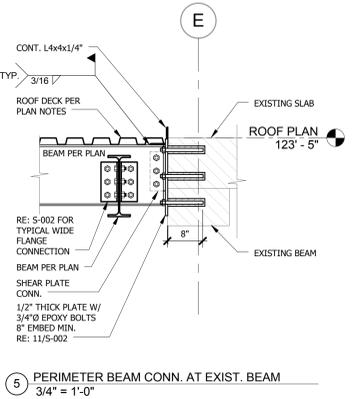


5 PERIMETER BEAM CONN. AT EXIST. BEAM
 3/4" = 1'-0"

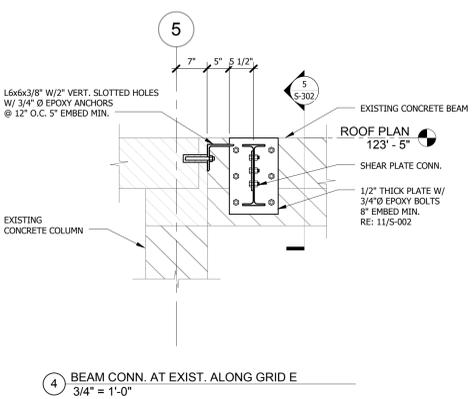


4 BEAM CONN. AT EXIST. ALONG GRID E
 3/4" = 1'-0"

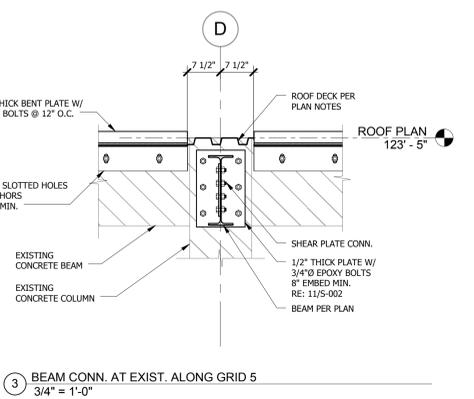

3 BEAM CONN. AT EXIST. ALONG GRID 5
 3/4" = 1'-0"

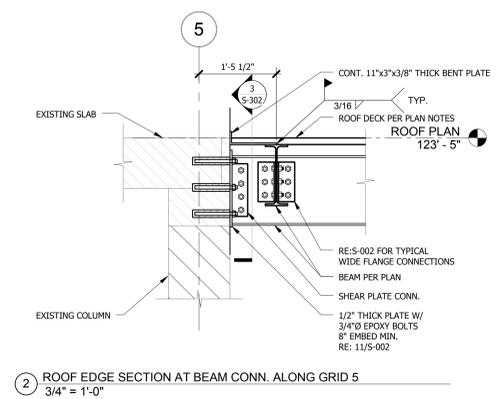

2 ROOF EDGE SECTION AT BEAM CONN. ALONG GRID 5
 3/4" = 1'-0"

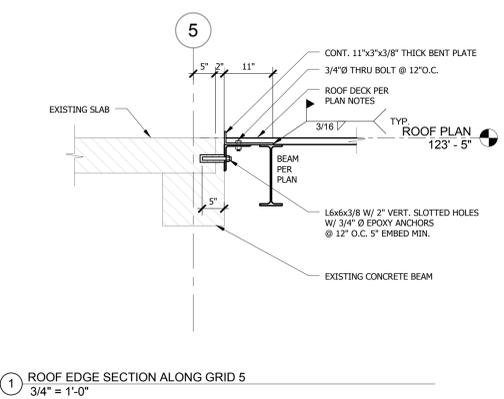

1 ROOF EDGE SECTION ALONG GRID 5
 3/4" = 1'-0"

CONSULTANTS:
 LEIGH AND O'KANE: STRUCTURAL ENGINEERS
 INSITE GROUP: MECHANICAL, ELECTRICAL, AND PLUMBING ENGINEERS
 FSC: FIRE PROTECTION AND CODE CONSULTANT
 PRBALANCE: COMMISSIONING AGENT
 CMR: ESTIMATING



ARCHITECT:

WELLNER architects inc
 802 Broadway . 4th Floor . Kansas City . MO . 64105
 p.816.221.0017 f.816.221.9456 e.wai@wellner.com

Drawing Title
SECTIONS
 Approved:

Project Title
WOMEN'S CLINIC ADDITION
 Project Number
589A7-CSI-403
 Building Number
B29
 Drawing Number
S-302
 Location
 5500 E. KELLOGG WICHITA KS
 Date
 JUNE 29th, 2016
 Checked
 WNH
 Drawn
 CMS
 Dwg 35 of 55

OFFICE OF CONSTRUCTION AND FACILITIES MANAGEMENT
 Department of Veterans Affairs