

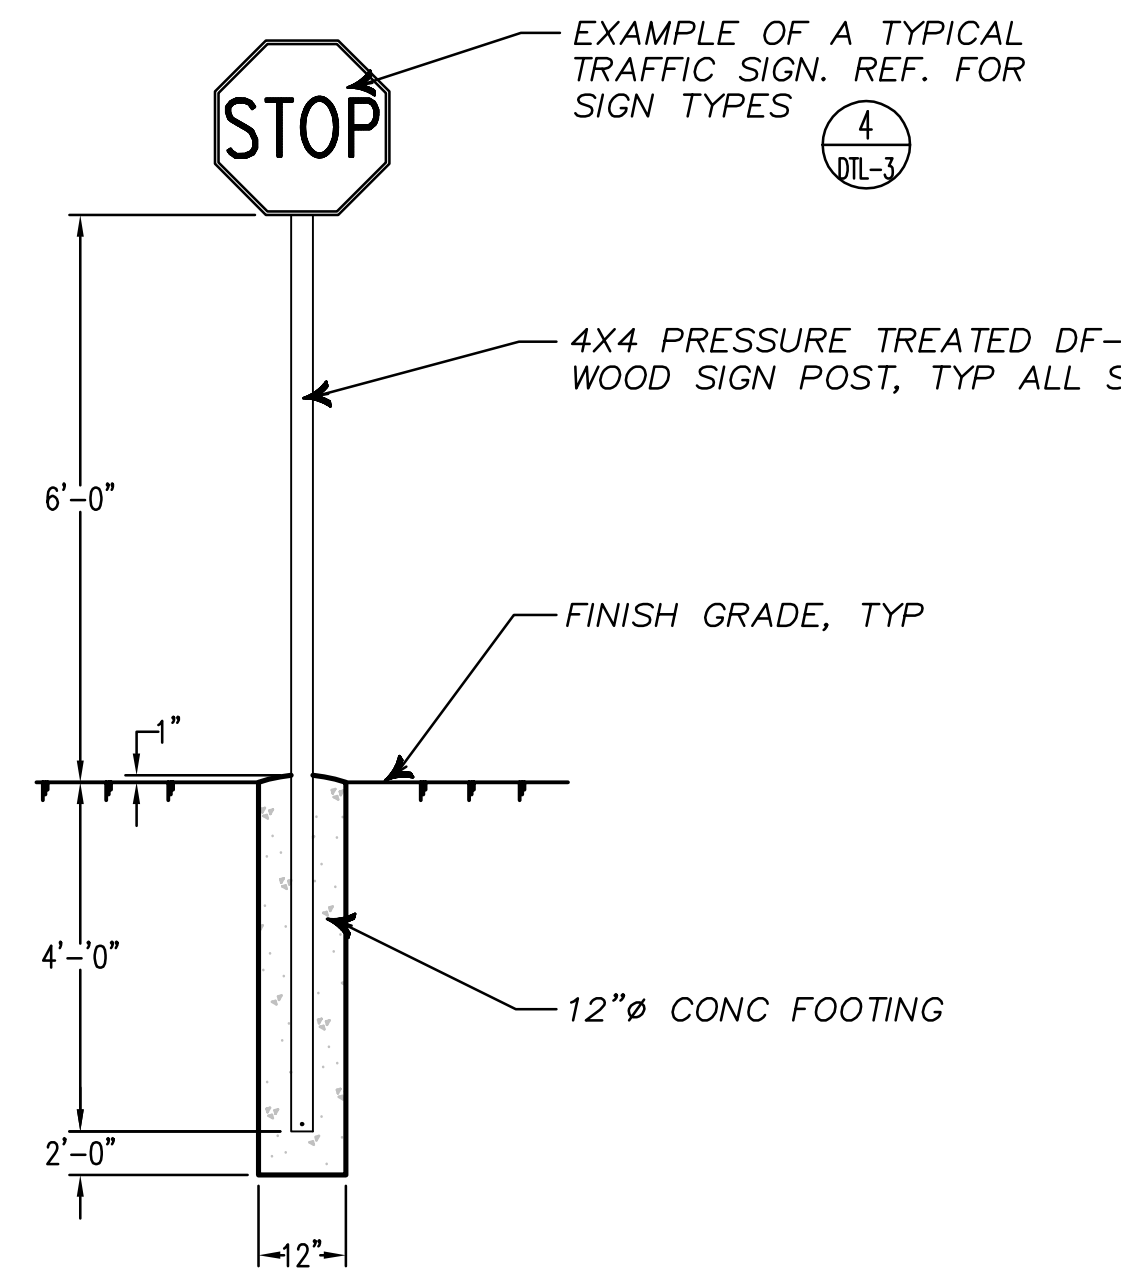



4 TRAFFIC CONTROL SIGNS  
DTL-3 VARIES 1-1/2" & 1" TO 1"

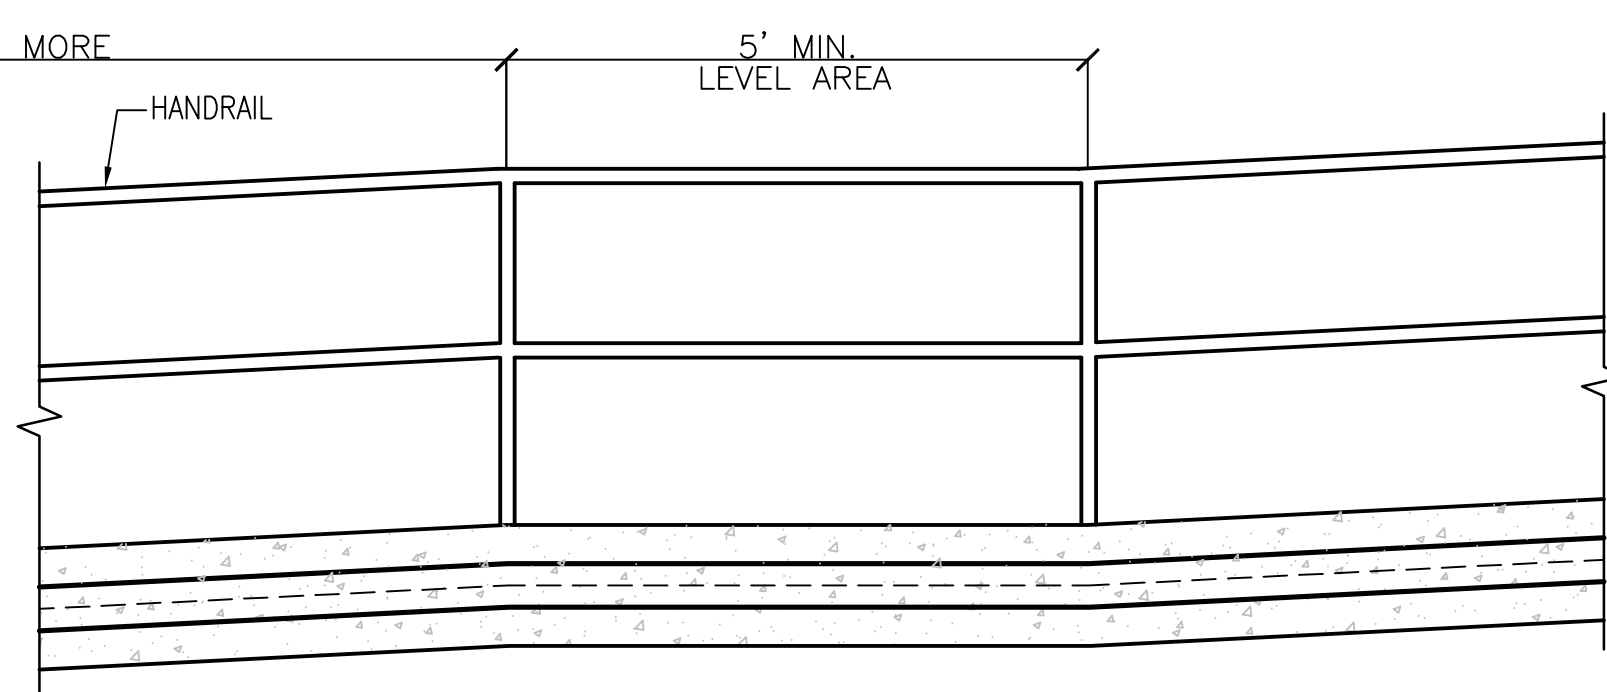

5 SIGN POST DETAIL  
DTL-3 1/2"=1'-0"

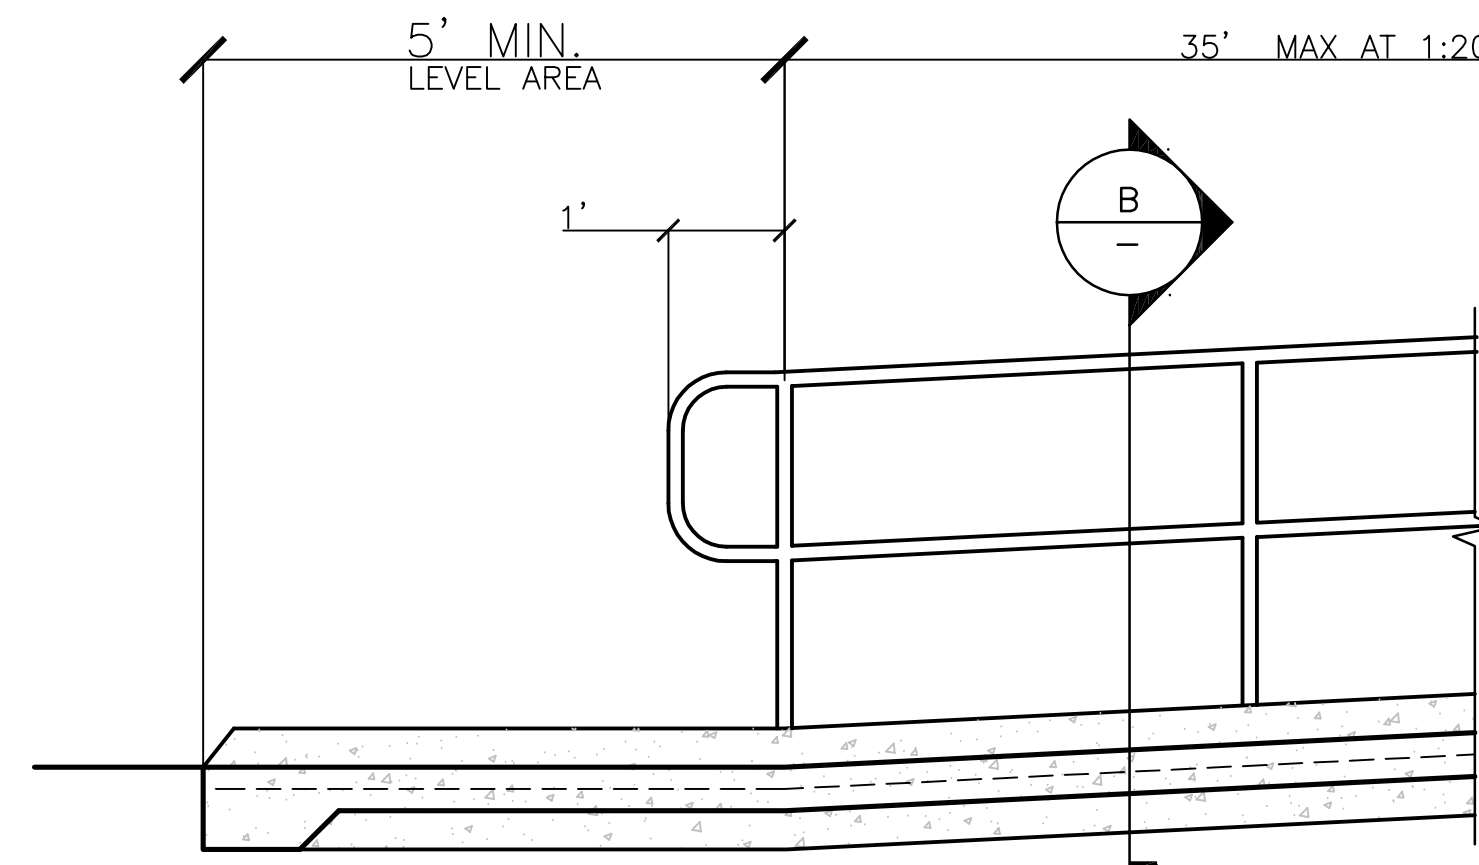


LONGITUDINAL SECTION A

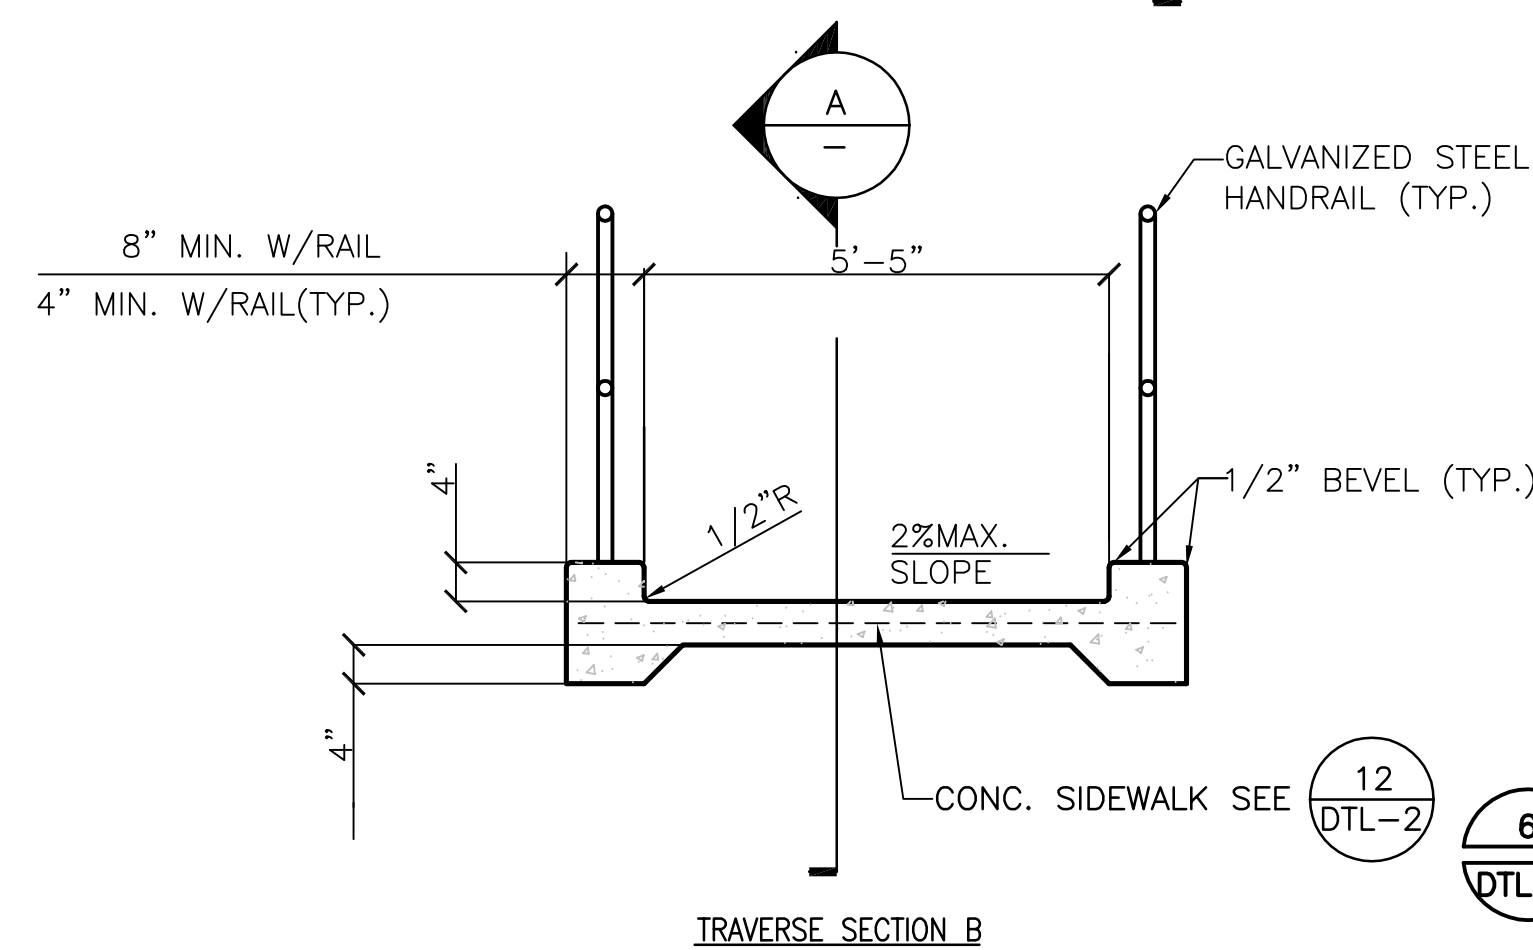


TRAVERSE SECTION B

6 RAMP FOR DISABLED PERSONS  
DTL-3 N.T.S.


- NOTE:
1. MAXIMUM SLOPE OF RAMP SHALL NOT EXCEED 5%.
  2. USE WITH STAIRS.

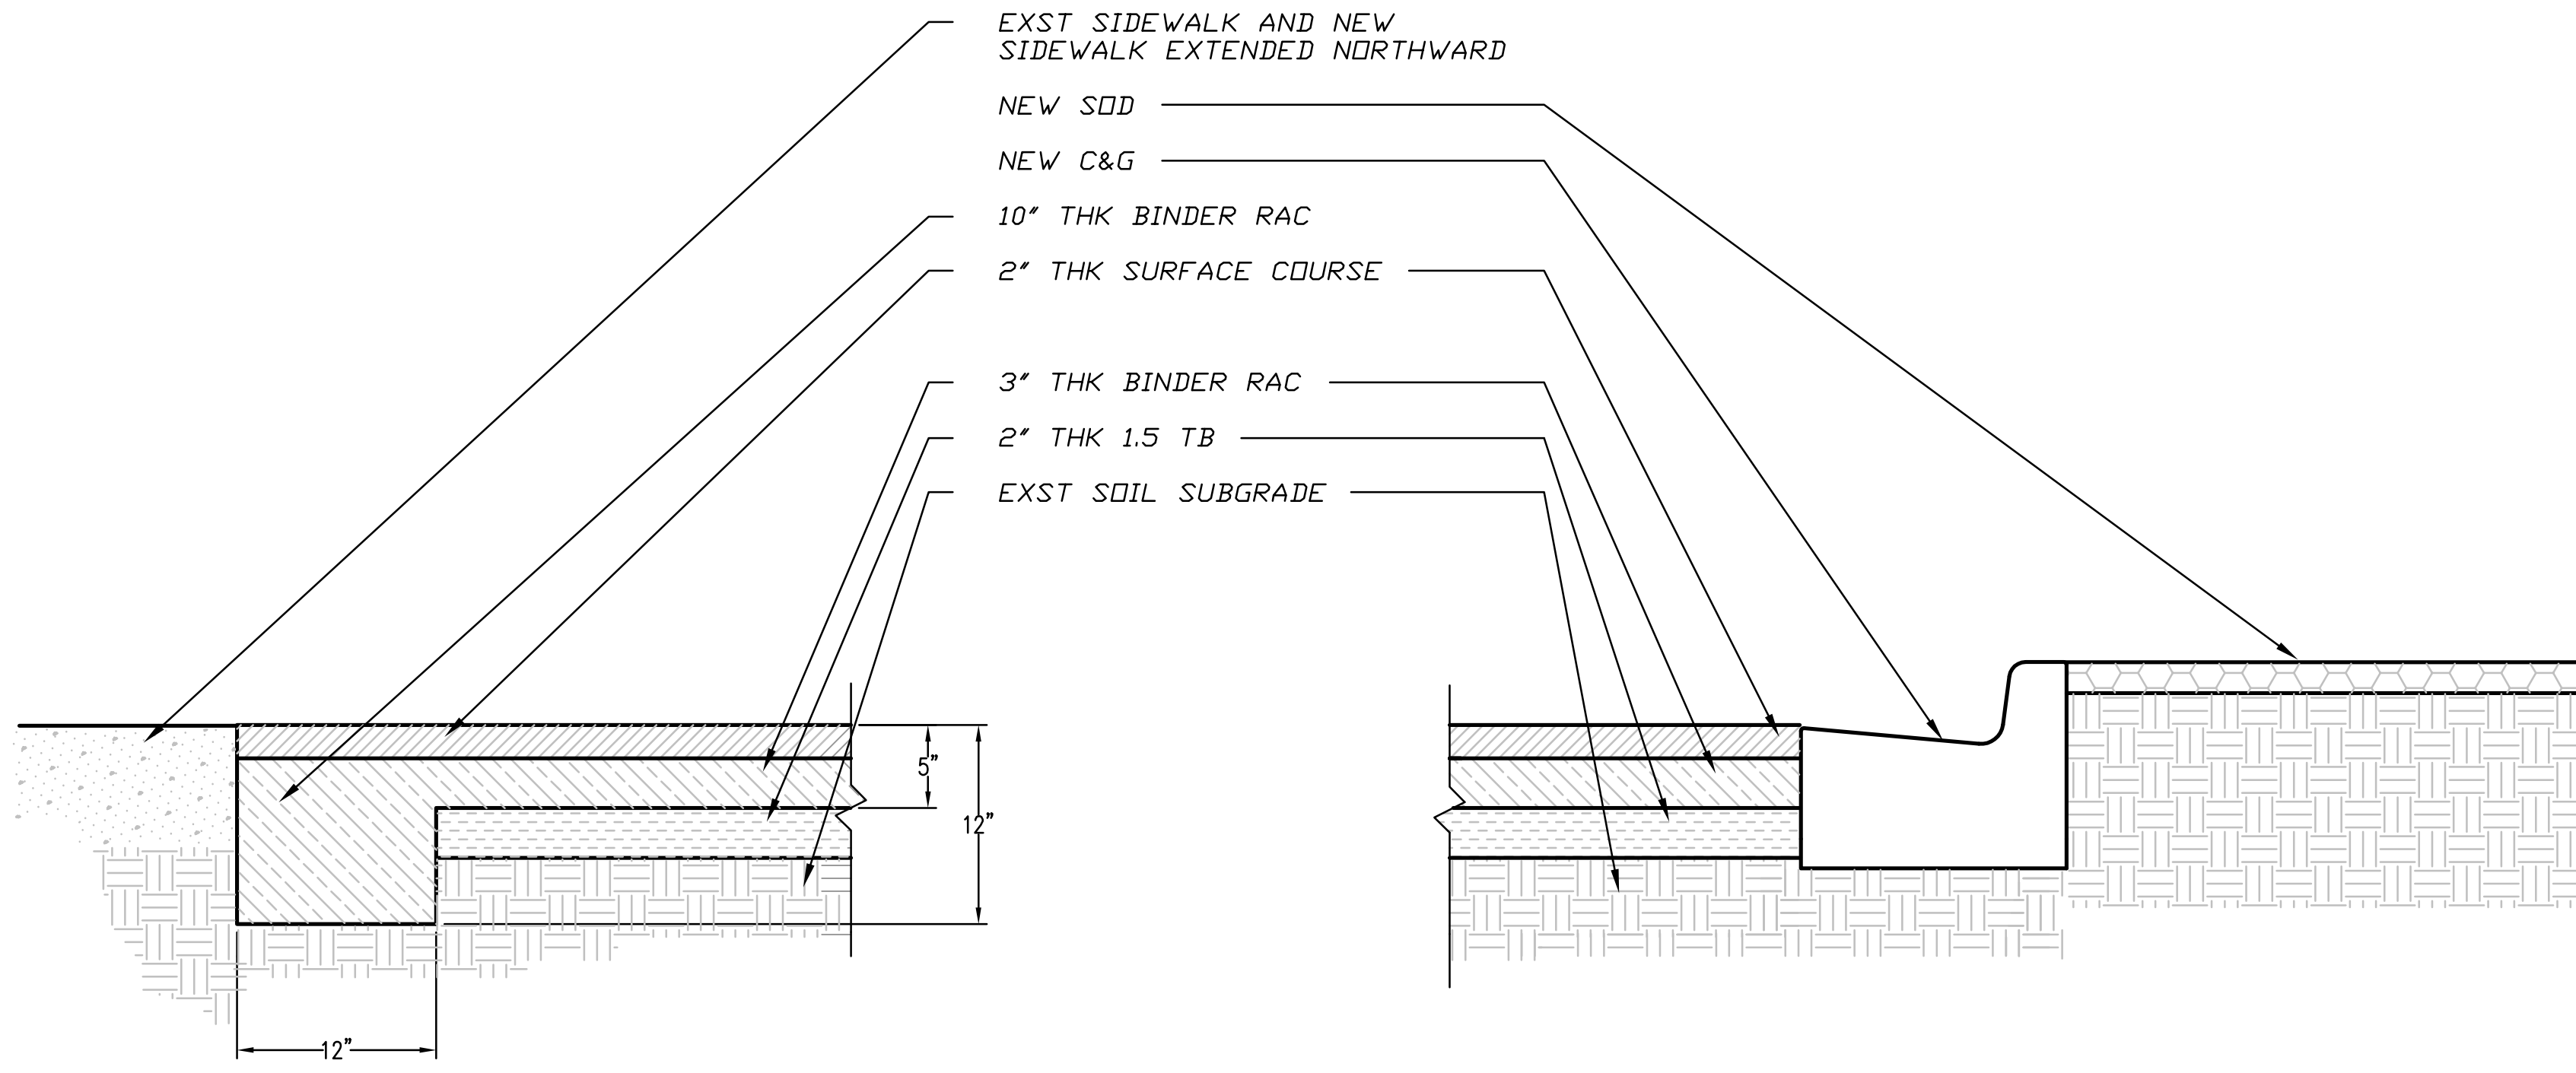


1 ASPHALT PARKING LOT DETAIL  
DTL-3 1/8"=2"

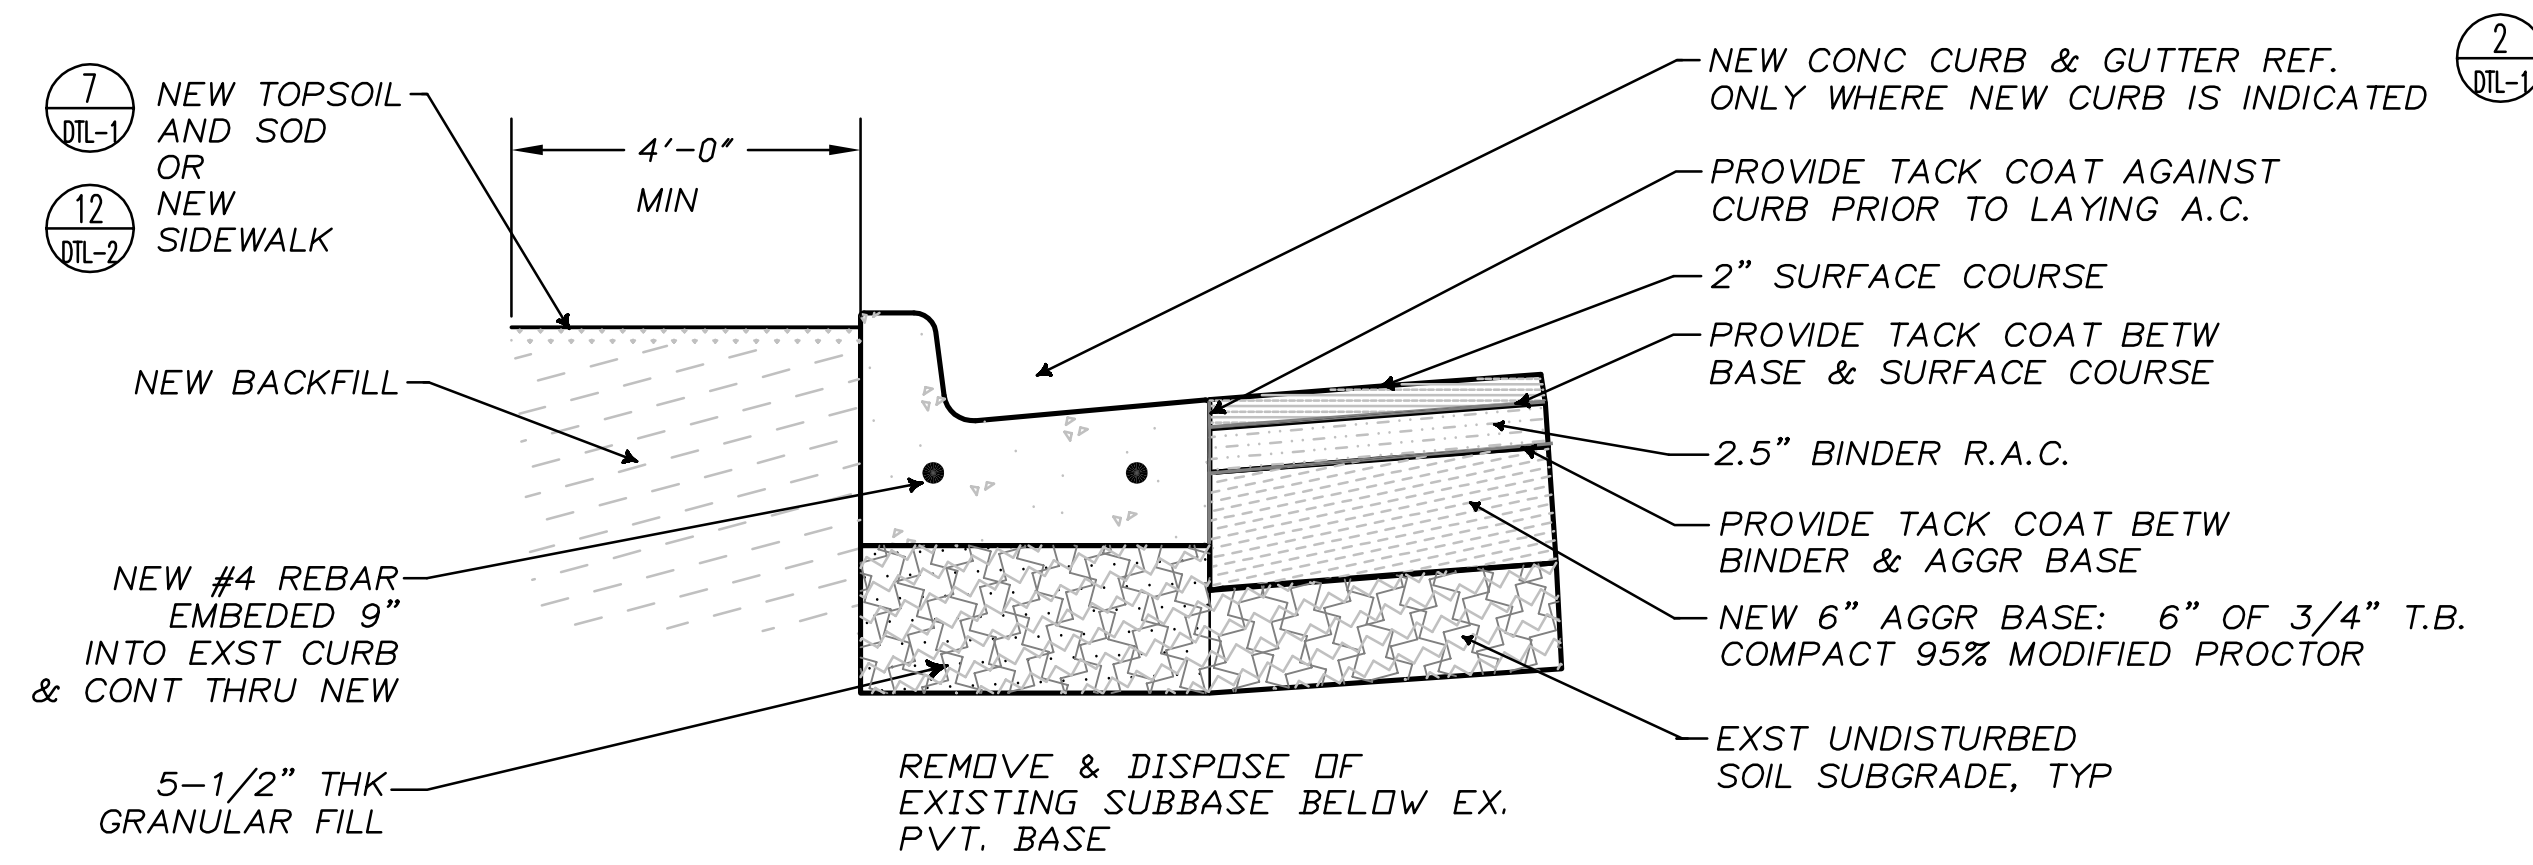

2 ROAD REPAIR W/TYPE 2 CURB & GUTTER  
DTL-3 1"=1'-0"

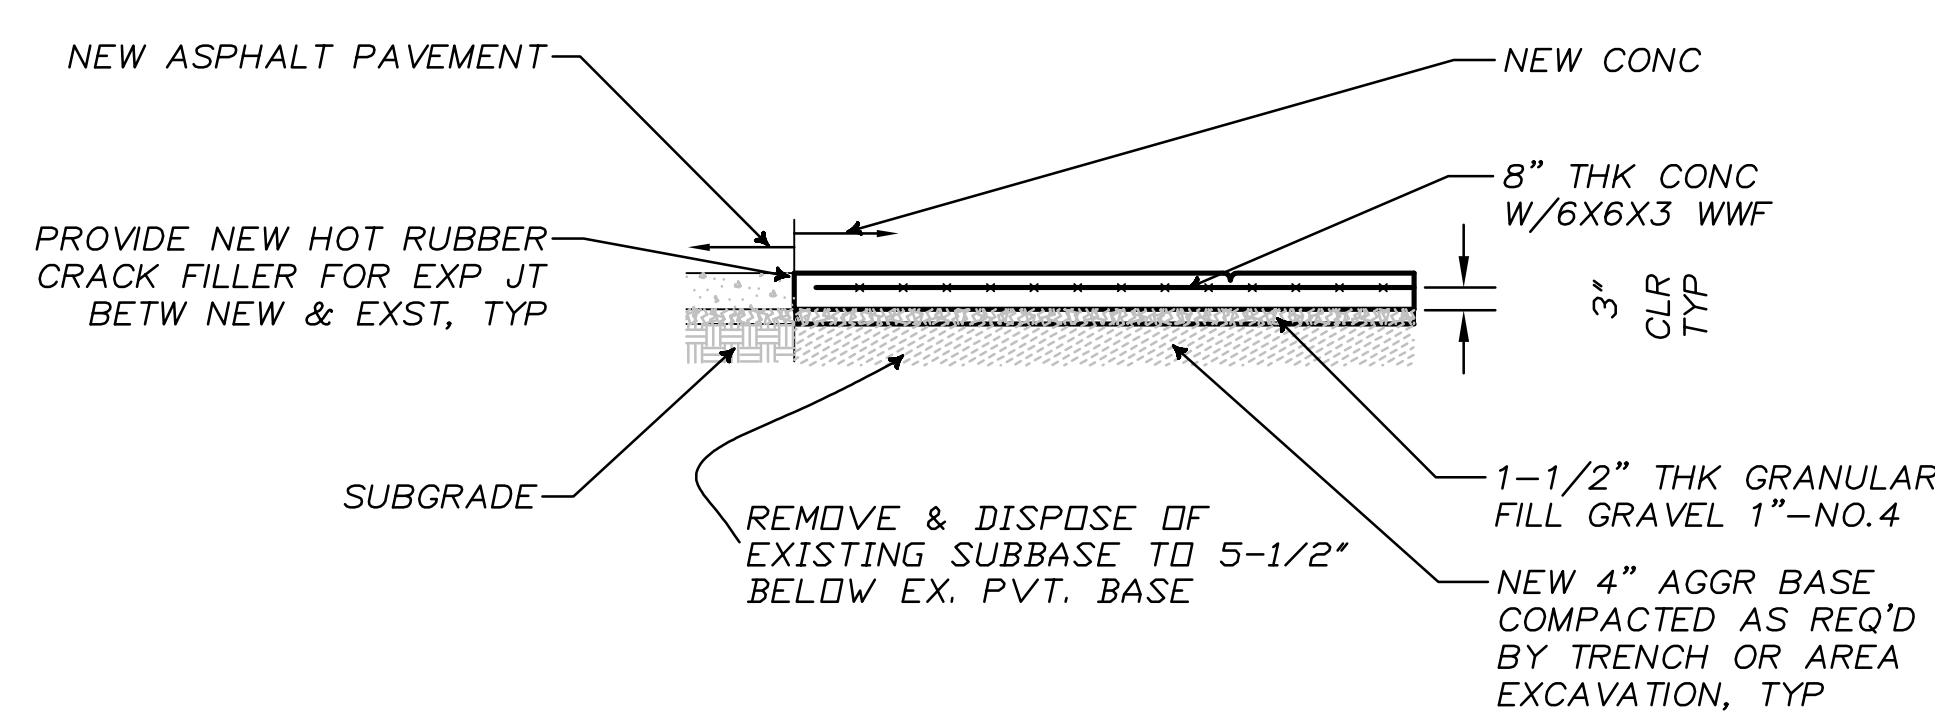

3 CONCRETE PAVEMENT  
DTL-3 1/2"=1'-0"

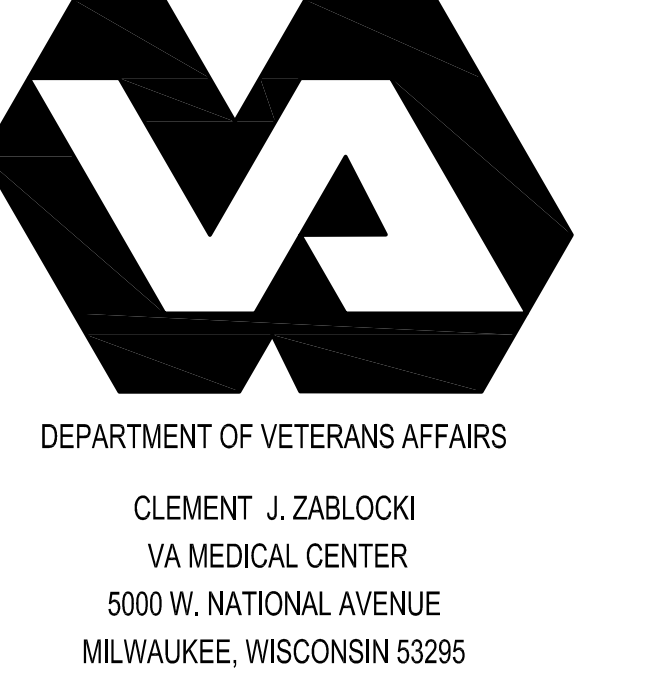

## SITE RESURFACE PARKING LOTS 4-15

### CONSTRUCTION CLASS:

- FIRE RESISTIVE TYPE A, NUMBER 1 (COMM, S/B)
- INTERIOR SUPPORTS: NC-4
  - FLOOR FRAMING: NC-3
  - ROOF FRAMING: NC-2
  - ROOF COVERING: CLASS A
  - EXTERIOR WALLS:
    - BEARING (OVER 30' FROM P.I.): NC-2
    - NON-BEARING (OVER 30' FROM P.I.): NC-0
  - INTERIOR BEARING WALLS: NC-3
  - PARTITIONS: NC-0
  - REQUIRED EXIT CORRIDOR ENCLOSURES: NC-2
  - PENTHOUSE WALLS: NC-0
  - PENTHOUSE ROOF: NC-0

### TYPE 1 (443) (NFPA 220)

- COLUMNS SUPPORTING MORE THAN 1 FLOOR: 4
- BEAMS SUPPORTING 1 FLOOR OR ROOF ONLY: 3
- FLOOR CONSTRUCTION: 3
- ROOF CONSTRUCTION: 2
- EXTERIOR BEARING WALLS: 4
- EXTERIOR NON-BEARING WALLS: 0
- INTERIOR BEARING WALLS: 3

### OCCUPANCY CHAPTER:

- ALL LEVELS:
- 58 - HEALTH CARE, DETENTION & CORRECTIONAL FACILITIES (COMM, S/B)

### EXIT SIGNS



### FIRE EXTINGUISHERS



MAX. TRAVEL: 75'-0"

PROVIDE (5) 3-A RATED FULLY RECESSED EXTINGUISHERS, UNLESS FEC (FIRE EXTINGUISHER CABINET) IS DENOTED BY SR WHICH MEANS SEMI-RECESSED.

MAXIMUM HEIGHT TO TOP OF FIRE EXTINGUISHER CABINET PER VA REGULATIONS = 53" A.F.F.

REVISION	DATE
----------	------

## DETAIL SHEET 3

VA PROJECT NO.

BLDG. NO.	AS SHOWN
SCALE	May, 2012
DATE	mm
DRAWN	

## CHECK PRINT

DTL-3