

RECORD DRAWING	1/5/95
Revisions	None


ORIGINAL
ASBUILT

REFERENCE DRAWINGS ONLY
NOT FOR CONSTRUCTION

DISCLAIMER

THIS DOCUMENT IS AN ORIGINAL ASBUILT DRAWING FROM WHICH THE MECHANICAL SYSTEM SHOWN WAS CONSTRUCTED. THIS DRAWING SHALL BE USED AS A REFERENCE DOCUMENT ONLY. SINCE THE TIME OF CONSTRUCTION SOME AREAS MAY HAVE BEEN RENOVATED, THEREFORE IT IS YOUR RESPONSIBILITY TO FIELD VERIFY ALL AREAS OF CONCERN TO VALIDATE THE MOST CURRENT ACCURACY. PRIOR TO MODIFYING OR MAKING ANY CHANGES TO THE SYSTEM.


042-PHASE4_1-H38

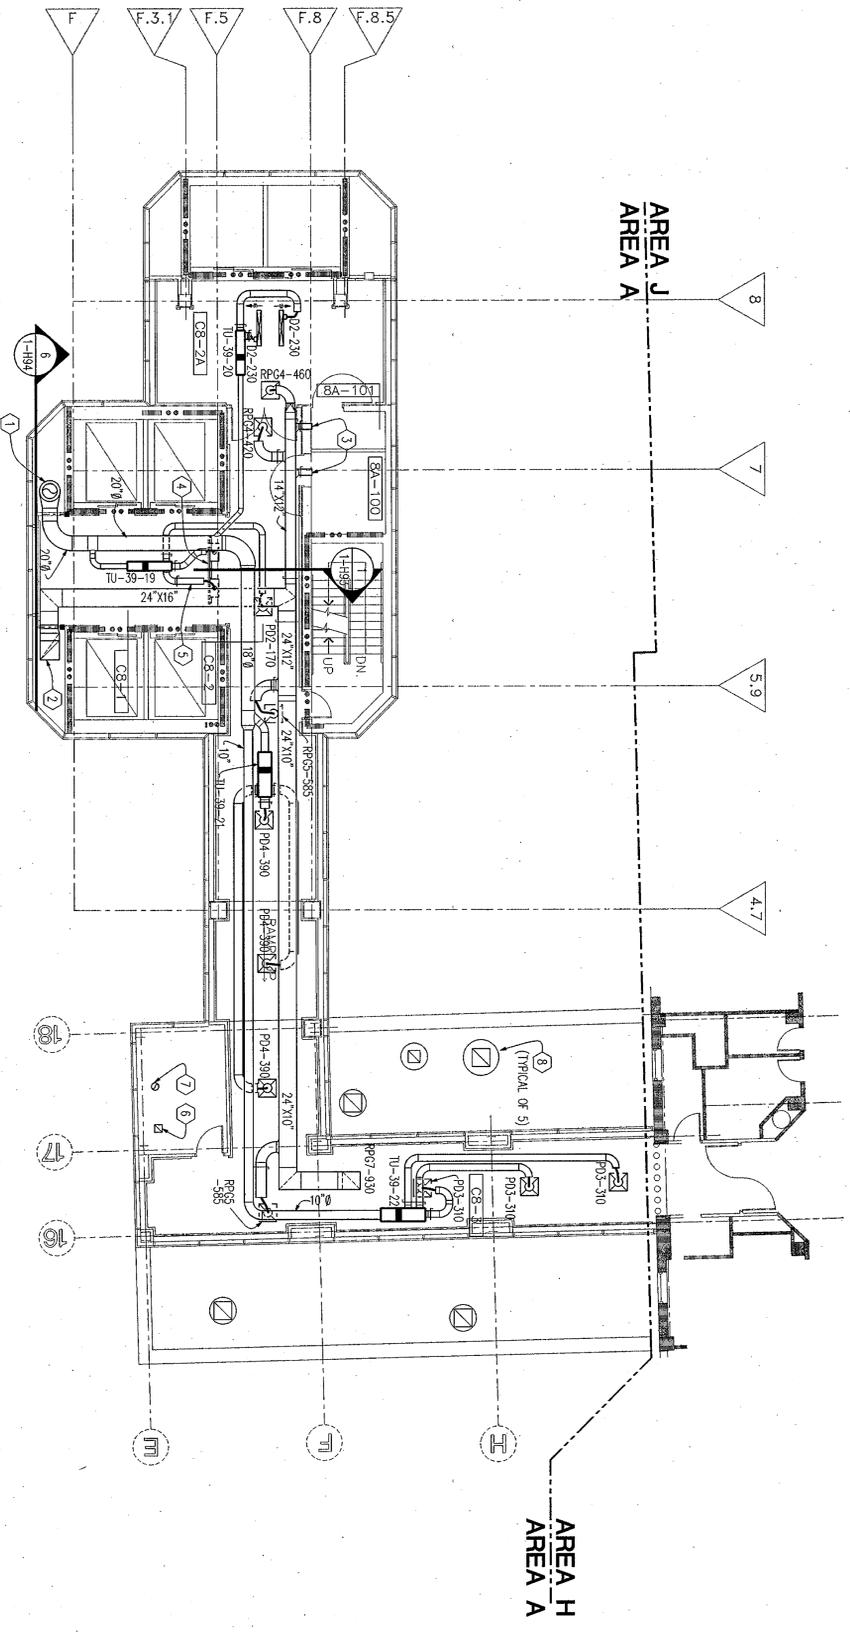

ROOM SCHEDULE		
8A-100	ELECTRICAL	8C-2A SERV ELEV LOBBY
8A-101	TELEPHONE	8C-3 CORRIDOR
8B-1	PASS. ELEV LOBBY	8-802 EXIST. WOMEN
8B-2	CORRIDOR	8-803 EXIST. DARKRM.

PLAN NOTES

- 1) 20" SUPPLY UP AND 28" SUPPLY DOWN (1-AC4). SEE ELEVATOR PENHOUSE HVAC PLAN AREA-A SHEET 1-H38 AND SEVENTH FLOOR HVAC PLAN AREA-A SHEET 1-H37 FOR CONTINUATION.
- 2) 26"28" RETURN UP AND 26"28" RETURN DOWN (1-RE39). SEE ELEVATOR PENHOUSE HVAC PLAN AREA-A SHEET 1-H38 AND SEVENTH FLOOR HVAC PLAN AREA-A SHEET 1-H37 FOR CONTINUATION.
- 3) EXTEND 8"x4" RETURN THROUGH WALL AS SHOWN. PROVIDE ENG OVER OPENING. BALANCE TO 50 CFM. TYPICAL OF TWO.
- 4) 6" x 7" LINEAR BAR DIFFUSER. CENTER DIFFUSER IN BALK-HEAD AND STOP 3" SHORT ON BOTH ENDS. FIELD VERIFY EXACT LENGTH. PROVIDE BLANK-OFFS ON UNUSED PORTIONS.
- 5) ROUTE 8" x AS SHOWN TO 12" x 12" x 24" BOOT. SPACE SPACE BOOTS EQUAL ON DIFFUSER. EXTERNALLY INSULATE BOOT AND PAINT REMAINDER OF BOOTS FLAT BLACK. BALANCE TO 175 CFM. TYPICAL OF TWO.
- 6) 10"X10" EXHAUST UP AND DOWN. SEE SHEETS 1-H37 AND 1-H32 FOR CONTINUATION.
- 7) 10" HOOD EXHAUST UP AND DOWN. SEE SHEETS 1-H37 AND 1-H32 FOR CONTINUATION.
- 8) EXISTING POWER ROOF VENTILATOR TO REMAIN.

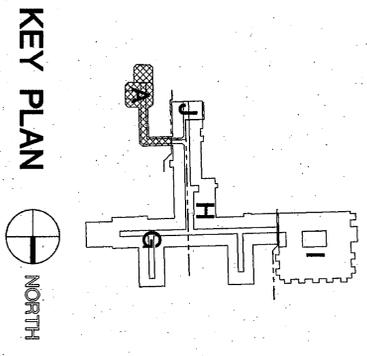

8-1-2-1564

FULLY PROTECTED BY AUTOMATIC SPRINKLER SYSTEM

Showing This
EIGHTH FLOOR
HVAC PLAN
AREA A

Location	WEST TENTH STREET
Building Number	#1
PROJECT NUMBER	583-12-159
Drawing Number	H-90
XFV012	
Dwg. 82 of 185	

Engineering and Facilities Management Services