
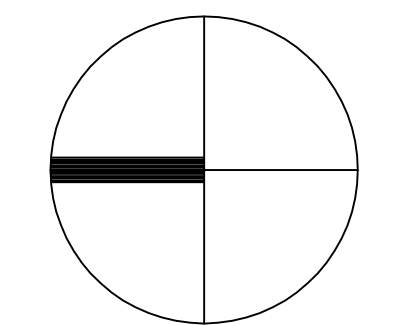


**# KEYED NOTES:** (FOR BOTH PLAN & PROFILES ON THIS SHEET)


1. REMOVE EXISTING WATER SERVICE LINE. SEE ABANDONMENT/REMOVAL PLANS CU100 & CU101.
2. ABANDON EXISTING WATER SERVICE LINE IN PLACE. SEE ABANDONMENT/REMOVAL PLANS CU100 & CU101.
3. POTENTIAL TREE IMPACT. SEE RESTORATION PLANS CU200 & CU201.
4. REMOVE EXISTING HYDRANT AND REMOVE EXISTING WATER SERVICE LINE.
5. UNDERGROUND TUNNEL LOCATIONS ARE BASED ON VA RECORD DRAWINGS, CONTRACTOR TO FIELD VERIFY LOCATION OF TUNNELS. PORTIONS OF TUNNELS HAVE BEEN REMOVED BY BUILDING 53. CONTRACTOR SHALL PROVIDE AND INSTALL ALL MECHANICAL FITTINGS TO REROUTE THE PROPOSED WATERMAIN AROUND THE EXISTING TUNNELS.
6. WATERMAIN ROUTING UNDER MOUNTAIN 12' WATERMAIN LOOP AROUND BUILDING 53. ABANDON EXISTING LINE NOT SERVICING BUILDING 53 AND NOT PART OF THE EXISTING 12' WATERMAIN LOOP. CONTRACTOR SHALL FIELD VERIFY WHICH SECTION TO WATERMAIN HAS BEEN ABANDONED OR CAN BE ABANDONED.



**NOTES:** (FOR BOTH PLAN & PROFILES ON THIS SHEET)

1. EXISTING UTILITIES ARE SHOWN FOR INFORMATIONAL PURPOSES ONLY. THE VA AND ENGINEER NEITHER ASSUME OR IMPLY RESPONSIBILITY FOR THE ACCURACY OR COMPLETENESS OF UTILITY DATA PRESENTED. ALL EXISTING TOPOGRAPHY, UNDERGROUND UTILITIES, STRUCTURES AND ASSOCIATED FACILITIES SHOWN ON THE DRAWINGS ARE BASED ON AVAILABLE SURVEYS AND RECORD DRAWINGS. THEREFORE, THEIR LOCATIONS AND ELEVATIONS MUST BE CONSIDERED APPROXIMATELY ONLY. THERE MAY BE ADDITIONAL FACILITIES, STRUCTURES, UTILITIES WHICH THEIR EXISTENCE ARE NOT PRESENTLY KNOWN. ACTUAL LOCATIONS OF UTILITIES MAY VARY FROM LOCATIONS SHOWN ON THE PLANS.
2. THE CONTRACTOR IS RESPONSIBLE FOR MAKING HIS OWN DETERMINATION AS TO THE TYPE AND LOCATION OF UNDERGROUND UTILITIES AS MAY BE NECESSARY TO AVOID CONFLICTS AND DAMAGE THERETO. CONTRACTOR SHALL VERIFY ALL FIELD CONDITIONS, ELEVATIONS, STRUCTURES AND FACILITIES AND SHALL REPORT ANY CONFLICTS, ERRORS, DISCREPANCIES OR OMISSIONS, TO THE COTR AND ENGINEER PRIOR TO ORDERING MATERIAL AND STARTING WORK SO THAT CLARIFICATION OR REDESIGN CAN OCCUR IF NECESSARY.
3. EXISTING UTILITY CROSSING IN PROFILE ARE OUTSIDE BOTTOM OF PIPE / STRUCTURE ELEVATIONS.
4. CONTRACTOR SHALL PHASE THE INSTALLATION OF THE LOW PRESSURE AND HIGH PRESSURE WATERMAIN AROUND BUILDING 53 SUCH THAT BOTH DRIVES ARE NOT CLOSED AT THE SAME TIME. CONTRACTOR SHALL COORDINATE THE CLOSURES AROUND BUILDING 53 WITH CATHOLIC CHARITIES, PROJECT ENGINEER AND THE VA.

- TEE - FACING YOU
- TEE - FACING AWAY
- VLV - VALVE BOX
- VV - VALVE VAULT (CONCRETE)



## PHASE 2 - CONSTRUCTION DOCUMENTS: MAY 22, 2012