


- 1.0  
5  
DEMOLITION HVAC  
SCALE: 1/8" = 1'-0"
- (DH1) REMOVE DIFFUSER
  - (DH2) REMOVE DUCT WORK AND ASSOCIATED HANGERS
  - (DH3) DISCONNECT AND CAP TO BE RECONNECTED DURING CONST.
  - (DH4) CAP AT CEILING
  - (DH9) REMOVE VAV AND SAVE FOR REUSE
  - (DH8) REMOVE DRYER VENT IN ITS ENTIRETY

DEMOL. HVAC TO LINE - - - - -

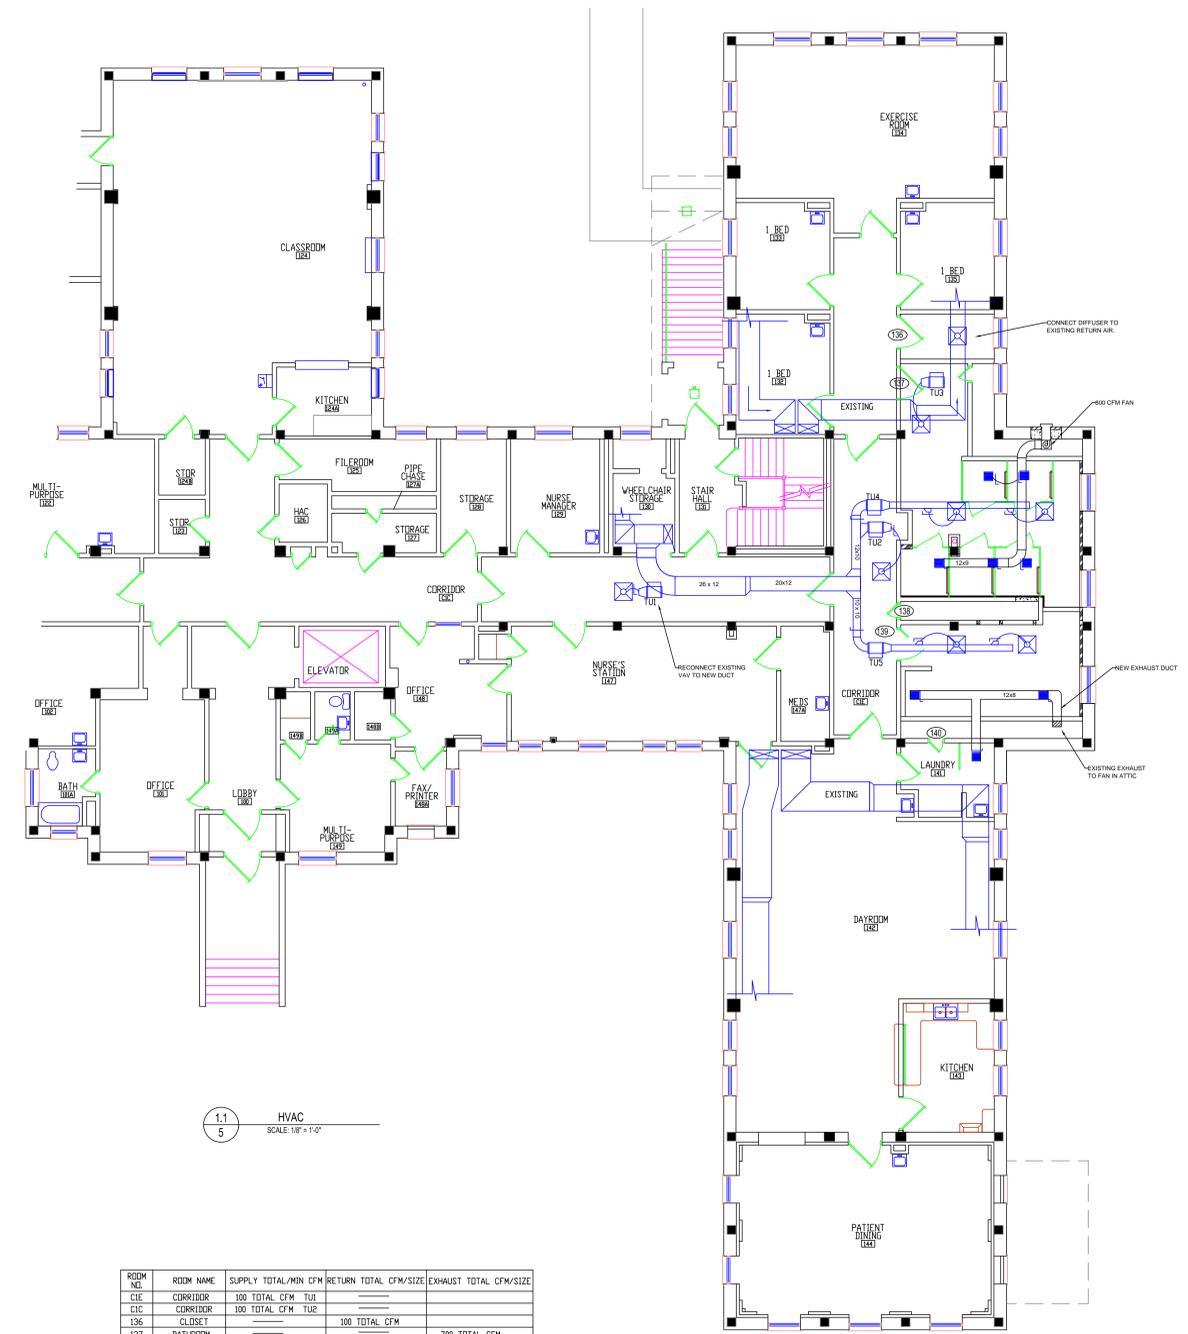

1.1  
5  
HVAC  
SCALE: 1/8" = 1'-0"

ROOM NO.	ROOM NAME	SUPPLY TOTAL/MIN CFM	RETURN TOTAL CFM/SIZE	EXHAUST TOTAL CFM/SIZE
C1E	CORRIDOR	100 TOTAL CFM TL1	---	---
C1E	CORRIDOR	100 TOTAL CFM TL2	---	---
136	CLOSET	---	100 TOTAL CFM	---
137	BATHROOM	---	---	700 TOTAL CFM
137	BATHROOM	180 TOTAL CFM TL3	---	---
137	BATHROOM	360 TOTAL CFM TL4	---	---
139	SHOWERS/TUB ROOM	300 TOTAL CFM TL5	---	350 TOTAL CFM
140	BATHROOM	---	---	150 TOTAL CFM

No.	REVISION	DATE
01	CHANGED DUCT LAYOUT AND ADDED INFORMATION TO VAV TABLE	5/30/12

# RENOVATE BUILDING 48 ADHC BATHROOMS

APPROVED SERVICE LINE DIRECTOR	DATE	APPROVED INFECTION CONTROL NURSE	DATE	DRAWING TITLE	BUILDING 48 HVAC
APPROVED GRAB COORDINATOR	DATE	APPROVED PATIENT SAFETY	DATE	PROJECT TITLE	BUILDING 48 ADULT DAY HEALTHCARE BATHROOM RENOVATION
APPROVED PROJECTS SECTION MANAGER	DATE	APPROVED CHIEF OF POLICE	DATE	DATE	06/21/11
APPROVED DIRECTOR I&M	DATE	APPROVED SAFETY MANAGER	DATE	SCALE	1/8" = 1'-0"
				PROJECT NO.	656-12-215
				ISSUE NO.	002
				ISSUE DATE	05
				ISSUE NO.	05
				ISSUE DATE	05/30/12

**St. Cloud VA Health Care System**  
Brainerd | Montevideo | Alexandria