




B1 RETAINING WALL "A" PROFILE
SCALE: H=1:100 V=1:300
LOCATION: NEXT TO BURIAL SITE XI

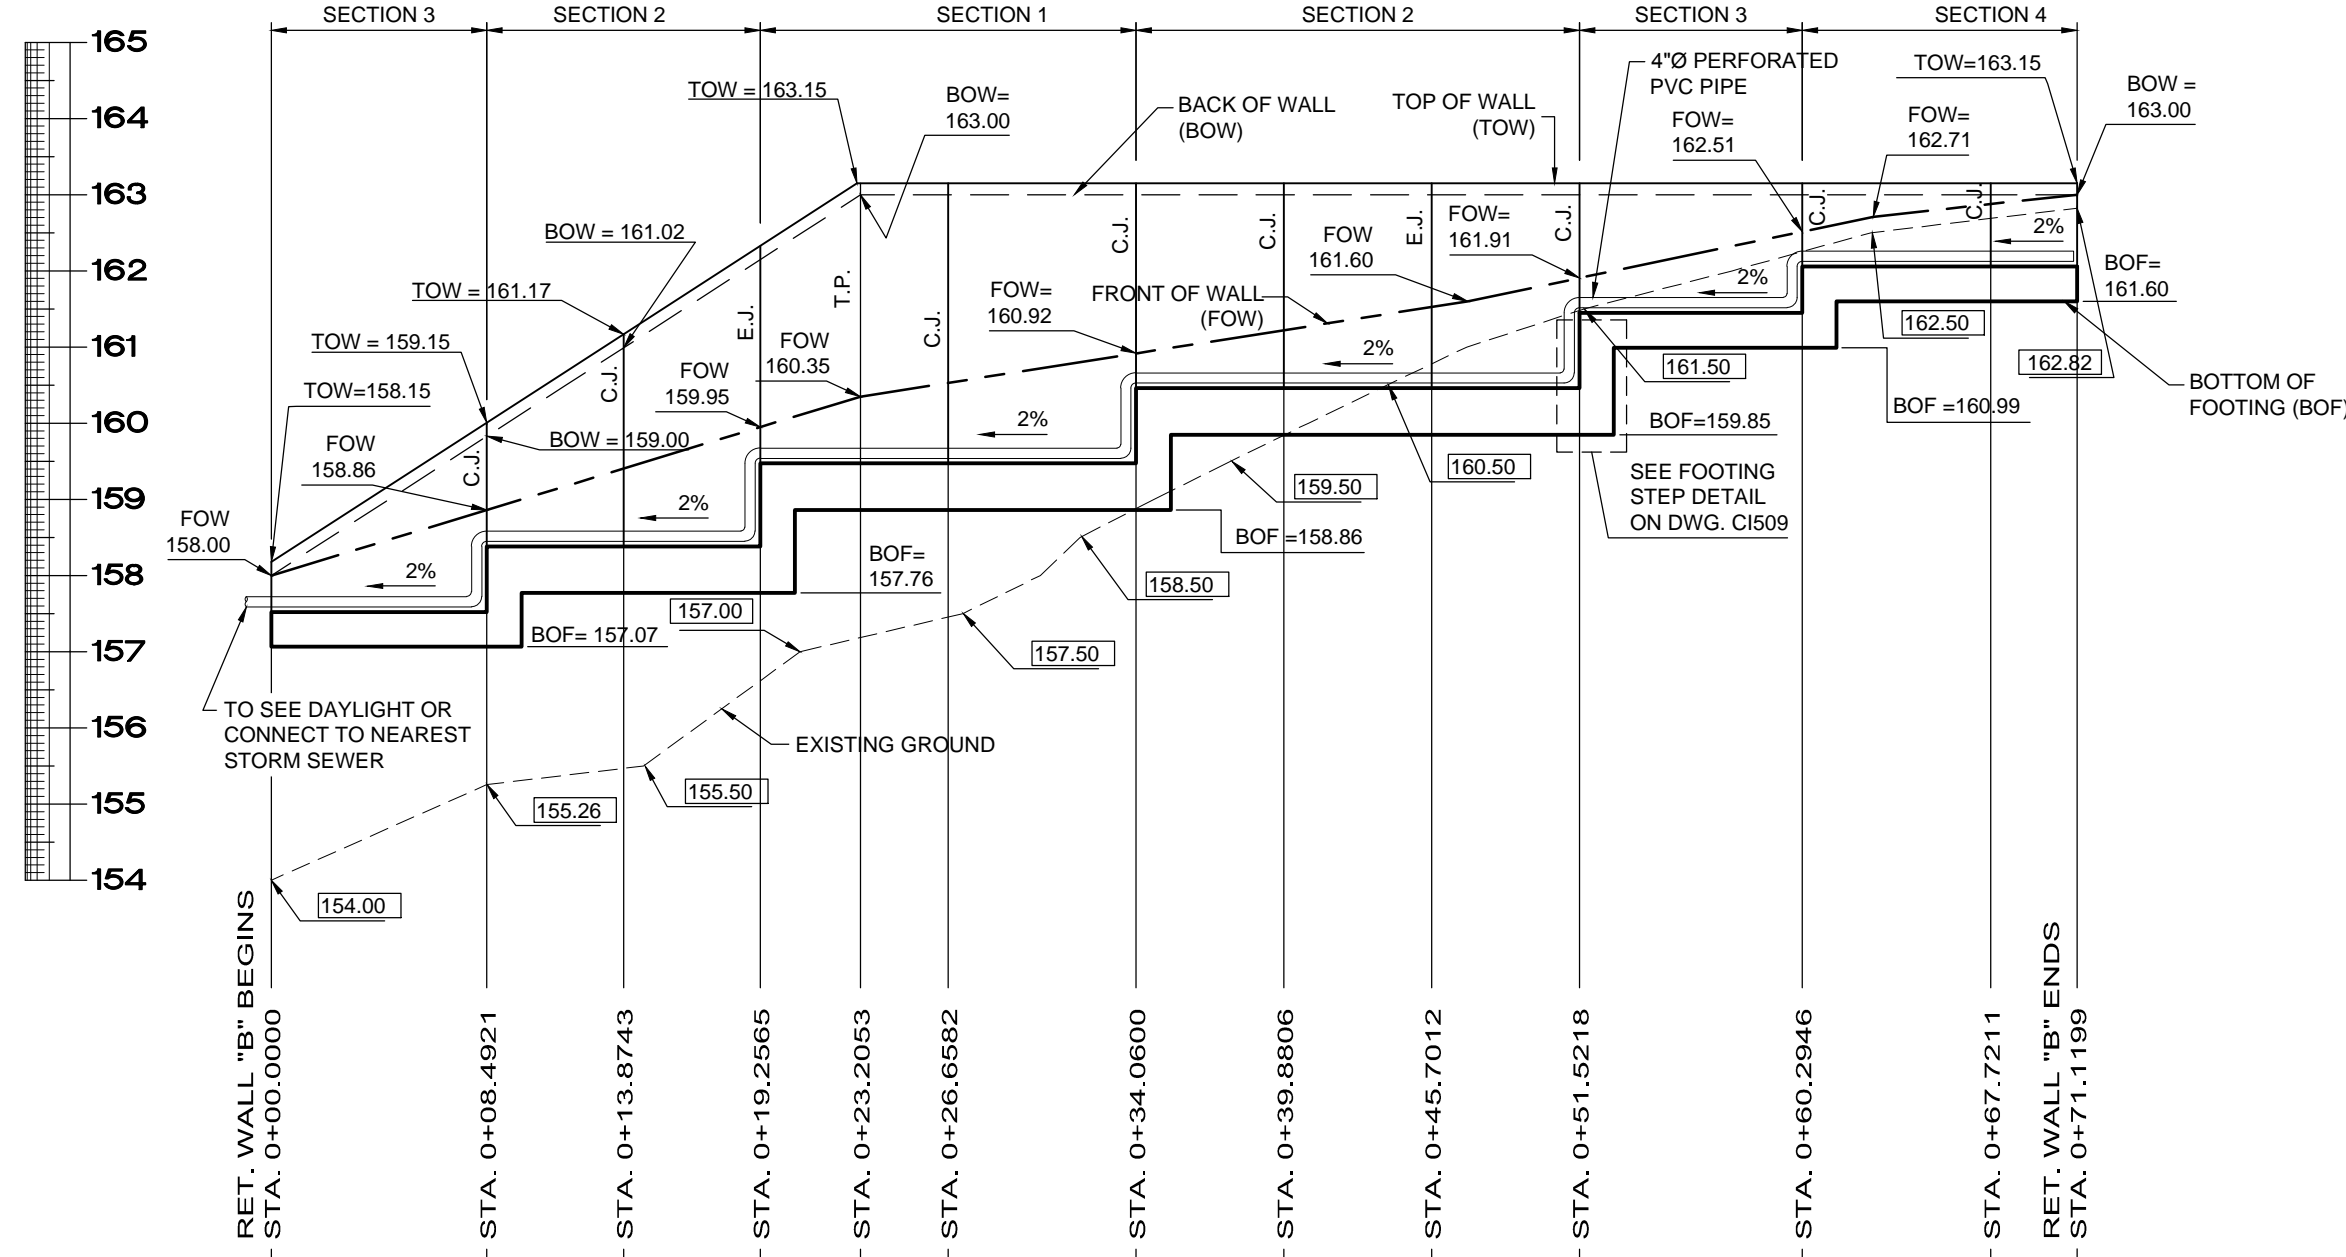

D1 RETAINING WALL "B" PROFILE
SCALE: H=1:100 V=1:300
LOCATION: NEXT TO BURIAL SITE IX

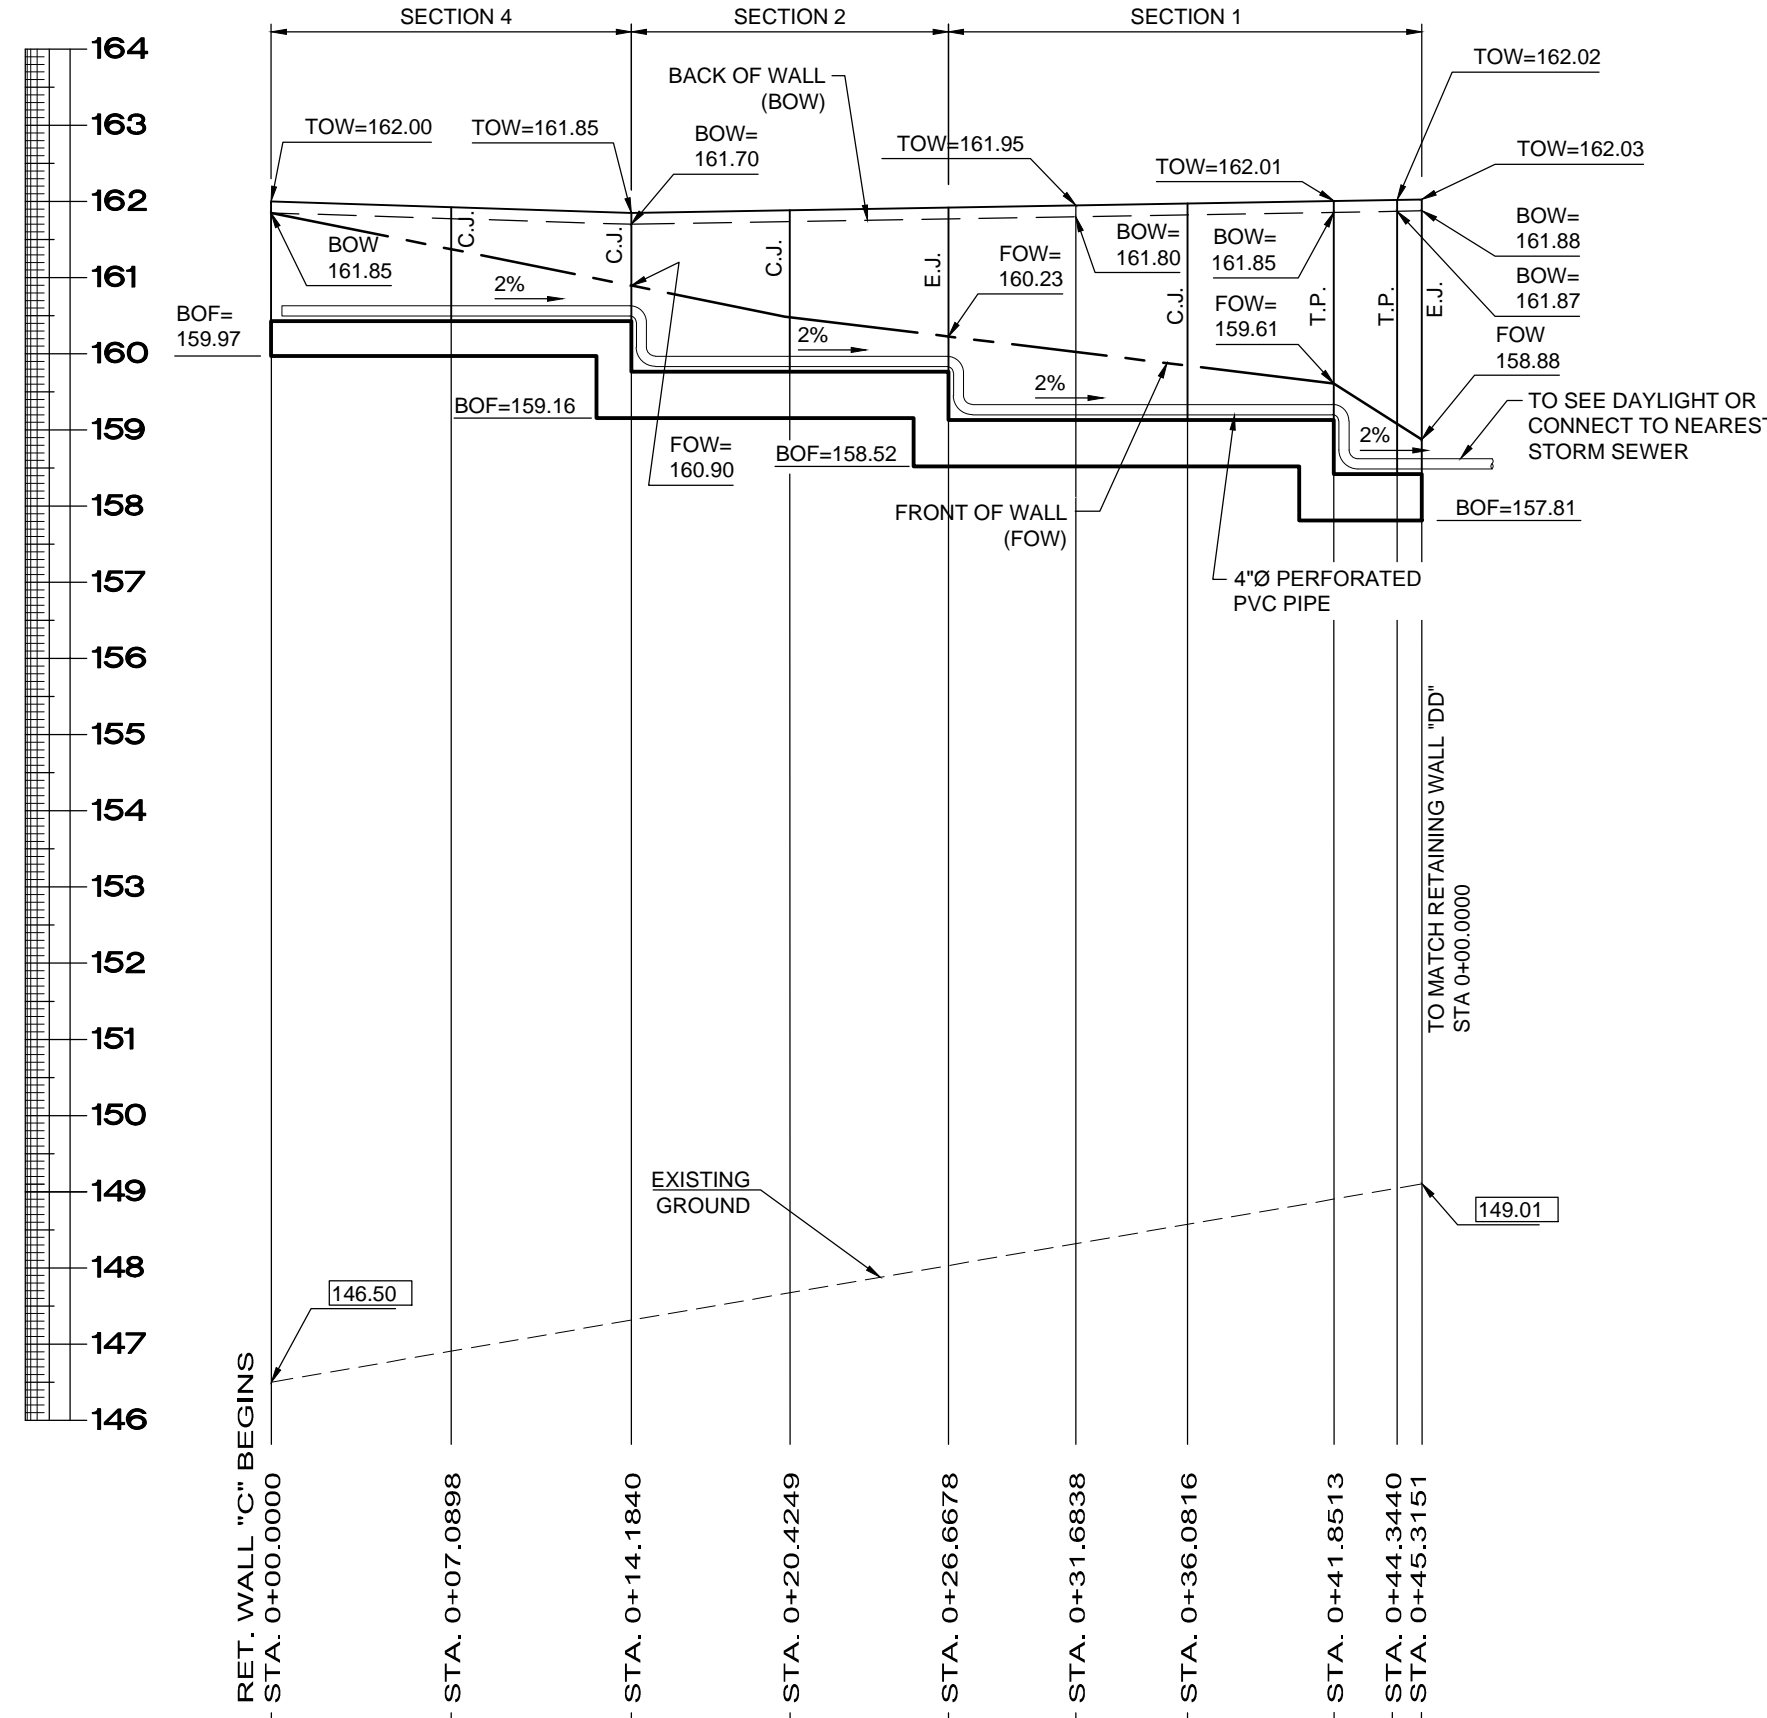

F1 RETAINING WALL "C" PROFILE
SCALE: H=1:100 V=1:300
LOCATION: NEXT TO BURIAL SITE IX

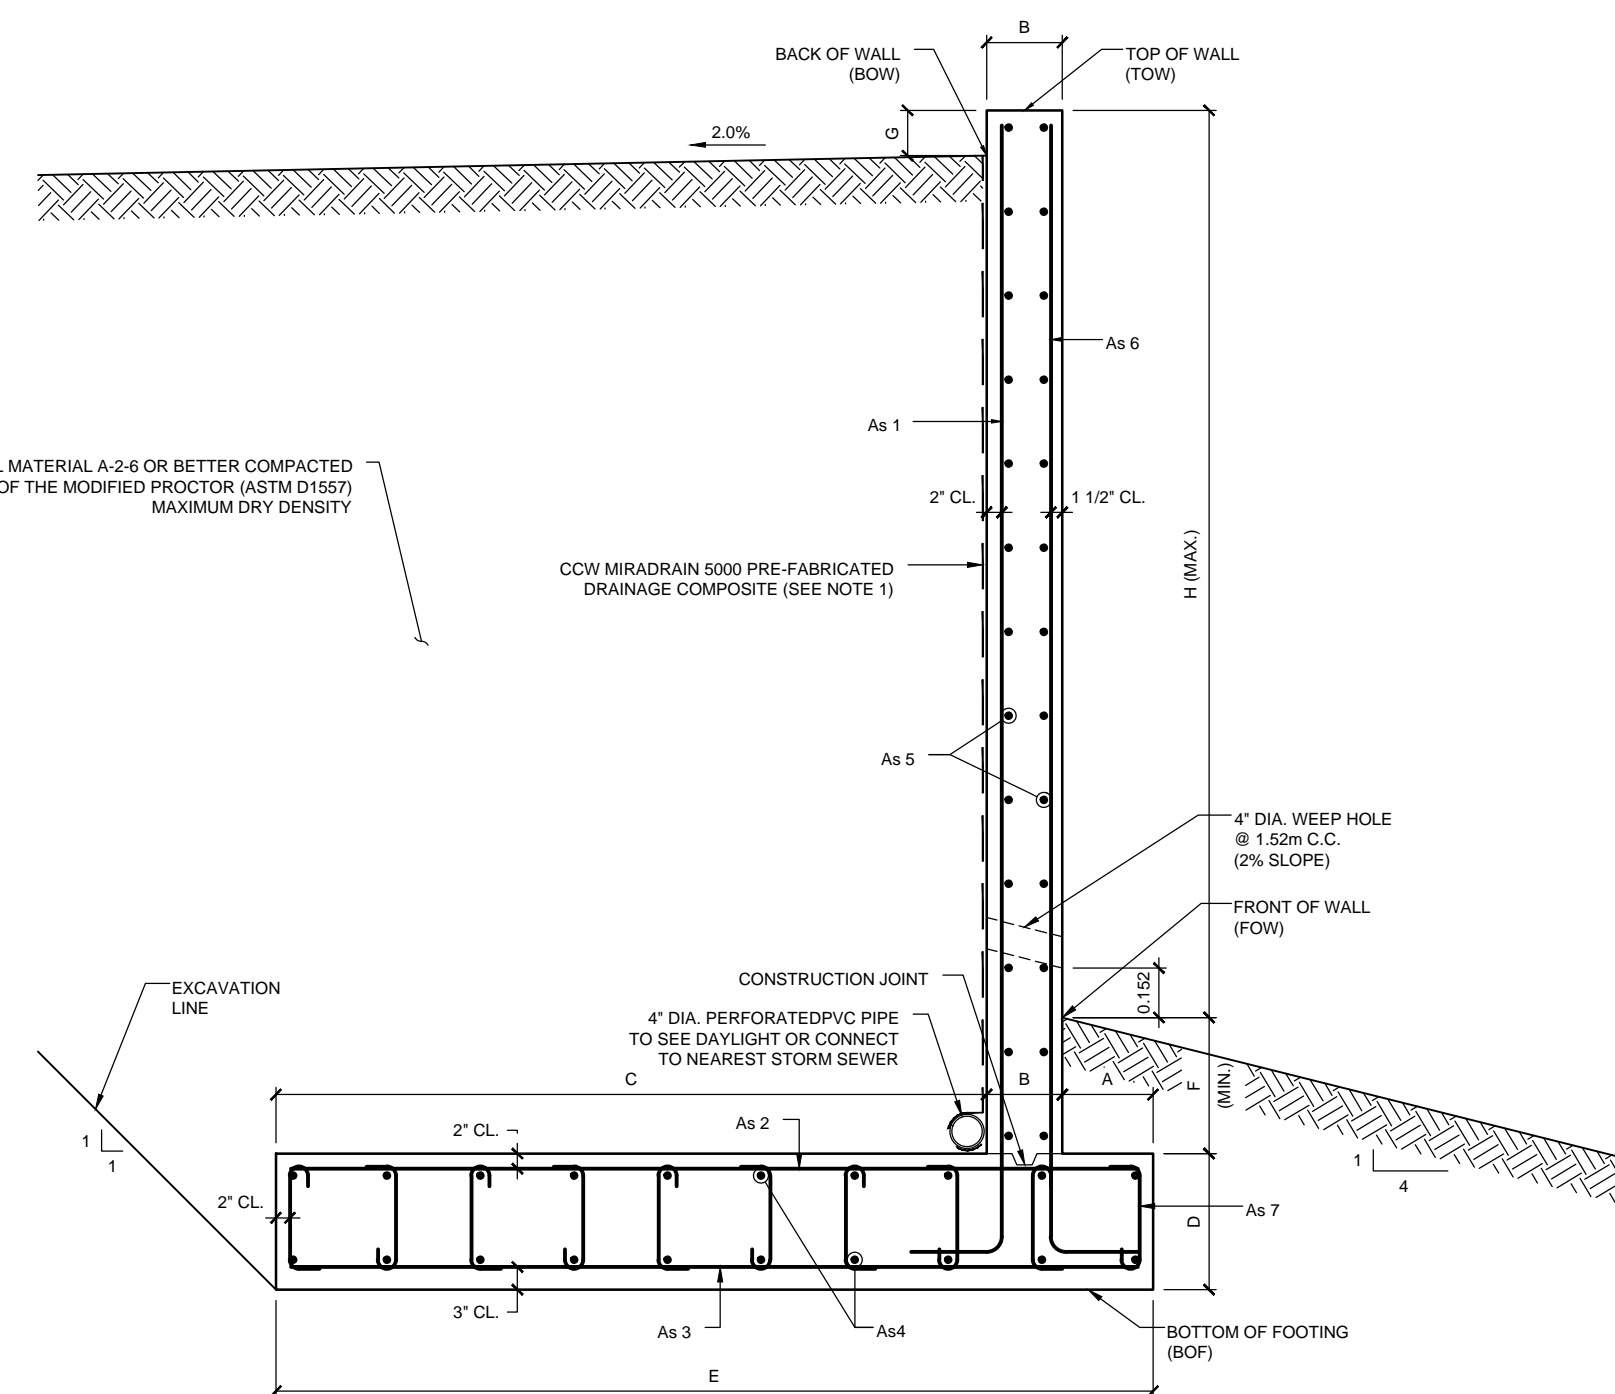

B5 RETAINING WALL A, B, C, D & E SECTION
SCALE: NONE

RETAINING WALL SCHEDULE												
RETAINING WALL	SECTION ID	DIMENSIONS										
		H (max) [m]	A [m]	B [m]	C [m]	D [m]	E [m]	F (min) [m]	G [m]	J [m]	K [m]	L [m]
A B C D E	1	3.353	0.305	0.253	2.743	0.610	3.301	0.457	0.152	-	-	-
	2	2.438	0.305	0.253	1.981	0.610	2.539	0.457	0.152	-	-	-
	3	1.524	0.305	0.253	1.219	0.457	1.777	0.457	0.152	-	-	-
	4	0.914	0.305	0.253	0.762	0.457	1.320	0.457	0.152	-	-	-
F	5	3.353	1.067	0.253	2.743	0.610	4.063	0.533	0.152	-	-	-
	6	2.438	0.610	0.253	1.981	0.610	2.844	0.533	0.152	-	-	-
	7	1.524	0.610	0.253	1.219	0.457	2.082	0.533	0.152	-	-	-
	8	0.914	0.610	0.253	0.762	0.457	1.625	0.533	0.152	-	-	-
H	9	3.353	1.067	0.253	2.743	0.610	4.063	0.914	0.152	0.381	0.914	1.067
	10	2.438	0.762	0.253	1.981	0.610	2.996	0.914	0.152	0.381	0.610	0.762
	11	1.524	0.610	0.253	1.219	0.457	2.082	0.914	0.152	0.305	0.305	0.610
	12	0.914	0.610	0.253	0.762	0.457	1.625	0.914	0.152	-	-	-
G	13	1.524	0.762	0.253	1.524	0.457	2.539	0.610	0.914	-	-	-
	14	3.295	0.762	0.253	1.524	0.457	2.539	0.610	VARIES	-	-	-

RETAINING WALL SCHEDULE											
RETAINING WALL	SECTION ID	REINFORCEMENT									
		X [m]	As1	As2	As3	As4	As5	As6	As7	As8	As9
A B C D E	1	-	#7 @ 12"	#7 @ 6"	#7 @ 12"	#4 @ 9" (T & B)	#4 @ 12" (E.F.)	#4 @ 12"	#4 @ 12" (E.W.)	-	-
	2	-	#6 @ 12"	#6 @ 8"	#6 @ 12"	#4 @ 9" (T & B)	#4 @ 12" (E.F.)	#4 @ 12"	-	-	-
	3	-	#5 @ 10"	#5 @ 12"	#5 @ 12"	#4 @ 12" (T & B)	#4 @ 12" (E.F.)	#4 @ 12"	-	-	-
	4	-	#5 @ 12"	#5 @ 12"	#5 @ 12"	#4 @ 12" (T & B)	#4 @ 12" (E.F.)	#4 @ 12"	-	-	-
F	5	-	#7 @ 12"	#7 @ 6"	#7 @ 12"	#4 @ 9" (T & B)	#4 @ 12" (E.F.)	#4 @ 12"	#4 @ 12" (E.W.)	-	-
	6	-	#6 @ 10"	#6 @ 6"	#6 @ 12"	#4 @ 12" (T & B)	#4 @ 12" (E.F.)	#4 @ 12"	#4 @ 12" (E.W.)	-	-
	7	-	#5 @ 10"	#5 @ 12"	#5 @ 12"	#4 @ 12" (T & B)	#4 @ 12" (E.F.)	#4 @ 12"	-	-	-
	8	-	#5 @ 12"	#5 @ 12"	#5 @ 12"	#4 @ 12" (T & B)	#4 @ 12" (E.F.)	#4 @ 12"	-	-	-
H	9	1.524000	#7 @ 12"	#7 @ 6"	#7 @ 12"	#4 @ 12" (T & B)	#4 @ 12" (E.F.)	#4 @ 12"	#4 @ 12" (E.W.)	#4 @ 12" (E.W.)	#5 @ 6"
	10	-	#6 @ 10"	#6 @ 6"	#6 @ 12"	#4 @ 12" (T & B)	#4 @ 12" (E.F.)	#4 @ 12"	#4 @ 12" (E.W.)	-	#5 @ 12"
	11	-	#5 @ 8"	#5 @ 10"	#5 @ 12"	#4 @ 12" (T & B)	#4 @ 12" (E.F.)	#4 @ 12"	-	-	#5 @ 12"
G	12	-	#5 @ 10"	#5 @ 12"	#5 @ 12"	#4 @ 12" (T & B)	#4 @ 12" (E.F.)	#4 @ 12"	-	-	-
	13	-	#5 @ 8"	#5 @ 12"	#5 @ 12"	#4 @ 12" (T & B)	#4 @ 12" (E.F.)	#4 @ 12"	-	-	-
	14	-	#5 @ 8"	#5 @ 12"	#5 @ 12"	#4 @ 12" (T & B)	#4 @ 12" (E.F.)	#4 @ 12"	-	-	-

- NOTES:
- MANUFACTURER ESTABLISHED ONLY AS DESIGN BASIS. SEE STRUCTURAL GENERAL NOTE 19 ON DRAWING 9001.
 - LEGEND:
 - TOW = TOP OF WALL
 - BOF = BOTTOM OF FOOTING
 - FOW = FRONT OF WALL
 - C.J. = CONSTRUCTION JOINT
 - T.P. = TURNING POINT
 - E.L. = EXISTING ELEVATIONS
 - RETAINING WALLS SHALL BE PLACED OVER COMPACTED STRUCTURAL FILL AT LEAST 3 FEET BELOW BOTTOM OF FOOTING ON AREAS WHERE THE FOUNDATION LEVEL IS ANTICIPATED OVER THE EXISTING OVERBURDEN SOILS. SEE FOUNDATION NOTES ON DRAWING 9001 FOR COMPLETE REQUIREMENTS.
 - IF THE GEOTECHNICAL ENGINEER DETERMINES THAT THE EXISTING SOILS AT THE BOTTOM OF FOOTING LEVEL ARE SUITABLE FOR THE RETAINING WALLS TO BEAR ON, AN EXPANSION JOINT SHALL BE PROVIDED BETWEEN THE SECTION OF THE WALL THAT BEARS ON EXISTING SOILS AND THE SECTION THAT BEARS ON COMPACTED STRUCTURAL FILL. SEE FOUNDATION NOTES ON DRAWING 9001 FOR COMPLETE REQUIREMENTS.
 - CONSTRUCTION JOINTS SHALL BE PLACED AT A MAXIMUM SPACING OF 8'.
 - EXPANSION JOINTS SHALL BE PLACED AT A MAXIMUM SPACING OF 27'.
 - OVER-COMPACTING OF THE SOIL BEHIND THE WALLS SHALL BE AVOIDED AS THE EARTH PRESSURE COEFFICIENT UNDER THE CONDITION COULD INCREASE TO 1.0 OR MORE. LIGHTWEIGHT COMPACTION EQUIPMENT SHALL BE CONSIDERED AS WELL AS USING 80% OF THE MODIFIED PROCTOR (ASTM D1557) MAXIMUM DRY DENSITY.
 - SEE TYPICAL DETAILS AND DESIGN DATA ON DRAWING 2000.

Revisions

Date

CONSULTANTS:

vireo

ETM
England-Thim & Miller, Inc.
VISION • EXPERIENCE • RESULTS

Aqua Engineering
Inc. Water Solutions

GMTS
GEOTECHNICAL & MATERIALS
TESTING SERVICES

ebp
LAND SURVEYING
SERVICES, P.S.C.
ENRIQUE BLANES PALMER
REGISTERED PROFESSIONAL SURVEYOR
No. 1000 PE
Puerto Rico

PROFESSIONAL SEAL

ARCHITECT/ENGINEERS:

ebp design group
CONSULTING ENGINEERS, P.S.C.
ENRIQUE BLANES PALMER - CIVIL ENGINEER, U.C. #416
TEL.: 787-268-0550 FAX: 787-268-1410
207 DEL PARQUE ST. 4TH FLOOR SAN JUAN, PUERTO RICO 00912
e-mail: ebpdesign@prtc.net - web: www.ebpdesigngroup.com

BID DOCUMENTS
SUBMISSION

Drawing Title

RETAINING WALLS STRUCTURAL
DETAILS - WALLS A, B, & C

Approved: PROJECT MANAGER,
BRYAN J. BODNER
PHONE: (202) 632-5722

Approved: CONTRACTING OFFICER,
TERENCE CRAWLEY
PHONE: (202) 382-2766

Project Title

"PUERTO RICO NATIONAL
CEMETERY REPLACEMENT"
PHASE 1 DEVELOPMENT

Location
MOROVIS

Date
FEBRUARY 28, 2017

Checked
JM

Drawn
JO

Project Number

87PC2031

Building Number


Drawing Number

C1-506


Dwg. of

Office of
Construction
and Facilities
Management


Department of
Veterans Affairs

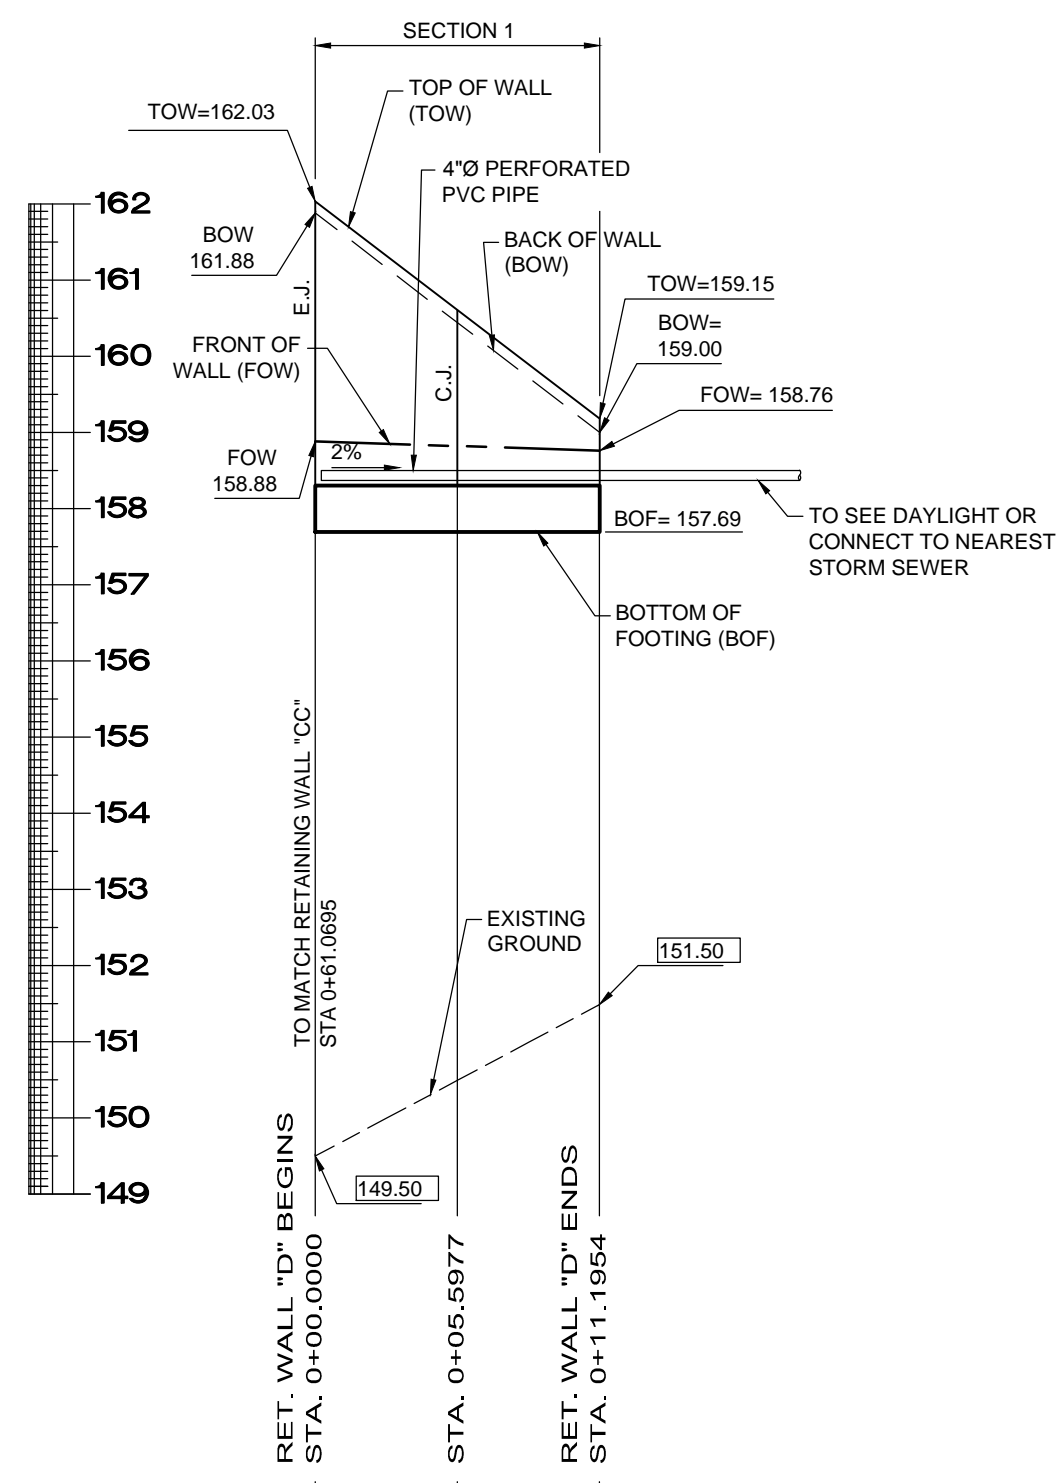

C1 RETAINING WALL "D" PROFILE
SCALE: H=1:100 V=1:300
LOCATION: NEXT TO BURIAL SITE IX

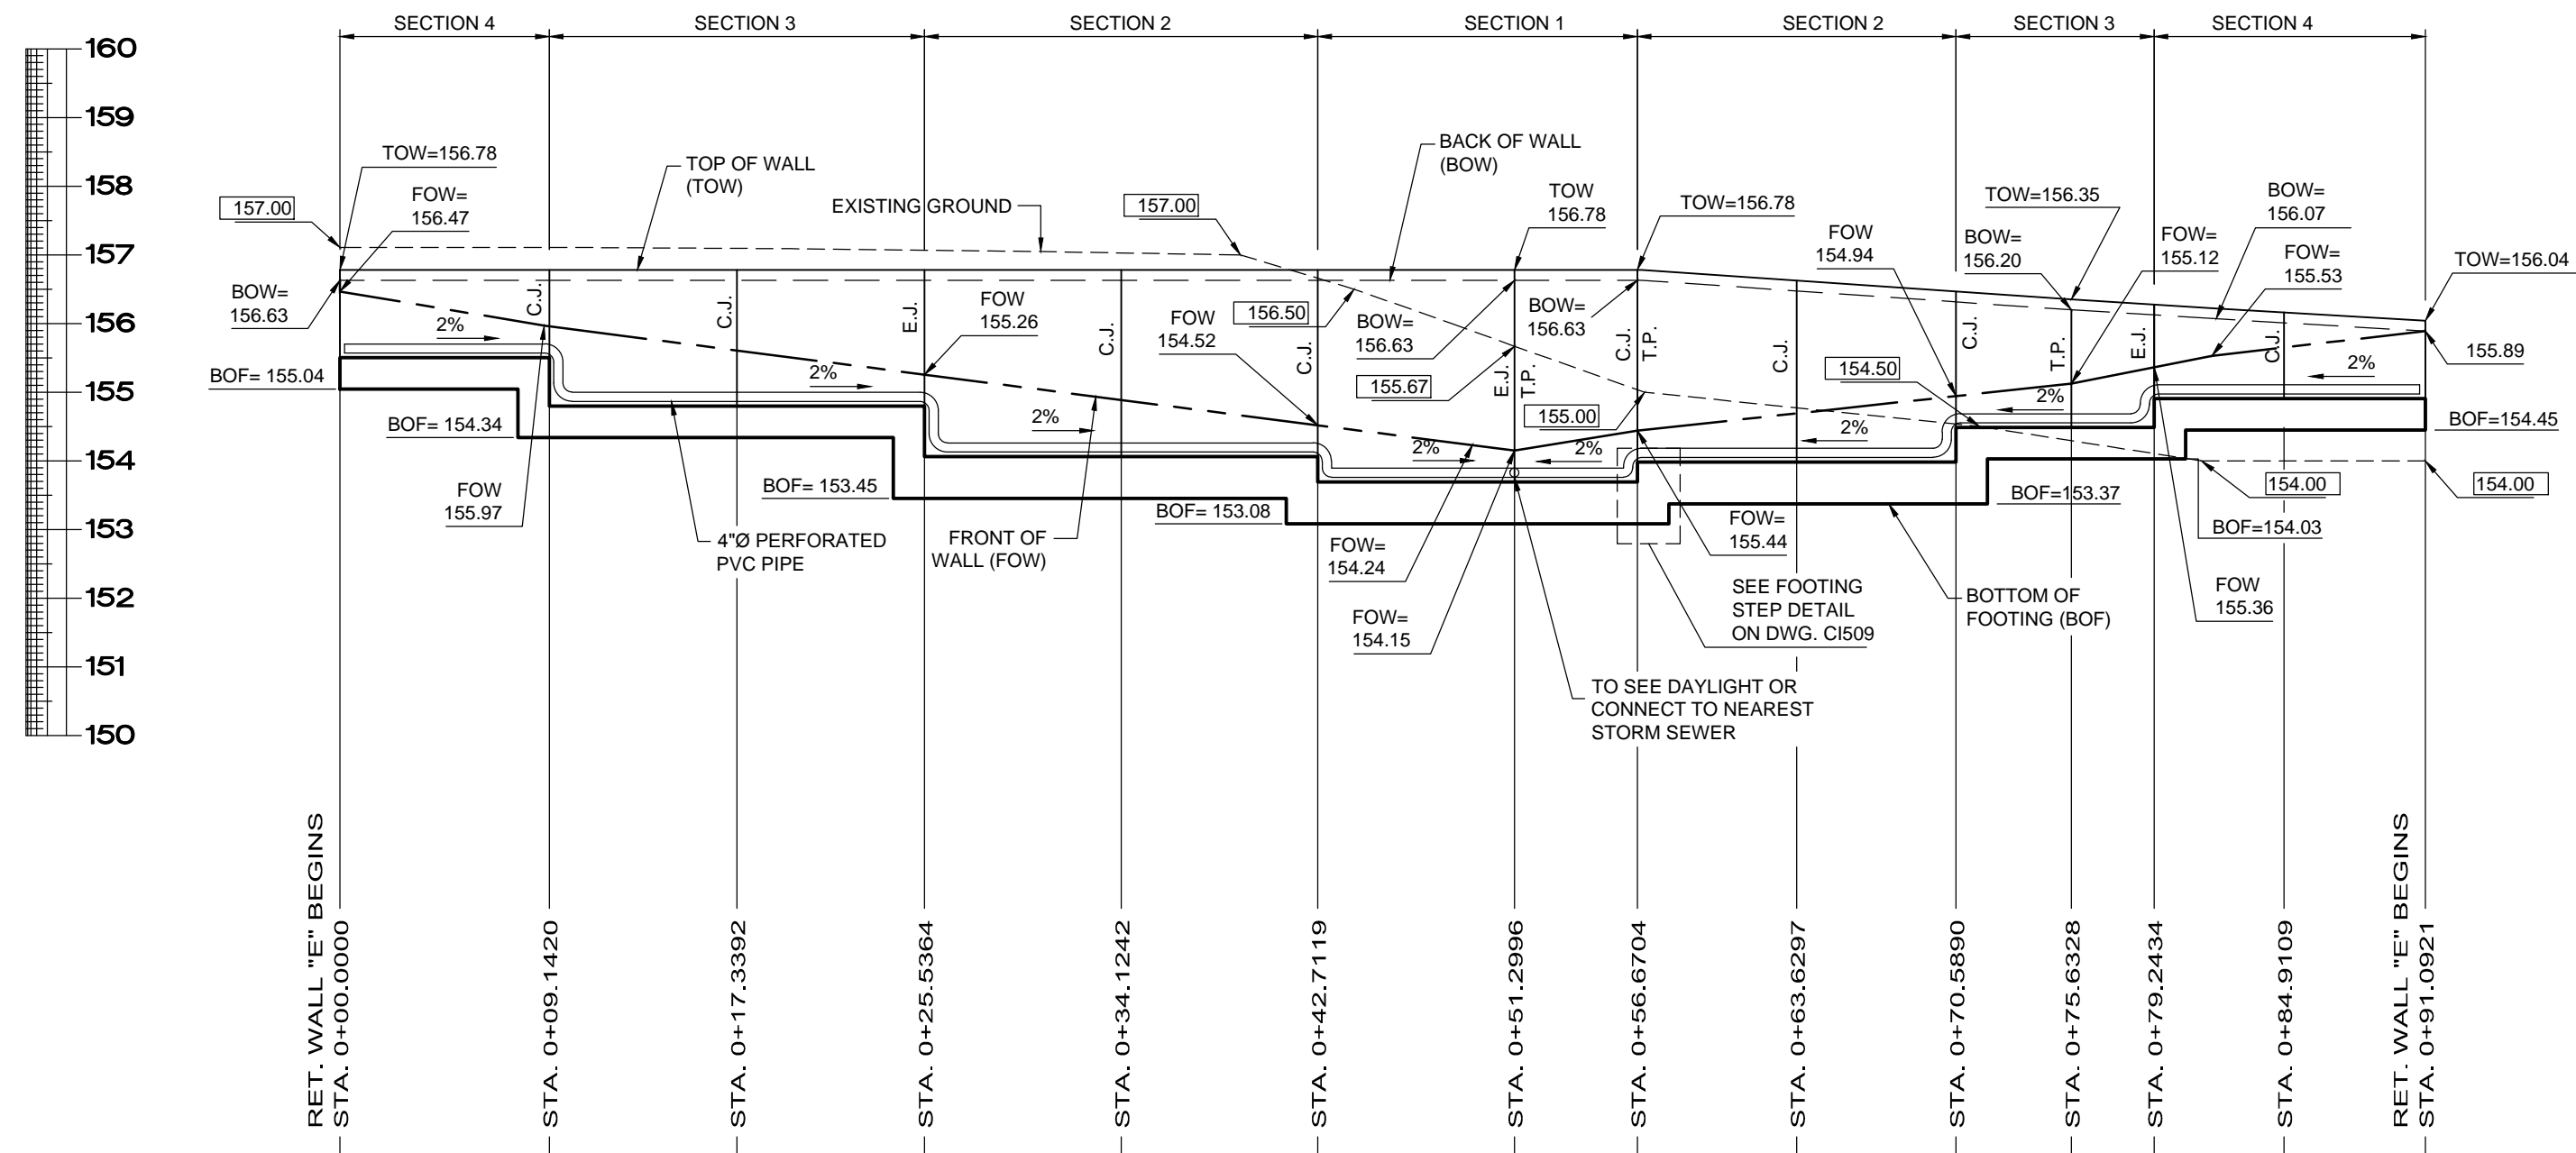

E1 RETAINING WALL "E" PROFILE
SCALE: H=1:100 V=1:300
LOCATION: NEXT TO BURIAL SITE II

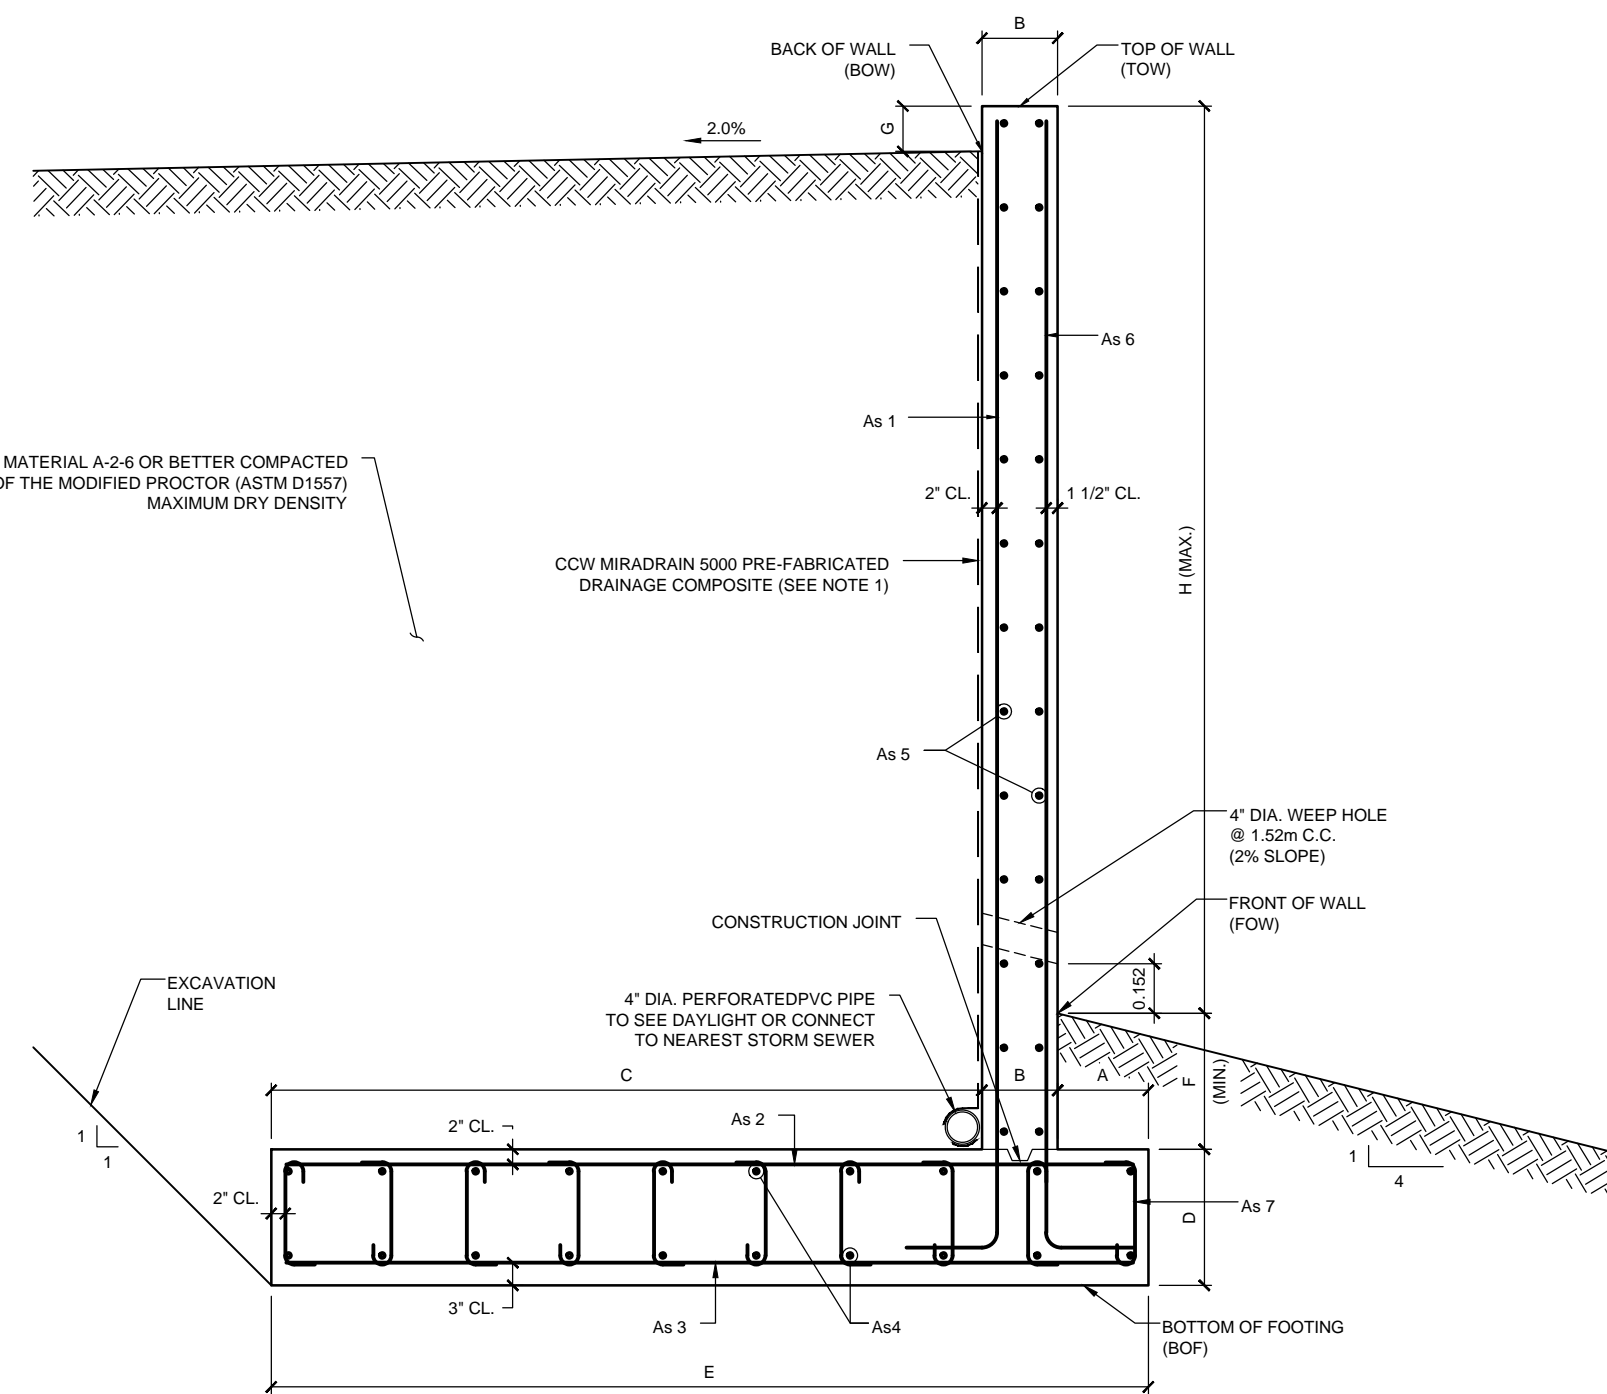


B5 RETAINING WALL D & E SECTION
SCALE: NONE

RETAINING WALL	SECTION ID	RETAINING WALL SCHEDULE										
		DIMENSIONS										
		H [max] [m]	A [m]	B [m]	C [m]	D [m]	E [m]	F [min] [m]	G [m]	J [m]	K [m]	L [m]
A B C D E	1	3.353	0.305	0.253	2.743	0.610	3.301	0.457	0.152	-	-	-
	2	2.438	0.305	0.253	1.981	0.610	2.539	0.457	0.152	-	-	-
	3	1.524	0.305	0.253	1.219	0.457	1.777	0.457	0.152	-	-	-
	4	0.914	0.305	0.253	0.762	0.457	1.320	0.457	0.152	-	-	-
F	5	3.353	1.067	0.253	2.743	0.610	4.063	0.533	0.152	-	-	-
	6	2.438	0.610	0.253	1.981	0.610	2.844	0.533	0.152	-	-	-
	7	1.524	0.610	0.253	1.219	0.457	2.082	0.533	0.152	-	-	-
	8	0.914	0.610	0.253	0.762	0.457	1.625	0.533	0.152	-	-	-
H	9	3.353	1.067	0.253	2.743	0.610	4.063	0.914	0.152	0.381	0.914	1.067
	10	2.438	0.762	0.253	1.981	0.610	2.996	0.914	0.152	0.381	0.610	0.762
	11	1.524	0.610	0.253	1.219	0.457	2.082	0.914	0.152	0.305	0.305	0.610
	12	0.914	0.610	0.253	0.762	0.457	1.625	0.914	0.152	-	-	-
G	13	1.524	0.762	0.253	1.524	0.457	2.539	0.610	0.914	-	-	-
	14	3.295	0.762	0.253	1.524	0.457	2.539	0.610	VARIES	-	-	-


RETAINING WALL	SECTION ID	RETAINING WALL SCHEDULE									
		X [m]	As1	As2	As3	As4	As5	As6	As7	As8	As9
A B C D E	1	-	#7 @ 12"	#7 @ 6"	#7 @ 12"	#4 @ 9" (T & B)	#4 @ 12" (E.F.)	#4 @ 12"	#4 @ 12" (E.W.)	-	-
	2	-	#6 @ 12"	#6 @ 8"	#6 @ 12"	#4 @ 9" (T & B)	#4 @ 12" (E.F.)	#4 @ 12"	-	-	-
	3	-	#5 @ 10"	#5 @ 12"	#5 @ 12"	#4 @ 12" (T & B)	#4 @ 12" (E.F.)	#4 @ 12"	-	-	-
	4	-	#5 @ 12"	#5 @ 12"	#5 @ 12"	#4 @ 12" (T & B)	#4 @ 12" (E.F.)	#4 @ 12"	-	-	-
F	5	-	#7 @ 12"	#7 @ 6"	#7 @ 12"	#4 @ 12" (T & B)	#4 @ 12" (E.F.)	#4 @ 12"	#4 @ 12" (E.W.)	-	-
	6	-	#6 @ 10"	#6 @ 6"	#6 @ 12"	#4 @ 12" (T & B)	#4 @ 12" (E.F.)	#4 @ 12"	#4 @ 12" (E.W.)	-	-
	7	-	#5 @ 10"	#5 @ 12"	#5 @ 12"	#4 @ 12" (T & B)	#4 @ 12" (E.F.)	#4 @ 12"	-	-	-
	8	-	#5 @ 12"	#5 @ 12"	#5 @ 12"	#4 @ 12" (T & B)	#4 @ 12" (E.F.)	#4 @ 12"	-	-	-
H	9	1.5240	#7 @ 12"	#7 @ 6"	#7 @ 12"	#4 @ 12" (T & B)	#4 @ 12" (E.F.)	#4 @ 12"	#4 @ 12" (E.W.)	#4 @ 12" (E.W.)	#5 @ 6"
	10	-	#6 @ 10"	#6 @ 6"	#6 @ 12"	#4 @ 12" (T & B)	#4 @ 12" (E.F.)	#4 @ 12"	#4 @ 12" (E.W.)	-	#5 @ 12"
	11	-	#5 @ 8"	#5 @ 10"	#5 @ 12"	#4 @ 12" (T & B)	#4 @ 12" (E.F.)	#4 @ 12"	-	-	#5 @ 12"
	12	-	#5 @ 10"	#5 @ 12"	#5 @ 12"	#4 @ 12" (T & B)	#4 @ 12" (E.F.)	#4 @ 12"	-	-	-
G	13	-	#5 @ 8"	#5 @ 12"	#5 @ 12"	#4 @ 12" (T & B)	#4 @ 12" (E.F.)	#4 @ 12"	-	-	-
	14	-	#5 @ 8"	#5 @ 12"	#5 @ 12"	#4 @ 12" (T & B)	#4 @ 12" (E.F.)	#4 @ 12"	-	-	-

- NOTES:
1. MANUFACTURER ESTABLISHED ONLY AS DESIGN BASIS. SEE STRUCTURAL GENERAL NOTE 19 ON DRAWING 8001.
 2. LEGEND:
TOW = TOP OF WALL
BOW = BACK OF WALL
FOW = FRONT OF WALL
BOF = BOTTOM OF FOOTING
E.J. = EXPANSION JOINT
C.J. = CONTRACTION JOINT
T.P. = TURNING POINT
E.E.T. = EXISTING ELEVATIONS
 3. RETAINING WALLS FOOTINGS TO BE PLACED OVER COMPACTED STRUCTURAL FILL AT LEAST 3 FEET BELOW BOTTOM OF FOOTING ON AREAS WHERE THE FOUNDATION LEVEL IS ANTICIPATED OVER THE EXISTING OVERBURDEN SOILS. SEE FOUNDATION NOTES ON DRAWINGS 8001 FOR COMPLETE REQUIREMENTS.
 4. IF THE GEOTECHNICAL ENGINEER RETAINED FOR THE PROJECT DETERMINES THAT THE EXISTING SOILS AT THE BOTTOM OF FOOTING LEVEL ARE SUITABLE FOR THE RETAINING WALLS TO BEAR ON, AN EXPANSION JOINT SHALL BE PROVIDED BETWEEN THE SECTION OF THE WALL THAT BEARS ON EXISTING SOILS AND THE SECTION THAT BEARS ON COMPACTED STRUCTURAL FILL. SEE FOUNDATION NOTES ON DRAWINGS 8001 FOR COMPLETE REQUIREMENTS.
 5. CONTRACTION JOINTS SHALL BE PLACED AT A MAXIMUM SPACING OF 5' MIN.
 6. EXPANSION JOINTS SHALL BE PLACED AT A MAXIMUM SPACING OF 27' MAX.
 7. OVERCOMPACTION OF THE SOIL BEHIND THE WALL SHALL BE AVOIDED AS THE EARTH PRESSURE COEFFICIENT UNDER THIS CONDITION COULD INCREASE TO 3.0 OR MORE. LIGHTWEIGHT COMPACTION EQUIPMENT SHALL BE CONSIDERED AS WELL AS USING 80% OF THE MODIFIED PROCTOR (ASTM D1557) MAXIMUM DRY DENSITY.
 8. SEE TYPICAL DETAILS AND DESIGN DATA ON DRAWING 8009.


Revisions		Date	
CONSULTANTS:			
PROFESSIONAL SEAL			
ARCHITECT/ENGINEERS:			
BID DOCUMENTS SUBMISSION			
Drawing Title		Project Title	
RETAINING WALLS STRUCTURAL DETAILS - WALLS D & E		"PUERTO RICO NATIONAL CEMETERY REPLACEMENT" PHASE 1 DEVELOPMENT	
Approved: PROJECT MANAGER, BRYAN J. BOONER, PHONE: (202) 632-5722		Location	
Approved: CONTRACTING OFFICER, TERENCE CRAWLEY, PHONE: (202) 382-2766		MOROVIS	
Date		Checked	
8/26/2016		JM	
Drawn		Dwg. of	
JO		CI-507	
Office of Construction and Facilities Management		Department of Veterans Affairs	

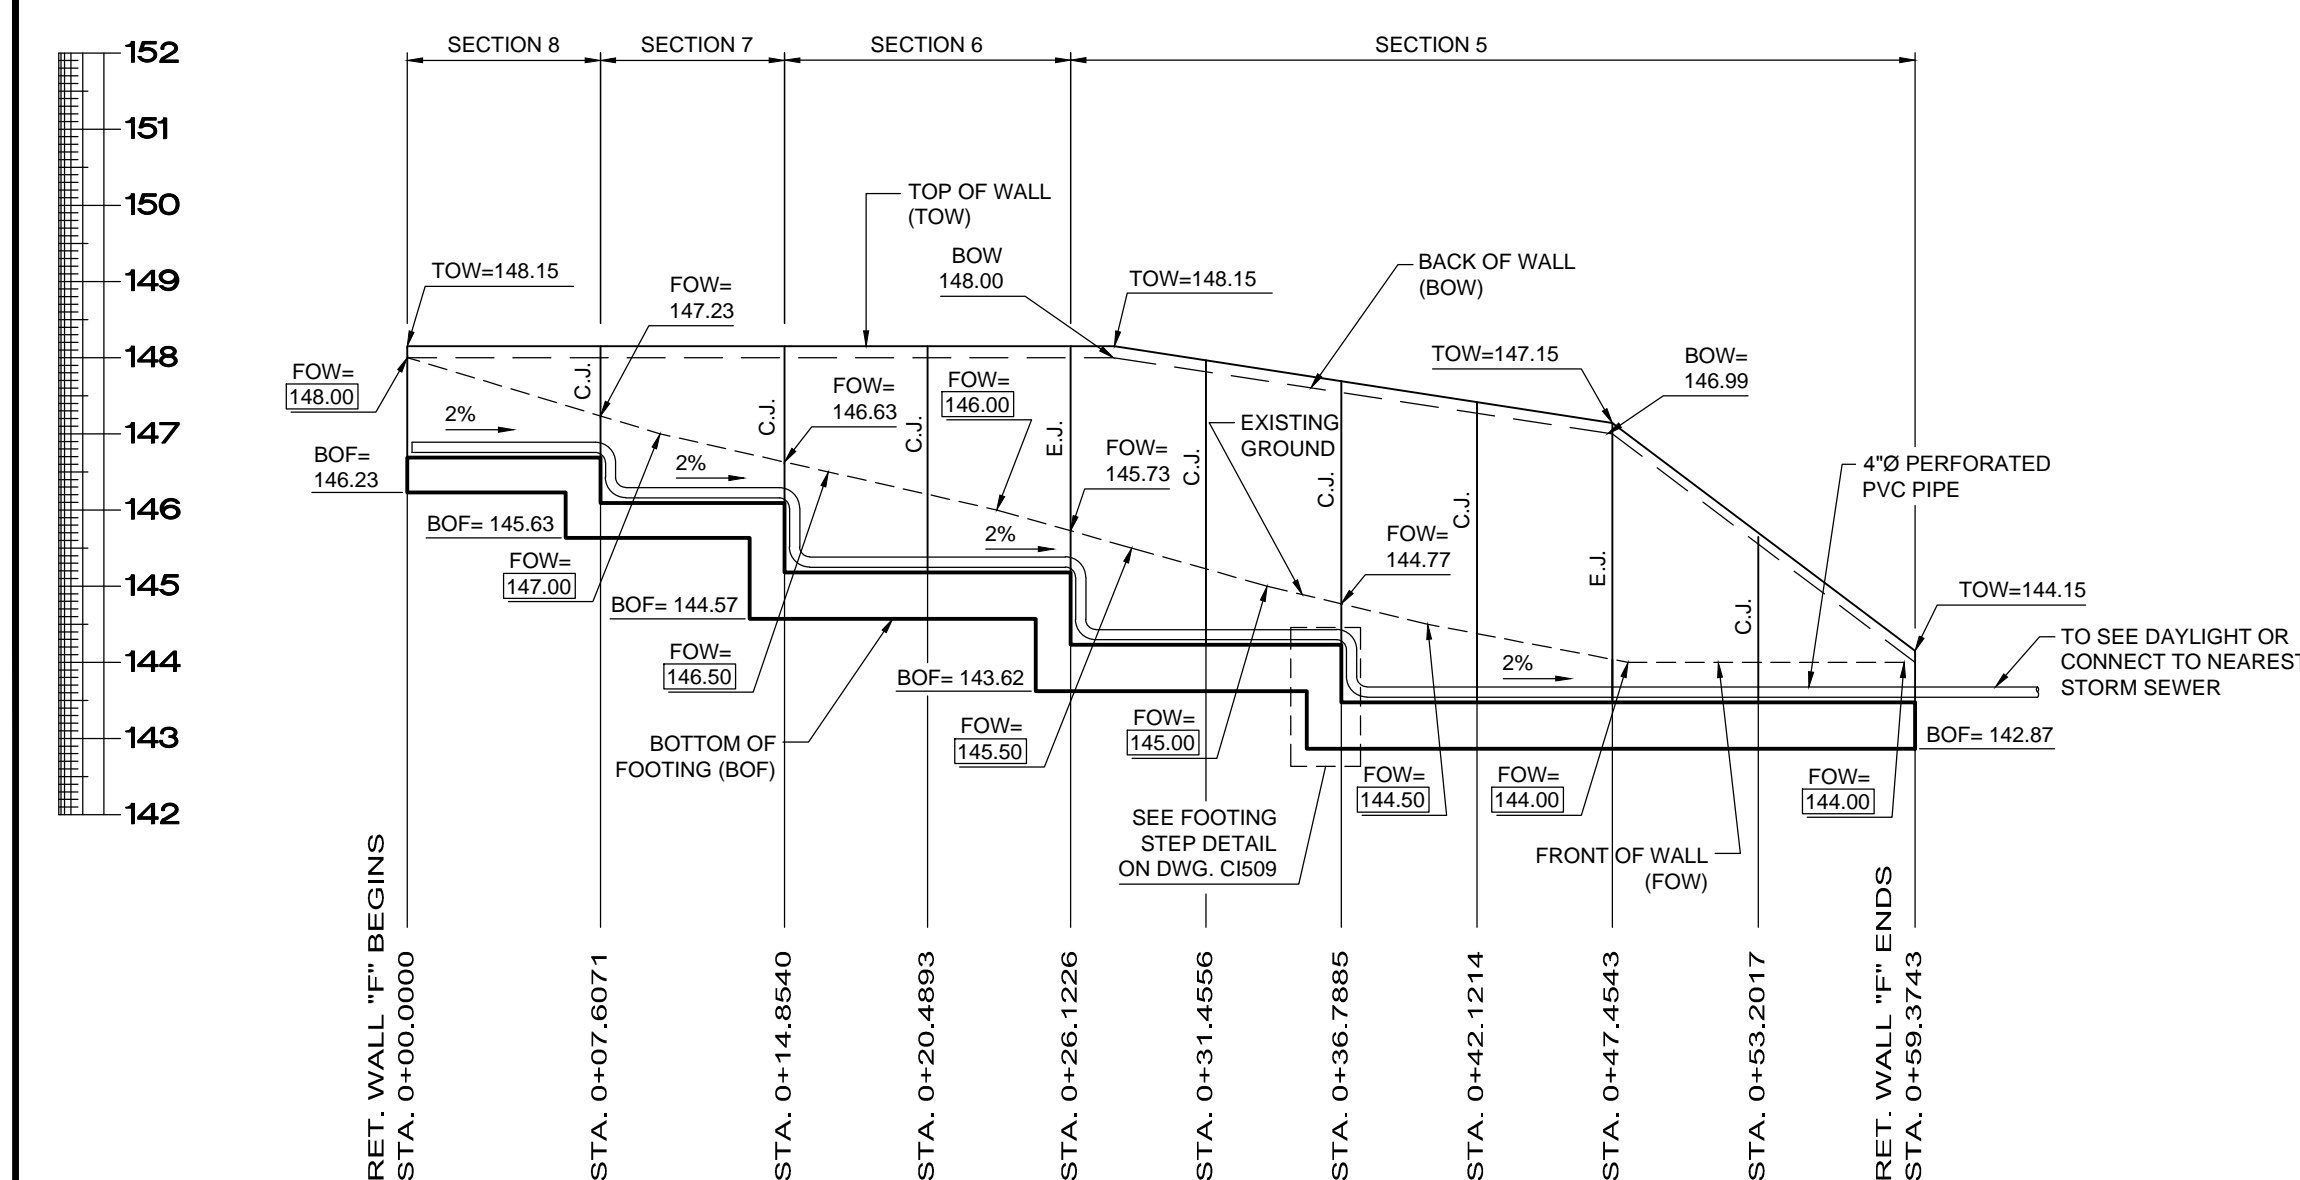


B1 RETAINING WALL "F" PROFILE
SCALE: H=1:300 V=1:100
LOCATION: BETWEEN RETENTION POND II & III

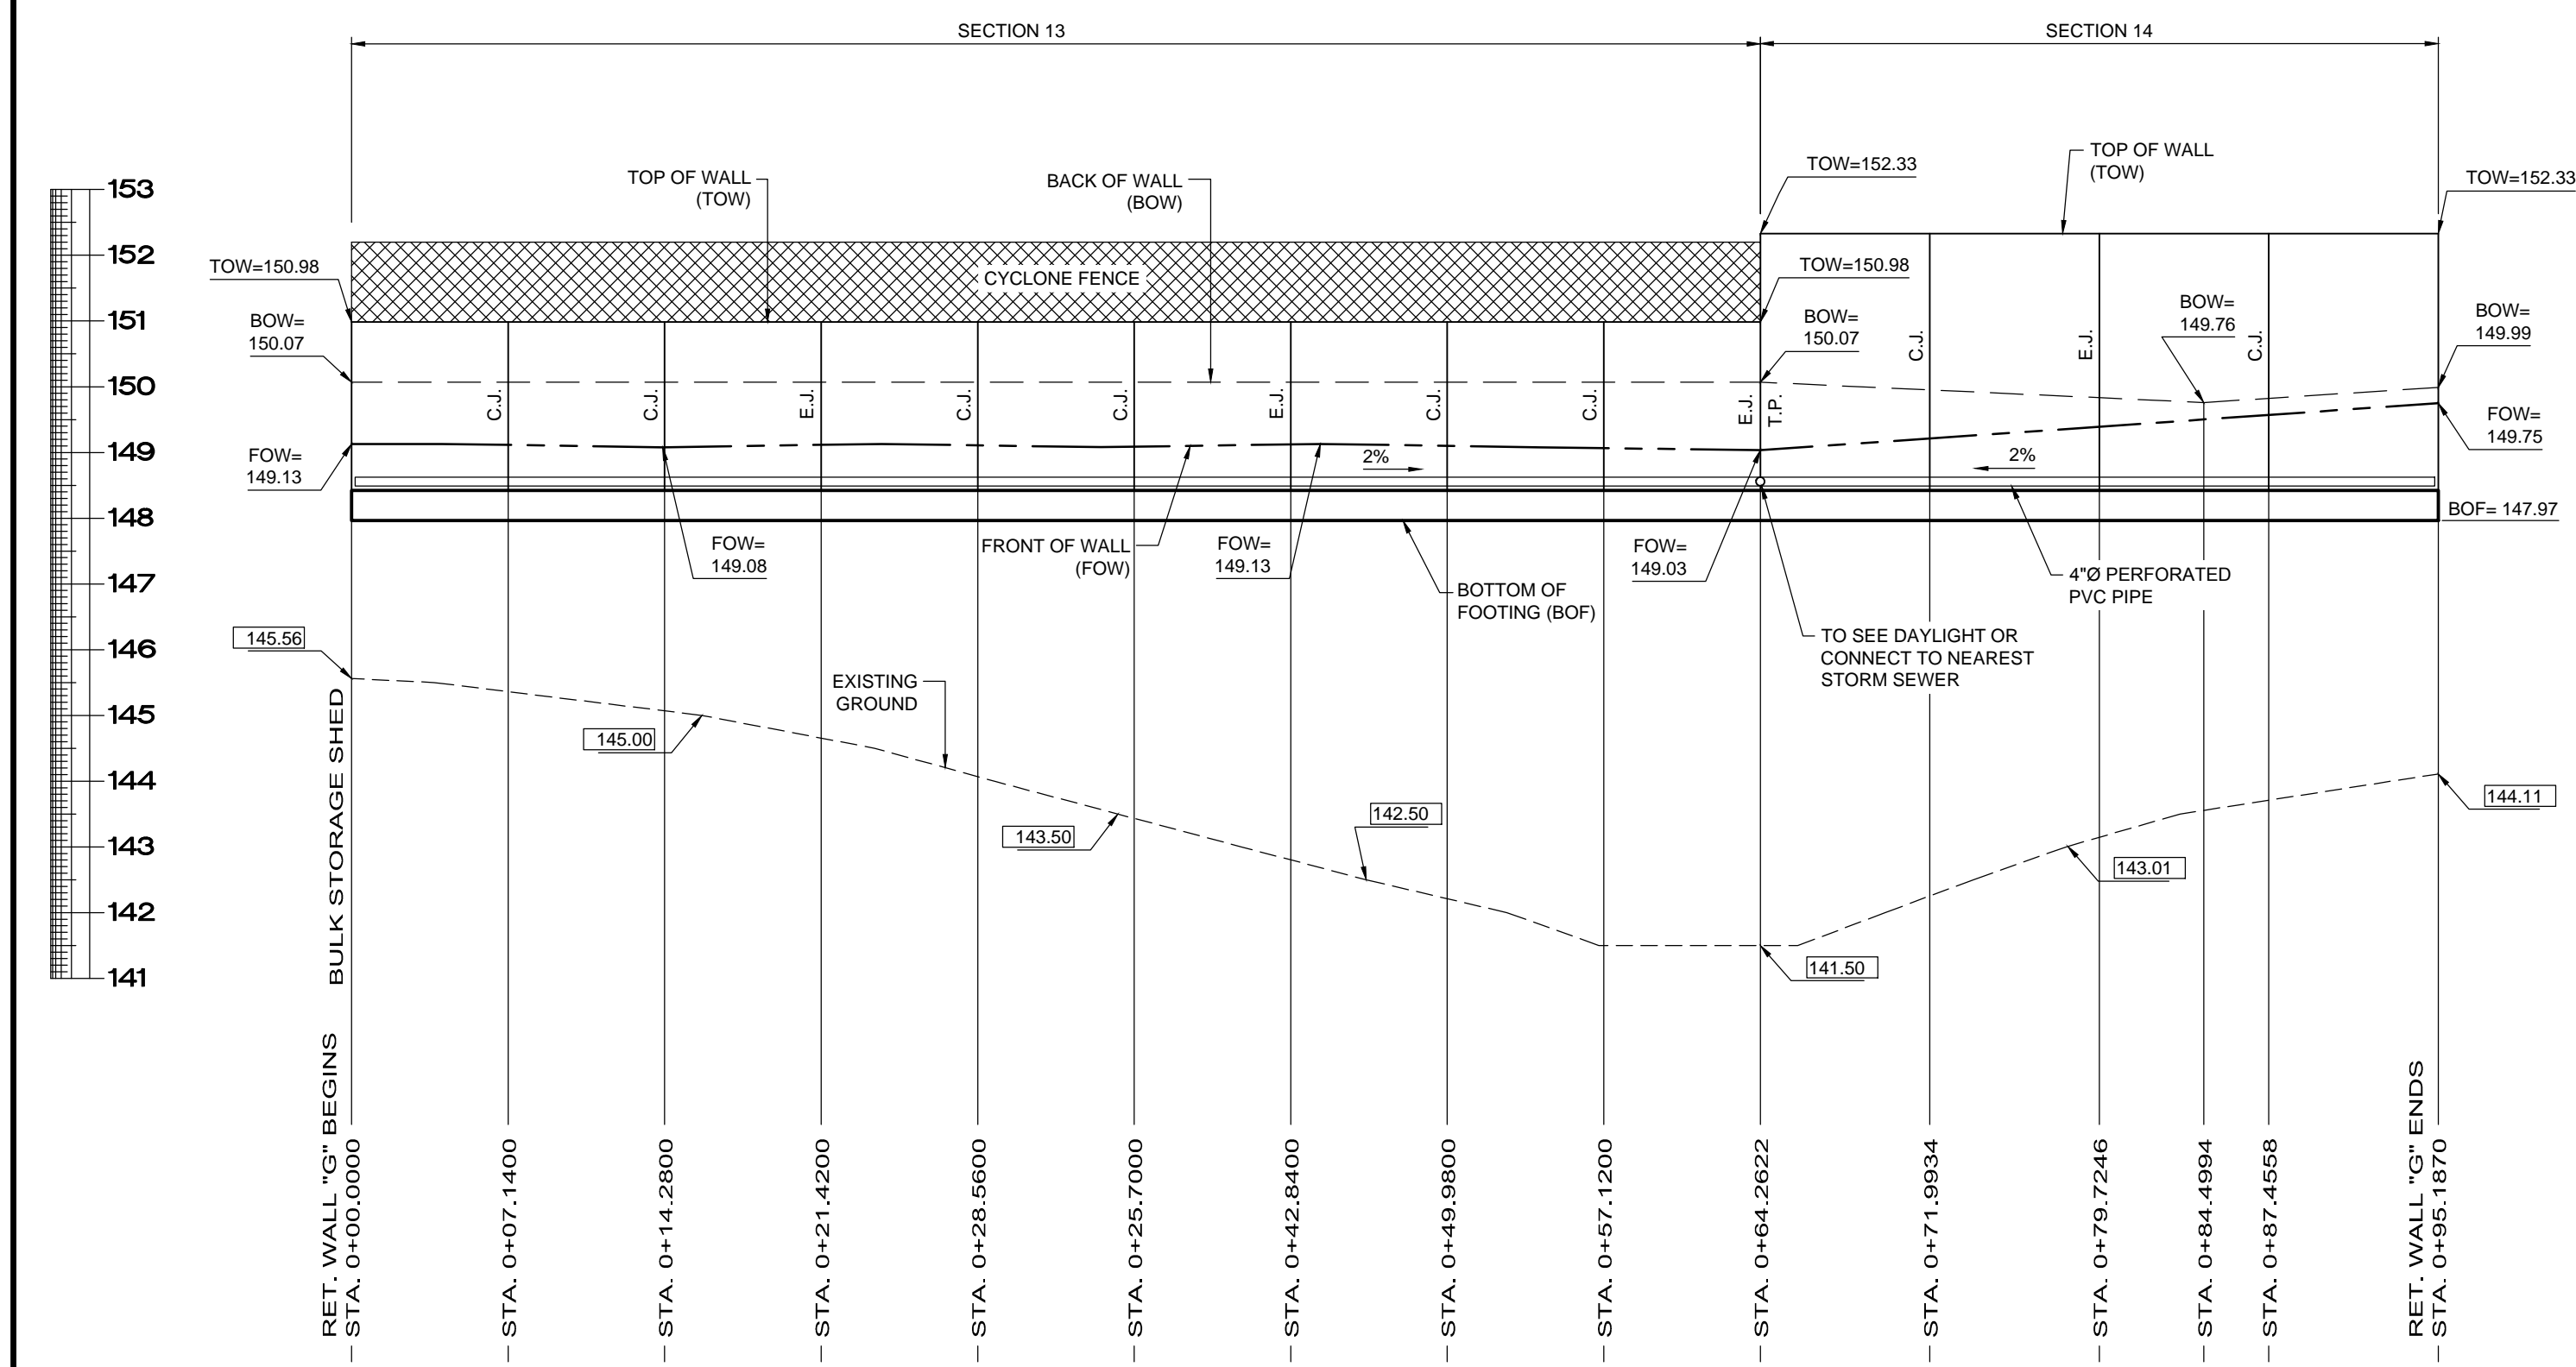


D1 RETAINING WALL "G" PROFILE
SCALE: H=1:300 V=1:100
LOCATION: ABOVE MAINTENANCE AND HONOR GUARD BUILDING

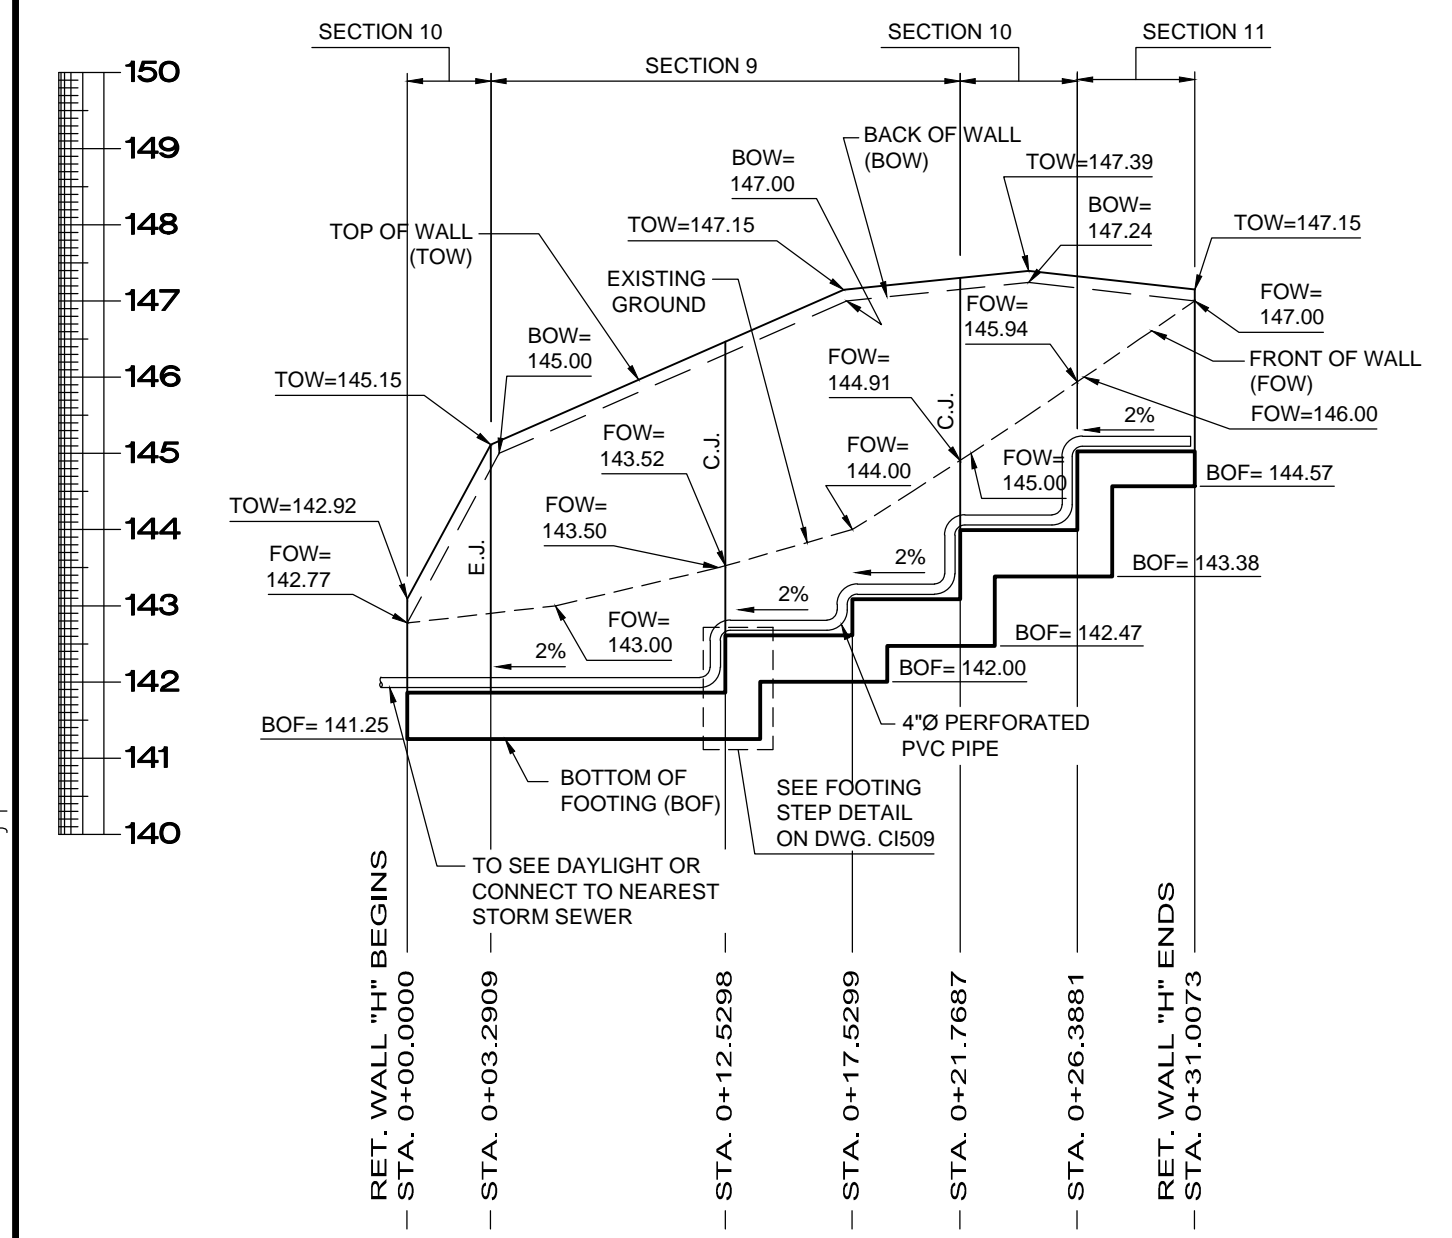

F1 RETAINING WALL "H" PROFILE
SCALE: H=1:300 V=1:100
LOCATION: BETWEEN RETENTION POND II & III

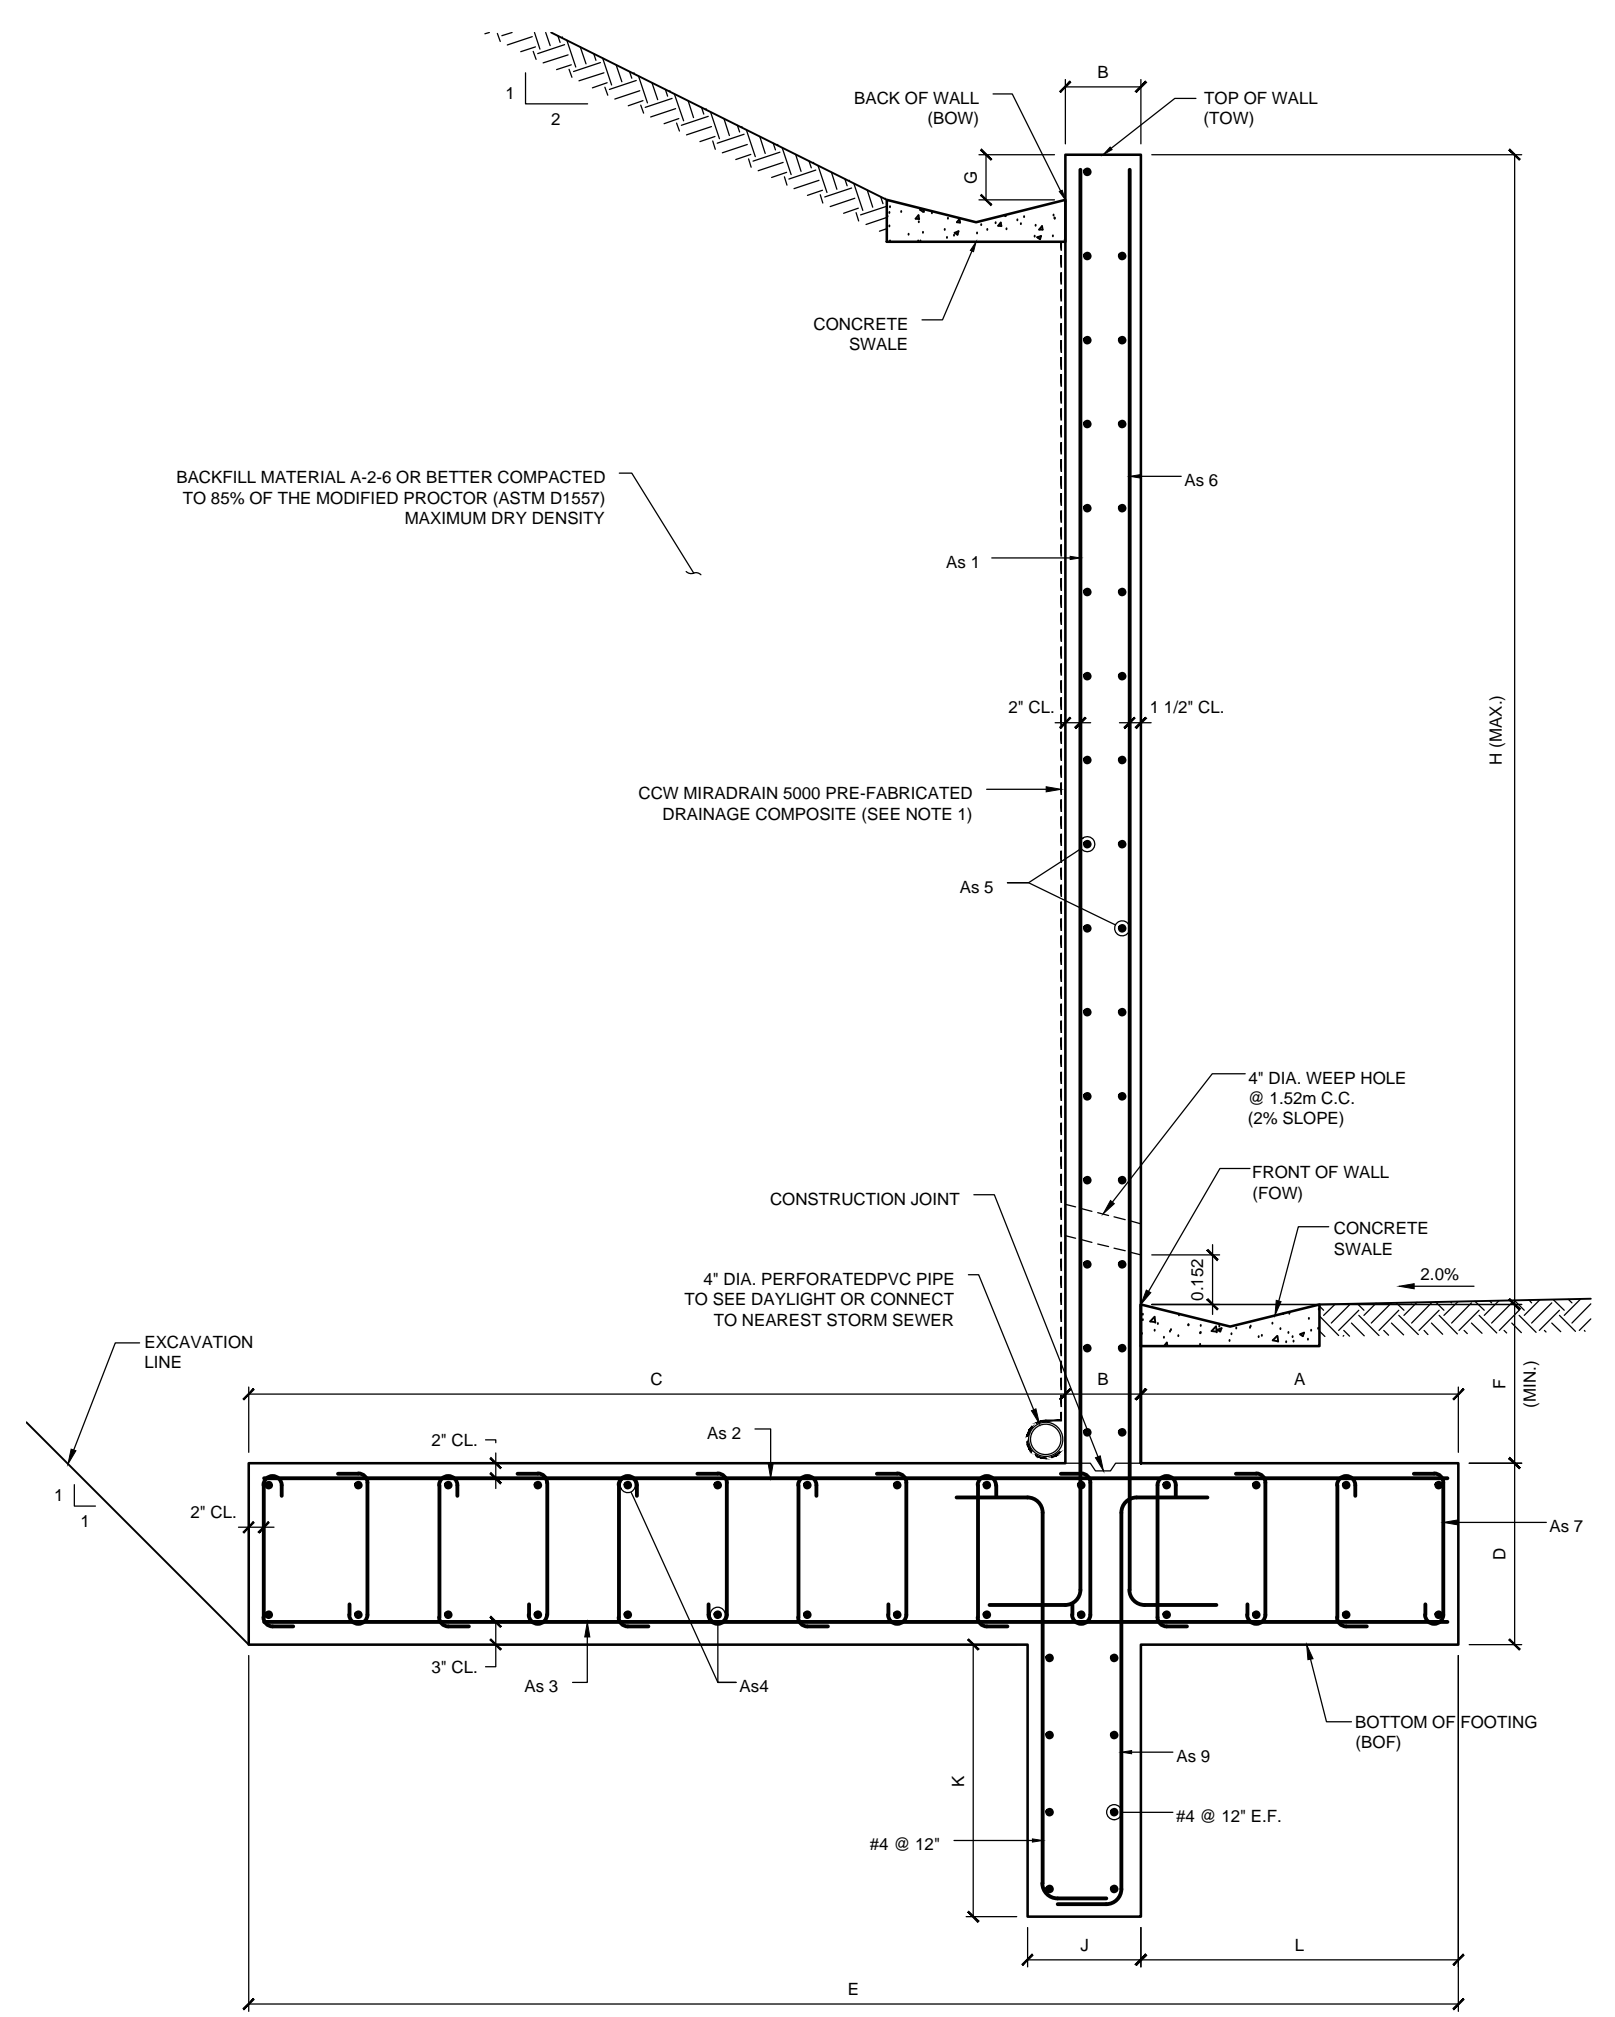

D5 RETAINING WALL F & H SECTION
SCALE: NONE

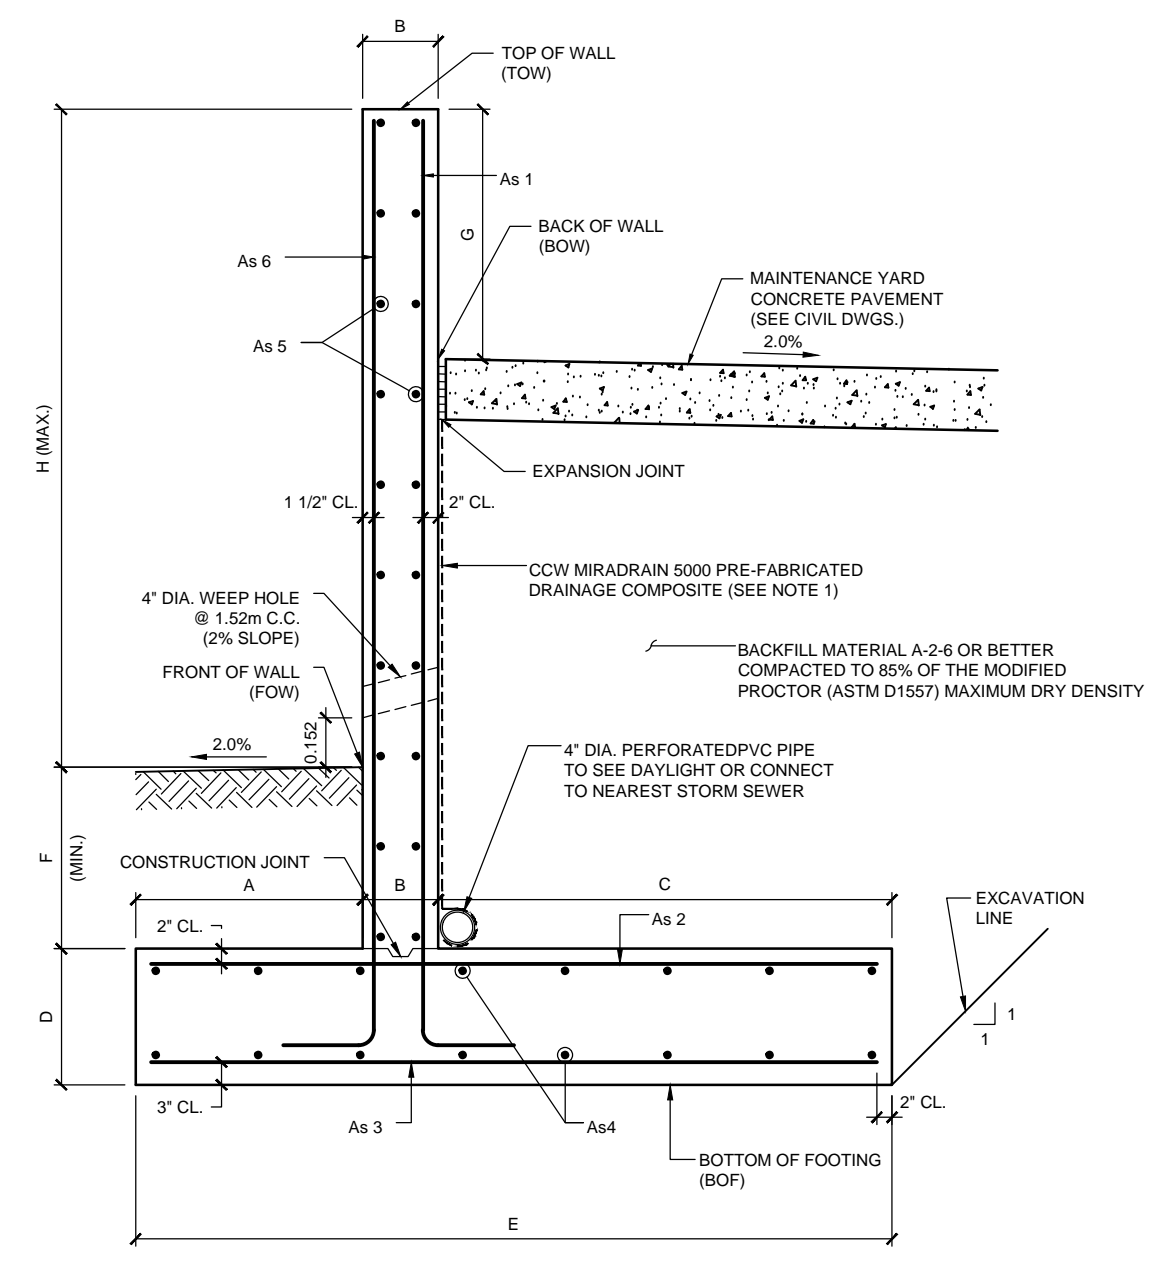

D7 RETAINING WALL G SECTION
SCALE: NONE

RETAINING WALL SCHEDULE												
RETAINING WALL	SECTION ID	DIMENSIONS										
		H [max] [m]	A [m]	B [m]	C [m]	D [m]	E [m]	F [min] [m]	G [m]	J [m]	K [m]	L [m]
A B C D E	1	3.353	0.305	0.253	2.743	0.610	3.301	0.457	0.152	-	-	-
	2	2.438	0.305	0.253	1.981	0.610	2.539	0.457	0.152	-	-	-
	3	1.524	0.305	0.253	1.219	0.457	1.777	0.457	0.152	-	-	-
	4	0.914	0.305	0.253	0.762	0.457	1.320	0.457	0.152	-	-	-
F	5	3.353	1.067	0.253	2.743	0.610	4.063	0.533	0.152	-	-	-
	6	2.438	0.610	0.253	1.981	0.610	2.844	0.533	0.152	-	-	-
	7	1.524	0.610	0.253	1.219	0.457	2.082	0.533	0.152	-	-	-
	8	0.914	0.610	0.253	0.762	0.457	1.625	0.533	0.152	-	-	-
H	9	3.353	1.067	0.253	2.743	0.610	4.063	0.914	0.152	0.381	0.914	1.067
	10	2.438	0.762	0.253	1.981	0.610	2.996	0.914	0.152	0.381	0.610	0.762
	11	1.524	0.610	0.253	1.219	0.457	2.082	0.914	0.152	0.305	0.305	0.610
	12	0.914	0.610	0.253	0.762	0.457	1.625	0.914	0.152	-	-	-
G	13	1.524	0.762	0.253	1.524	0.457	2.539	0.610	0.914	-	-	-
	14	3.295	0.762	0.253	1.524	0.457	2.539	0.610	VARIES	-	-	-

RETAINING WALL SCHEDULE											
RETAINING WALL	SECTION ID	REINFORCEMENT									
		X [m]	As1	As2	As3	As4	As5	As6	As7	As8	As9
A B C D E	1	-	#7 @ 12"	#7 @ 6"	#7 @ 12"	#4 @ 9" (T & B)	#4 @ 12" (E.F.)	#4 @ 12"	#4 @ 12" (E.W.)	-	-
	2	-	#6 @ 12"	#6 @ 8"	#6 @ 12"	#4 @ 9" (T & B)	#4 @ 12" (E.F.)	#4 @ 12"	-	-	-
	3	-	#5 @ 10"	#5 @ 12"	#5 @ 12"	#4 @ 12" (T & B)	#4 @ 12" (E.F.)	#4 @ 12"	-	-	-
	4	-	#5 @ 12"	#5 @ 12"	#5 @ 12"	#4 @ 12" (T & B)	#4 @ 12" (E.F.)	#4 @ 12"	-	-	-
F	5	-	#7 @ 12"	#7 @ 6"	#7 @ 12"	#4 @ 9" (T & B)	#4 @ 12" (E.F.)	#4 @ 12"	#4 @ 12" (E.W.)	-	-
	6	-	#6 @ 10"	#6 @ 6"	#6 @ 12"	#4 @ 12" (T & B)	#4 @ 12" (E.F.)	#4 @ 12"	#4 @ 12" (E.W.)	-	-
	7	-	#5 @ 10"	#5 @ 12"	#5 @ 12"	#4 @ 12" (T & B)	#4 @ 12" (E.F.)	#4 @ 12"	-	-	-
	8	-	#5 @ 12"	#5 @ 12"	#5 @ 12"	#4 @ 12" (T & B)	#4 @ 12" (E.F.)	#4 @ 12"	-	-	-
H	9	1.5240	#7 @ 12"	#7 @ 6"	#7 @ 12"	#4 @ 12" (T & B)	#4 @ 12" (E.F.)	#4 @ 12"	#4 @ 12" (E.W.)	#4 @ 12" (E.W.)	#5 @ 6"
	10	-	#6 @ 10"	#6 @ 6"	#6 @ 12"	#4 @ 12" (T & B)	#4 @ 12" (E.F.)	#4 @ 12"	#4 @ 12" (E.W.)	-	#5 @ 12"
	11	-	#5 @ 8"	#5 @ 10"	#5 @ 12"	#4 @ 12" (T & B)	#4 @ 12" (E.F.)	#4 @ 12"	-	-	#5 @ 12"
	12	-	#5 @ 10"	#5 @ 12"	#5 @ 12"	#4 @ 12" (T & B)	#4 @ 12" (E.F.)	#4 @ 12"	-	-	-
G	13	-	#5 @ 8"	#5 @ 12"	#5 @ 12"	#4 @ 12" (T & B)	#4 @ 12" (E.F.)	#4 @ 12"	-	-	-
	14	-	#5 @ 8"	#5 @ 12"	#5 @ 12"	#4 @ 12" (T & B)	#4 @ 12" (E.F.)	#4 @ 12"	-	-	-

NOTES:
1. MANUFACTURER ESTABLISHED ONLY AS DESIGN BASIS. SEE STRUCTURAL GENERAL NOTE 19 ON DRAWING S8001.
2. LEGEND:
TOW = TOP OF WALL
BOW = BACK OF WALL
FOW = FRONT OF WALL
BOF = BOTTOM OF FOOTING
E.J. = EXPANSION JOINT
C.J. = CONTRACTION JOINT
T.P. = TURNING POINT
3. RETAINING WALLS FOOTINGS TO BE PLACED OVER COMPACTED STRUCTURAL FILL AT LEAST 3 FEET BELOW BOTTOM OF FOOTING ON AREAS WHERE THE FOUNDATION LEVEL IS ANTICIPATED OVER THE EXISTING OVERBURDEN SOILS. SEE FOUNDATION NOTES ON DRAWINGS S8001 FOR COMPLETE REQUIREMENTS.
4. IF THE GEOTECHNICAL ENGINEER RETAINED FOR THE PROJECT DETERMINES THAT THE EXISTING SOILS AT THE BOTTOM OF FOOTING LEVEL ARE SUITABLE FOR THE RETAINING WALLS TO BEAR ON, AN EXPANSION JOINT SHALL BE PROVIDED BETWEEN THE SECTION OF THE WALL THAT BEARS ON EXISTING SOILS AND THE SECTION THAT BEARS ON COMPACTED STRUCTURAL FILL. SEE FOUNDATION NOTES ON DRAWINGS S8001 FOR COMPLETE REQUIREMENTS.
5. CONTRACTION JOINTS SHALL BE PLACED AT A MAXIMUM SPACING OF 8' MAX.
6. EXPANSION JOINTS SHALL BE PLACED AT A MAXIMUM SPACING OF 24' MAX.
7. OVER-COMPACTING OF THE SOIL BEHIND THE WALLS SHALL BE AVOIDED AS THE EARTH PRESSURE COEFFICIENT UNDER THIS CONDITION COULD INCREASE TO 3.0 OR MORE. LIGHTEST WEIGHT COMPACTION EQUIPMENT SHALL BE CONSIDERED AS WELL AS USING 80% OF THE MODIFIED PROCTOR (ASTM D1557) MAXIMUM DRY DENSITY.
8. SEE TYPICAL DETAILS AND DESIGN DATA ON DWG. C2008.

Revisions

Date

CONSULTANTS:

vireo
CSA Group

ETM
England-Thimms & Miller, Inc.
VISION • EXPERIENCE • RESULTS

Aqua Engineering
Inc.
Tribune Water Solutions

GMTS
GEOTECHNICAL & MATERIALS
TESTING SERVICES

ebp
LAND SURVEYING
SERVICES, P.S.C.
ENRIQUE BLANES PALMER
REGISTERED PROFESSIONAL
SURVEYOR

PROFESSIONAL SEAL

ARCHITECT/ENGINEERS:

ebp design group
CONSULTING ENGINEERS, P.S.C.
ENRIQUE BLANES PALMER - CIVIL ENGINEER LIC. 6416
TEL.: 787-268-0550 FAX: 787-268-1410
207 DEL PARQUE ST. 4TH FLOOR SAN JUAN, PUERTO RICO 00912
e-mail: ebpdesign@prtc.net - web: www.ebpdesigngroup.com

BID DOCUMENTS
SUBMISSION

Drawing Title

RETAINING WALLS STRUCTURAL
DETAILS - WALLS F, G & H

Project Title

"PUERTO RICO NATIONAL
CEMETERY REPLACEMENT"
PHASE 1 DEVELOPMENT

Project Number

87PC2031

Building Number

Location

MOROVIS

PUERTO RICO

Drawing Number

CI-508

Dwg. of

Approved PROJECT MANAGER

BRYAN J. BOONER
PHONE: (202)-632-5722

Approved CONTRACTING OFFICER

TERENCE CRAWLEY
PHONE: (202)-382-2766

Date

SEPTEMBER 28, 2016

Checked

JM

Drawn

JO

Office of
Construction
and Facilities
Management

Department of
Veterans Affairs

