

three inches = one foot

one and one half inches = one foot

one inch = one foot

three quarters inch = one foot


one half inch = one foot

three eighths inch = one foot

one quarter inch = one foot

one eighth inch = one foot

one sixteenth inch = one foot

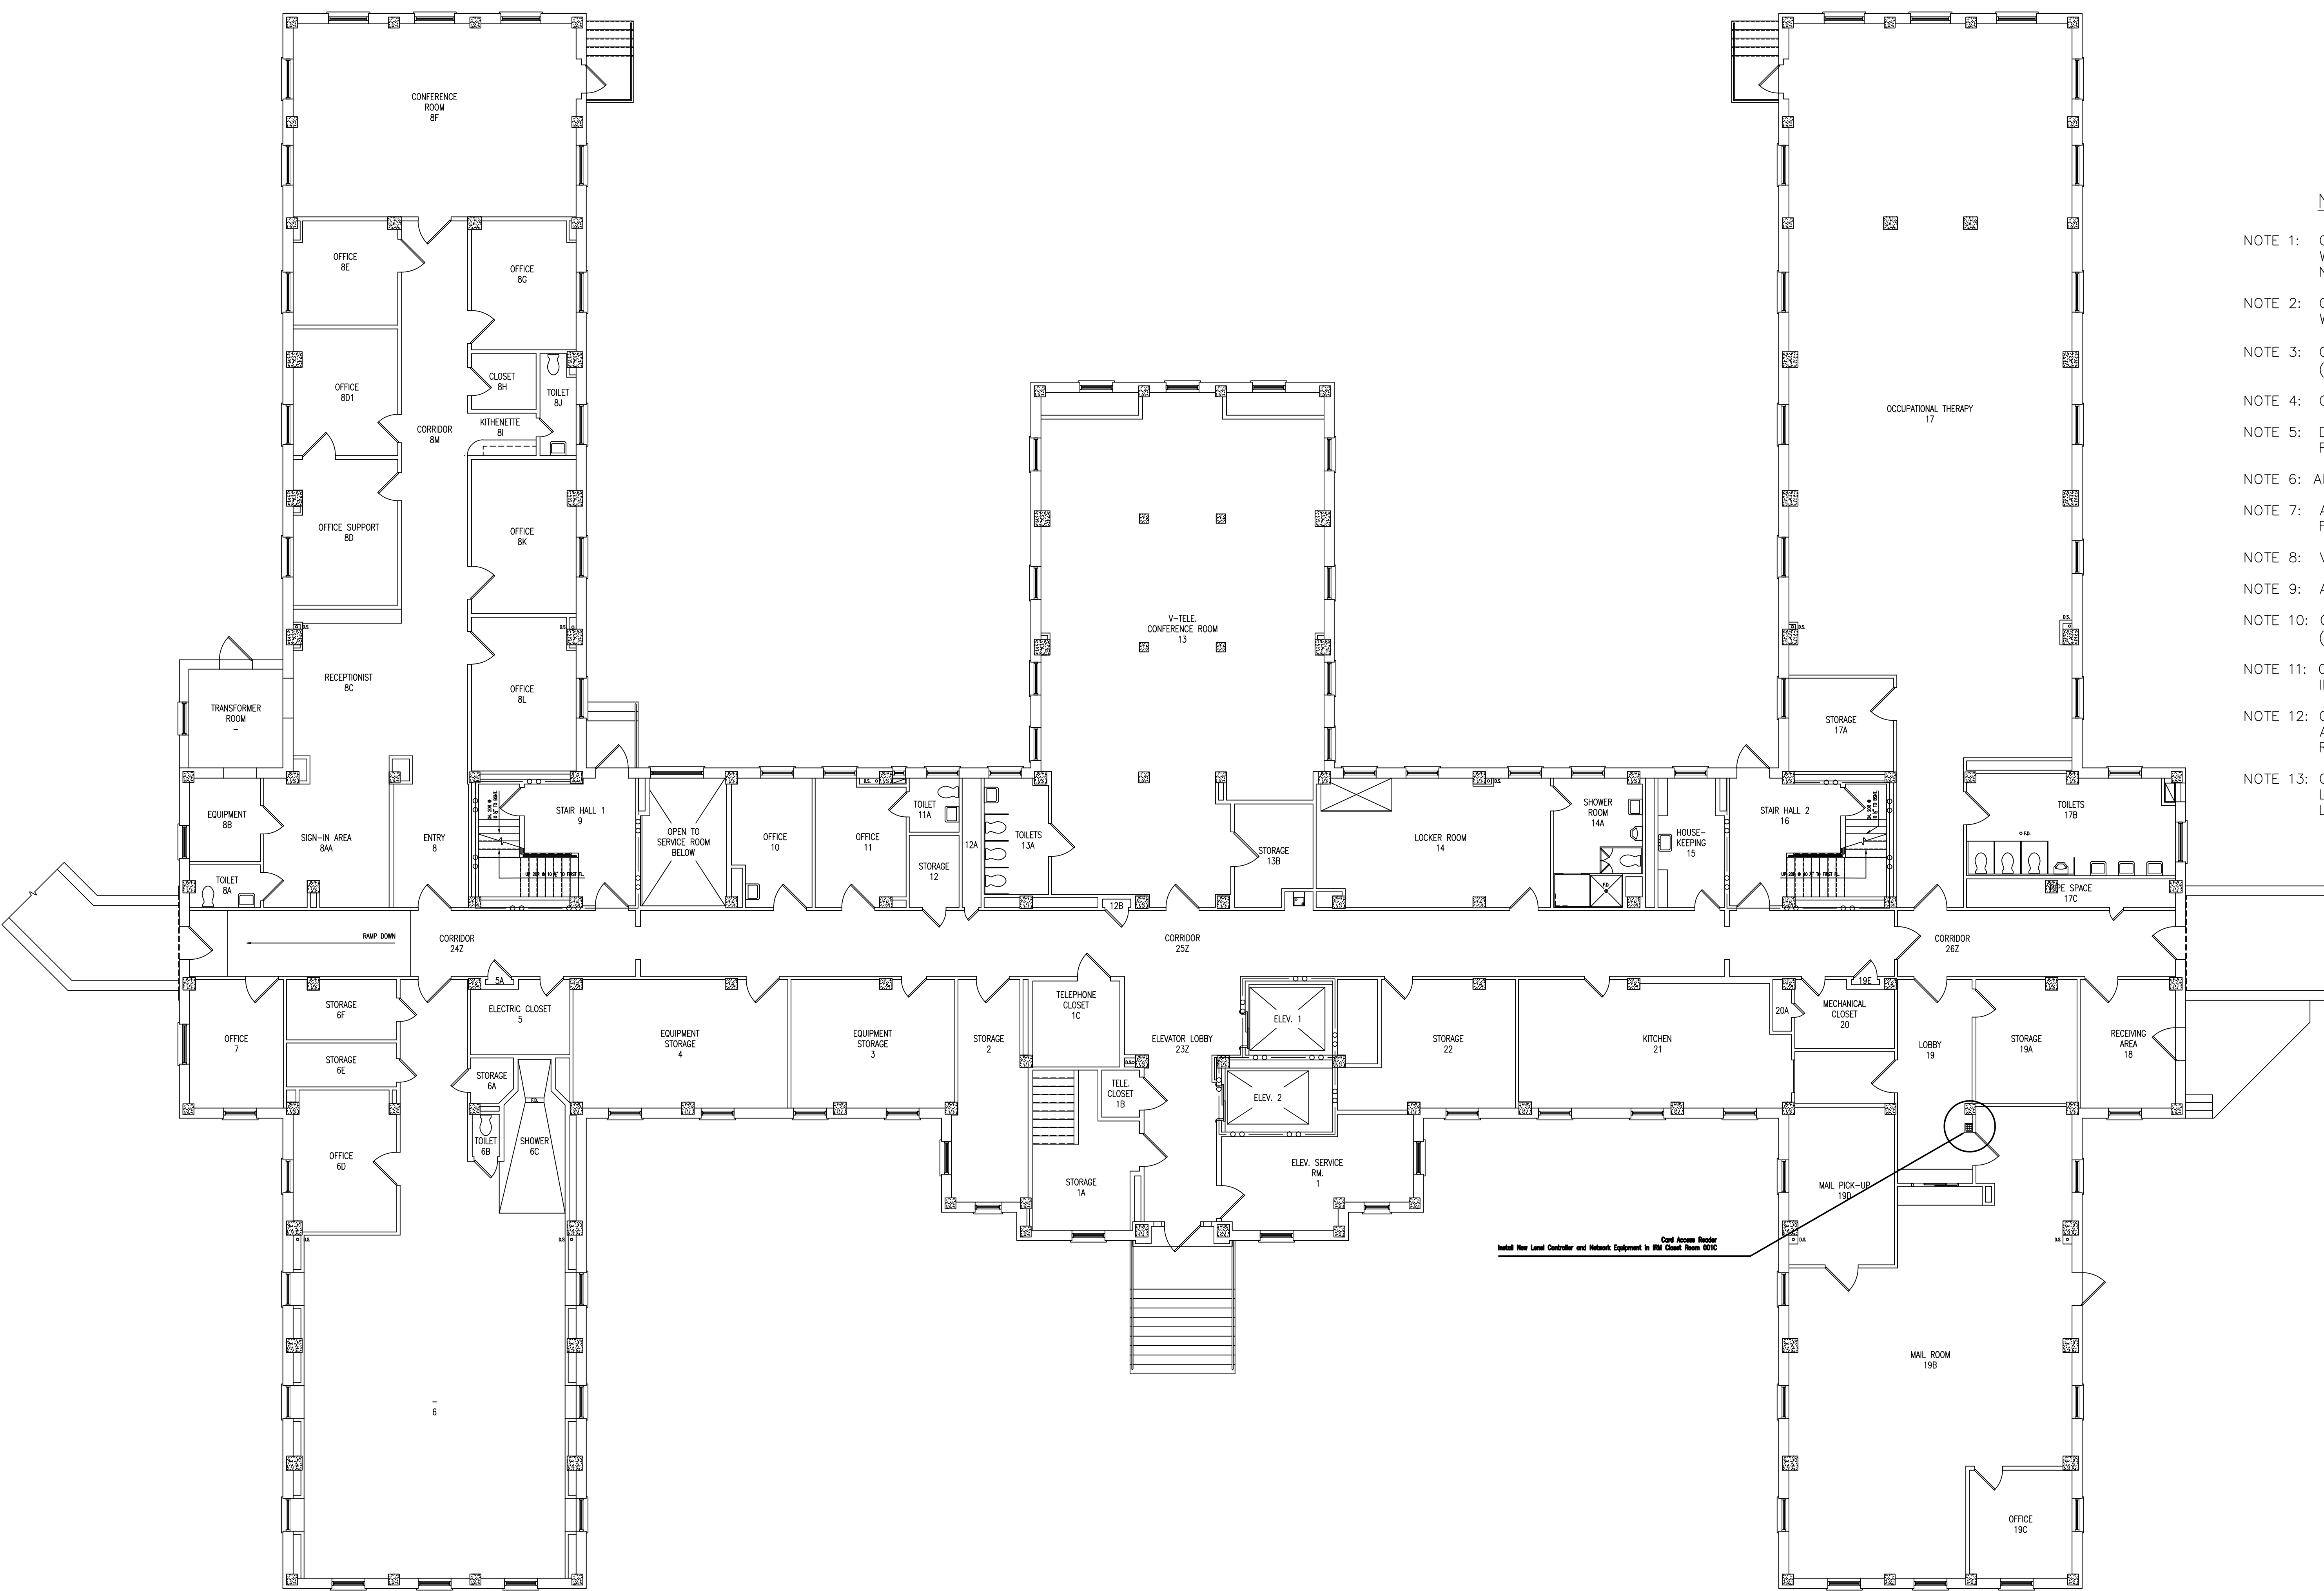

- NOTES
- NOTE 1:

CONTRACTOR WILL USE PANASONIC NETWORK CAMERAS MODEL WV-NW 502S WHEN REPLACING EXISTING CAMERAS AND INSTALLING NEW CAMERAS.
- NOTE 2:

CONTRACTOR WILL USE PANASONIC NETWORK PTZ MODEL WV-NW964 WHEN INSTALLING OUTDOOR CAMERAS.
- NOTE 3:

CONTRACTOR WILL USE PANASONIC NDR MODEL WJ-ND400K/8000T2 (8 TERABYTE NETWORK RECORDER).
- NOTE 4:

CONTRACTOR WILL USE CAT6 NETWORK CABLE.
- NOTE 5:

DO NOT USE THE STAIRWELL TO RUN VERTICAL CONDUIT FROM FLOOR TO FLOOR.
- NOTE 6:

ALL WIRING INSIDE STAIRWELLS MUST BE INSTALLED IN CONDUIT.
- NOTE 7:

ALL WALL PENETRATIONS THROUGH FIRE RATED BARRIERS WILL BE FIRE STOPPED.
- NOTE 8:

VERTICAL CONDUIT RISER MUST BE RUN IN MECHANICAL ROOMS.
- NOTE 9:

ALL CAT6 CABLE RUNS WILL BE INSIDE THE CABLE TRAY.
- NOTE 10:

CONTRACTOR WILL USE PANASONIC COMPACT NETWORK CAMERA (WV-SW155) FOR ELEVATOR.
- NOTE 11:

COORDINATE LOCATION OF ALL CAMERAS WITH COTR PRIOR TO INSTALLATION.
- NOTE 12:

CONTRACTOR IS RESPONSIBLE FOR DEMO OF EXISTING CAMERAS AND ANY ASSOCIATED PATCHING, REPAIR, CEILING TILE REPLACEMENT AND ASSOCIATED ANCILLARY WORK.
- NOTE 13:

CONTRACTOR WILL INSTALL NEW ACCESS CARD READERS, KEY LOCKBOXES, AND SAFES THAT WILL COMMUNICATE VIA THE EXISTING LENEL NETWORK.

- SYMBOLS
- PANASONIC NETWORK CAMERA (WV-NW 502S)
- PANASONIC PTZ NETWORK CAMERA (WV-NW964)
- Access Card Reader W/Keypad
- Gun Safe
- Key Lockbox
- 1 HR FIRE RATED BARRIER
- 2 HR FIRE RATED BARRIER

Card Access Reader  
Install New Land Controller and Network Equipment in RM Closet Room 007C

CONSULTANTS:		ARCHITECT/ENGINEERS:		NORTH:		Drawing Title		Project Title		Project Number		Office of Facilities Management Department of Veterans Affairs
						Architectural Plan		Card Access, Safe, Keylock Box, and Camera		620-11-242		
						GROUND FLOOR				Drawing Number		
						NTS				14		
Revisions						Approved Director		Location		Drawing Number		
								Montrose, New York		TY-10		
Date						Approved Chief of Engineering		Date		Checked		
								JP		DWG. 10 OF 13		