


**GENERAL DEMOLITION NOTES:**

1. THE EXTENT OF DEMOLITION IS NOT SHOWN HERE. CONTRACTOR IS RESPONSIBLE FOR DEMOLITION AS REQUIRED BY NEW WORK.
2. ALL ELECTRICAL CONDUIT, WIRING, DEVICES, FIXTURES, ETC. REQUIRED TO BE REMOVED TO ALLOW FOR NEW CONSTRUCTION, ABANDONED AS A RESULT OF NEW CONSTRUCTION, OR CURRENTLY NOT IN SERVICE SHALL BE REMOVED AS PART OF THIS CONTRACT. EXPOSED CONDUITS & CONDUITS IN ACCESSIBLE AREAS SHALL BE REMOVED COMPLETELY. CONDUITS CONCEALED IN FLOORS, WALLS & ABOVE NON-ACCESSIBLE CEILINGS MAY BE CAPPED AND ABANDONED AFTER REMOVAL OF ALL CONDUCTORS.
3. EXISTING ELECTRICAL EQUIPMENT AND CIRCUITRY NOT BEING REMOVED OR REWORKED UNDER THIS CONTRACT, BUT LOCATED SO AS TO BE AFFECTED BY THE WORK UNDER THIS CONTRACT, SHALL REMAIN IN SERVICE. SUCH CIRCUITS, EQUIPMENT, ETC., SHALL BE EXTENDED, RELOCATED OR REMOVED & REINSTALLED AS REQUIRED TO ACCOMMODATE NEW CONSTRUCTION.
4. DUE TO THE DEMOLITION OF CEILINGS, CONTRACTOR SHALL RELOCATE AND/OR SUPPORT EXISTING ITEMS AT OR ABOVE CEILING THAT WILL REMAIN IN SERVICE.

**NOTES:**

1. DISCONNECT POWER TO EXISTING FAN COIL UNIT AND REMOVE CIRCUIT COMPLETE BACK TO SOURCE. MECHANICAL CONTRACTOR SHALL REMOVE AND/OR RELOCATE EXISTING FAN COIL UNIT.

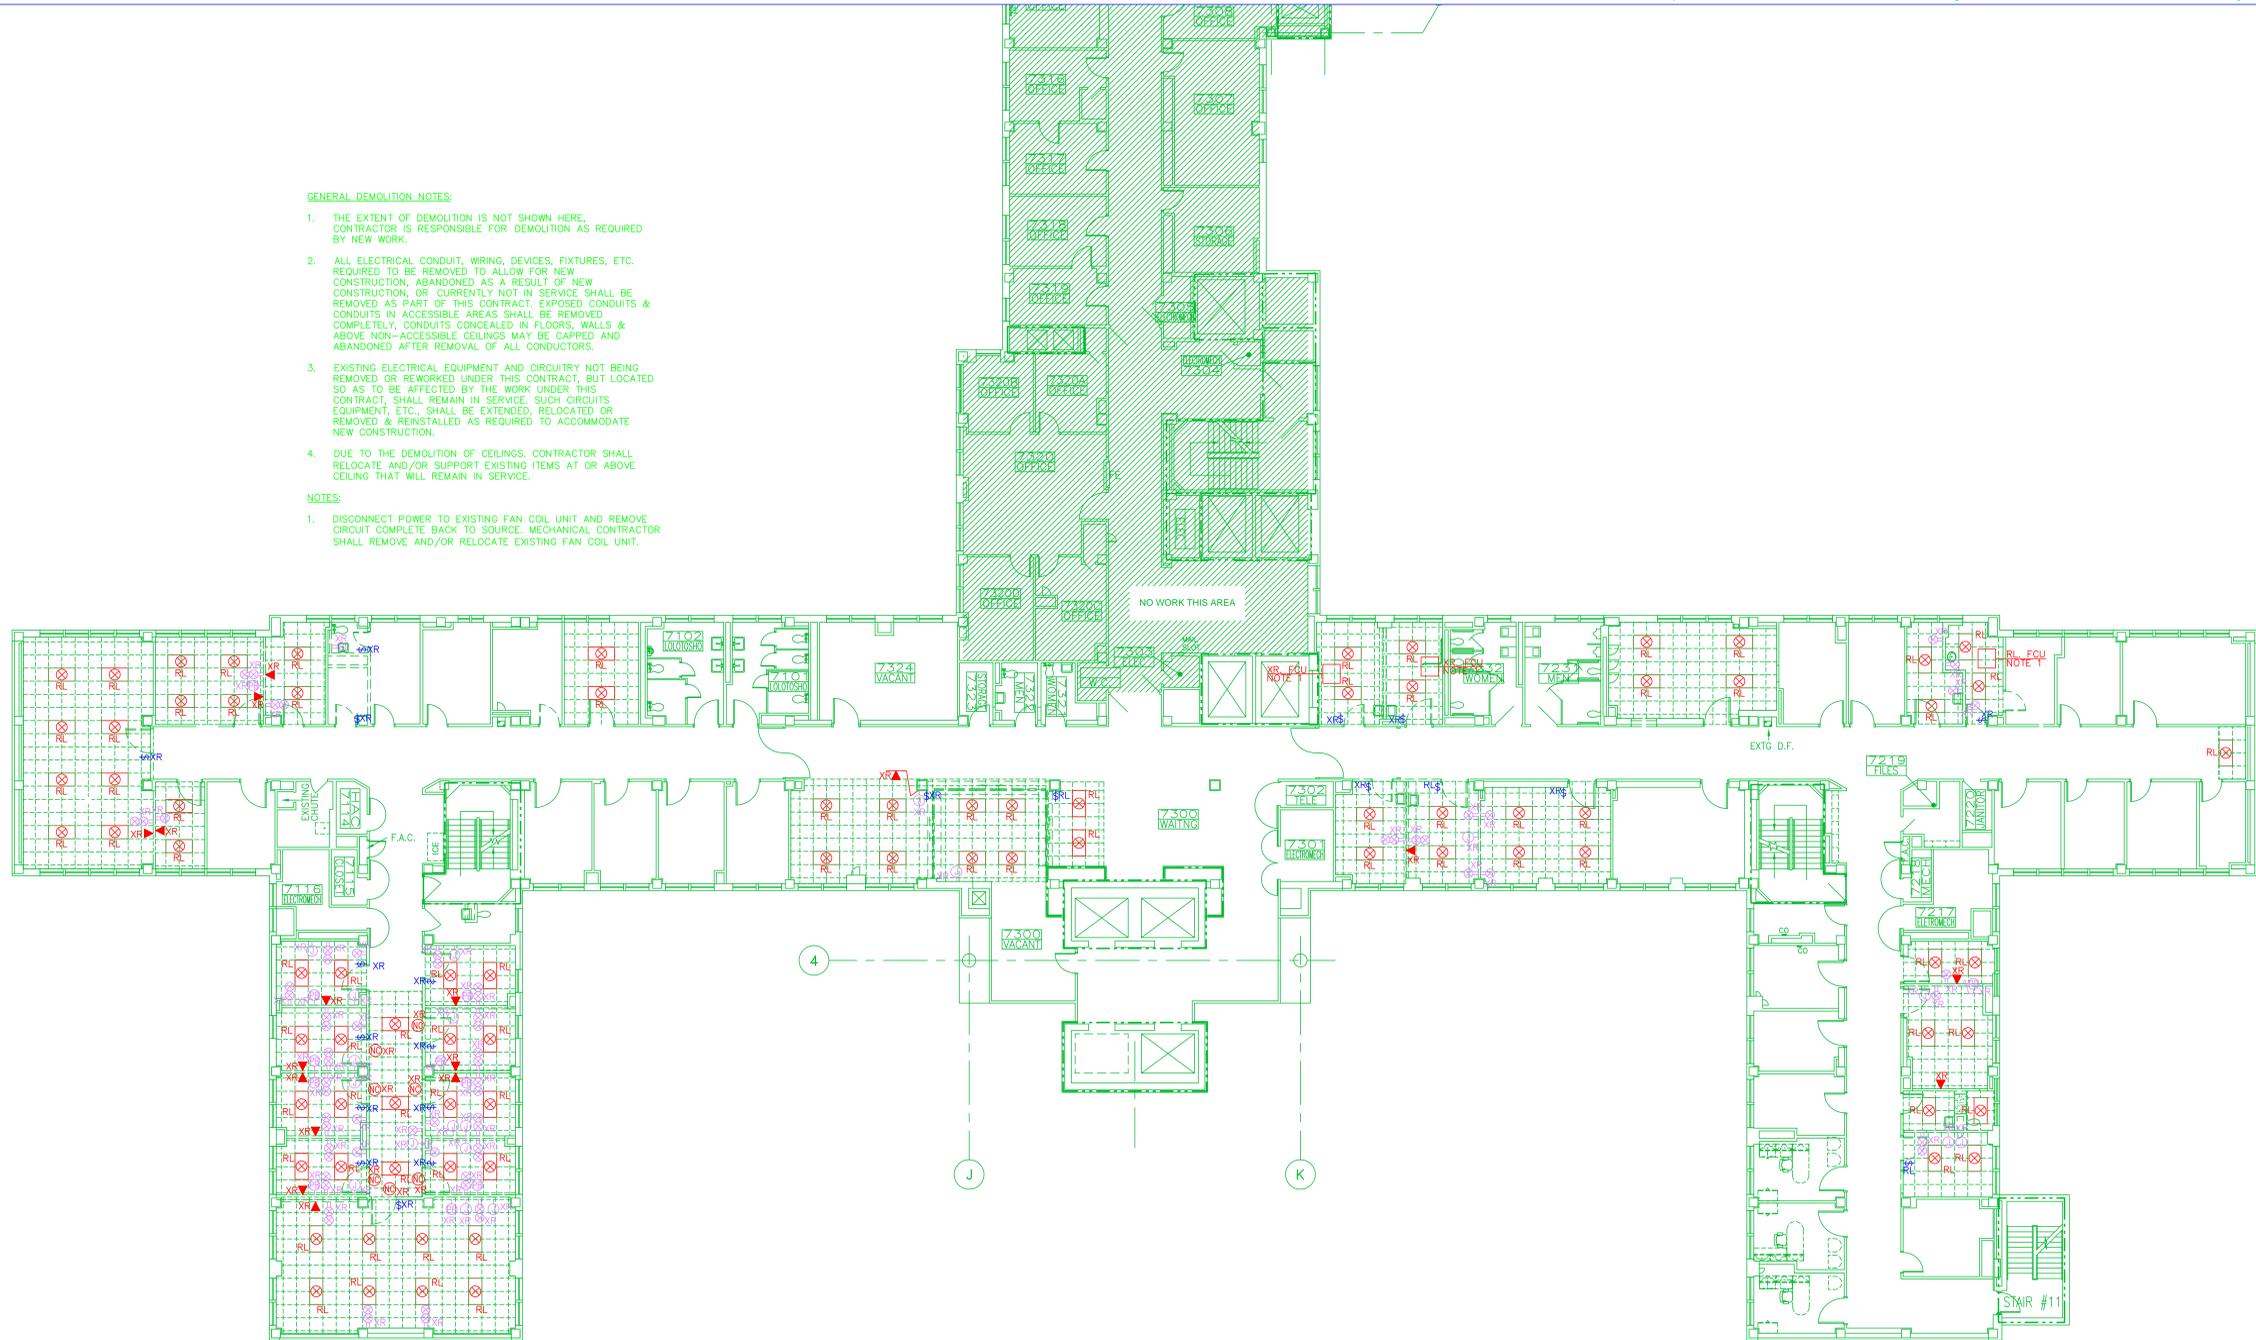

**1** PARTIAL 7TH FLOOR DEMOLITION PLAN - ELECTRICAL  
SCALE: 3/32" = 1'-0"

**SEG**  
SAJJADIEH ENGINEERING GROUP, P.C.  
1507 ALEX DRIVE, SUITE 101  
BIRMINGHAM, ALABAMA 35210  
205.833.7033 FAX: 205.314.6180  
www.segengineering.com

Date:	08-02-11
VA Project No.	521-10-101
CAD File No.	10-01_E2.0
DRAWING NO.	<b>E2.0</b>
Dwg. of	

Revisions	Date

**BIRCHFIELD  
PENUEL &  
ASSOCIATES,  
ARCHITECTS**  
2805 CRESCENT AVENUE • SUITE 200 • BIRMINGHAM, ALABAMA 35209

**Department of Veterans Affairs  
MEDICAL CENTER  
BIRMINGHAM, ALABAMA**

Drawing Title	<b>PARTIAL 7TH FLOOR DEMOLITION PLAN - ELECTRICAL</b>		
Project Title	<b>RENOVATE SPACE FOR REHAB AND PHYSICAL MEDICINE</b>		
Building Numbers	Checked	Drawn	
Location	VA MEDICAL CENTER BIRMINGHAM, ALABAMA		

**Veterans Administration**

**FINAL SUBMITTAL**