GENERAL NOTES:

1. CIRCUIT NUMBERS ARE FOR CLARITY ONLY.
2. VERIFY LOAD ON EXISTING CIRCUITS. MAXIMUM LOAD ON LIGHTING CIRCUIT SHALL BE 1900 WATTS.

NOTES:

1. CONNECT TO EXISTING 120VOLT NORMAL LIGHTING CIRCUIT IN THIS AREA.
2. CONNECT TO EXISTING 120VOLT EMERGENCY (LIFE SAFETY) LIGHTING CIRCUIT IN THIS AREA.
3. LOCAL OVER RIDE OFF SWITCH. SEE OCCUPANCY SENSOR WIRING DIAGRAM A ON SHEET E1.1.
4. LOCAL OVER RIDE OFF SWITCH. SEE OCCUPANCY SENSOR WIRING DIAGRAM B ON SHEET E1.1.
5. LOCAL OVERRIDE OFF SWITCH. SEE OCCUPANCY SENSOR WIRING DIAGRAM D ON SHEET E1.1.

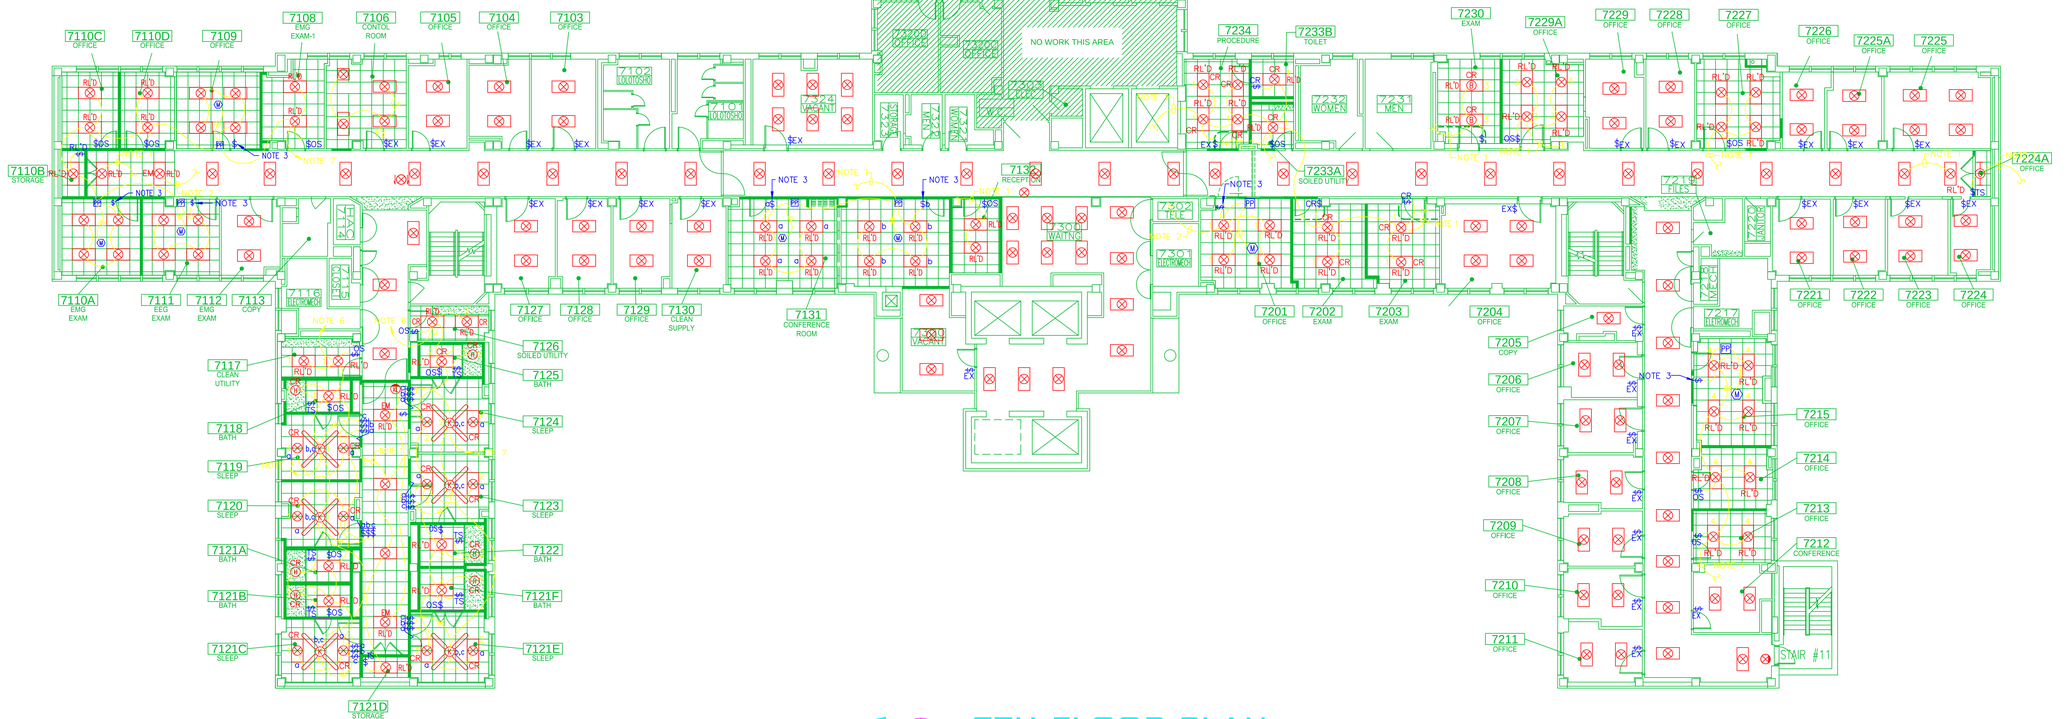

1 N 7TH FLOOR PLAN - LIGHTING

SCALE: 3/32"=1'-0"

SAJJADIEH ENGINEERING GROUP, P.C.
1907 ALEX DRIVE, SUITE 101
BIRMINGHAM, ALABAMA 35210
205.833.7033 FAX: 205.314.0180
www.sajjadiehengineering.com

PROJECT: 10-01

FINAL SUBMITTAL

Revisions	Date

BIRCHFIELD PENUEL & ASSOCIATES, ARCHITECTS
2805 CRESCENT AVENUE · SUITE 200 ·BIRMINGHAM, ALABAMA 35209

Department of Veterans Affairs
MEDICAL CENTER
BIRMINGHAM, ALABAMA

Drawing Title: 7TH FLOOR PLAN - C - LIGHTING

Project Title: RENOVATE SPACE FOR REHAB AND PHYSICAL MEDICINE

Date: 08-02-11
VA Project No. 521-10-101
CAD File No. 10-01_E3.0

Building Numbers | Checked | Drawn

Location: VA MEDICAL CENTER BIRMINGHAM, ALABAMA

DRAWING NO. E3.0
Dwg. of

Veterans Administration