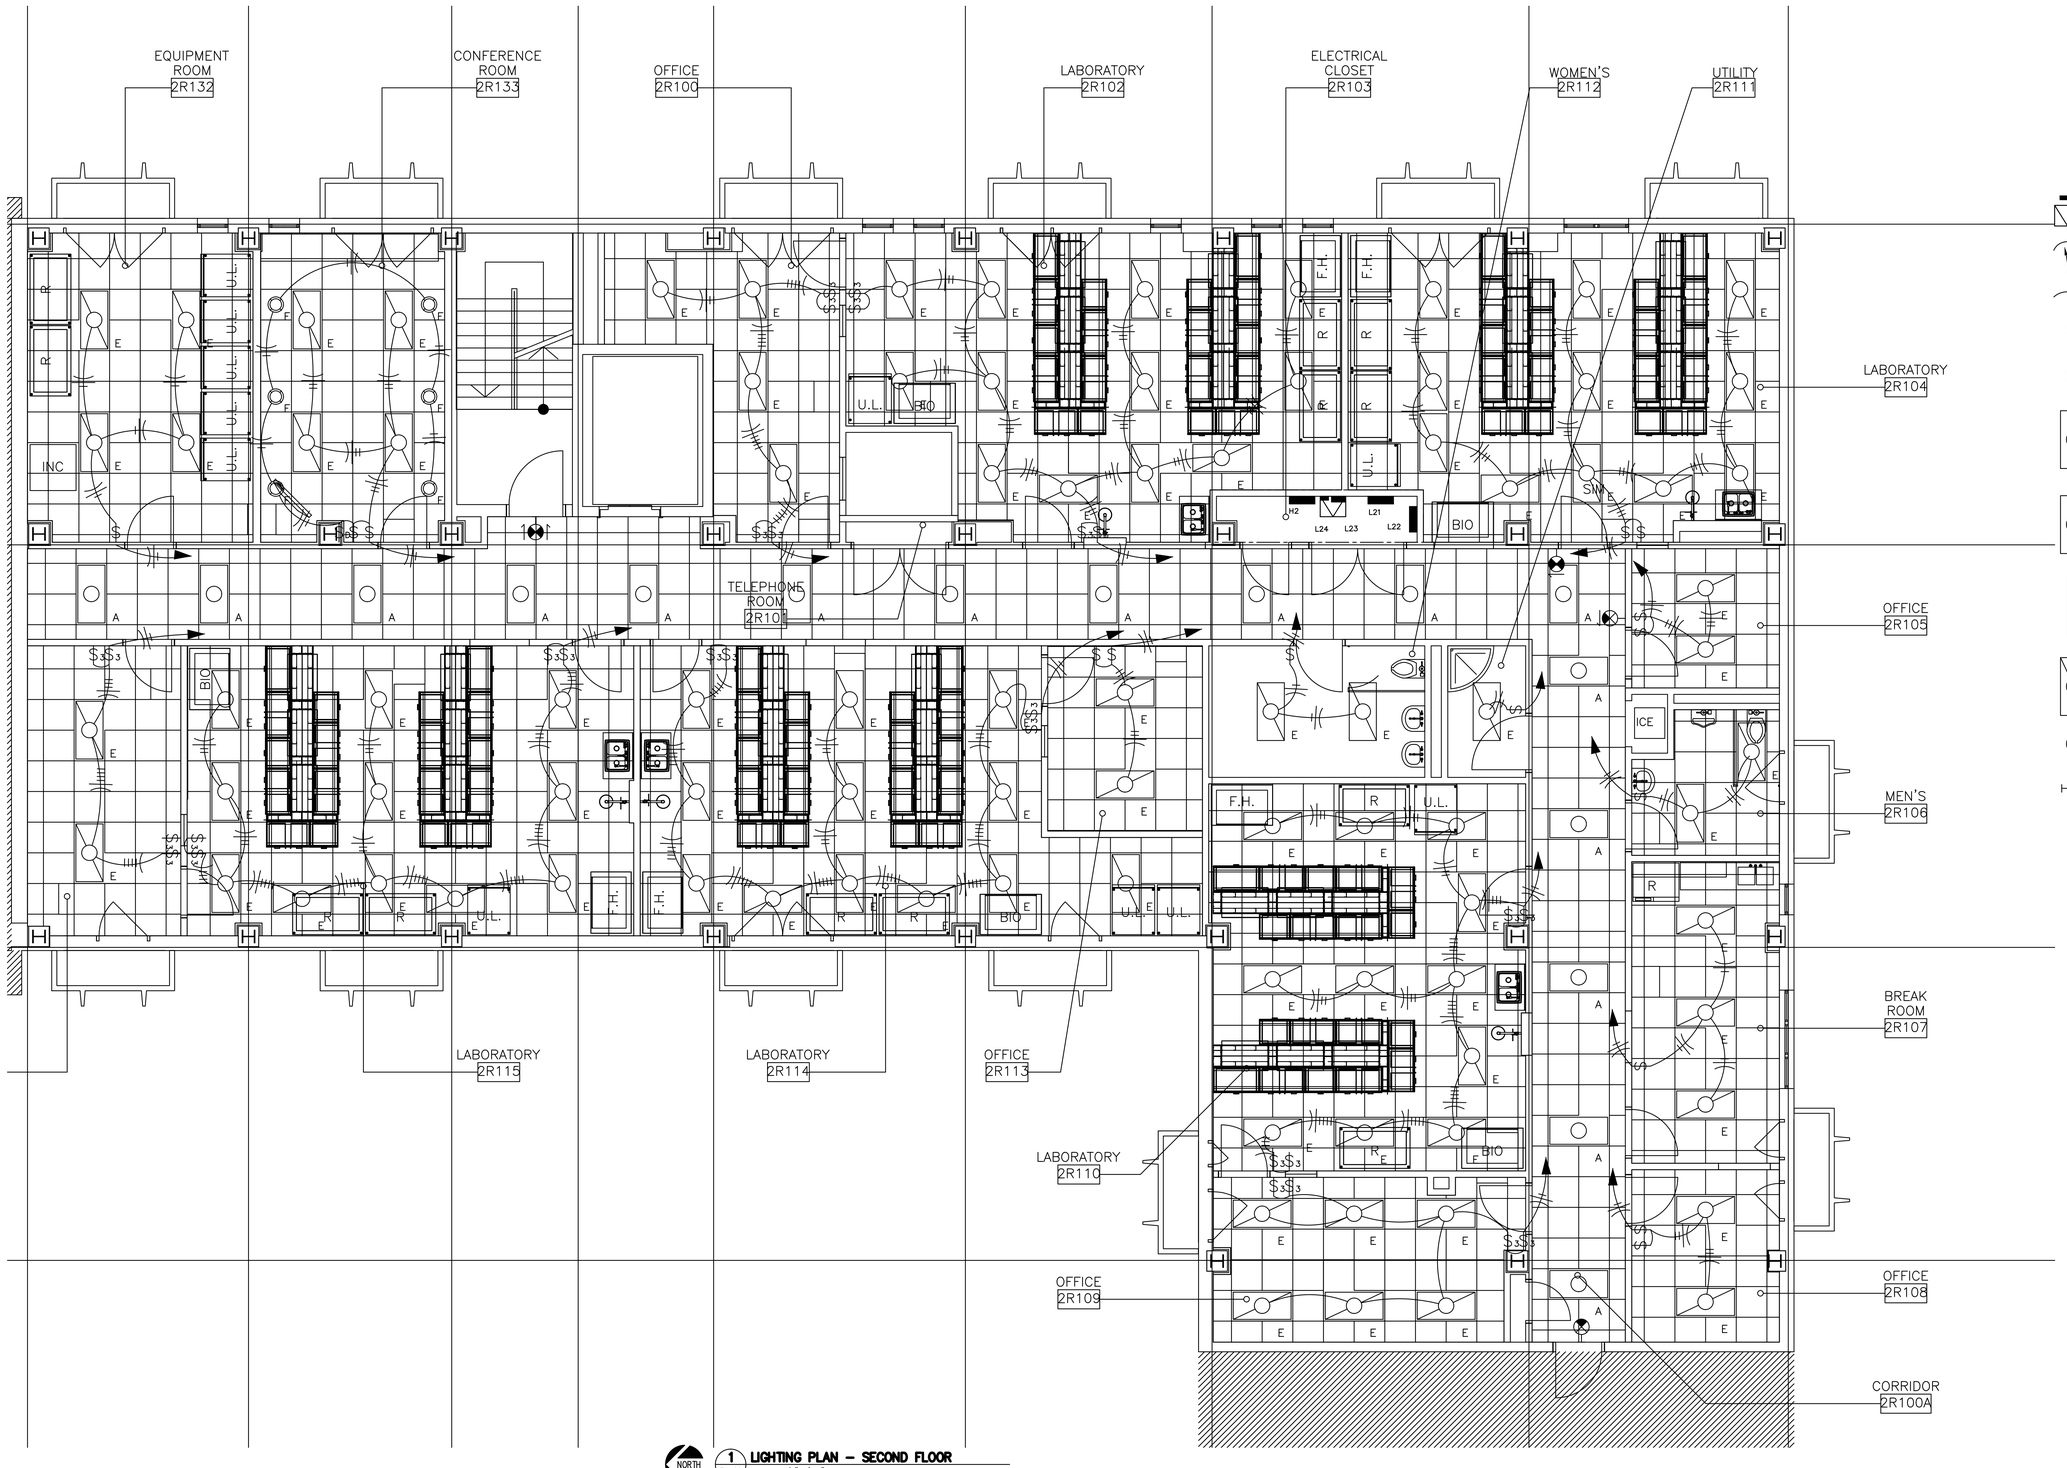

SYMBOL LEGEND

- PANELBOARD
- DRY TYPE TRANSFORMER
- BRANCH CIRCUIT CONDUCTORS, 3/4"C MINIMUM UNLESS NOTED OTHERWISE. #12 AWG MINIMUM UNLESS NOTED OTHERWISE.
  - PHASE CONDUCTOR(S)
  - NEUTRAL CONDUCTOR(S)
  - GROUND CONDUCTOR
- ARROWHEAD DENOTES HOMERUN TO EQUIPMENT AS DESIGNATED.
  p.c. = PARTIAL CIRCUIT
- $ WALL BOX TOGGLE SWITCH, 48" AFF TO CENTER OF BOX.
  BLANK = SINGLE-POLE
  3 = THREE-WAY
- $D WALLBOX DIMMER, COMPATIBLE WITH CONNECTED FIXTURES. PROVIDE CONTROL WIRING TO FIXTURES AS REQUIRED.
- A FLOURESCENT TROFFER, 2x4, PRISMATIC LENS, TWO (2) T8 LAMPS.
- B FLOURESCENT TROFFER, 2x4, PRISMATIC LENS, THREE (3) T8 LAMPS.
- D WALL BRACKET FLOURESCENT FIXTURE, PRISMATIC LENSE, ONE (1) T8 LAMP.
- E FLOURESCENT TROFFER
- F OPEN DOWNLIGHT, 26W FLOURESCENT LAMP, CLEAR ALZAK SELF-RIM REFLECTOR, 277V DIMMING BALLAST.
- EXIT SIGN, 277V, RED LED LETTERING

NORTH

1 / E-402 **LIGHTING PLAN – SECOND FLOOR**
SCALE: 1/4"=1'-0"

4' 2' 0 4'
SCALE IN FEET

KEY PLAN

Revisions:	Date

CONSULTANTS:

ARCHITECT/ENGINEERS:

Drawing Title: SECOND FLOOR LIGHTING PLAN	Project Title: BUILDING 19	Project Number	Office of OKC VAMC ENGINEERING PROJECTS
Approved: Medical Center Director		Building Number: Bldg. 1	
Approved: Chief, Engineers	Location: VA MEDICAL CENTER OKLAHOMA CITY, OKLAHOMA	Drawing Number	
Approved: Chief, Projects	Date: MAY 2012 / Checked / Drawn	Dwg. 11 of 16	Department of Veterans Affairs

VA FORM 08-6231