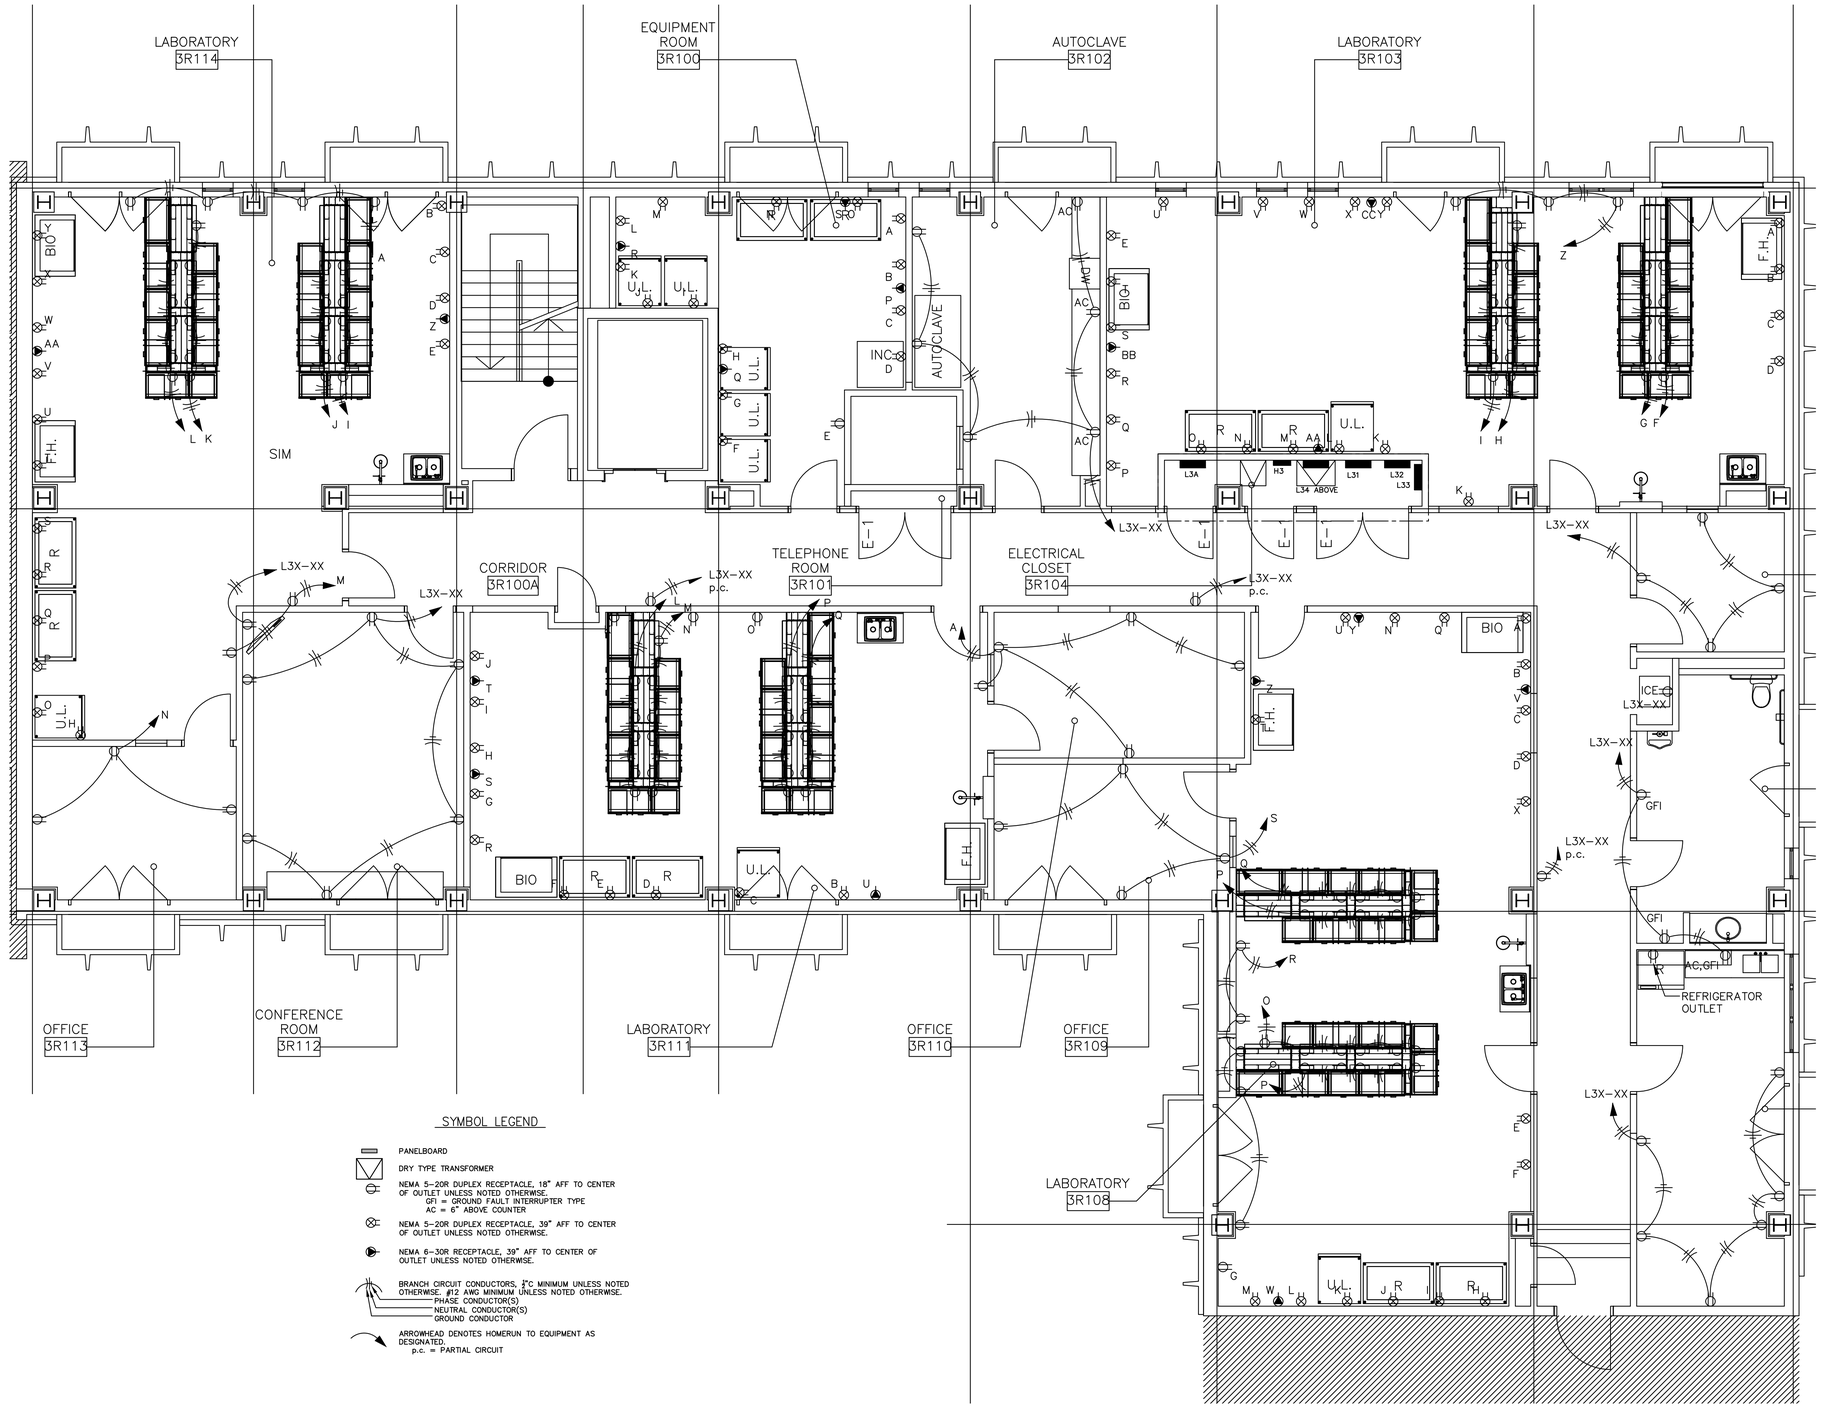

OUTLET/HOMERUN CONNECTION SCHEDULE

ROOM	OUTLETS/HOMERUNS ON COMMON CIRCUIT	CIRCUIT RATING	ACTUAL CONNECTED CIRCUIT
3R100	A,E	120V, 1-PHASE, 20A	
	B,G	120V, 1-PHASE, 20A	
	C,H	120V, 1-PHASE, 20A	
	D,I	120V, 1-PHASE, 20A	
	F,J	120V, 1-PHASE, 20A	
	P,Q,R,S	**208V, 1-PHASE, 30A**	
	K,N	120V, 1-PHASE, 20A	
	L,O	120V, 1-PHASE, 20A	
	M	120V, 1-PHASE, 20A	
3R103	J,Z	120V, 1-PHASE, 20A	
	A,U	120V, 1-PHASE, 20A	
	B,V	120V, 1-PHASE, 20A	
	C,W	120V, 1-PHASE, 20A	
	AA,BB,CC	**208V, 1-PHASE, 30A**	
	D,X	120V, 1-PHASE, 20A	
	E,Y	120V, 1-PHASE, 20A	
	P,K	120V, 1-PHASE, 20A	
	L,Q	120V, 1-PHASE, 20A	
	M,R	120V, 1-PHASE, 20A	
	N,S	120V, 1-PHASE, 20A	
	O,T	120V, 1-PHASE, 20A	
	I	120V, 1-PHASE, 20A	
	H	120V, 1-PHASE, 20A	
	G	120V, 1-PHASE, 20A	
	F	120V, 1-PHASE, 20A	
3R108	A,I	120V, 1-PHASE, 20A	
	B,J	120V, 1-PHASE, 20A	
	C,L	120V, 1-PHASE, 20A	
	D,M	120V, 1-PHASE, 20A	
	E,T	120V, 1-PHASE, 20A	
	F,U	120V, 1-PHASE, 20A	
	H,N	120V, 1-PHASE, 20A	
	K	120V, 1-PHASE, 20A	
	R,X,G	120V, 1-PHASE, 20A	
	V,W,Y,Z	**208V, 1-PHASE, 30A**	
	S	120V, 1-PHASE, 20A	
	O	120V, 1-PHASE, 20A	
	P	120V, 1-PHASE, 20A	
	Q	120V, 1-PHASE, 20A	
	C,G	120V, 1-PHASE, 20A	
3R111	D,H	120V, 1-PHASE, 20A	
	E,I	120V, 1-PHASE, 20A	
	T,S,U	**208V, 1-PHASE, 30A**	
	F,J	120V, 1-PHASE, 20A	
	B,R	120V, 1-PHASE, 20A	
	A	120V, 1-PHASE, 20A	
	K,N,O	120V, 1-PHASE, 20A	
	L	120V, 1-PHASE, 20A	
	M	120V, 1-PHASE, 20A	
	P	120V, 1-PHASE, 20A	
	Q	120V, 1-PHASE, 20A	
	B,Q	120V, 1-PHASE, 20A	
3R114	C,R	120V, 1-PHASE, 20A	
	Z,AA,BB	**208V, 1-PHASE, 30A**	
	D,S	120V, 1-PHASE, 20A	
	E,T	120V, 1-PHASE, 20A	
	U,V	120V, 1-PHASE, 20A	
	H,W	120V, 1-PHASE, 20A	
	P,X	120V, 1-PHASE, 20A	
	O,Y	120V, 1-PHASE, 20A	
	M,N	120V, 1-PHASE, 20A	
	A	120V, 1-PHASE, 20A	
	L	120V, 1-PHASE, 20A	
	K	120V, 1-PHASE, 20A	
	J	120V, 1-PHASE, 20A	
	I	120V, 1-PHASE, 20A	

SYMBOL LEGEND

- PANELBOARD
- DRY TYPE TRANSFORMER
- NEMA 5-20R DUPLEX RECEPTACLE, 18" AFF TO CENTER OF OUTLET UNLESS NOTED OTHERWISE.
  GFI = GROUND FAULT INTERRUPTER TYPE
  AC = 6" ABOVE COUNTER
- NEMA 5-20R DUPLEX RECEPTACLE, 39" AFF TO CENTER OF OUTLET UNLESS NOTED OTHERWISE.
- NEMA 6-30R RECEPTACLE, 39" AFF TO CENTER OF OUTLET UNLESS NOTED OTHERWISE.
- BRANCH CIRCUIT CONDUCTORS, $\frac{3}{4}$"C MINIMUM UNLESS NOTED OTHERWISE. #12 AWG MINIMUM UNLESS NOTED OTHERWISE.
  PHASE CONDUCTOR(S)
  NEUTRAL CONDUCTOR(S)
  GROUND CONDUCTOR
- ARROWHEAD DENOTES HOMERUN TO EQUIPMENT AS DESIGNATED.
  p.c. = PARTIAL CIRCUIT

NORTH

1 E-303 **RECEPTACLE PLAN – THIRD FLOOR**
SCALE: 1/4"=1'-0"

4' 2' 0 4'
SCALE IN FEET

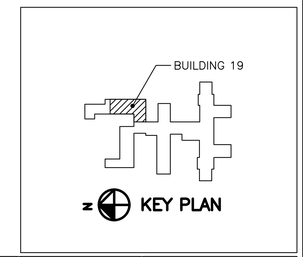

Revisions:	Date

CONSULTANTS:

ARCHITECT/ENGINEERS:

Drawing Title	THIRD FLOOR RECEPTACLE PLAN
Approved: Medical Center Director	
Approved: Chief, Engineers	
Approved: Chief, Projects	
Project Title	BUILDING 19
Location	VA MEDICAL CENTER OKLAHOMA CITY, OKLAHOMA
Date	MAY 2012
Checked	
Drawn	
Project Number	
Building Number	Bldg. 1
Drawing Number	Dwg. 8 of 16

Office of OKC VAMC ENGINEERING PROJECTS
Department of Veterans Affairs

VA FORM 08-6231