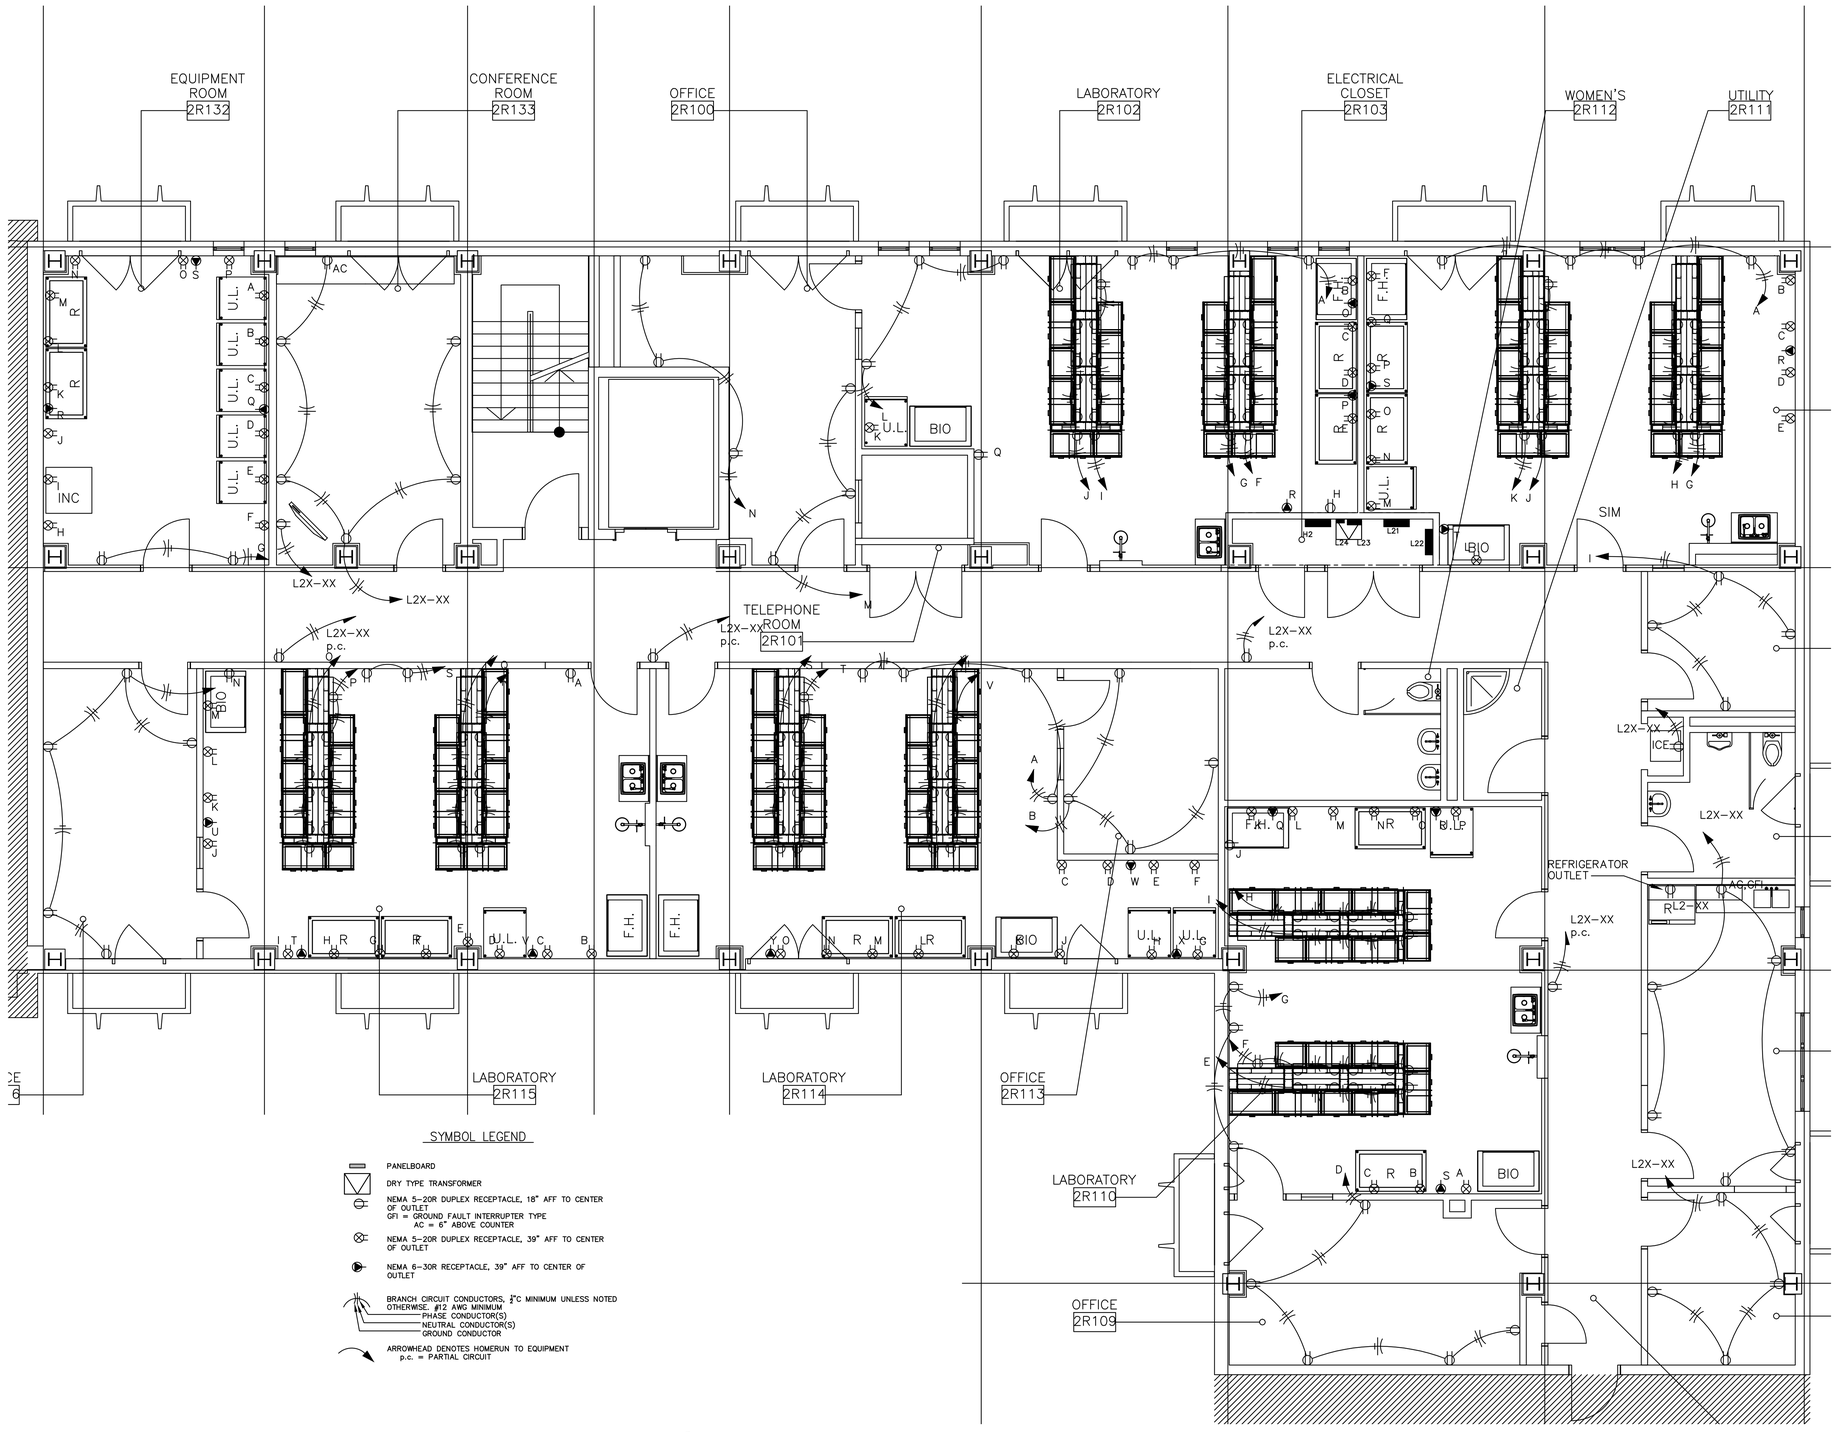

SYMBOL LEGEND

- PANELBOARD
- DRY TYPE TRANSFORMER
- NEMA 5-20R DUPLEX RECEPTACLE, 18" AFF TO CENTER OF OUTLET
  GFI = GROUND FAULT INTERRUPTER TYPE
  AC = 6" ABOVE COUNTER
- NEMA 5-20R DUPLEX RECEPTACLE, 39" AFF TO CENTER OF OUTLET
- NEMA 6-30R RECEPTACLE, 39" AFF TO CENTER OF OUTLET
- BRANCH CIRCUIT CONDUCTORS, ¾"C MINIMUM UNLESS NOTED OTHERWISE. #12 AWG MINIMUM
  - PHASE CONDUCTOR(S)
  - NEUTRAL CONDUCTOR(S)
  - GROUND CONDUCTOR
- ARROWHEAD DENOTES HOMERUN TO EQUIPMENT
  p.c. = PARTIAL CIRCUIT

NORTH

1 E-302 **RECEPTACLE PLAN – SECOND FLOOR**

SCALE: 1/4"=1'-0"

4' 2' 0 4'

SCALE IN FEET

OUTLET/HOMERUN CONNECTION SCHEDULE

ROOM	OUTLETS/HOMERUNS ON COMMON CIRCUIT	CIRCUIT RATING	ACTUAL CONNECTED CIRCUIT
2R102	B,A	120V, 1-PHASE, 20A	
	C,L	120V, 1-PHASE, 20A	
	D,H	120V, 1-PHASE, 20A	
	E,K,Q	120V, 1-PHASE, 20A	
	O,P,R	**208V, 1-PHASE, 30A**	
	M,N	120V, 1-PHASE, 20A	
	F	120V, 1-PHASE, 20A	
	G	120V, 1-PHASE, 20A	
	I	120V, 1-PHASE, 20A	
	J	120V, 1-PHASE, 20A	
2R104	B,N	120V, 1-PHASE, 20A	
	C,O	120V, 1-PHASE, 20A	
	D,P	120V, 1-PHASE, 20A	
	E,Q	120V, 1-PHASE, 20A	
	R,S,T	**208V, 1-PHASE, 30A**	
	F	120V, 1-PHASE, 20A	
	L,M	120V, 1-PHASE, 20A	
	A	120V, 1-PHASE, 20A	
	I	120V, 1-PHASE, 20A	
	G	120V, 1-PHASE, 20A	
	H	120V, 1-PHASE, 20A	
	J	120V, 1-PHASE, 20A	
	K	120V, 1-PHASE, 20A	
2R110	A,G,J	120V, 1-PHASE, 20A	
	C	120V, 1-PHASE, 20A	
	K,L	120V, 1-PHASE, 20A	
	M,P	120V, 1-PHASE, 20A	
	N,B	120V, 1-PHASE, 20A	
	O	120V, 1-PHASE, 20A	
	Q,R,S	**208V, 1-PHASE, 30A**	
	D	120V, 1-PHASE, 20A	
	E	120V, 1-PHASE, 20A	
	F	120V, 1-PHASE, 20A	
	I	120V, 1-PHASE, 20A	
	H	120V, 1-PHASE, 20A	
2R114	C,I	120V, 1-PHASE, 20A	
	D,J	120V, 1-PHASE, 20A	
	E,K	120V, 1-PHASE, 20A	
	W,X,Y	**208V, 1-PHASE, 30A**	
	F,L	120V, 1-PHASE, 20A	
	G,M	120V, 1-PHASE, 20A	
	H,N	120V, 1-PHASE, 20A	
	S	120V, 1-PHASE, 20A	
	T	120V, 1-PHASE, 20A	
	U	120V, 1-PHASE, 20A	
	V	120V, 1-PHASE, 20A	
	Q,R	120V, 1-PHASE, 20A	
	A,O	120V, 1-PHASE, 20A	
	B,P	120V, 1-PHASE, 20A	
2R115	A,S,N	120V, 1-PHASE, 20A	
	B,H	120V, 1-PHASE, 20A	
	T,U,V	**208V, 1-PHASE, 30A**	
	C,I	120V, 1-PHASE, 20A	
	D,J	120V, 1-PHASE, 20A	
	E,K	120V, 1-PHASE, 20A	
	O	120V, 1-PHASE, 20A	
	P	120V, 1-PHASE, 20A	
	Q	120V, 1-PHASE, 20A	
	R	120V, 1-PHASE, 20A	
	F,L	120V, 1-PHASE, 20A	
	G,M	120V, 1-PHASE, 20A	
2R132	A,K	120V, 1-PHASE, 20A	
	B,L	120V, 1-PHASE, 20A	
	C,M	120V, 1-PHASE, 20A	
	D,N	120V, 1-PHASE, 20A	
	E,O	120V, 1-PHASE, 20A	
	F,P	120V, 1-PHASE, 20A	
	Q,R,S	**208V, 1-PHASE, 30A**	
	H,G	120V, 1-PHASE, 20A	
	I	120V, 1-PHASE, 20A	
	J	120V, 1-PHASE, 20A	

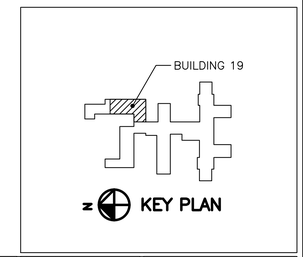

Revisions:	Date

CONSULTANTS:

ARCHITECT/ENGINEERS:

Drawing Title: SECOND FLOOR RECEPTACLE PLAN

Approved: Medical Center Director

Approved: Chief, Engineers

Approved: Chief, Projects

Project Title: BUILDING 19

Location: VA MEDICAL CENTER, OKLAHOMA CITY, OKLAHOMA

Date: MAY 2012 | Checked | Drawn

Project Number

Building Number: Bldg. 1

Drawing Number: Dwg. 7 of 16

Office of OKC VAMC ENGINEERING PROJECTS

Department of Veterans Affairs

VA FORM 08-6231