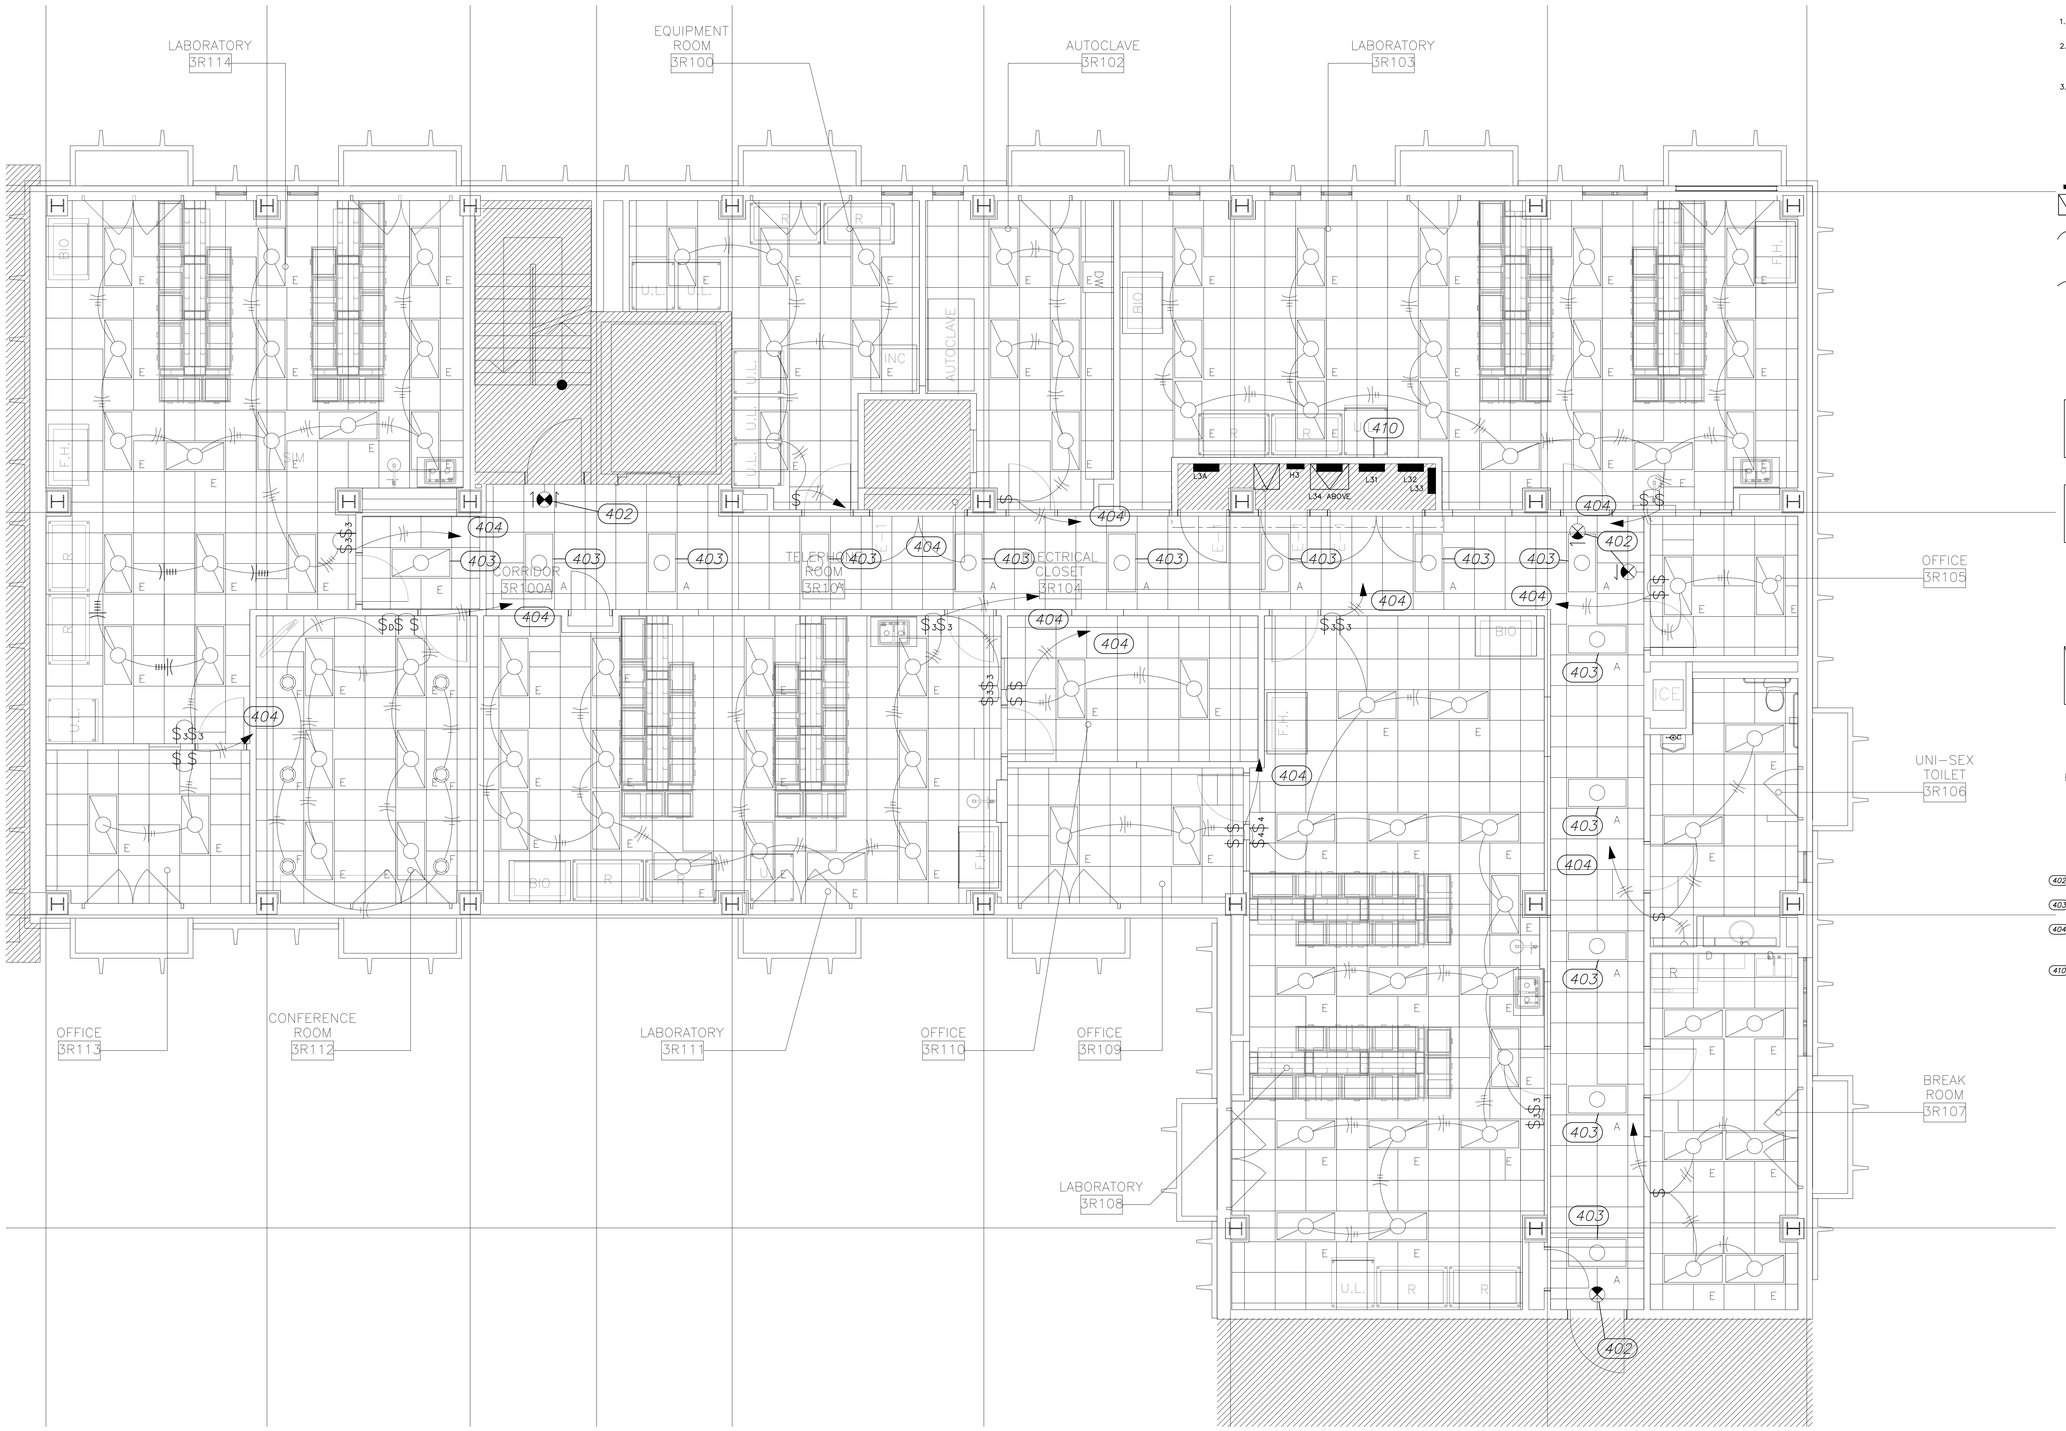

GENERAL NOTES

1. ALL WORK SHOWN ON THIS SHEET SHALL BE PERFORMED IN ACCORDANCE WITH NFPA 70-2011, NATIONAL ELECTRICAL CODE.
2. LAYOUTS SHOWN ON THIS SHEET ARE DIAGRAMMATIC AND DO NOT NECESSARILY DEPICT EXACT CONFIGURATIONS. EQUIPMENT AND DEVICE LOCATIONS SHALL BE AS NEAR AS PRACTICABLE TO LOCATIONS SHOWN EXCEPT WHERE SPECIFIED, NOTED, OR INDICATED OTHERWISE.
3. FOR ACTUAL LOCATIONS OF CEILING MOUNTED FIXTURES AND EQUIPMENT REF. ARCHITECTURAL REFLECTED CEILING PLANS.

SYMBOL LEGEND

- PANELBOARD
- DRY TYPE TRANSFORMER
- BRANCH CIRCUIT CONDUCTORS, 3/4"C MINIMUM UNLESS NOTED OTHERWISE. #12 AWG MINIMUM UNLESS NOTED OTHERWISE.
  - PHASE CONDUCTOR(S)
  - NEUTRAL CONDUCTOR(S)
  - GROUND CONDUCTOR
- ARROWHEAD DENOTES HOMERUN TO EQUIPMENT AS DESIGNATED.
  p.c. = PARTIAL CIRCUIT
- $ WALL BOX TOGGLE SWITCH, 48" AFF TO CENTER OF BOX.
  BLANK = SINGLE-POLE
  3 = THREE-WAY
- $D WALLBOX DIMMER, COMPATIBLE WITH CONNECTED FIXTURES. PROVIDE CONTROL WIRING TO FIXTURES AS REQUIRED.
- A FLOURESCENT TROFFER, 2x4, PRISMATIC LENS, TWO (2) T8 LAMPS.
- B FLOURESCENT TROFFER, 2x4, PRISMATIC LENS, THREE (3) T8 LAMPS.
- D WALL BRACKET FLOURESCENT FIXTURE, PRISMATIC LENSE, ONE (1) T8 LAMP.
- E EXISTING FLOURESCENT TROFFER, REUSED.
- F OPEN DOWNLIGHT, 26W FLOURESCENT LAMP, CLEAR ALZAK SELF-RIM REFLECTOR, 277V DIMMING BALLAST.
- EXIT SIGN, 277V, RED LED LETTERING

KEYED NOTES THIS SHEET

- 402 CONNECT EXIT SIGN TO EXISTING UNSWITCHED LEG OF LIGHTING CIRCUIT IN VICINITY.
- 403 CONNECT CORRIDOR LIGHTS TO EXISTING CORRIDOR LIGHTING CIRCUIT.
- 404 CONNECT BRANCH CIRCUIT TO EXISTING 277V HOME-RUN. BALANCE LOADS BETWEEN CIRCUITS INSOFAR AS PRACTICABLE. RECORD CIRCUIT DESIGNATIONS ON AS-BUILT DOCUMENTS.
- 410 REVISE IMPACTED PANELBOARD DIRECTORIES TO REFLECT LIGHTING LOADS AS CONNECTED.

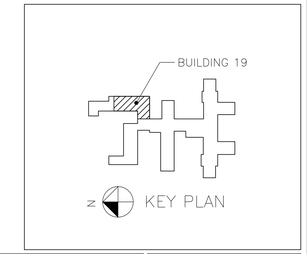

NORTH

1 (E-403) LIGHTING PLAN – THIRD FLOOR
SCALE: 1/4"=1'-0"

4' 2' 0 4'
SCALE IN FEET

ZRHD P.C.
CERTIFICATE OF AUTHORIZATION: CA1373
EXPIRATION DATE: 30 JUNE 2013

C:\Documents and Settings\vhaokthoopek.VHA16\Desktop\Bldg. 19 Eng 403 LIGHTING PLAN.dwg
June 07, 2012 - 11:58am

Revisions:	Date

CONTRACTOR:

CONSTRUCTION CONTRACTOR:
HGL CONSTRUCTION
2000 S. DOUGLAS BOULEVARD
MIDWEST CITY, OKLAHOMA 73130
405-737-7588
CONTACT: EDDIE COX

ARCHITECT/ENGINEERS:

ARCHITECT:
PDG Architects
333 12th Ave SE
Norman, Oklahoma 73071
OFFICE PHONE: 405-360-1102
OFFICE FAX: 405-360-0055
CONTACT: DONALD FRICK

MECHANICAL ENGINEER:
ZRHD, P.C. Engineers
1318 N. Robinson
Oklahoma City, Oklahoma 73103
405-942-8475
CONTACT: John Parks

ELECTRICAL ENGINEER:
ZRHD, P.C. Engineers
1318 N. Robinson
Oklahoma City, Oklahoma 73103
405-942-8475
CONTACT: Wayne Wright

Drawing Title: LIGHTING PLAN THIRD FLOOR

Approved: Project Director

Project Title: RENOVATION BUILDING 19 VA MEDICAL CENTER

Location: VAMC, OKLAHOMA CITY, OK

Date: 5/11/2012 | Checked: WHW | Drawn: SWW

Project Number: 635-11-303

Building Number: 19

Drawing Number: E-403

Dwg. 67 of 71

Office of Construction and Facilities Management

Department of Veterans Affairs

VA FORM 08-6231