

**Project Number 803-NRM17-04**

**Replace Admin Building Roof and Repair Walls**

**at the**

**Bath National Cemetery**

# TECHNICAL SPECIFICATION

## TABLE OF CONTENTS

### SECTIONS:

01 00 02	General Requirements
01 33 23	Shop Drawings, Production Data, and Samples
01 57 19	Temporary Environmental Controls
01 74 19	Construction Waste Management
02 41 10	Demolition and Site Clearing
06 10 00	Rough Carpentry
07 13 13	Asphalt Shingles
07 60 00	Flashing and Sheet Metal
07 92 00	Joint Sealants
09 91 00	Painting

### DRAWINGS:

803NRM1704-01	1986 Service & Admin Building Addition Roof Plan
839NRM1701-02	1986 Service & Admin Building Addition Roof Edge Details
839NRM1701-03	1986 Service & Admin Building Addition Wall Sections
839NRM1701-04	1986 North Admin Building Addition Elevations

SECTION 01 00 02  
GENERAL REQUIREMENTS

1.1 STATEMENT OF BID ITEM(S)

A. General


The contractor shall provide all design services, labor, tools, materials, equipment, and supervision necessary to remove the Services and Administration Building roof and wood siding to match original design from 1986. The Bath National Cemetery is located at the VA Medical Center, Bath, NY 14810. An aerial view of the Services and Administration Building is depicted below:



B. Work shall be in compliance with all applicable Federal, State & Local Codes, and Department of Veterans Affairs (VA) specifications. The VA

specifications include, but are not limited to, the following requirements:

1. Submit project health and safety plan, schedule, and other submittals to the Contracting Officer Representative (COR) for approval before commencing any work at the cemetery.
2. Cut down (fell) the large tree overhanging the service building, as depicted in the photo below then grind the stump and surface lateral roots down to a point 6 inches below the existing surface. Contractor to haul off the tree trunk, branches, and stump grindings. Remaining stump to be covered with top soil to grade and seeded. It is the Contractor's responsibility to return all items/areas damaged during tree removal to their original state. This includes any structure damage by the felling of the tree or tree branches; as well as turf damage or ground depressions caused by equipment movement or tree felling.

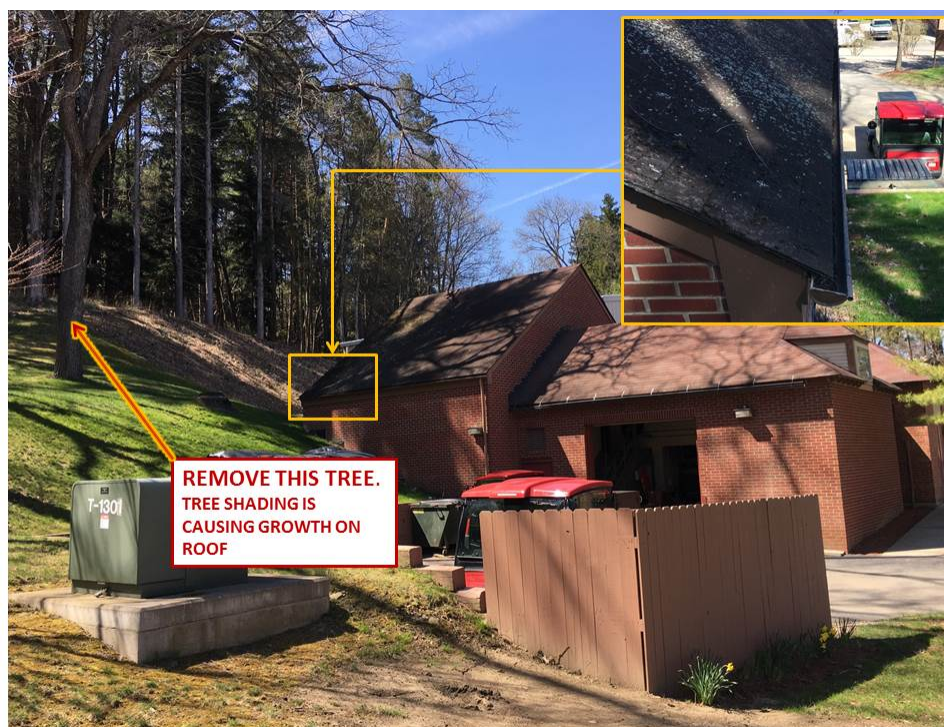

3. Prior to conducting any roof or siding demolition the Contractor shall utilize the services of a professional design firm to perform the following:


- a. Redesign the gazebo to vestibule Loggia roof (roof over trellis area) to correct drainage problems and minimize roof snow/debris collection issues in the area depicted in the below photos. Loggia roof design shall consider and include the following:
  - i. Evaluation of the adequacy of the existing foundation and wall construction to support the roof.
  - ii. Maintain the existing 9/12 roof slope.
  - iii. Remove the existing trellis construction; but incorporate trellis work on roof rafter cords as possible.
  - iv. Include either outriggers on fascia board to match the existing roofing or include cut rafter ends to match outrigger design.
  - v. Redesign plan submittal shall include as a minimum updated structural foundation plans & details, structural roof framing plan and details, north-end architectural roof plan, and architectural roof to wall and roof to roof details.
- b. Redesign the roof plan and associated siding to enlarge the roof extension/overhang over the Gravesite Locator Kiosk and cemetery map box, as identified in photo below.
- c. Revise the entire roof plan, to include the new Loggia roof design and Kiosk extension. Plan shall reflect new gutter and downspout locations. Downspout locations must consider and include means of conveying water away from the foundation and building entrances.
- d. Revise the gutter details to reflect the use of 4" half round galvanized gutters and round downspouts, as was originally designed.
- e. Provide revised west, north, and east building architectural elevations.

A selection of the 1986 Service and Administration Building Addition plans and details are provided with the solicitation. A complete hardcopy of the 1986 addition plans are available for review at the cemetery. No AutoCAD drawings are available. No plans are available for the trellis roof addition. Contractor



shall submit revised plans to the COR for review and approval no later than 45 days after notice to proceed.

A roof was added over the trellis walkway to shield visitors after the 1986 addition was completed. The design of the trellis roof does not provide for adequate drainage of rain from the new valley area or limit the amount of snow and debris accumulation in the valley. The moisture that accumulates in the valley has resulted in extensive damage to the roof, walls, and structure below. The trellis roof will need to be redesigned and replaced.

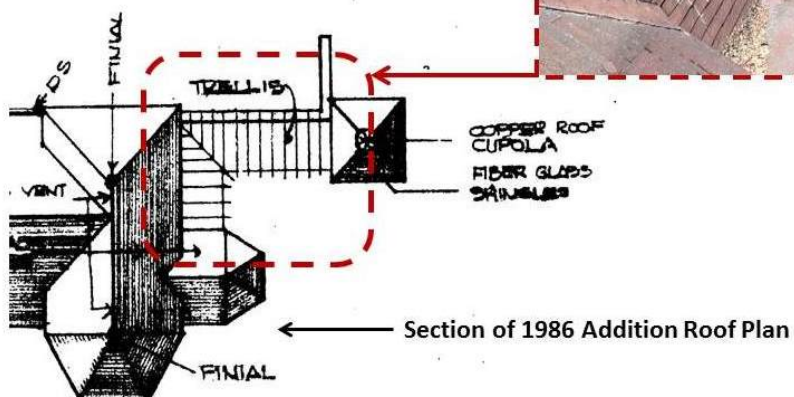




4. Contractor shall apply pesticides or other means to kill all insects on the roof eaves and siding prior to beginning any demolition and reconstruction work.
5. Contractor shall remove and dispose of all existing roof gutters.
6. Contractor shall power wash the roof eaves to remove any dirt, insect nests, and organic matter from the roof wood fascia, outriggers, trim, joists, and sheathing.
7. Contractor shall identify and mark any fascia, outriggers, trim, joists, and sheathing that has weathered or rotted and needs to be replaced. Contractor shall assume no more than 5% of these materials will need to be replaced, other than in the redesign areas identified earlier. Contractor shall get prior approval from the COR to replace any eave materials and contracting officer approval to install new eave materials exceeding 5%.
8. Contractor shall remove and replace all existing fiberglass asphalt shingles, 30# felt underlayment, the ridge vent, step flashing, and V crimp valley flashing to match existing color, material, and quality; except as necessary to comply with current specifications. Contractor shall remove and replace the roofing materials by roof sections and not leave more than a third of the total roofing without new or old shingles at any time.
9. Contractor shall remove and replace all existing 5" beveled wood siding and corner boards; as well as, all building paper. Contractor shall assume that 50% of the existing 1/2 inch exterior grade wall sheathing will need to be replaced due to weather damage. Siding replacement to be coordinated with replacement of roof flashing. Typical weather damage to the siding is depicted in the photos below. The existing siding construction is depicted in the drawings included in the solicitation and additional drawings available for review at the cemetery. No AutoCAD drawings are available.







10. Contractor shall utilize an exterior elastomeric (permanently flexible) joint sealant between all wood siding and corner boards; as well as, wood to brick joints.
11. Contractor to construct the COR approved trellis roof revised design. Paint to match existing building color and material.
12. Contractor shall scrape out existing caulking, dirt, plants, asphalt fiber expansion board, and other matter between the paver border and the wall to a depth of not less than 2 inches. After all material has been removed the contractor shall power wash border, wall, and joint. After the joint is dry the contractor shall insert non-gassing closed cell polyethylene backer rod(s) then fill joint with self-leveling polyurethane sealant to a depth not less than 3/8 inch. See picture below of typical paver border to wall joint conditions.

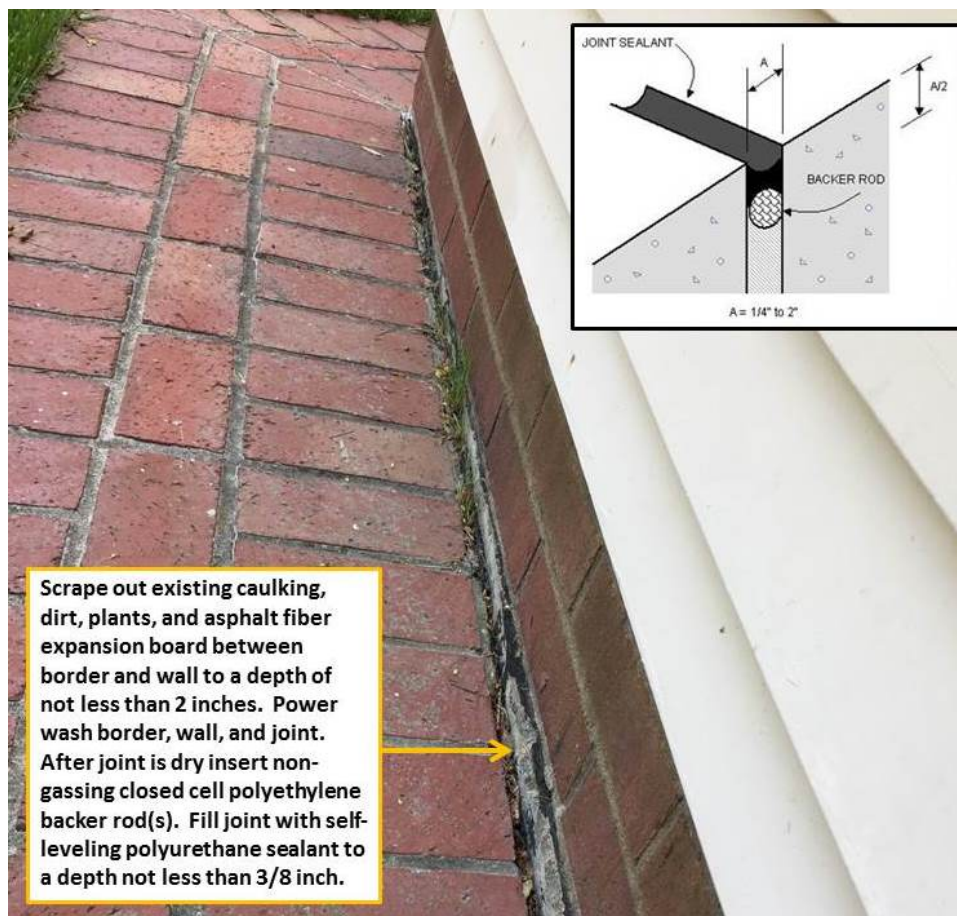

13. Contractor to repaint roof eaves and siding by building section to match existing color and material prior to hanging new gutters. Galvanized gutters and down spouts to be painted to match trim.
14. Contractor to sand, caulk, and repaint all wooden doors and windows to match existing color. Below is an example of the arched wooden windows on the original building that will need to be sanded and repainted.





## 1.2 DRAWINGS

- 803NRM1704-01 1986 Service & Admin Building Addition Roof Plan
- 839NRM1701-02 1986 Service & Admin Bldg Addition Roof Edge Details
- 839NRM1701-03 1986 Service & Admin Building Addition Wall Sections
- 839NRM1701-04 1986 North Admin Building Addition Elevations



### 1.3 SITE VISIT

A. Bidders may inspect the site, investigate by observation, and Request Information via (RFI) and responses through the Contracting Office to satisfy their understanding of the work to be done, all general, local and technical conditions that may affect the cost and the feasibility of their proposal. In no event shall failure to inspect the site constitute grounds for a claim after award. Visitors planning to conduct a site visit shall contact the Cemetery Director to make arrangements:

Cemetery POC(s):

Bath National Cemetery (Station #824) -  
Duane Mendenhall, Cemetery Director; (607) 664-4853  
David Swarthout, Cemetery Foreman; (607) 644-4853

District Technical POC:

Rico Silvetti, North Atlantic District (NAD) Engineer; (215) 381-3787

### 1.4 CONSTRUCTION SECURITY REQUIREMENTS

A. Security Plan:

1. The security plan defines both physical and administrative security procedures that will remain effective for the entire duration of the project.
2. The General Contractor is responsible for assuring that all sub-contractors working on the project and their employees also comply with these regulations.

B. Security Procedures:

1. General Contractor's employees shall not enter the site without following the procedures approved by the COR. They may also be subject to inspection of their personal effects when entering or leaving the project site.
2. For working outside the "regular hours" as defined in the contract, The General Contractor shall give 3 days notice to the COR so that appropriate arrangements can be provided for the Cemetery employees. This notice is separate from any notices required for utility shutdown described later in this section.

3. No photography of VA premises is allowed without written permission of the COR.
4. VA reserves the right to close down or shut down the project site and order General Contractor's employees off the premises in the event of a national emergency. The General Contractor may return to the site only with the written approval of the COR.

C. Guards: NOT USED

D. Key Control: NOT USED

E. Document Control:

1. Before starting any work, the General Contractor/Sub Contractors shall submit an electronic security memorandum describing the approach to following goals and maintaining confidentiality of "sensitive information".
2. The General Contractor is responsible for safekeeping of all drawings, project manual and other project information. This information shall be shared only with those with a specific need to accomplish the project.
3. Certain documents, sketches, videos or photographs and drawings may be marked "Law Enforcement Sensitive" or "Sensitive Unclassified". Secure such information in separate containers and limit the access to only those who will need it for the project. Return the information to the COR upon request.
4. These security documents shall not be removed or transmitted from the project site without the written approval of COR.
5. All paper waste or electronic media such as CD's and diskettes shall be shredded and destroyed in a manner acceptable to the VA.
6. Notify COR immediately when there is a loss or compromise of "sensitive information".
7. All electronic information shall be stored in a specified location following VA standards and procedures using an Engineering Document Management Software (EDMS).
  - a. Security, access and maintenance of all project drawings, both scanned and electronic shall be performed and tracked through the EDMS system.
  - b. "Sensitive information" including drawings and other documents may be attached to e-mail provided all VA encryption procedures are followed.

F. Motor Vehicle Restrictions

1. Vehicle authorization request shall be required for any vehicle entering the site and such request shall be submitted 24 hours before the date and time of access. Access shall be restricted to picking up and dropping off materials and supplies.

#### 1.5 FIRE SAFETY

- A. Applicable Publications: Publications listed below form part of this Article to the extent referenced. Publications are referenced in text by basic designations only.
  1. American Society for Testing and Materials (ASTM):
    - E84-2009a Surface Burning Characteristics of Building Materials
  2. National Fire Protection Association (NFPA):
    - 10-2010 Standard for Portable Fire Extinguishers
    - 30-2008 Flammable and Combustible Liquids Code
    - 51B-2009 Standard for Fire Prevention during Welding, Cutting and Other Hot Work
    - 70-2008 National Electrical Code
    - 241-2009 Standard for Safeguarding Construction, Alteration, and Demolition Operations
  3. Occupational Safety and Health Administration (OSHA):
    - 29 CFR 1926 Safety and Health Regulations for Construction
- B. Fire Safety Plan: Establish and maintain a fire protection program in accordance with 29 CFR 1926. Prior to start of work, prepare a plan detailing project-specific fire safety measures, including periodic status reports, and submit to COR/Cemetery Director for review for compliance with contract requirements in accordance with Section 01 33 23, SHOP DRAWINGS, PRODUCT DATA AND SAMPLES. Prior to any worker for the contractor or subcontractor's beginning work, they shall undergo a safety briefing provided by the General Contractor's competent person per OSHA requirements. This briefing shall include information on the construction limits, safety guidelines, means of egress, break areas, work hours, locations of restrooms, use of NCA equipment, etc. Documentation shall be provided to the COR that individuals have undergone the Contractor's safety briefing.
- C. Site and Building Access: Maintain free and unobstructed access to emergency services and for fire, police and other emergency response forces in accordance with NFPA 241.
- D. Separate temporary facilities, such as trailers, storage sheds, and dumpsters, from existing buildings and new construction by distances

- in accordance with NFPA 241. For small facilities with less than 6 m (20 feet) exposing overall length, separate by 3m (10 feet).
- E. Temporary Construction Partitions: NOT USED
  - F. Temporary Heating and Electrical: Install, use and maintain installations in accordance with 29 CFR 1926, NFPA 241 and NFPA 70.
  - G. Means of Egress: Do not block exiting for occupied buildings, including paths from exits to roads. Minimize disruptions and coordinate with COR/Cemetery Director.
  - H. Egress Routes for Construction Workers: Maintain free and unobstructed egress. Inspect daily. Report findings and corrective actions weekly to the COR.
  - I. Fire Extinguishers: Provide and maintain extinguishers in construction areas and temporary storage areas in accordance with 29 CFR 1926, NFPA 241 and NFPA 10.
  - J. Flammable and Combustible Liquids: Store, dispense and use liquids in accordance with 29 CFR 1926, NFPA 241 and NFPA 30.
  - K. Existing Fire Protection: Do not impair automatic sprinklers, smoke and heat detection, and fire alarm systems, except for portions immediately under construction, and temporarily for connections. Request interruptions in accordance with Article, OPERATIONS AND STORAGE AREAS, and coordinate with COR. All existing or temporary fire protection systems (fire alarms) located in construction areas shall be tested as coordinated with the Cemetery. Parameters for the testing and results of any tests performed shall be recorded by the Cemetery and copies provided to the COR.
  - L. Smoke Detectors: Prevent accidental operation. Remove temporary covers at end of work operations each day. Coordinate with COR.
  - M. Hot Work: Perform and safeguard hot work operations in accordance with NFPA 241 and NFPA 51B. Coordinate with COR.
  - N. Fire Hazard Prevention and Safety Inspections: Inspect entire construction areas weekly. Coordinate with, and report findings and corrective actions weekly to COR.
  - O. Smoking: Smoking is prohibited in and adjacent to construction areas inside existing buildings and additions under construction. In separate and detached buildings under construction, smoking is prohibited except in designated smoking rest areas.
  - P. Dispose of waste and debris in accordance with NFPA 241. Remove from the site weekly.



- Q. Perform other construction, alteration and demolition operations in accordance with 29 CFR 1926.

#### 1.6 OPERATIONS AND STORAGE AREAS

- A. The Contractor shall confine all operations (including storage of materials) on Government premises to areas authorized or approved by the COR. The Contractor shall hold and save the Government, its officers and agents, free and harmless from liability of any nature occasioned by the Contractor's performance.
- B. Temporary buildings (e.g., storage trailers, office trailers) and utilities may be erected by the Contractor only with the approval of the COR and shall be built with labor and materials furnished by the Contractor without expense to the Government. The temporary buildings and utilities shall remain the property of the Contractor and shall be removed by the Contractor at its expense upon completion of the work.
- C. The Contractor shall, under regulations prescribed by the COR, use only established roadways, or use temporary roadways constructed by the Contractor when and as authorized by the COR. When materials are transported in prosecuting the work, vehicles shall not be loaded beyond the loading capacity recommended by the manufacturer of the vehicle or prescribed by any Federal, State, or local law or regulation. When it is necessary to cross curbs or sidewalks, the Contractor shall protect them from damage. The Contractor shall repair or pay for the repair of any damaged curbs, sidewalks, or roads.
- D. Working space and space available for storing materials shall be as determined by the COR with agreement of the Cemetery. Contractor parking will be only in areas and on roadways designated and agreed to by the COR in agreement of the Cemetery.
- E. Workmen are subject to rules of the Cemetery applicable to their conduct.
- F. Execute work so as to interfere as little as possible with normal functioning of Cemetery as a whole, including operations of utility services, fire protection systems and any existing equipment, and with work being done by others.
1. Do not store materials and equipment in other than assigned areas.
  2. Schedule delivery of materials and equipment to immediate construction working areas within buildings in use by the

Cemetery in quantities sufficient for not more than two work days. Provide unobstructed access to the Cemetery areas required to remain in operation.

3. Where access by Cemetery personnel to vacated portions of buildings is not required, storage of Contractor's materials and equipment will be permitted subject to fire and safety requirements. All such actions shall be coordinated with the Utility Company involved:
  - a. Whenever it is required that a connection fee be paid to a public utility provider for new permanent service to the construction project, for such items as water, sewer, electricity, gas or steam, payment of such fee shall be the responsibility of the Government and not the Contractor.
- G. Phasing: To insure such executions, the Contractor shall furnish the COR with a schedule of approximate phasing dates on which the Contractor intends to accomplish work in each specific area of site, building or portion thereof. In addition, the Contractor shall notify the COR two weeks in advance of the proposed date of starting work in each specific area of site, building or portion thereof. Arrange such phasing dates to insure accomplishment of this work in successive phases mutually agreeable to the Cemetery Director, COR and Contractor.
- H. The Contractor shall take all measures and provide all material necessary for protecting existing equipment and property in affected areas of construction against dust and debris, so that equipment and affected areas to be used in the Cemetery are not affected.
- K. Utilities Services: Maintain existing utility services for the Cemetery at all times.
- L. Abandoned Lines: NOT USED
- M. To minimize interference of construction activities with flow of Cemetery traffic, comply with the following:
  1. Keep roads, walks and entrances to grounds, to parking and to occupied areas of buildings clear of construction materials, debris and standing construction equipment and vehicles. Wherever excavation for new utility lines cross existing roads, at least one lane must be open to traffic at all times.

2. Method and scheduling of required cutting, altering and removal of existing roads, walks and entrances must be approved by the COR.
- N. Coordinate the work for this contract with other construction operations as directed by COR. This includes the scheduling of traffic and the use of roadways, as specified in Article, USE OF ROADWAYS.
- O. Coordination of Construction with Cemetery Director: The burial activities at a National Cemetery shall take precedence over construction activities. The Contractor must cooperate and coordinate with the Cemetery Director, through the COR, in arranging construction schedule to cause the least possible interference with Cemetery activities in actual burial areas. Construction noise during the committal services shall not disturb the service. Trucks and workmen shall not pass through the service area during this period.
1. The Contractor is required to discontinue his work sufficiently in advance of Easter Sunday, Mother's Day, Father's Day, Memorial Day, Veteran's Day and/or Federal holidays, to permit him to clean up all areas of operation adjacent to existing burial plots before these dates.
  2. Clean up shall include the removal of all equipment, tools, materials and debris and leaving the areas in a clean, neat condition.
- P. Dignity Clause:
1. Every action by contractor personnel at a national cemetery must be performed with the special care, reverence, dignity, and respect that acknowledges the cemetery as the final resting place that commemorates the service and sacrifice that service members, Veterans and their families made for our Nation. Critically important is the awareness required of the Contractor employees of the remains buried in the grounds where the work is performed. The utmost care must be given to these remains and the headstones and flat grave markers that mark those gravesites and memorialize the service of individuals.
  2. Contractors cannot walk, stand, lean, sit or jump on headstones or markers. Nor can they drive over them. Contractor personnel should use tools approved by the Contracting Officer Representative (COR), such as shovels, pry bars or pinch bars to

lift flat markers out of the ground; pick axes are not an acceptable tool.

## 1.7 ALTERATIONS

- A. Survey: Before any work is started, the Contractor shall make a thorough survey with the COR of buildings, areas in which alterations occur, areas which are anticipated routes of access, and furnish a signed report, to the Contracting Officer. This report shall list:
  - 1. Shall note any discrepancies between drawings and existing conditions at site.
  - 2. Shall designate areas for working space, materials storage and routes of access to areas within buildings where alterations occur and which have been agreed upon by Contractor and COR.
- B. Any items required by drawings to be either reused or relocated or both, found during this survey to be nonexistent, or in opinion of COR, to be in such condition that their use is impossible or impractical, shall be furnished and/or replaced by the Contractor with new items in accordance with specifications which will be furnished by the Government. Provided the contract work is changed by reason of this subparagraph B, the contract will be modified accordingly, under provisions of clause entitled "DIFFERING SITE CONDITIONS" (FAR 52.236-2) and "CHANGES" (FAR 52.243-4 and VAAR 852.236-88).
- C. Re-Survey: Thirty days before expected partial or final inspection date, the Contractor and COR together shall make a thorough re-survey of the areas of buildings involved. They shall furnish a report on conditions present compared with conditions of same as noted in first condition survey report.
  - 1. Re-survey report shall also list any damage caused by the Contractor to such flooring and other surfaces, despite protection measures; and, will form the basis for determining extent of repair work required of the Contractor to restore damage caused by the Contractor's workmen in executing work of this contract.
- D. Protection: Provide the following protective measures:
  - 1. Temporary protection against damage for portions of existing structures and grounds where work is to be done, materials handled and equipment moved and/or relocated.



**1.8 ENVIRONMENTAL CONTROL: NOT USED****1.9 DISPOSAL AND RETENTION**

A. Materials and equipment accruing from work removed and from demolition of buildings or structures, or parts thereof, shall be disposed of as follows:

1. Reserved items which are to remain property of the Government are described as such in the scope of work above. Items that remain property of the Government shall be removed or dislodged from present locations in such a manner as to prevent damage which would be detrimental to re-installation and reuse. Store such items where directed by COR.
2. Items not reserved shall become property of the Contractor and be removed by Contractor from the Cemetery.
3. Items of portable equipment and furnishings located in rooms and spaces in which work is to be done under this contract shall remain the property of the Government. When rooms and spaces are vacated by the Department of Veterans Affairs during the alteration period, such items which are NOT required by drawings and specifications to be either relocated or reused will be removed by the Government in advance of work to avoid interfering with Contractor's operation.

**1.10 PROTECTION OF EXISTING VEGETATION, STRUCTURES, EQUIPMENT, UTILITIES, AND IMPROVEMENTS**

- A. The Contractor shall preserve and protect all structures, equipment, and vegetation (such as trees, shrubs, and grass) on or adjacent to the work site, which are not to be removed and which do not unreasonably interfere with the work required under this contract. The Contractor shall only remove trees when specifically authorized to do so, and shall avoid damaging vegetation that will remain in place. If any limbs or branches of trees are broken during contract performance, or by the careless operation of equipment, or by workmen, the Contractor shall trim those limbs or branches with a clean cut and paint the cut with a tree-pruning compound as directed by the COR.
- B. The Contractor shall protect from damage all existing improvements and utilities at or near the work site and on adjacent property of a third party, the locations of which are made known to or should be known by

the Contractor. The Contractor shall repair any damage to those facilities, including those that are the property of a third party, resulting from failure to comply with the requirements of this contract or failure to exercise reasonable care in performing the work. If the Contractor fails or refuses to repair the damage promptly, the COR may have the necessary work performed and charge the cost to the Contractor.

#### **1.11 RESTORATION**

- A. Remove, cut, alter, replace, patch and repair existing work as necessary to install new work. Except as otherwise shown or specified, do not cut, alter or remove any structural work, and do not disturb any ducts, plumbing, steam, gas, water/irrigation or electric work without approval of the COR. Existing work to be altered or extended and that is found to be defective in any way, shall be reported to the COR before it is disturbed. Materials and workmanship used in restoring work, shall conform in type and quality to that of original existing construction, except as otherwise shown or specified.
- B. Upon completion of contract, deliver work complete and undamaged. Existing work (walls, ceilings, partitions, floors, mechanical and electrical work, landscape stone, lawns, paving, roads, walks, etc.) disturbed or removed as a result of performing required new work, shall be patched, repaired, reinstalled, or replaced with new work, and refinished and left in as good condition as existed before commencing work.
- C. At the Contractor's own expense, the Contractor shall immediately restore to service and repair any damage caused by the Contractor's workmen to existing installations and improvements.
- D. Expense of repairs to such utilities and systems not shown on drawings or locations of which are unknown will be covered by adjustment to contract time and price in accordance with clause entitled "CHANGES" (FAR 52.243-4 and VAAR 852.236-88) and "DIFFERING SITE CONDITIONS" (FAR 52.236-2).

**1.12 PHYSICAL DATA: NOT USED****1.13 PROFESSIONAL SURVEYING SERVICES**

A registered professional land surveyor or registered civil engineer whose services are retained and paid for by the Contractor shall perform services specified herein and in other specification sections. The Contractor shall certify that the land surveyor or civil engineer is not one who is a regular employee of the Contractor, and that the land surveyor or civil engineer has no financial interest in this contract.

**1.14 LAYOUT OF WORK**

A. The Contractor shall lay out the work by contracting with a professional surveying company, and shall be responsible for all measurements in connection with the layout. The Contractor shall furnish, at the Contractor's own expense, all stakes, templates, platforms, equipment, tools, materials, and labor required to lay out any part of the work. The Contractor shall be responsible for executing the work to the lines and grades that may be established or indicated by the COR. The Contractor shall also be responsible for maintaining and preserving all stakes and other marks established by the COR until authorized to remove them. If such marks are destroyed by the Contractor or through Contractor's negligence before their removal is authorized, the COR may replace them and deduct the expense of the replacement from any amounts due or to become due to the Contractor.

**(FAR 52.236-17)**

- B. Establish and plainly mark center lines for each building and/or addition to each existing building, lines for each gravesite control monument, and such other lines and grades that are reasonably necessary to properly assure that location, orientation, and elevations established for each such structure and/or addition, roads, parking lots, gravesite control monuments, are in accordance with lines and elevations developed by the professional surveying company discussed above.
- C. Following completion of general mass excavation and before any other permanent work is performed, establish and plainly mark (through use of appropriate batter boards or other means) sufficient additional survey control points or system of points as may be necessary to

assure proper alignment, orientation, and grade of all major features of work. The Survey shall include, but not be limited to, location of lines and grades of footings, exterior walls, center lines of columns in both directions, major utilities and elevations of floor slabs:

1. Such additional survey control points or system of points thus established shall be checked and certified by a registered land surveyor or registered civil engineer. Furnish such certification to the COR before any work (such as footings, floor slabs, columns, walls, utilities and other major controlling features) is placed.

D. During progress of work, the Contractor shall have lines, grades, locations and plumbness of all major form work checked and certified by a registered land surveyor or registered civil engineer. Furnish such certification to the COR before any major items or concrete work are placed. In addition, furnish to the COR certificates from a registered land surveyor or registered civil engineer that the following work is complete in every respect as required by contract drawings.

1. Lines of each building and/or addition.
2. Elevations of bottoms of footings and tops of floors of each building and/or addition.
3. Lines and elevations of sewers and of all outside distribution systems.
4. Lines of grave plot documentation.
5. Lines of elevations of all swales and interment areas.
6. Lines and elevations of roads, streets and parking lots.
7. Lines and elevations and location of top of pre-placed crypts within their respective plots.
8. Lines and elevations of grade over pre-placed crypts.
9. Northing/Easting coordinate locations, and elevation, depth below finished grade of all water, sanitary, storm, gas and irrigation structures, directional fittings, control wire and lines.
10. Northing/Easting coordinate locations, and elevation for each gravesite grid monument.

E. Upon completion of the work, the Contractor shall furnish the COR with reproducible scaled drawings, in AutoCAD format, pdf format and in full size 42x30" hard copy, showing the finished grade on the grid developed for constructing the work. These drawings shall bear the

seal of the registered land surveyor or registered civil engineer. These drawings shall show all new work and provide a scaled record of the entire project area including all improvements, monuments, and items contained both on the existing site and included in this scope of work.

- F. The Contractor shall perform the surveying and layout work of this and other articles and specifications in accordance with the provisions of Article "Professional Surveying Services".

#### **1.15 AS-BUILT DRAWINGS**

- A. The Contractor shall maintain two full size sets of as-built drawings which will be kept current during construction of the project, which will include all contract changes, modifications and clarifications.
- B. All variations shall be shown in the same general detail as used in the contract drawings. To insure compliance, as-built drawings shall be made available for the COR's review, as often as requested.
- C. The Contractor shall deliver two approved completed sets of as-built drawings to the COR within 15 calendar days after acceptance of the project by the COR.
- D. Paragraphs A, B, & C shall also apply to all shop drawings.

#### **1.16 USE OF ROADWAYS**

- A. For hauling, use only established public roads and designated permanent roads on Cemetery property and, or where authorized by the COR, such existing or Contractor constructed and/or modified temporary roads which are necessary in the performance of contract work. Temporary roads shall be constructed or modified by the Contractor at the Contractor's expense following approved plans that include: construction, operation, maintenance and restoration. When necessary to cross curbing, sidewalks, or similar construction, they must be protected by well-constructed bridges.
- B. When new permanent roads are to be a part of this contract, the Contractor may construct them immediately to facilitate building operations. These roads may be used by all who have business thereon within zone of building operations.
- C. When certain buildings (or parts of certain buildings) are required to be completed in advance of general date of completion, all roads

leading thereto must be completed and available for use at the time set for completion of such buildings or parts thereof.

**1.17 COR'S FIELD OFFICE: NOT USED**

**1.18 TEMPORARY USE OF MECHANICAL AND ELECTRICAL EQUIPMENT - NOT USED**

**1.19 TEMPORARY TOILETS**

- A. Provide for use of all Contractor's workers ample temporary sanitary toilet accommodations with suitable sewer and water connections, or when approved by COR provide suitable dry closets where directed. Keep such places clean and free from flies, and all connections and appliances connected therewith are to be removed prior to completion of contract, and premises left perfectly clean.
- B. Contractor may have for use of the Contractor's workmen, such toilet accommodations as may be assigned to the Contractor by the Cemetery. The Contractor shall keep such places clean and be responsible for any damage done thereto by the Contractor's workmen. Failure to maintain satisfactory condition in toilets will deprive the Contractor of the privilege to use such toilets.

**1.20 NEW TELEPHONE EQUIPMENT: NOT USED**

**1.21 INSTRUCTIONS**

- A. The Contractor shall furnish Maintenance and Operating manuals and verbal instructions when required by the various sections of the specifications and as hereinafter specified.
- B. Manuals: Maintenance and operating manuals (four copies each) for each separate piece of equipment shall be delivered to the COR coincidental with the delivery of the equipment to the job site. Manuals shall be complete, detailed guides for the maintenance and operation of equipment. They shall include complete information necessary for starting, adjusting, maintaining in continuous operation for long periods of time and dismantling and reassembling of the complete units and sub-assembly components. Manuals shall include an index covering all component parts clearly cross-referenced to diagrams and illustrations. Illustrations shall include "exploded" views showing and identifying each separate item. Emphasis shall be placed on the use of special tools and instruments. The function of each piece of



equipment, component, accessory and control shall be clearly and thoroughly explained. All necessary precautions for the operation of the equipment and the reason for each precaution shall be clearly set forth. Manuals must reference the exact model, style and size of the piece of equipment and system being furnished. Manuals referencing equipment similar to but of a different model, style, and size than that furnished will not be accepted.

- C. Instructions: the Contractor shall provide qualified, factory-trained manufacturers' representatives to give detailed instructions to assigned Department of Veterans Affairs personnel in the operation and complete maintenance for each piece of equipment. All such training will be at the job site. These requirements are more specifically detailed in the various technical sections. Instructions for different items of equipment that are component parts of a complete system; shall be given in an integrated, progressive manner. All instructors for every piece of component equipment in a system shall be available until instructions for all items included in the system have been completed. This is to assure proper instruction in the operation of inter-related systems. All instruction periods shall be at such times as scheduled by the COR and shall be considered concluded only when the COR is satisfied in regard to complete and thorough coverage. The Department of Veterans Affairs reserves the right to request the removal of, and substitution for, any instructor who, in the opinion of the COR, does not demonstrate sufficient qualifications in accordance with requirements for instructors above.

#### **1.22 RELOCATED EQUIPMENT AND ITEMS**

- A. Contractor shall disconnect, dismantle as necessary, remove and reinstall in new location, all existing equipment and items indicated by symbol "R", stated herein these specifications, or otherwise shown to be relocated by the Contractor.
- B. Perform relocation of such equipment or items at such times and in such a manner as directed by the COR.
- C. Suitably cap existing service lines, such as water, drain, gas, air, and/or electrical, whenever such lines are disconnected from equipment to be relocated. Remove abandoned lines in finished areas and cap as specified herein before under paragraph "Abandoned Lines".

- D. Provide all mechanical and electrical service connections, fittings, fastenings and any other materials necessary for assembly and installation of relocated equipment; and leave such equipment in proper operating condition.
- E. All service lines such as noted above for relocated equipment shall be in place at point of relocation ready for use before any existing equipment is disconnected. Make relocated existing equipment ready for operation or use immediately after reinstallation.

#### **1.23 FINAL ELEVATION PHOTOGRAPHS: NOT USED**

#### **1.24 PROJECT HEALTH AND SAFETY PLAN**

- A. Prior to commencing any construction, the Contractor shall submit a site specific Project Health and Safety Plan (PHSP). At a minimum, the PHSP shall cover the following topics:
  - 1. Organizational structure (including Responsible Persons)
  - 2. Site Characterization and Job Hazard Identification
  - 3. Site Control and Security
  - 4. Training
  - 5. PPE
  - 6. Heat Stress
  - 7. Spill Containment
  - 8. Decontamination
  - 9. Emergency Response
  - 10. Trench Safety
- B. General contractor shall provide proof that an OSHA certified "competent person" (CP) (29 CFR 1926.20(b) (2) will maintain a presence at the work site whenever the general or subcontractors are present.
- C. Training
  - 1. All employees of general contractor or subcontractors shall, at the minimum, have successfully completed the 10-hour OSHA certified Construction Safety course and/or other relevant competency training, as determined by VA COR.
  - 2. Submit OSHA training records of all employees for approval before the start of work.

- - - E N D - - -

**SECTION 01 33 23**  
**SHOP DRAWINGS, PRODUCT DATA, AND SAMPLES**

- 1-1. Refer to Articles titled SPECIFICATIONS AND DRAWINGS FOR CONSTRUCTION (FAR 52.236-21) and, SPECIAL NOTES (VAAR 852.236-91), in GENERAL CONDITIONS.
- 1-2. For the purposes of this contract, samples including laboratory samples to be tested, test reports, certificates, and manufacturers' literature and data shall also be subject to the previously referenced requirements. The following text refers to all items collectively as SUBMITTALS.
- 1-3. Submit for approval, all of the items specifically mentioned under the separate sections of the specification, with information sufficient to evidence full compliance with contract requirements. Materials, fabricated articles and the like to be installed in permanent work shall equal those of approved submittals. After an item has been approved, no change in brand or make will be permitted unless:
  - A. Satisfactory written evidence is presented to, and approved by Contracting Officer, that manufacturer cannot make scheduled delivery of approved item or;
  - B. Item delivered has been rejected and substitution of a suitable item is an urgent necessity or;
  - C. Other conditions become apparent which indicates approval of such substitute item to be in best interest of the Government.
- 1-4. Forward submittals in sufficient time to permit proper consideration and approval action by Government. Time submission to assure adequate lead time for procurement of contract - required items. Delays attributable to untimely and rejected submittals including any laboratory samples to be tested will not serve as a basis for extending contract time for completion.
- 1-5. Submittals will be reviewed for compliance with contract requirements by the Contracting Officer's Representative.

- 1-6. The Government reserves the right to require additional submittals, whether or not particularly mentioned in this contract. If additional submittals beyond those required by the contract are furnished pursuant to request therefor by Contracting Officer, adjustment in contract price and time will be made in accordance with Articles titled CHANGES (FAR 52.243-4) and CHANGES - SUPPLEMENT (VAAR 852.236-88) of the GENERAL CONDITIONS.
- 1-7. Schedules called for in specifications shall be submitted for use and information of Department of Veterans Affairs. However, the Contractor shall assume responsibility for coordinating and verifying schedules. The Contracting Officer assumes no responsibility for checking schedules or layout drawings for exact sizes, exact numbers and detailed positioning of items.
- 1-9. Submittals must be submitted by Contractor only and shipped prepaid. Contracting Officer assumes no responsibility for checking quantities or exact numbers included in such submittals.
- A. Submit samples in single units unless otherwise specified. Submit shop drawings, schedules, manufacturers' literature and data, and certificates in duplicate, except where a greater number is specified.
- B. Submittals will receive consideration only when covered by a transmittal letter signed by Contractor. Letter shall be sent via first class mail or e-mail in DF format; and shall contain the list of items, name of Cemetery, name of Contractor, contract number, applicable specification paragraph numbers, applicable drawing numbers (and other information required for exact identification of location for each item), manufacturer and brand, ASTM or Federal Specification Number (if any) and such additional information as may be required by specifications for particular item being furnished. In addition, catalogs shall be marked to indicate specific items submitted for approval.
1. A copy of letter must be enclosed with items, and any items received without identification letter will be considered "unclaimed goods" and held for a limited time only.

2. Each sample, certificate, manufacturers' literature and data shall be labeled to indicate the name and location of the Cemetery, name of Contractor, manufacturer, brand, contract number and ASTM or Federal Specification Number as applicable and location(s) on project.
  3. Required certificates shall be signed by an authorized representative of manufacturer or supplier of material, and by Contractor.
- C. In addition to complying with the applicable requirements specified in preceding Article 1.9, samples which are required to have Laboratory Tests (those preceded by symbol "LT" under the separate sections of the specification shall be tested, at the expense of Contractor, in a commercial laboratory approved by Contracting Officer.
1. Laboratory shall furnish Contracting Officer with a certificate stating that it is fully equipped and qualified to perform intended work, is fully acquainted with specification requirements and intended use of materials and is an independent establishment in no way connected with organization of Contractor or with manufacturer or supplier of materials to be tested.
  2. Certificates shall also set forth a list of comparable projects upon which laboratory has performed similar functions during past five years.
  3. Samples and laboratory tests shall be sent directly to approved commercial testing laboratory.
  4. Contractor shall send a copy of transmittal letter to the Contracting Officer's Representative with submission of material to a commercial testing laboratory.
  5. Laboratory test reports shall be sent directly to Contracting Officer's Representative for appropriate action.

6. Laboratory reports shall list contract specification test requirements and a comparative list of the laboratory test results. When tests show that the material meets specification requirements, the laboratory shall so certify on test report.
  7. Laboratory test reports shall also include a recommendation for approval or disapproval of tested item.
- D. If submittal samples have been disapproved, resubmit new samples as soon as possible after notification of disapproval. Such new samples shall be marked "Resubmitted Sample" in addition to containing other previously specified information required on label and in transmittal letter.
- E. Approved samples will be kept on file by the Contracting Officer's Representative at the site until completion of contract, at which time such samples will be delivered to Contractor as Contractor's property. Where noted in technical sections of specifications, approved samples in good condition may be used in their proper locations in contract work. At completion of contract, samples that are not approved will be returned to Contractor only upon request and at Contractor's expense. Such request should be made prior to completion of the contract. Disapproved samples that are not requested for return by Contractor will be discarded after completion of contract.
- F. Submittal drawings (shop, erection or setting drawings) and schedules, required for work of various trades, shall be checked before submission by technically qualified employees of Contractor for accuracy, completeness and compliance with contract requirements. These drawings and schedules shall be stamped and signed by Contractor certifying to such check.
1. For each drawing required, submit one legible photographic paper or vellum reproducible.
  2. Reproducible shall be full size.

3. Each drawing shall have marked thereon, proper descriptive title, including Cemetery location, project number, manufacturer's number, reference to contract drawing number, detail Section Number, and Specification Section Number.
  4. A space 4-3/4 by 5 inches) shall be reserved on each drawing to accommodate approval or disapproval stamp.
  5. Submit drawings, ROLLED WITHIN A MAILING TUBE, fully protected for shipment.
  6. One reproducible print of approved or disapproved shop drawings will be forwarded to Contractor.
  7. When work is directly related and involves more than one trade, shop drawings shall be submitted to Architect-Engineer under one cover.
- 1-10. Submittals shall be submitted for approval to the Contracting Officer's Representative.

- - - E N D - - -

**SECTION 01 57 19**  
**TEMPORARY ENVIRONMENTAL CONTROLS**

**PART 1 GENERAL**

**1.1 DESCRIPTION**

- A. This section specifies the control of environmental pollution and damage that the Contractor must consider for air, water, and land resources. It includes management of visual aesthetics, noise, and solid waste, as well as other pollutants and resources encountered or generated by the Contractor. The Contractor is obligated to consider specified control measures with the costs included within the various contract items of work.
- B. Environmental pollution and damage is defined as the presence of chemical, physical, or biological elements or agents which:
  - 1. Adversely effect human health or welfare.
  - 2. Unfavorably alter ecological balances of importance to human life.
  - 3. Affect other species of importance to humankind.
  - 4. Degrade the utility of the environment for aesthetic, cultural, and historical purposes.

**1.2 DEFINITIONS OF POLLUTANTS**

- A. Chemical Waste: Petroleum products, bituminous materials, salts, acids, alkalis, herbicides, pesticides, organic chemicals, and inorganic wastes.
- B. Debris: Combustible and noncombustible wastes, such as leaves, tree trimmings, ashes, and waste materials resulting from construction or maintenance and repair work.
- C. Sediment: Soil and other debris that has been eroded and transported by runoff water.
- D. Solid Waste: Rubbish, debris, garbage, and other discarded solid materials resulting from project construction activities.
- E. Surface Discharge: The term "Surface Discharge" implies that the water is discharged with possible sheeting action and subsequent soil erosion may occur. Waters that are surface discharged may terminate in drainage ditches, storm sewers, creeks, and/or "waters of the United States" and require a permit to discharge water from the governing agency.



- F. Rubbish: Combustible and noncombustible wastes such as, but not limited to, paper, plastic, metal and plastic containers and cans, boxes, metal and lumber scrap.
- G. Sanitary Wastes: Domestic Sanitary Sewage.

### 1.3 QUALITY CONTROL

- A. Establish and maintain quality control for the environmental protection of all items set forth herein.
- B. Record on daily reports any problems in complying with laws, regulations, ordinances and note any corrective action taken.

### 1.4 REFERENCES

- A. Publications listed below form a part of this specification to extent referenced. Publications are referenced in text by the basic designation only. Comply with applicable provisions and recommendations of the following, except as otherwise shown or specified.
- B. U.S. National Archives and Records Administration (NARA):  
33 CFR 328, Definitions, Waters of the United States.
- C. Federal Environmental Regulatory Requirements: Comply with applicable regulations. The following is for Contractor's information only:
  - 1. Storm water permits; refer to The Office of Wastewater Management, NPDES Storm Water Program: <http://www.epa.gov/npdes/stormwater>
  - 2. Dredge and fill (Section 404) permits; refer to U.S. EPA Office of Wetlands, Oceans, and Watersheds (OWOW): <http://www.epa.gov/owow/>
  - 3. RCRA hazardous and non-hazardous solid waste requirements; refer to EPA's Office of Solid Waste and Emergency Response:  
<http://www.epa.gov/epaoswer/osw/laws-reg.htm>
  - 4. Oil spill requirements for construction activities; refer to EPA Oil Program web site: <http://www.epa.gov/oilspill/>
  - 5. Hazardous substances (Superfund Liability) requirements for construction activities; refer to EPA's Superfund website:  
<http://www.epa.gov/superfund/index.htm>
  - 6. Polychlorinated Biphenyl (PCB) waste requirements; refer to EPA's Polychlorinated Biphenyl (PCB) Homepage: <http://www.epa.gov/pcb/>
  - 7. Air quality requirements for construction activities; refer to EPA'S Air Program Mobile Sources Page:  
<http://www.epa.gov/ebtpages/airmobilesources.html>

8. Asbestos requirements for construction activities; refer to EPA's Asbestos Management and Regulatory Requirements Website:  
<http://www.epa.gov/fedsite/cd/asbestos.html>
  9. National Environmental Policy Act (NEPA) requirements for construction activities
  10. Endangered Species Act; refer to The US Fish and Wildlife Service Endangered Species Program: <http://endangered.fws.gov/>
  11. National Historic Preservation Act
- C. State and Local Environmental Regulatory Requirements: Comply with applicable regulations. The following is for Contractor's information only:
1. State Office/Department of Environmental Quality.
  2. Local Office/Department of Environmental Quality.
  3. The Construction Industry Compliance Assistance Center:  
<http://www.cicacenter.org/index.cfm>
  4. The National Environmental Compliance Assistance Clearinghouse:  
<http://cfpub.epa.gov/clearinghouse/>

#### **1.5 SUSTAINABILITY REQUIREMENTS**

- A. Materials in this section may contribute towards contract compliance with sustainability requirements.
- B. Biobased Material: For products designated by the USDA's BioPreferred® program, provide products that meet or exceed USDA recommendations for biobased content, subject to the products compliance with performance requirements in this Section. For more information regarding the product categories covered by the BioPreferred® program, visit <http://www.biopreferred.gov>.

#### **1.6 SUBMITTALS**

- A. In accordance with Section, 01 33 23, SHOP DRAWINGS, PRODUCT DATA, AND SAMPLES, the Contractor shall furnish the following:
  1. Environmental Protection Plan: After the contract is awarded and prior to the commencement of the work, meet with the Resident Engineer/Contracting Officer's Representative (RE/COR) to discuss the proposed Environmental Protection Plan and to develop mutual understanding relative to details of environmental protection. Not more than 20 days after the meeting, prepare and submit to the

RE/COR for approval, a written and/or graphic Environmental Protection Plan including, but not limited to, the following:

- a. Name(s) and qualifications of person(s) within the Contractor's organization who is (are) responsible for:
  - 1) Ensuring adherence to the Environmental Protection Plan.
  - 2) Manifesting hazardous waste to be removed from the site.
  - 3) Training the Contractor's environmental protection personnel.
- b. Description of the Contractor's environmental protection personnel training program.
- c. A list of Federal, State, and local laws, regulations, and permits concerning environmental protection, pollution control, noise control and abatement that are applicable to the Contractor's proposed operations and the requirements imposed by those laws, regulations, and permits.
- d. Methods for protection of features to be preserved within authorized work areas including trees, shrubs, vines, grasses, ground cover, landscape features, air and water quality, fish and wildlife, soil, historical, and archeological and cultural resources.
- e. Procedures to provide environmental protection that complies with the applicable laws and regulations. Describe the procedures to correct pollution of the environment due to accident, natural causes, or failure to follow the procedures as described in the Environmental Protection Plan.
- f. Permits, licenses, and the location of the solid waste disposal area.
- g. Drawings showing locations of any proposed temporary excavations or embankments for haul roads, stream crossings, material storage areas, structures, sanitary facilities, and stockpiles of excess or spoil materials. Include as part of an Erosion Control Plan approved by the District Office of the U.S. Soil Conservation Service and/or mandated state agency, and the Department of Veterans Affairs.
- h. Environmental Monitoring Plans for the job site including land, water, air, and noise.
- i. Work Area Plan showing the proposed activity in each portion of the area and identifying the areas of construction limits or protected areas. Plan should include measures for marking the

limits of use areas. This plan may be incorporated within the Erosion Control Plan.

- B. Within 20 days after the date of its submittal, the RE/COR shall approve the Contractor's Comprehensive Environmental Protection Plan, or respond with an explanation for its rejection and resubmittal.
- C. Approval of the Contractor's Environmental Protection Plan will not relieve the Contractor of responsibility for adequate and continued control of pollutants and other environmental protection measures.

#### **1.7 PROTECTION OF ENVIRONMENTAL RESOURCES**

- A. Protect environmental resources within the project boundaries and those affected outside the limits of permanent work during the entire period of this contract and after the project is complete, based upon leaving the site that has yet to mature of hydro-seeding. Confine construction activities to areas defined by construction limits, the specifications and drawings.
- B. Protection of Land Resources: Prior to construction, identify all land resources to be preserved within the work area. Do not remove, cut, deface, injure, or destroy land resources including trees, shrubs, vines, grasses, top soil, land forms, wetlands or wetland buffers without prior approval from the RE/COR. Do not fasten or attach ropes, cables, or guys to trees for anchorage unless specifically authorized, or dictated by special emergency use.
  - 1. Work Area Limits: Prior to any construction, mark/fence/protect the areas that require work to be performed under this contract. Prior to construction, mark/fence/protect monuments, works of art, and any other markers to remain. Convey to all personnel the purpose of marking and protecting all marked and protected objects.
  - 2. Protection of Specific Regulated Elements: Wetlands and wetland buffers and other landscape features shown on the drawings to be preserved by marking, fencing, or using any other approved protective techniques.
    - a. Protect trees and shrubs to remain on site to protect from damage per contract details.
    - b. All damage to existing trees and shrubs shall be immediately repaired by trimming, cleaning, and painting with antiseptic tree paint.

- c. Do not store building materials or perform construction activities closer to existing trees or shrubs than the farthest extension of their limbs.
- 3. Reduction of Exposure of Unprotected Erodible Soils: Plan and conduct earthwork to minimize the duration of exposure of unprotected soils. Clear areas only as needed to use to work the area to be developed. Form earthwork to final grade as shown as quickly as possible to minimize potential erosion damage. Immediately protect side slopes and back slopes upon completion of rough grading or clearing with appropriate material as defined in the Sediment and Erosion Control Plan.
- 4. Temporary Protection of Disturbed Areas: Construct diversion ditches, benches, check dams and berms to retard and divert runoff from the construction site to protected drainage areas as intended under paragraph 208 of the Clean Water Act.
  - a. Sediment Basins: Trap sediment from construction areas in temporary or permanent sediment basins that accommodate the runoff of a local 10 year storm. After each storm, pump the basins dry and remove the accumulated sediment. Control overflow/drainage with paved weirs or by vertical overflow pipes, that drain from the surface of the basin.
  - b. Reuse or conserve the collected topsoil sediment as directed by the RE/COR. Topsoil use and requirements are specified in Section 31 20 11, EARTH MOVING short form.
  - c. Institute effluent quality monitoring programs as required by Federal, State, and local environmental agencies.
- 5. Erosion and Sedimentation Control Devices: Construct or install all temporary and permanent erosion and sedimentation control features to avoid violating water quality in accordance with federal and state regulations. Maintain temporary erosion and sediment control measures such as berms, dikes, drains, sedimentation basins, grassing, and mulching, straw waddles, fiber rolls, until permanent drainage and erosion control facilities are completed and operative.
- 6. Manage and control borrow and spoil areas on or off Government property (coordinate with COR) to minimize erosion and to prevent soil and/or sediment from entering nearby water courses or lakes.
- 7. Protect adjacent areas from despoilment by temporary excavations and embankments.

8. Handle and dispose of solid wastes in such a manner that will prevent contamination of the environment. Place solid wastes (excluding clearing debris) in containers that are emptied on a regular schedule. Transport all solid waste off Government property and dispose of waste in compliance with Federal, State, and local requirements.
  9. Store chemical waste away from the work areas in corrosion resistant containers and dispose of waste in accordance with Federal, State, and local regulations.
  10. Handle discarded materials other than those included in the solid waste category as directed by the RE/COR.
- C. Protection of Water Resources: Keep construction activities under surveillance, management, and control to avoid pollution of surface and ground waters and sewer systems. Implement management techniques to control water pollution by the listed construction activities that are included in this contract.
1. Washing and Curing Water: Do not allow wastewater directly derived from construction activities to enter water areas. Collect and place wastewater in sediment basins prior to entering retention/detention ponds, allowing the suspended material to settle, the pollutants to separate, or the water to evaporate.
  2. Control movement of materials and equipment at stream crossings during construction to prevent violation of water pollution control standards of the Federal, State, or local government.
  3. Monitor water areas, wetlands and wetland buffers affected by construction.
- D. Protection of Fish and Wildlife Resources: Keep construction activities under surveillance, management, and control to minimize interference with, disturbance of, or damage to fish and wildlife. Prior to beginning construction operations, list protected species that require specific attention along with measures for their protection.
- E. Protection of Air Resources: Keep construction activities under surveillance, management, and control to minimize pollution of air resources. Burning is not permitted on the job site. Keep activities, equipment, processes, and work operated or performed, in strict accordance with the State and Federal emission and performance laws and standards. Maintain ambient air quality standards set by the

Environmental Protection Agency, for those construction operations and activities specified.

1. Particulates: Control dust particles, aerosols, and gaseous by-products from all construction activities, processing, and preparation of materials from asphaltic batch plants if onsite, or other onsite material processing operations at all times, including weekends, holidays, and hours when work is not in progress.
  2. Particulates Control: Maintain all excavations, stockpiles, haul roads, permanent and temporary access roads, plant sites, spoil areas, borrow areas, and all other work areas within or outside the project boundaries free from particulates which would cause a hazard or a nuisance. Sprinkling, chemical treatment of an approved type, light bituminous treatment, or other methods are permitted to control particulates in the work area as approved in the Environmental Protection Plan.
  3. Hydrocarbons and Carbon Monoxide: Control monoxide emissions from equipment to Federal and State allowable limits.
  4. Odors: Control odors of construction activities and prevent obnoxious odors from occurring.
- F. Noise Control: Minimize noise using every action possible. Perform noise-producing work in less sensitive hours of the day or week as directed by the Resident Engineer/COR. Maintain noise-produced work at or below the decibel levels and within the time periods specified.
1. Perform construction activities involving repetitive, high-level impact noise only between the hours permitted by the RE/COR. Reference other specification sections for cemetery operations hours. Repetitive impact noise on the property shall not exceed the following Decibel A-scale (dBA) limitations:

Time Duration of Impact Noise	Sound Level in dBA
More than 12 minutes in any hour	70
Less than 30 seconds of any hour	85
Less than three minutes of any hour	80
Less than 12 minutes of any hour	75

2. Provide sound-deadening devices on equipment and take noise abatement measures that are necessary to comply with the requirements of this contract, consisting of, but not limited to, the following:



- a. Maintain maximum permissible construction equipment noise levels as measured with an A-scale decibel measuring device at 15 m (50 feet) (dBA):

CATEGORY OF EQUIPMENT			
EARTHMOVING		MATERIALS HANDLING	
EQUIPMENT STYLE	SOUND LEVEL dBA	EQUIPMENT STYLE	SOUND LEVEL dBA
FRONT LOADERS	75	CONCRETE MIXERS	75
BACKHOES	75	CONCRETE PUMPS	75
DOZERS	75	CRANES	75
TRACTORS	75	DERRICKS IMPACT	75
SCAPERS	80	PILE DRIVERS	95
GRADERS	75	JACK HAMMERS	75
TRUCKS	75	ROCK DRILLS	80
PAVERS, STATIONARY	80	PNEUMATIC TOOLS	80
PUMPS	75	BLASTING	95
GENERATORS	75	SAWS	75
COMPRESSORS	75	VIBRATORS	75

- b. Provide soundproof housings or enclosures for noise-producing machinery.
- c. Use efficient silencers on equipment air intakes.
- d. Use efficient intake and exhaust mufflers on internal combustion engines that are maintained so equipment performs below noise levels specified.
- e. Line hoppers and storage bins with sound deadening material.
- f. Conduct truck loading, unloading, and hauling operations so that noise is kept to a minimum.
3. Measure sound level for noise exposure due to the construction at least once every five successive working days while work is being performed above 75 dB(A) noise level. Measure noise exposure at the property line or 15 m (50 feet) from the noise source, whichever is greater. Measure the sound levels on the A weighted sound level of a General Purpose sound level meter at slow response. To minimize the effect of reflective sound waves at buildings, take measurements at 900 to 1800 mm (three to six feet) in front of any building face. Submit the recorded information to the Resident Engineer/COR noting any problems and the alternatives for mitigating actions.

- G. Restoration of Damaged Property: If any direct or indirect damage is done to public or private property resulting from any act, omission, neglect, or misconduct, the Contractor shall restore the damaged property to a condition equal to that existing before the damage at no additional cost to the Government. Repair, rebuild, or restore property as directed or make good such damage in an acceptable manner.
- H. Final Clean-up: On completion of project and after removal of all debris, rubbish, and temporary construction, Contractor shall leave the construction area in a clean condition as approved by the RE/COR. The site shall be left meeting the requirements of the local and state environmental requirements associated with the (SWPPP) Storm Water Pollution Protection Plan as submitted. Cleaning shall include off-cemetery disposal of all items and materials not required to be salvaged, as well as all debris and rubbish resulting from demolition and new work operations, clearing, logging and general construction in accordance with state and local regulations and the contract.

- - - E N D - - -

**SECTION 01 74 19**  
**CONSTRUCTION WASTE MANAGEMENT**

**PART 1 - GENERAL**

**1.1 DESCRIPTION**

- A. This section specifies the requirements for the management of non-hazardous building construction and demolition waste.
- B. Waste disposal in landfills shall be minimized to the greatest extent possible. Of the inevitable waste that is generated, as much of the waste material as economically feasible shall be salvaged, recycled or reused.
- C. Contractor shall use all reasonable means to divert construction and demolition waste from landfills and incinerators, and facilitate their salvage and recycle not limited to the following:
  - 1. Waste Management Plan development and implementation.
  - 2. Techniques to minimize waste generation.
  - 3. Sorting and separating of waste materials.
  - 4. Salvage of existing materials and items for reuse or resale.
  - 5. Recycling of materials that cannot be reused or sold.
- D. At a minimum the following waste categories shall be diverted from landfills:
  - 1. Soil.
  - 2. Inerts (eg, concrete, masonry and asphalt).
  - 3. Clean dimensional wood and palette wood.
  - 4. Green waste (biodegradable landscaping materials).
  - 5. Engineered wood products (plywood, particle board and I-joists, etc).
  - 6. Metal products (eg, steel, wire, beverage containers, copper, etc).
  - 7. Cardboard, paper and packaging.
  - 8. Bitumen roofing materials.
  - 9. Plastics (eg, ABS, PVC).
  - 10. Carpet and/or pad.
  - 11. Gypsum board.
  - 12. Insulation.
  - 13. Paint.
  - 14. Fluorescent lamps.

**1.3 QUALITY ASSURANCE**

- A. Contractor shall practice efficient waste management when sizing, cutting and installing building products. Processes shall be employed

to ensure the generation of as little waste as possible. Construction /Demolition waste includes products of the following:

1. Excess or unusable construction materials.
  2. Packaging used for construction products.
  3. Poor planning and/or layout.
  4. Construction error.
  5. Over ordering.
  6. Weather damage.
  7. Contamination.
  8. Mishandling.
  9. Breakage.
- B. Establish and maintain the management of non-hazardous building construction and demolition waste set forth herein. Conduct a site assessment to estimate the types of materials that will be generated by demolition and construction.
- C. Contractor shall develop and implement procedures to recycle construction and demolition waste to a minimum of 50 percent.
- D. Contractor shall be responsible for implementation of any special programs involving rebates or similar incentives related to recycling. Any revenues or savings obtained from salvage or recycling shall accrue to the contractor.
- E. Contractor shall provide all demolition, removal and legal disposal of materials. Contractor shall ensure that facilities used for recycling, reuse and disposal shall be permitted for the intended use to the extent required by local, state, federal regulations. The Whole Building Design Guide website <http://www.wbdg.org/tools/cwm.php> provides a Construction Waste Management Database that contains information on companies that haul, collect, and process recyclable debris from construction projects.
- F. Contractor shall assign a specific area to facilitate separation of materials for reuse, salvage, recycling, and return. Such areas are to be kept neat and clean and clearly marked in order to avoid contamination or mixing of materials.
- G. Contractor shall provide on-site instructions and supervision of separation, handling, salvaging, recycling, reuse and return methods to be used by all parties during waste generating stages.
- H. Record on daily reports any problems in complying with laws, regulations and ordinances with corrective action taken.

#### 1.4 TERMINOLOGY

- A. Class III Landfill: A landfill that accepts non-hazardous resources such as household, commercial and industrial waste resulting from construction, remodeling, repair and demolition operations.
- B. Clean: Untreated and unpainted; uncontaminated with adhesives, oils, solvents, mastics and like products.
- C. Construction and Demolition Waste: Includes all non-hazardous resources resulting from construction, remodeling, alterations, repair and demolition operations.
- D. Dismantle: The process of parting out a building in such a way as to preserve the usefulness of its materials and components.
- E. Disposal: Acceptance of solid wastes at a legally operating facility for the purpose of land filling (includes Class III landfills and inert fills).
- F. Inert Backfill Site: A location, other than inert fill or other disposal facility, to which inert materials are taken for the purpose of filling an excavation, shoring or other soil engineering operation.
- G. Inert Fill: A facility that can legally accept inert waste, such as asphalt and concrete exclusively for the purpose of disposal.
- H. Inert Solids/Inert Waste: Non-liquid solid resources including, but not limited to, soil and concrete that does not contain hazardous waste or soluble pollutants at concentrations in excess of water-quality objectives established by a regional water board, and does not contain significant quantities of decomposable solid resources.
- I. Mixed Debris: Loads that include commingled recyclable and non-recyclable materials generated at the construction site.
- J. Mixed Debris Recycling Facility: A solid resource processing facility that accepts loads of mixed construction and demolition debris for the purpose of recovering re-usable and recyclable materials and disposing non-recyclable materials.
- K. Permitted Waste Hauler: A company that holds a valid permit to collect and transport solid wastes from individuals or businesses for the purpose of recycling or disposal.
- L. Recycling: The process of sorting, cleansing, treating, and reconstituting materials for the purpose of using the altered form in the manufacture of a new product. Recycling does not include burning, incinerating or thermally destroying solid waste.

1. On-site Recycling - Materials that are sorted and processed on site for use in an altered state in the work, i.e. concrete crushed for use as a sub-base in paving.
  2. Off-site Recycling - Materials hauled to a location and used in an altered form in the manufacture of new products.
- M. Recycling Facility: An operation that can legally accept materials for the purpose of processing the materials into an altered form for the manufacture of new products. Depending on the types of materials accepted and operating procedures, a recycling facility may or may not be required to have a solid waste facilities permit or be regulated by the local enforcement agency.
- N. Reuse: Materials that are recovered for use in the same form, on-site or off-site.
- O. Return: To give back reusable items or unused products to vendors for credit.
- P. Salvage: To remove waste materials from the site for resale or re-use by a third party.
- Q. Source-Separated Materials: Materials that are sorted by type at the site for the purpose of reuse and recycling.
- R. Solid Waste: Materials that have been designated as non-recyclable and are discarded for the purposes of disposal.
- S. Transfer Station: A facility that can legally accept solid waste for the purpose of temporarily storing the materials for re-loading onto other trucks and transporting them to a landfill for disposal, or recovering some materials for re-use or recycling.

#### **1.5 SUBMITTALS**

- A. Prior to final invoice, location of facility where concrete materials were taken for recycling; along with weight tickets indicating amount of material recycled.

### **PART 2 - PRODUCTS**

#### **2.1 MATERIALS**

- A. List of each material and quantity to be salvaged, recycled, reused.
- B. List of each material and quantity proposed to be taken to a landfill.
- C. Material tracking data: Receiving parties, dates removed, transportation costs, weight tickets, tipping fees, manifests, invoices, net total costs or savings.

## **PART 3 - EXECUTION**

### **3.1 COLLECTION**

- A. Provide all necessary containers, bins and storage areas to facilitate effective waste management.
- B. Clearly identify containers, bins and storage areas so that recyclable materials are separated from trash and can be transported to respective recycling facility for processing.
- C. Hazardous wastes shall be separated, stored, disposed of according to local, state, federal regulations.

### **3.2 DISPOSAL**

- A. Contractor shall be responsible for transporting and disposing of materials that cannot be delivered to a source-separated or mixed materials recycling facility to a transfer station or disposal facility that can accept the materials in accordance with state and federal regulations.
- B. Construction or demolition materials with no practical reuse or that cannot be salvaged or recycled shall be disposed of at a landfill or incinerator.

### **3.3 REPORT**

- A. With each application for progress payment, submit a summary of construction and demolition debris diversion and disposal including beginning and ending dates of period covered.
- B. Quantify all materials diverted from landfill disposal through salvage or recycling during the period with the receiving parties, dates removed, transportation costs, weight tickets, manifests, invoices. Include the net total costs or savings for each salvaged or recycled material.
- C. Quantify all materials disposed of during the period with the receiving parties, dates removed, transportation costs, weight tickets, tipping fees, manifests, invoices. Include the net total costs for each disposal.

- - - E N D - - -



**SECTION 02 41 10  
DEMOLITION AND SITE CLEARING**

**PART 1 - GENERAL**

**1.1 DESCRIPTION**

- A. This section specifies all site preparation work, demolition and removal of buildings, portions of buildings, utilities, other structures and debris from trash dumps shown.

**1.2 RELATED WORK**

- B. Safety Requirements: GENERAL CONDITIONS Article, ACCIDENT PREVENTION.
- C. Disconnecting utility services prior to demolition: Section 01 00 02, GENERAL REQUIREMENTS.
- D. Reserved items that are to remain the property of the Government: Section 01 00 02, GENERAL REQUIREMENTS.

**1.3 PROTECTION**

- A. Perform demolition in such manner as to eliminate hazards to persons and property; to minimize interference with use of adjacent areas, utilities and structures or interruption of use of such utilities; and to provide free passage to and from such adjacent areas of structures. Comply with requirements of GENERAL CONDITIONS Article, ACCIDENT PREVENTION.
- B. Provide safeguards, including warning signs, barricades, temporary fences, warning lights, and other similar items that are required for protection of all personnel during demolition and removal operations. Comply with requirements of Section 01 00 02, GENERAL REQUIREMENTS.
- C. Maintain fences, barricades, lights, and other similar items around exposed excavations until such excavations have been completely filled.
- D. Provide enclosed dust chutes with control gates from each floor to carry debris to truck beds and govern flow of material into truck. Provide overhead bridges of tight board or prefabricated metal construction at dust chutes to protect persons and property from falling debris.
- E. Prevent spread of flying particles and dust. Sprinkle rubbish and debris with water to keep dust to a minimum. Do not use water if it results in hazardous or objectionable condition such as, but not limited to; ice, flooding, or pollution. Vacuum and dust the work area daily.
- F. In addition to previously listed fire and safety rules to be observed in performance of work, include following:

1. No wall or part of wall shall be permitted to fall outwardly from structures.
  2. Maintain at least one stairway in each structure in usable condition to highest remaining floor. Keep stairway free of obstructions and debris until that level of structure has been removed.
  3. Wherever a cutting torch or other equipment that might cause a fire is used, provide and maintain fire extinguishers nearby ready for immediate use. Instruct all possible users in use of fire extinguishers.
  4. Keep hydrants clear and accessible at all times. Prohibit debris from accumulating within a radius of 4500 mm (15 feet) of fire hydrants.
- G. Before beginning any demolition work, survey the site and examine the drawings and specifications to determine the extent of the work. Take necessary precautions to avoid damages to existing items to remain in place, to be reused, or to remain the property of the Cemetery; any damaged items shall be repaired or replaced as approved by the Resident Engineer/Contracting Officer's Representative (RE/COR). Coordinate the work of this section with all other work and shall construct and maintain shoring, bracing, and supports as required. Ensure that structural elements are not overloaded and shall be responsible for increasing structural supports or adding new supports as may be required as a result of any cutting, removal, or demolition work performed under this contract. Do not overload structural elements. Provide new supports and reinforcement for existing construction weakened by demolition or removal works. Repairs, reinforcement, or structural replacement must have RE/COR's approval.

#### **1.4 UTILITY SERVICES**

- A. Demolish and remove outside utility service lines shown to be removed.
- B. Remove abandoned outside utility lines that would interfere with installation of new utility lines and new construction.

#### **PART 2 - PRODUCTS (NOT USED)**

#### **PART 3 - EXECUTION**

##### **3.1 SITE CLEARING**

- A. General: Remove trees, shrubs, grass, and other vegetation, pavements, improvements, or obstructions, as required, to permit installation of new construction. Remove similar items elsewhere on site or premises as specifically indicated. Removal includes digging out and off-site

disposal of stumps and roots. Cutting down a tree, or felling a tree, does not include removing the stump or roots.

1. Cut minor roots and branches of trees indicated to remain in a clean and careful manner where such roots and branches obstruct installation of new construction.
  2. Cutting tree branches larger than 4 inches in diameter adjacent to, or overhanging, structures, gravestones, fences or other improvements shall be done in pieces utilizing a cherry picker to assist in lowering the branches to the ground.
- B. Erosion Control: Provide erosion control measures to prevent erosion or displacement of soils and discharge of soil-bearing water runoff or airborne dust to adjacent properties and walkways. Install silt fence and inlet protection as shown and as per requirements of the SWPPP, prior to any soil disturbance activities. Provide temporary seeding as required by the SWPPP.
- C. Maintain site controls in accordance with Storm Water Pollution Prevention Plan and repair as directed by COTR to sustain compliance with SPDES permit. Maintain all records as required by the SWPPP. Perform inspections as required by the SWPPP.
- D. Topsoil - On-site: Topsoil is defined as friable clay loam surface soil found in a depth of not less than 150 mm (6 inches). Satisfactory topsoil is reasonably free and/or screened of subsoil, clay lumps, stones, and other objects over 25 mm (1 inch) in diameter, and without weeds, roots, and other objectionable material.
1. Strip topsoil to whatever depths encountered in a manner to prevent intermingling with underlying subsoil or other objectionable material. Remove heavy growths of grass from areas before stripping.
    - a. Where existing trees are indicated to remain, leave existing topsoil in place within drip lines to prevent damage to root system.
  2. Stockpile topsoil in storage piles in areas indicated or directed. Construct storage piles to provide free drainage of surface water. Cover storage piles to prevent wind erosion in accordance with the Storm Water Pollution Prevention Plan. Refer to Division 2 Section 32 90 00, "Planting" for soil amendments required prior to spreading topsoil.

- a. Stockpile shall be contained with erosion and sediment controls (silt fence) and stabilized if undisturbed in accordance with the Storm Water Pollution Prevention Plan.
- 3. Dispose of unsuitable or excess topsoil as specified for disposal of waste material only after approval of the Architect.
- E. Clearing and Grubbing: Clear site of trees, shrubs, and other vegetation, except for those indicated to be left standing.
  - 1. Completely remove stumps, roots, and other debris protruding through ground surface.
  - 2. Use only hand methods for grubbing inside drip line of trees indicated to remain.
  - 3. Fill depressions caused by clearing and grubbing operations with satisfactory soil material, unless further excavation or earthwork is indicated.
    - a. Place fill material in horizontal layers not exceeding 150 mm (6 inches) loose depth, and thoroughly compact each layer to a density equal to adjacent original ground.
- F. Removal of Improvements: Remove existing above-grade and below-grade improvements as indicated and as necessary to facilitate new construction.
- G. Abandonment or removal of certain underground pipe or conduits may be indicated on mechanical or electrical drawings and is included under work of related Division 15 and 16 Sections. Removing abandoned underground piping or conduits interfering with construction is included under this Section, except as indicated to be abandoned in-place.
- H. Continue maintenance of erosion controls in compliance with the Storm Water Pollution Prevention Plan until the work is completed and the threat of erosion is gone by either around surface stabilizer or lawn "grow-in" is at 85% complete. Temporary erosion control devices shall not be removed until the area is certified as being stabilized by the Qualified Inspector.

### **3.2 DEMOLITION**

- A. Completely demolish and remove buildings and structures, including all appurtenances related or connected thereto, as noted below:
  - 1. As required for installation of new utility service lines.
  - 2. To full depth within an area defined by hypothetical lines located 1500 mm (5 feet) outside building lines of new structures.

- B. Debris, including brick, concrete, stone, metals and similar materials shall become property of Contractor and shall be disposed of by him daily, off the Cemetery Property to avoid accumulation at the demolition site. Materials that cannot be removed daily shall be stored in areas specified by the RE/COR. Break up concrete slabs below grade that do not require removal from present location into pieces not exceeding 600 mm (24 inches) square to permit drainage. Contractor shall dispose debris in compliance with applicable federal, state or local permits, rules and/or regulations.
- C. In removing buildings and structures of more than two stories, demolish work story by story starting at highest level and progressing down to third floor level. Demolition of first and second stories may proceed simultaneously.
- D. Remove and legally dispose of all materials, other than earth to remain as part of project work, from any trash dumps shown. Materials removed shall become property of contractor and shall be disposed of in compliance with applicable federal, state or local permits, rules and/or regulations. All materials in the indicated trash dump areas, including above surrounding grade and extending to a depth of 1500 mm (5 feet) below surrounding grade, shall be included as part of the lump sum compensation for the work of this section. Materials that are located beneath the surface of the surrounding ground more than 1500 mm (5 feet), or materials that are discovered to be hazardous, shall be handled as unforeseen. The removal of hazardous material shall be referred to Hazardous Materials specifications. Burning is not permitted on the property.
- E. Remove existing utilities as indicated or uncovered by work and terminate in a manner conforming to the nationally recognized code covering the specific utility and approved by the RE/COR. When Utility lines are encountered that are not indicated on the drawings, the RE/COR shall be notified prior to further work in that area.

### **3.2 CLEAN-UP**

- A. On completion of work of this section and after removal of all debris, leave site in clean condition satisfactory to RE/COR. Clean-up shall include off the Cemetery Property disposal of all items and materials not required to remain property of the Government as well as all debris and rubbish resulting from demolition operations.

- - - E N D - - -

**SECTION 06 10 00  
ROUGH CARPENTRY**

**PART 1 - GENERAL**

**1.1 DESCRIPTION**

- A. Section specifies framing, blocking, sheathing, furring, nailers, and rough hardware, and includes the use of preassembled components and plastic lumber. Wood finished flooring, trim, millwork, siding, heavy timber work, custom woodwork, and finish carpentry are specified in other sections.

**1.2 RELATED WORK**

- A. NA

**1.3 PERFORMANCE REQUIREMENTS**

- B. Engineered Wood Products:
1. Provide products with no added urea formaldehyde; determine formaldehyde concentrations in air from wood products under test conditions of temperature and relative humidity in accordance with ASTM D6007 or E1333.
  2. Bio-based Content:
    - a. Interior Panels: Engineered products designed specifically for interior applications and providing a surface that is impact-, scratch-, and wear-resistant and that does not absorb or retain moisture; provide minimum 55 percent bio-based content.
    - b. Structural Interior Panels: Engineered products designed for use in structural construction applications; provide minimum 89 percent bio-based content.
    - c. Structural Wall Panels: Engineered products designed for use in structural walls, curtain walls, floors and roofs; provide minimum 94 percent bio-based content.
  3. VOC Emissions:
    - a. Provide low VOC products with Green Seal Certification to GS-36 and description of the basis for certification

**1.4 SUSTAINABILITY REQUIREMENTS**

- A. Materials in this section may contribute towards contract compliance with sustainability requirements.
- B. Biobased Material: For products designated by the USDA's BioPreferred® program, provide products that meet or exceed USDA recommendations for biobased content, subject to the products compliance with performance requirements in this Section. For more information regarding the



product categories covered by the BioPreferred® program, visit  
<http://www.biopreferred.gov>.

#### **1.5 SUBMITTALS**

- A. Submit in accordance with Section 01 33 23, SHOP DRAWINGS, PRODUCT DATA, AND SAMPLES.
- B. Provide documentation of conformance with performance requirements of this section.
- C. Prepare shop drawings showing framing connection details, fasteners, connections and dimensions.

#### **1.6 PRODUCT DELIVERY, STORAGE, AND HANDLING**

- A. Protect lumber and other products from dampness both during and after delivery at site.
- B. Pile lumber in stacks in such manner as to provide air circulation around surfaces of each piece.
- C. Stack plywood and other board products so as to prevent warping.
- D. Locate stacks on well drained areas, supported at least 150 mm (6 inches) above grade and cover with well-ventilated sheds having firmly constructed over hanging roof with sufficient end wall to protect lumber from driving rain.

#### **1.7 APPLICABLE PUBLICATIONS**

- A. Publications listed below form a part of this specification to extent referenced. Publications are referenced in text by the basic designation only. Comply with applicable provisions and recommendations of the following, except as otherwise shown or specified.
- B. American Forest and Paper Association (AF&PA):  
Wood Structural Design Data
- C. American Lumber Standard Committee, Incorporated (ALSC):  
ALSC Board of Review
- D. American National Standards Institute (ANSI):  
ANSI A190.1-2012                      Structural Glued Laminated Timber
- E. American Plywood Association (APA):  
E30-2011                                  Engineered Wood Construction Guide
- F. American Society of Mechanical Engineers (ASME):  
B18.2.1-2012                              Square, Hex, Heavy Hex and Askew Head Bolts and  
Hex, Heavy Hex, Hex Flange, Lobed Head, and Lag  
Screws  
B18.2.2-2010                              Hex Nuts for General Applications  
B18.6.1-81 (R2008)                      Wood Screws

- B18.6.4-98(R2005)      Thread Forming and Thread Cutting Tapping  
Screws and Metallic Drive Screws
- G. American Society for Testing and Materials (ASTM):
- A307-10      Carbon Steel Bolts and Studs, 60,000 PSI  
Tensile Strength
- C954-11      Steel Drill Screws for the Application of  
Gypsum Panel Products or Metal Plaster Bases to  
Steel Studs from 0.033 in. (0.84 mm) to 0.112  
in. (2.84 mm) in Thickness
- C1002-07      Steel Self-Piercing Tapping Screws for the  
Application of Gypsum Panel Products or Metal  
Plaster Bases to Wood Studs or Steel Studs
- D6007-02      Determining Formaldehyde Concentration in Air  
from Wood Products Using a Small Scale Chamber
- E1333-10      Determining Formaldehyde Concentrations in Air  
and Emission Rates from Wood Products Using a  
Large Chamber
- F547      Nails for Use with Wood and Wood-Base Materials
- F844-07a      Washers, Steel, Plain (Flat) Unhardened for  
General Use
- F1667-11a      Nails, Spikes, and Staples
- H. American Wood Council
- AWC NDS      National Design Specification (NDS) For Wood  
Construction
- AWC WFCM      Wood Frame Construction Manual for One- and  
Two-Family Dwellings
- I. FM Global Group (FM):
- FM 4435      Approval Standard for Edge Systems Used with  
Low Slope Roofing Systems
- J. Green Seal (GS):
- GS-36      Commercial Adhesives
- K. Northeastern Lumber Manufacturers Association (NELMA)
- NELMA Grading Rules      Standard Grading Rules for Northeastern Lumber
- L. U.S. Department of Commerce/National Institute of Science and  
Technology:
- PS 1-09      Structural Plywood
- PS 20-10      American Softwood Lumber Standard

**PART 2 - PRODUCTS****2.1 LUMBER**

- A. Unless otherwise specified, each piece of lumber to bear a grade mark, stamp, or other identifying marks indicating grades of material, and rules or standards under which produced.
  - 1. Identifying marks in accordance with rule or standard under which material is produced, including requirements for qualifications and authority of the inspection organization, usage of authorized identification, and information included in the identification.
  - 2. Inspection agency for lumber approved by the Board of Review, American Lumber Standards Committee, to grade species used.
  - 3. Design members and fastenings to conform to AITC Timber Construction Manual. Coordinate to show structural properties on drawings of load bearing structural members.
- B. Structural Members: Species and grade as listed in the AF&PA, National Design Specification for Wood Construction having design stresses as shown.
- C. Lumber Other Than Structural:
  - 1. Unless otherwise specified, species graded under the grading rules of an inspection agency approved by Board of Review, American Lumber Standards Committee.
  - 2. Framing lumber: Minimum extreme fiber stress in bending of 1100.
  - 3. Furring, blocking, nailers and similar items 100 mm (4 inches) and narrower Standard Grade; and, members 150 mm (6 inches) and wider, Number 2 Grade.
- D. Sizes:
  - 1. Conforming to Prod. Std. PS20.
  - 2. Size references are nominal sizes, unless otherwise specified, actual sizes within manufacturing tolerances allowed by standard under which produced.
- E. Moisture Content:
  - 1. At time of delivery and maintained at the site.
  - 2. Boards and lumber 50 mm (2 inches) and less in thickness: 19 percent or less.
  - 3. Lumber over 50 mm (2 inches) thick: 25 percent or less.
- F. Preservative Treatment:
  - 1. Do not treat Heart Redwood and Western Red Cedar.
  - 2. Products containing chromium or arsenic will not be permitted.

3. Provide products with waterborne or boron-based preservatives.

G. Waterborne Wood Preservatives:

1. Treat wood products with waterborne wood preservatives listed in Section 4 of AWPA Standards U1, excluding those which contain arsenic and/or chromium.
2. Pressure treatment of wood products must conform to the requirements of AWPA Standards U1 and T1.
3. Retention of preservatives as prescribed in AWPA Standard U1 for the following Use Categories (material conforming to a higher AWPA Use Category may be specified):
  - a. UC1: Interior construction - above ground, dry conditions.
  - b. UC2: Interior construction - above ground, damp conditions.
  - c. UC3A: Exterior construction - above ground, coated and with rapid water runoff.
  - d. UC3B: Exterior construction - above ground, uncoated or poor water runoff.
  - e. UC4A: General purpose soil or fresh water contact - heavy duty above ground.
  - f. UC4B: Heavy duty soil or fresh water contact - critical or difficult to replace components.
  - g. UC4C: Extreme duty soil or fresh water contact - critical structural components.

H. Boron-based Preservatives: Impregnate lumber with preservative treatment conforming to AWPA Standard U1.

I. Fire-retardant Treatment:

1. Fire-retardant-treated wood products to be free of halogens, sulfates, ammonium phosphate and formaldehyde.
2. Fire retardant treatment of wood products to conform to the requirements of AWPA Standard U1, Commodity Specification H and AWPA Standard T1, Section H.

## 2.2 PLYWOOD

- A. Comply with Prod. Std. PS 1 and APA E30.
- B. Bear the mark of a recognized association or independent inspection agency that maintains continuing control over quality of plywood which identifies compliance by veneer grade, group number, span rating where applicable, and glue type.
- C. Sheathing:
  1. APA rated Exposure 1 or Exterior; panel grade CD or better.

2. Wall Sheathing:

- a. Minimum 9 mm (11/32 inch) thick with supports 400 mm (16 inches) on center and 12 mm (15/32 inch) thick with supports 600 mm (24 inches) on center unless specified otherwise.
- b. Minimum 1200 mm (48 inches) wide at corners without corner bracing of framing.

3. Roof Sheathing:

- a. Minimum 15 mm (19/32 inch) thick or span rating of 40/20 or 18 mm (23/32 inch) thick or span rating of 48/24 for supports 600 mm (24 inches) on center.

**2.3 ROUGH HARDWARE**

- A. Anchor Bolts: ASTM A307, size as indicated, complete with nuts and washers.
- B. Washers:
  - 1. ASTM F844.
  - 2. Use zinc or cadmium coated steel or cast iron for washers exposed to weather.
- C. Screws:
  - 1. Wood to Wood: ANSI B18.6.1 or ASTM C1002.
  - 2. Wood to Steel: ASTM C954, or ASTM C1002.
- D. Nails:
  - 1. ASTM F1667:
    - a. Common: Type I, Style 10.
    - b. Concrete: Type I, Style 11.
    - c. Barbed: Type I, Style 26.
    - d. Underlayment: Type I, Style 25.
    - e. Masonry: Type I, Style 27.

**2.4 BLOCKING**

- A. General: Provide miscellaneous lumber as indicated and lumber support or attachment for other construction, including the following:
  - 1. Blocking.
  - 2. Nailers.
  - 3. Furring.
- B. Provide Standard or No. 2 Grade lumber.

2.5 Rough Carpentry Products shall comply with following standards for biobased materials:

Material Type	Percent by Weight
Lumber	25 percent biobased material
plywood	55 percent biobased material

The minimum-content standards are based on the weight (not the volume) of the material in the insulating core only.

### **PART 3 - EXECUTION**

#### **3.1 INSTALLATION OF FRAMING AND MISCELLANEOUS WOOD MEMBERS**

- A. Conform to applicable requirements of the following:
  - 1. Comply with APA standards for installation of plywood.
- B. Anchors in Masonry: Embed anchor bolts not less than 400 mm (15 inches) in masonry unit walls and provide each with a nut and a 50 mm (2 inch) diameter washer at bottom end. Fully grout bolts with mortar.
- C. Anchors in Concrete:
  - 1. Embed anchor bolts not less than 200 mm (8 inches) in poured concrete walls and provide each with a nut and a 50 mm (2 inch) diameter washer at bottom end.
  - 2. A bent end may be substituted for the nut and washer; bend to be not less than 90 degrees.
  - 3. Powder-actuated fasteners spaced 900 mm (3 feet) o.c. may be provided instead of bolts for single thickness plates on concrete.
- D. Sheathing:
  - 1. Lay panels with joints staggered, with edge and ends 3 mm (1/8 inch) apart and nailed over bearings as specified.
  - 2. Set nails not less than 9 mm (3/8 inch) from edges.
  - 3. Install 50 mm by 100 mm (2 inch by 4 inch) blocking spiked between studs to support edge or end joints of panels.
- E. Wood Roof Nailers, Edge Strips, Crickets, Curbs, and Cants: Provide sizes and configurations indicated or specified and anchored securely to continuous construction.
  - 1. Roof Edge Strips and Nailers: Provide at perimeter of roof, around openings through roof, and where roofs abut walls, curbs, and other vertical surfaces.
  - 2. Except where indicated otherwise, nailers to be 150 mm (6 inches) wide and the same thickness as the insulation. Anchor nailers securely to underlying construction.

3. Anchor perimeter nailers in accordance with FM 4435. Provide strips grooved for edge venting; install at walls, curbs, and other vertical surfaces with a 6 to 12 mm (1/4 to 1/2 inch) air space.
  4. Crickets, Cants, and Curbs: Provide wood saddles or crickets, cant strips, curbs for scuttles and ventilators, and wood nailers bolted to tops of concrete or masonry curbs and at expansion joints, and at lumber and exterior plywood.
- F. Wood Blocking: Provide proper sizes and shapes at proper locations for the installation and attachment of wood and other finish materials, fixtures, equipment, and items indicated or specified.
- G. Wood Grounds: Provide for fastening wood trim, finish materials, and other items to plastered walls and ceilings. Install grounds in proper alignment and true with a 2400 mm (8 foot) straightedge.
- H. Wood Furring:
1. Provide where shown and as necessary for facing materials specified.
  2. Except as shown otherwise, furring strips to be nominal one by 3, continuous, and spaced 400 mm (16 inches) o.c. Erect furring vertically or horizontally as necessary.
  3. Nail furring strips to masonry.
  4. Do not use wood plugs.
  5. Provide furring strips around openings, behind bases, and at angles and corners.
  6. Furring to be plumb, rigid, and level and shimmed as necessary to provide a true, even plane with surfaces suitable to receive the finish required.

### 3.2 PROTECTION

- A. Protect rough carpentry from weather.
- B. If rough carpentry becomes wet, apply EPA-registered borate treatment complying with EPA registered label.

- - - E N D - - -

**SECTION 07 31 13  
ASPHALT SHINGLES**

**PART 1 - GENERAL**

**1.1 DESCRIPTION**

This section specifies organic felt and fiberglass asphalt shingles.

**1.2 RELATED WORK**

- A. Color of shingles: Submit for approval. Match existing roof color.
- B. Counterflashing and flashing of roof projections: Section 07 60 00, FLASHING AND SHEET METAL.

**1.3 SUMMITTALS**

- A. Submit in accordance with Section 01 33 23, SHOP DRAWINGS, PRODUCT DATA, AND SAMPLES.
- B. Samples: Shingles, each type, color and texture.
- C. Manufacturer's Literature and Data:
  - 1. Shingles, each type
  - 2. Installation instructions

**1.4 DELIVERY AND STORAGE**

- A. Deliver materials in manufacturer's unopened bundles or containers with the manufacturer's brand and name clearly marked thereon.
- B. Shingle bundle wrapping shall bear the label of Underwriters Laboratories, Inc.
- C. Store shingles in accordance with manufacturer's printed instructions. Store roll goods on end in an upright position.
- D. Keep materials dry, covered completely and protected from the weather.

**1.5 APPLICABLE PUBLICATIONS**

- A. Publications listed below form a part of this specification to the extent referenced. Publications are referenced in the text by the basic designation only.
- B. American Society for Testing and Materials (ASTM):
  - D226-09.....Asphalt-Saturated Organic Felt Used in Roofing  
and Waterproofing
  - D2178-04.....Asphalt Glass Felt used in Roofing and  
Waterproofing
  - D3018-10.....Class A Asphalt Shingles Surfaced with Mineral  
Granules
  - F1667-11.....Driven Fasteners: Nails, Spikes, and Staples
- C. Underwriter's Laboratories Inc. (UL):



UL790-04.....Fire Tests of Roof Covering

## **PART 2 - PRODUCTS**

### **2.1 SHINGLES**

- A. Class A: (Fire resistive), per UL790. ASTM D3018, Type I and ASTM 3462, square butt for a maximum exposure of 125 mm (5 inches), headlap minimum 50 mm (2 inches), wind resistant, self-sealing. Minimum weight: 10.3 Kg/sqm (210 lbs/100sft).

### **2.2 ROOFING NAILS**

- A. ASTM F1667; Type I, Style 20, galvanized steel, deformed shanks, with heads 9.5 mm to 11 mm (3/8-inch to 7/16-inch) diameter.
- B. Use nails 32 mm (1-1/4 inches) long for shingles and 19 mm (3/4-inch long) for felt.

### **2.3 ROOFING FELT**

- A. Fiberglass Felt: ASTM D2178.
- B. Organic Felt: ASTM D226, TYPE 1.
- C. Modified bitumen; ASTM D 1970.

## **PART 3 EXECUTION**

### **3.1 PREPARATION**

- A. Roof surfaces shall be sound, reasonably smooth and free from defects which would interfere with roofing installation.
- B. Roof accessories, vent pipes and other projections through the roof must be in place and roof flashing installed or ready for installation before laying shingles.

### **3.2 LAYING**

- A. Lay felt under shingles over entire roof.
- B. Install asphalt felt underlayment, lapping a minimum of 100 mm (four inches) at ends, 50 mm (2 inches) at head and 300 mm (12 inches) over ridge. Extend felt 13 mm (1/2-inch) beyond edges of roof. Nail felt 125 mm (five inches) on centers along laps.
- C. At eaves, install strip of 41 Kg (90 pound) mineral surface roll roofing not less than 460 mm (18 inches) wide and starter course of roof shingles with tabs reversed. Both shall overhang lower edge of roof 13 mm (1/2-inch).
- D. Lay shingles with maximum exposure of 125 mm (5 inches). Nail shingles in accordance with manufacturer's published directions.

**3.3 METAL DRIP EDGES**

- A. At rakes, install metal drip edges made of stainless steel specified under Section 07 60 00, FLASHING AND SHEET METAL. Apply the metal drip edge directly over the underlayment along the rakes.
- B. Secure metal drip edges with compatible nails spaced not more than 250 mm (10 inches) on center along the inner edges.

**3.4 FLASHINGS**

Provide metal flashings specified under Section 07 60 00, FLASHING AND SHEET METAL at the intersections of roofs, adjoining walls, or projections through the deck such as chimneys and vent stacks. Give careful attention to the installation of all flashings.

**3.5 RIDGE**

- A. Bend each shingle lengthwise down center to provide equal exposure on each side of ridge. Beginning at one end of ridge, apply shingles with maximum 125 mm (5 inches) exposure.
- B. Secure each shingle with one nail on each side, 210 mm (8-1/2 inches) back from exposed end and one inch up from edge.

**3.6 VALLEY FLASHING**

- A. Install metal valley flashing shown and as specified under Section 07 60 00, FLASHING AND SHEET METAL.
- B. Secure valley flashing in accordance with shingle manufacturer's printed instructions.
- C. Expose flashing in open portion of valley a minimum of 125 mm (5 inches) and lap the shingles over the flashing a minimum of 125 mm (5 inches).

**3.7 ROOF ACCESSORIES**

- A. Install all existing accessories.
- B. Lap shingles over the accessories flashing a minimum of 125 mm (5 inches).

- - - E N D - - -

**SECTION 07 60 00  
FLASHING AND SHEET METAL**

**PART 1 - GENERAL**

**1.1 DESCRIPTION**

- A. Formed sheet metal work for wall and roof flashing, copings, roof edge metal, fasciae, drainage specialties including gutters and downspouts, and formed expansion joint covers are specified in this section.

**1.2 RELATED WORK**

NA

**1.3 APPLICABLE PUBLICATIONS**

- A. Publications listed below form a part of this specification to extent referenced. Publications are referenced in text by the basic designation only. Comply with applicable provisions and recommendations of the following, except as otherwise shown or specified.

B. Aluminum Association (AA):

AA-C22A41	Aluminum Chemically etched medium matte, with clear anodic coating, Class I Architectural, 0.7-mil thick
AA-C22A42	Chemically etched medium matte, with integrally colored anodic coating, Class I Architectural, 0.7 mils thick
AA-C22A44	Chemically etched medium matte with electrolytically deposited metallic compound, integrally colored coating Class I Architectural, 0.7-mil thick finish

C. American Architectural Manufacturers Association (AAMA):

AAMA 620	High Performance Organic Coatings on Coil Coated Architectural Aluminum
AAMA 621	High Performance Organic Coatings on Coil Coated Architectural Hot Dipped Galvanized (HDG) and Zinc-Aluminum Coated Steel Substrates

D. American National Standards Institute/Single-Ply Roofing Institute (ANSI/SPRI):

ANSI/SPRI ES-1-03	Wind Design Standard for Edge Systems Used with Low Slope Roofing Systems
-------------------	---

E. ASTM International (ASTM):

A167-99(R2009)	Stainless and Heat-Resisting Chromium-Nickel Steel Plate, Sheet, and Strip
----------------	--

- |                 |   |
|-----------------|---|
| A653/A653M-09   | Steel Sheet Zinc-Coated (Galvanized) or Zinc Alloy Coated (Galvanized) by the Hot-Dip Process |
| B32-08          | Solder Metal  |
| B209-10         | Aluminum and Aluminum-Alloy Sheet and Plate   |
| B370-09         | Copper Sheet and Strip for Building Construction  |
| D173-03         | Bitumen-Saturated Cotton Fabrics Used in Roofing and Waterproofing                            |
| D412-06         | Vulcanized Rubber and Thermoplastic Elastomers-Tension  |
| D1187-97(R2002) | Asphalt Base Emulsions for Use as Protective Coatings for Metal                               |
| D3656-07        | Insect Screening and Louver Cloth Woven from Vinyl-Coated Glass Yarns                         |
| D4586-07        | Asphalt Roof Cement, Asbestos Free  |
- F. FM Approvals: RoofNav Approved Roofing Assemblies and Products:  
 1-49-09 Loss Prevention Data Sheet: Perimeter Flashing
- G. International Code Commission (ICC):  
 International Building Code, Current Edition
- H. National Association of Architectural Metal Manufacturers (NAAMM):  
 AMP 500-06 Metal Finishes Manual
- I. Sheet Metal and Air Conditioning Contractors National Association (SMACNA): Architectural Sheet Metal Manual 2012

#### 1.4 PERFORMANCE REQUIREMENTS

- A. Wind Uplift Forces: Resist the following forces per FM Approvals 1-49:
1. Wind Zone 1: 0.48 to 0.96 kPa (10 to 20 lbf/sq. ft.): 1.92-kPa (40-lbf/sq. ft.) perimeter uplift force, 2.87-kPa (60-lbf/sq. ft.) corner uplift force, and 0.96-kPa (20-lbf/sq. ft.) outward force.
  2. Wind Zone 1: 1.00 to 1.44 kPa (21 to 30 lbf/sq. ft.): 2.87-kPa (60-lbf/sq. ft.) perimeter uplift force, 4.31-kPa (90-lbf/sq. ft.) corner uplift force, and 1.44-kPa (30-lbf/sq. ft.) outward force.
  3. Wind Zone 2: 1.48 to 2.15 kPa (31 to 45 lbf/sq. ft.): 4.31-kPa (90-lbf/sq. ft.) perimeter uplift force, 5.74-kPa (120-lbf/sq. ft.) corner uplift force, and 2.15-kPa (45-lbf/sq. ft.) outward force.
  4. Wind Zone 3: 2.20 to 4.98 kPa (46 to 104 lbf/sq. ft.): 9.96-kPa (208-lbf/sq. ft.) perimeter uplift force, 14.94-kPa (312-lbf/sq. ft.) corner uplift force, and 4.98-kPa (104-lbf/sq. ft.) outward force.

ft.) corner uplift force, and 4.98-kPa (104-lbf/sq. ft.) outward force.

- B. Wind Design Standard: Fabricate and install copings, roof-edge flashings tested per ANSI/SPRI ES-1.

### **1.5 SUSTAINABILITY REQUIREMENTS**

- A. Materials in this section may contribute towards contract compliance with sustainability requirements.

### **1.6 SUBMITTALS**

- A. Submit in accordance with Section 01 33 23, SHOP DRAWINGS, PRODUCT DATA, AND SAMPLES.
- B. Shop Drawings: For all specified items, including:
1. Flashings.
  2. Gutter and Conductors.
  3. Expansion joints.
  4. Fascia-cant.
- C. Manufacturer's Literature and Data: For all specified items, including:
1. Two-piece counterflashing.
  2. Thru wall flashing.
  3. Non-reinforced, elastomeric sheeting.
  4. Copper clad stainless steel.
  5. Polyethylene coated copper.
  6. Bituminous coated copper.
  7. Fascia-cant.
- D. Certificates: Indicating compliance with specified finishing requirements, from applicator and contractor.

### **1.7 PRE-INSTALLATION CONFERENCE**

- A. Convene a meeting on site, after submittals are received and approved but before any work, to review drawings and specifications, submittals, schedule, manufacturer instructions, site logistics and pertinent matters of coordination, temporary protection, governing regulations, tests and inspections; participants to include RE/COR and all parties whose work is effected or related to the work of this section.

## **PART 2 - PRODUCTS**

### **2.1 FLASHING AND SHEET METAL MATERIALS**

- A. Stainless Steel: ASTM A167, Type 302B, dead soft temper.
- B. Copper ASTM B370, cold-rolled temper.

- C. Bituminous Coated Copper: Minimum copper ASTM B370, weight not less than 1 kg/m<sup>2</sup> (3 oz/sf); bituminous coating weight not less than 2 kg/m<sup>2</sup> (6 oz/sf); or, copper sheets may be bonded between two layers of coarsely woven bitumen-saturated cotton fabric ASTM D173. Provide crimped exposed fabric surface.
- D. Polyethylene Coated Copper: Copper sheet ASTM B370, weighing 1 Kg/m<sup>2</sup> (3 oz/sf) bonded between two layers of (two mil) thick polyethylene sheet.
- E. Aluminum Sheet: ASTM B209, Alloy 3003-H14 except alloy used for color anodized aluminum to be as required to produce specified color. Alloy required to produce specified color must have the same structural properties as Alloy 3003-H14.
- F. Galvanized Sheet: ASTM A653.
- G. Non-reinforced, Elastomeric Sheet: Elastomeric substances reduced to thermoplastic state and extruded into continuous homogenous sheet (0.056 inch) thick.
  - 1. Tensile Strength: Minimum 7 MPa (1,000 psi) tensile strength and not more than seven percent tension-set at 50 percent elongation when tested in accordance with ASTM D412.
  - 2. No cracking or flaking when bent through 180 degrees over a 1 mm (1/32 inch) diameter mandrel and then bent at same point over same size mandrel in opposite direction through 360 degrees at temperature of -30°C (-20 °F).

## 2.2 FLASHING ACCESSORIES

- A. Solder: ASTM B32; flux type and alloy composition as required for use with metals to be soldered.
- B. Rosin Paper: Sheathing paper, weighing minimum 141 g m<sup>2</sup> (3 lbs/100 sf).
- C. Bituminous Paint: ASTM D1187, Type I.
- D. Fasteners:
  - 1. Use copper, copper alloy, bronze, brass, or stainless steel for copper and copper clad stainless steel, and stainless steel for stainless steel and aluminum alloy. Use galvanized steel or stainless steel for galvanized steel.
  - 2. Nails:
    - a. Minimum diameter for copper nails: 3 mm (0.109 inch).
    - b. Minimum diameter for aluminum nails 3 mm (0.105 inch).
    - c. Minimum diameter for stainless steel nails: 2 mm (0.095 inch) and annular threaded.

- d. Length to provide not less than 22 mm (7/8 inch) penetration into anchorage.
- 3. Rivets: Not less than 3 mm (1/8 inch) diameter.
- E. Sealant: As specified in Section 07 92 00, JOINT SEALANTS for exterior locations.
- F. Insect Screening: ASTM D3656, 18 by 18 regular mesh.
- G. Roof Cement: ASTM D4586.

### **2.3 SHEET METAL THICKNESS**

- A. Except as otherwise shown or specified use thickness or weight of sheet metal as follows:
- B. Concealed Locations (Built into Construction):
  - 1. Copper: 30g (10 oz) minimum 0.33 mm (0.013 inch thick).
  - 2. Stainless steel: 0.25 mm (0.010 inch) thick.
  - 3. Copper clad stainless steel: 0.25 mm (0.010 inch) thick.
  - 4. Galvanized steel: 0.5 mm (0.021 inch) thick.
- C. Exposed Locations:
  - 1. Copper: 0.4 Kg (16 oz).
  - 2. Stainless steel: 0.4 mm (0.015 inch).
  - 3. Copper clad stainless steel: 0.4 mm (0.015 inch).
- D. Thickness of aluminum or galvanized steel is specified with each item.

### **2.4 FABRICATION, GENERAL**

- A. Jointing:
  - 1. Lock and solder copper, stainless steel and copper clad stainless steel joints, except expansion and contraction joints.
  - 2. Jointing of copper over 0.5 Kg (20 oz) weight or stainless steel over 0.45 mm (0.018 inch) thick to be done by lapping, riveting and soldering.
  - 3. Provide joints conforming to following requirements:
    - a. Finish flat-lock joints not less than 19 mm (3/4 inch) wide.
    - b. Finish lap joints subject to stress not less than 25 mm (one inch) wide; soldered and riveted.
    - c. Finish unsoldered lap joints not less than 100 mm (4 inches) wide.
  - 4. Make flat and lap joints in direction of flow.
  - 5. Edges of bituminous coated copper, non-reinforced elastomeric sheeting and polyethylene coated copper to be jointed by lapping not less than 100 mm (4 inches) in the direction of flow and cementing

with asphalt roof cement or sealant as required by the manufacturer's printed instructions.

6. Soldering:

- a. Pre tin both mating surfaces with solder for a width not less than 38 mm (1 1/2 inches) of uncoated copper, stainless steel, and copper clad stainless steel.
- b. Wire brush to produce a bright surface before soldering lead coated copper.
- c. Treat in accordance with metal producers recommendations other sheet metal required to be soldered.
- d. Completely remove acid and flux after soldering is completed.

B. Expansion and Contraction Joints:

1. Fabricate in accordance with the Architectural Sheet Metal Manual recommendations for expansion and contraction of sheet metal work in continuous runs.
2. Space joints as shown or as specified.
3. Space expansion and contraction joints for copper, stainless steel, and copper clad stainless steel at intervals not exceeding 7200 mm (24 feet).
4. Space expansion and contraction joints for aluminum at intervals not exceeding 5400 mm (18 feet), except do not exceed 3000 mm (10 feet) for gravel stops and fascia-cant systems.
5. Fabricate slip-type or loose locked joints and fill with sealant unless otherwise specified.
6. Fabricate joint covers of same thickness material as sheet metal served.

C. Cleats:

1. Fabricate cleats to secure flashings and sheet metal work over 300 mm (12 inches) wide and where specified.
2. Provide cleats for maximum spacing of 300 mm (12 inch) centers unless specified otherwise.
3. Form cleats of same metal and weights or thickness as the sheet metal being installed unless specified otherwise.
4. Fabricate cleats from 50 mm (2 inch) wide strip. Form end with not less than 19 mm (3/4 inch) wide loose lock to item for anchorage. Form other end of length to receive nails free of item to be anchored and end edge to be folded over and cover nail heads.

D. Edge Strips or Continuous Cleats:



1. Fabricate continuous edge strips where shown and specified to secure loose edges of the sheet metal work.
2. Except as otherwise specified, fabricate edge strips of minimum 0.6 Kg (24 ounce) copper, 0.6 mm (0.024 inch) thick stainless steel, 1.25 mm (0.050 inch) thick aluminum.
3. Use material compatible with sheet metal to be secured by the edge strip.
4. Fabricate in 3000 mm (10 feet) maximum lengths with not less than 19 mm (3/4 inch) loose lock into metal secured by edge strip.
5. Fabricate Strips for fascia anchorage to extend below the supporting wood construction to form a drip and to allow the flashing to be hooked over the lower edge at least 19 mm (3/4-inch).
6. Fabricate anchor edge maximum width of 75 mm (3 inches) or of sufficient width to provide adequate bearing area to insure a rigid installation using 1 Kg (32 oz.) copper 0.8 mm (0.031 inch) thick stainless steel 1.6 mm (0.0625 inch) thick aluminum.

#### E. Drips:

1. Form drips at lower edge of sheet metal counter-flashings (cap flashings), fascias, gravel stops, wall copings, by folding edge back 13 mm (1/2 inch) and bending out 45 degrees from vertical to carry water away from the wall.
2. Form drip to provide hook to engage cleat or edge strip for fastening for not less than 19 mm (3/4 inch) loose lock where shown.

#### F. Edges:

1. Turn up edges of flashings concealed in masonry joints and opposite drain side 6 mm (1/4 inch) to form dam, unless otherwise specified or shown otherwise.
2. Finish exposed edges of flashing with a 6 mm (1/4 inch) hem formed by folding edge of flashing back on itself when not hooked to edge strip or cleat. Use 6 mm (1/4 inch) minimum penetration beyond wall face with drip for through-wall flashing exposed edge.
3. All metal roof edges must meet requirements of IBC, current edition.

#### G. Metal Options:

1. Where options are permitted for different metals use only one metal throughout.
2. Stainless steel may be used in concealed locations for fasteners of other metals exposed to view.

3. Where copper gravel stops, copings and flashings will carry water onto cast stone, stone, or architectural concrete, or stainless steel.

## 2.5 FINISHES

- A. Use same finish on adjacent metal or components and exposed metal surfaces unless specified or shown otherwise.
- B. In accordance with NAAMM Metal Finishes Manual AMP 500, unless otherwise specified.

## 2.6 THROUGH-WALL FLASHINGS

- A. Form through-wall flashing to provide a mechanical bond or key against lateral movement in all directions. Install a sheet having 2 mm (1/16 inch) deep transverse channels spaced four to every 25 mm (one inch), or ribbed diagonal pattern, or having other deformation unless specified otherwise.
  1. Fabricate in not less than 2400 mm (8 feet) lengths; 3000 mm (10 feet) maximum lengths.
  2. Fabricate so keying nests at overlaps.
- B. For Masonry Work When Concealed Except for Drip:
  1. Use copper, stainless steel, or copper clad stainless steel.
  2. Form an integral dam at least 5 mm (3/16 inch) high at back edge.
  3. Form exposed portions of flashing with drip, approximately 6 mm (1/4 inch) projection beyond wall face.
- C. For Masonry Work When Exposed Edge Forms a Receiver for Counter Flashing:
  1. Use same metal and thickness as counter flashing.
  2. Form an integral dam at least 5 mm (3/16 inch) high at back edge.
  3. Form exposed portion as snap lock receiver for counter flashing upper edge.
- D. For Flashing at Architectural Precast Concrete Panels or Stone Panels.
  1. Use plan flat sheet of stainless steel.
  2. Form exposed portions with drip as specified or receiver.
- E. Window Sill Flashing and Lintel Flashing:
  1. Use copper, stainless steel, copper clad stainless steel plane flat sheet, or non-reinforced elastomeric sheeting, bituminous coated copper, copper covered paper, or polyethylene coated copper.
  2. Fabricate flashing at ends with folded corners to turn up 5 mm (3/16 inch) in first vertical masonry joint beyond masonry opening.
  3. Turn up back edge as shown.

4. Form exposed portion with drip as specified or receiver.

F. Door Sill Flashing:

1. Where concealed, use 0.5 Kg (20 oz) copper, 0.5 mm (0.018 inch) thick stainless steel, or 0.5 mm (0.018 inch) thick copper clad stainless steel.
2. Where shown on drawings as combined counter flashing under threshold, sill plate, door sill, or where subject to foot traffic, use 0.6 Kg (24 ounce) copper, 0.6 mm (0.024 inch) stainless steel, or 0.6 mm (0.024 inch) thick stainless steel.
3. Fabricate flashing at ends to turn up 5 mm (3/16 inch) in first vertical masonry joint beyond masonry opening with folded corners.

## 2.7 COUNTERFLASHING (CAP FLASHING OR HOODS)

- A. Use copper or stainless steel, unless specified otherwise.

- B. Fabricate to lap base flashing a minimum of 100 mm (4 inches) with drip:

1. Form lock seams for outside corners. Allow for lap joints at ends and inside corners.
2. In general, form flashing in lengths not less than 2400 mm (8 feet) and not more than 3000 mm (10 feet).
3. Two-piece, lock in type flashing may be used instead of one piece counter-flashing.
4. Manufactured assemblies may be used.
5. Where counterflashing is installed at new work use an integral flange at the top designed to be extended into the masonry joint or reglet in concrete.
6. Where counterflashing is installed at existing work use surface applied type, formed to provide a space for the application of sealant at the top edge.

- C. One-piece Counterflashing:

1. Back edge turned up and fabricate to lock into reglet in concrete.
2. Upper edge formed to extend full depth of masonry unit in mortar joint with back edge turned up 6 mm (1/4 inch).

- D. Two-Piece Counterflashing:

1. Receiver to extend into masonry wall depth of masonry unit with back edge turned up 6 mm (1/4 inch) and exposed edge designed to receive and lock counterflashing upper edge when inserted.
2. Counterflashing upper edge designed to snap lock into receiver.

- E. Surface Mounted Counterflashing; one or two piece:

1. Use at existing or new surfaces where flashing cannot be inserted in vertical surface.
2. One piece fabricate upper edge folded double for 65 mm (2 1/2 inches) with top 19 mm (3/4 inch) bent out to form "V" joint sealant pocket with vertical surface. Perforate flat double area against vertical surface with horizontally slotted fastener holes at 400 mm (16 inch) centers between end holes. Option: One piece surface mounted counter-flashing (cap flashing) may be used. Fabricate as detailed on Plate 51 of SMACNA Architectural Sheet Metal Manual.
3. Two pieces: Fabricate upper edge to lock into surface mounted receiver. Fabricate receiver joint sealant pocket on upper edge and lower edge to receive counterflashing, with slotted fastener holes at 400 mm (16 inch) centers between upper and lower edge.

## 2.8 HANGING GUTTERS

- A. Fabricate gutters of not less than the following:
  1. 0.5 Kg 20 oz.) copper.
  2. 0.6 mm (0.025 inch) thick stainless steel.
  3. 0.8 mm (0.032 inch) thick aluminum.
- B. Fabricate hanging gutters in sections not less than 2400 mm (8 feet) long, except at ends of runs where shorter lengths are required.
- C. Provide building side of gutter not less than 38 mm (1 1/2 inches) higher than exterior side.
- D. Gutter Bead: Stiffen outer edge of gutter by folding edge over approximately 19 mm (3/4 inch) toward roof and down approximately 19 mm (3/4 inch) unless shown otherwise.
- E. Gutter Spacers:
  1. Fabricate of same material and thickness as gutter.
  2. Fabricate 25 mm (one inch) wide strap and fasten to gutters not over 900 mm (36 inches) on center.
  3. Turn back edge up 25 mm (one inch) and lap front edge over gutter bead.
  4. Rivet and solder to gutter except rivet and seal to aluminum.
- F. Outlet Tubes:
  1. Form outlet tubes to connect gutters to conductors of same metal and thickness as gutters extend into the conductor 75 mm (3 inch). Flange upper end of outlet tube 13 mm (1/2 inch).
  2. Lock and solder longitudinal seam except use sealant instead of solder with aluminum.

3. Solder tube to gutter. Seal aluminum tube to gutter and rivet to gutter.

4. Fabricate basket strainers of same material as gutters.

**G. Gutter Brackets:**

1. Fabricate of same metal as gutter. Use the following:

a. 6 by 25 mm (1/4 by 1 inch) copper.

b. 3 by 40 mm (1/8 by 1 1/2 inch) stainless steel.

c. 6 by 25 mm (1/4 by 1 inch) aluminum.

2. Fabricate to gutter profile.

3. Drill two 5 mm (3/16 inch) diameter holes in anchor leg for countersunk flat head screws.

**2.9 CONDUCTORS (DOWNSPOUTS)**

A. Fabricate conductors of same metal and thickness as gutters in sections approximately 3000 mm (10 feet) long with 19 mm (3/4 inch) wide flat locked seams.

1. Fabricate open face channel shape with hemmed longitudinal edges.

B. Fabricate elbows by mitering, riveting, and soldering except seal aluminum instead of solder. Lap upper section to the inside, of the lower piece.

C. Fabricate conductor brackets or hangers of same material as conductor, 2 mm (1/16 inch) thick by 25 mm (1 inch) minimum width. Form to support conductors 25 mm (one inch) from wall surface in accordance with Architectural Sheet Metal Manual Plate 34, Design C for rectangular shapes and E for round shapes.

**2.10 REGLETS**

A. Fabricate reglets of one of the following materials:

1. 0.4 Kg (16 ounce) copper.

2. Stainless steel, not less than 0.3 mm (0.012 inch) thick.

3. Plastic coated extruded aluminum, not less than 1.4 mm (0.055 inch) thick prefilled with butyl rubber sealer and complete with plastic wedges inserted at 1000 mm (40 inches) on centers.

B. Fill open-type reglets with fiberboard or other suitable separator, to prevent crushing of the slot during installation.

C. Bend edges of reglets for setting into concrete to an angle of not less than 45 degrees, and make wide enough to provide firm anchorage in the concrete.

- D. Fabricate reglets for building into horizontal masonry mortar joints not less than 19 mm (3/4 inch) deep, nor more than 25 mm (one inch) deep.
- E. Fabricate mitered corners, fittings, and special shapes as may be required by details.
- F. Reglets for concrete may be formed to receive flashing and have a 10 mm (3/8 inch), 45 degree snap lock.

### **PART 3 - EXECUTION**

#### **3.1 INSTALLATION**

##### **A. General:**

1. Install flashing and sheet metal items as shown in Sheet Metal and Air Conditioning Contractors National Association, Inc., publication, ARCHITECTURAL SHEET METAL MANUAL, except as otherwise shown or specified.
2. Anchor sheet metal flashing and trim and other components of the work securely in place with provisions for thermal and structural movement. Use fasteners, solder, welding rods, protective coatings, separators, sealants and other miscellaneous items as required, to complete flashing and trim assemblies.
3. Apply Sealant as specified in Section 07 92 00, JOINT SEALANTS.
4. Apply sheet metal and other flashing material to surfaces which are smooth, sound, clean, dry and free from defects that might affect the application.
5. Remove projections which would puncture the materials and fill holes and depressions with material compatible with the substrate. Cover holes or cracks in wood wider than 6 mm (1/4 inch) with sheet metal compatible with the roofing and flashing material used.
6. Coordinate with masonry work for the application of a skim coat of mortar to surfaces of unit masonry to receive flashing material before the application of flashing.
7. Apply a layer of 7 Kg (15 pound) saturated felt followed by a layer of rosin paper to wood surfaces to be covered with copper. Lap each ply 50 mm (2 inch) with the slope and nail with large headed copper nails.
8. Confine direct nailing of sheet metal to strips 300 mm (12 inch) or less wide. Nail flashing along one edge only. Space nails not over 100 mm (4 inches) on center unless specified otherwise.

9. Install bolts, rivets, and screws where indicated, specified, or required in accordance with the SMACNA Sheet Metal Manual. Space rivets at 75 mm (3 inch) on centers in two rows in a staggered position. Use neoprene washers under fastener heads when fastener head is exposed.
10. Coordinate with roofing work for the installation of metal base flashings and other metal items having roof flanges for anchorage and watertight installation.
11. Nail continuous cleats on 75 mm (3 inch) on centers in two rows in a staggered position.
12. Nail individual cleats with two nails and bend end tab over nail heads. Lock other end of cleat into hemmed edge.
13. Install flashings in conjunction with other trades so that flashings are inserted in other materials and joined together to provide a water tight installation.
14. Where required to prevent galvanic action between dissimilar metal isolate the contact areas of dissimilar metal with sheet lead, waterproof building paper, or a coat of bituminous paint.
15. Isolate aluminum in contact with dissimilar metals others than stainless steel, white bronze or other metal compatible with aluminum by:
  - a. Paint dissimilar metal with a prime coat of zinc-chromate or other suitable primer, followed by two coats of aluminum paint.
  - b. Paint dissimilar metal with a coat of bituminous paint.
  - c. Apply an approved caulking material between aluminum and dissimilar metal.
16. Paint aluminum in contact with or built into mortar, concrete, plaster, or other masonry materials with a coat of bituminous paint.
17. Paint aluminum in contact with absorptive materials that may become repeatedly wet with two coats of bituminous paint or two coats of aluminum paint.

### **3.2 THROUGH-WALL FLASHING**

#### **A. General:**

1. Install continuous through-wall flashing between top of concrete foundation walls and bottom of masonry building walls; at top of concrete floors; under masonry, concrete, or stone copings and elsewhere as shown.

2. Where exposed portions are used as a counter flashings, lap base flashings at least 100 mm (4 inches) and use thickness of metal as specified for exposed locations.
3. Exposed edge of flashing may be formed as a receiver for two piece counter flashing as specified.
4. Terminate exterior edge beyond face of wall approximately 6 mm (1/4 inch) with drip edge where not part of counter flashing.
5. Turn back edge up 6 mm (1/4 inch) unless noted otherwise where flashing terminates in mortar joint or hollow masonry unit joint.
6. Terminate interior raised edge in masonry backup unit approximately 38 mm (1 1/2 inch) into unit unless shown otherwise.
7. Under copings terminate both edges beyond face of wall approximately 6 mm (1/4 inch) with drip edge.
8. Lap end joints at least two corrugations, but not less than 100 mm (4 inches). Seal laps with sealant.
9. Where dowels, reinforcing bars and fastening devices penetrate flashing, seal penetration with sealing compound. Sealing compound is specified in Section 07 92 00, JOINT SEALANTS.
10. Coordinate with other work to set in a bed of mortar above and below flashing so that total thickness of the two layers of mortar and flashing are same as regular mortar joint.
11. Where ends of flashing terminate turn ends up 25 mm (1 inch) and fold corners to form dam extending to wall face in vertical mortar or veneer joint.
12. Turn flashing up not less than 200 mm (8 inch) between masonry or behind exterior veneer.
13. When flashing terminates in reglet extend flashing full depth into reglet and secure with lead or plastic wedges spaced 150 mm (6 inch) on center.
14. Continue flashing around columns:
  - a. Where flashing cannot be inserted in column reglet hold flashing vertical leg against column.
  - b. Counterflash top edge with 75 mm (3 inch) wide strip of saturated cotton unless shown otherwise. Secure cotton strip with roof cement to column. Lap base flashing with cotton strip 38 mm (1-1/2 inch).



- B. Flashing at Top of Concrete Foundation Walls Where Concrete is Exposed:  
Turn up not less than 200 mm (8 inch) high and into masonry backup mortar joint or reglet in concrete backup as specified.
- C. Flashing at Top of Concrete Floors (except where shelf angles occur):  
Place flashing in horizontal masonry joint not less than 200 mm (8 inch) below floor slab and extend into backup masonry joint at floor slab 38 mm (1 1/2 inch).
- D. Flashing at Cavity Wall Construction: Where flashing occurs in cavity walls turn vertical portion up against backup under waterproofing, if any, into mortar joint. Turn up over insulation, if any, and horizontally through insulation into mortar joint.
- E. Flashing at Veneer Walls:
1. Install near line of finish floors over shelf angles or where shown.
  2. Turn up against sheathing.
  3. At stud framing, hem top edge 19 mm (3/4 inch) and secure to each stud with stainless steel fasteners through sheathing.
  4. At concrete backing, extend flashing into reglet as specified.
  5. Coordinate with installation of waterproofing or asphalt felt for lap over top of flashing.
- F. Lintel flashing when not part of shelf angle flashing:
1. Install flashing full length of lintel to nearest vertical joint in masonry over veneer.
  2. Turn ends up 25 mm (one inch) and fold corners to form dam and extend end to face of wall.
  3. Turn back edge up to top of lintel; terminate back edge as specified for back-up wall.
- G. Window Sill Flashing:
1. Install flashing to extend not less than 100 mm (4 inch) beyond ends of sill into vertical joint of masonry or veneer.
  2. Turn back edge up to terminate under window frame.
  3. Turn ends up 25 mm (one inch) and fold corners to form dam and extend to face of wall.
- H. Door Sill Flashing:
1. Install flashing under bottom of plate sills of doors over curbs opening onto roofs. Extend flashing out to form counter flashing or receiver for counter flashing over base flashing. Set in sealant.

2. Extend sill flashing 200 mm (8 inch) beyond jamb opening. Turn ends up one inch in vertical masonry joint, extend end to face of wall. Join to counter flashing for water tight joint.
3. Where doors thresholds cover over waterproof membranes install sill flashing over water proof membrane under thresholds. Extend beyond opening to cover exposed portion of waterproof membrane and not less than 150 mm (6 inch) beyond door jamb opening at ends. Turn up approximately 6 mm (1/4 inch) under threshold.

I. Flashing at Masonry, Stone, or Precast Concrete Copings:

1. Install flashing with drips on both wall faces unless shown otherwise.
2. Form penetration openings to fit tight against dowel or other item with edge turned up. Seal penetrations with sealant.

### **3.3 BASE FLASHING**

- A. Install where roof membrane type base flashing is not used and where shown.
  1. Install flashing at intersections of roofs with vertical surfaces or at penetrations through roofs, to provide watertight construction.
  2. Install metal flashings and accessories having flanges extending out on top of the built-up roofing before final bituminous coat and roof aggregate is applied.
  3. Set flanges in heavy trowel coat of roof cement and nail through flanges into wood nailers over bituminous roofing.
  4. Secure flange by nailing through roofing into wood blocking with nails spaced 75 mm (3 inch) on centers or, when flange over 100 mm (4 inch) wide terminate in a 13 mm (1/2 inch) folded edge anchored with cleats spaced 200 mm (8 inch) on center. Secure one end of cleat over nail heads. Lock other end into the seam.
- B. For long runs of base flashings install in lengths of not less than 2400 mm (8 feet) nor more than 3000 mm (ten feet). Install a 75 mm (3 inch) wide slip type, loose lock expansion joint filled with sealant in joints of base flashing sections over 2400 mm (8 feet) in length. Lock and solder corner joints at corners.
- C. Extend base flashing up under counter flashing of roof specialties and accessories or equipment not less than 75 mm (3 inch).

### **3.4 COUNTERFLASHING (CAP FLASHING OR HOODS)**

- A. General:

1. Install counterflashing over and in conjunction with installation of base flashings, except as otherwise specified or shown.
2. Install counterflashing to lap base flashings not less than 100 mm (4 inch).
3. Install upper edge or top of counterflashing not less than 225 mm (9 inch) above top of the roofing.
4. Lap joints not less than 100 mm (4 inch). Stagger joints with relation to metal base flashing joints.
5. Use surface applied counterflashing on existing surfaces and new work where not possible to integrate into item.
6. When fastening to concrete or masonry, use screws driven in expansion shields set in concrete or masonry. Use screws to wood and sheet metal. Set fasteners in mortar joints of masonry work.

B. One Piece Counterflashing:

1. Where flashing is installed at new masonry, coordinate to insure proper height, embed in mortar, and end lap.
2. Where flashing is installed in reglet in concrete insert upper edge into reglet. Hold flashing in place with lead wedges spaced not more than 200 mm (8 inch) apart. Fill joint with sealant.
3. Where flashing is surface mounted on flat surfaces.
  - a. When top edge is double folded anchor flat portion below sealant "V" joint with fasteners spaced not over 400 mm (16 inch) on center:
    - 1) Locate fasteners in masonry mortar joints.
    - 2) Use screws to sheet metal or wood.
  - b. Fill joint at top with sealant.
4. Where flashing or hood is mounted on pipe.
  - a. Secure with draw band tight against pipe.
  - b. Set hood and secure to pipe with a one by 25 mm x 3 mm (1 x 1/8 inch) bolt on stainless steel draw band type clamp, or a stainless worm gear type clamp.
  - c. Completely fill joint at top with sealant.

C. Two-Piece Counterflashing:

1. Where receiver is installed at new masonry coordinate to insure proper height, embed in mortar, and lap.
2. Surface applied type receiver:
  - a. Secure to face construction in accordance, with manufacturer's instructions.

- b. Completely fill space at the top edge of receiver with sealant.
- 3. Insert counter flashing in receiver in accordance with fabricator or manufacturer's instructions and to fit tight against base flashing.
- D. Where vented edge occur install so lower edge of counterflashing is against base flashing.
- E. When counter flashing is a component of other flashing install as shown.

### **3.5 REGLETS**

- A. Install reglets in a manner to provide a watertight installation.
- B. Locate reglets not less than 225 mm (9 inch) nor more than 400 mm (16 inch) above roofing, and not less than 125 mm (5 inch) nor more than 325 mm (13 inch) above cant strip.
- C. Butt and align end joints on each section of reglet and securely hold in position until concrete or mortar are hardened:
  - 1. Coordinate reglets for anchorage into concrete with formwork construction.
  - 2. Coordinate reglets for masonry to locate horizontally into mortar joints.

### **3.6 HANGING GUTTERS**

- A. Hang gutters with high points equidistant from downspouts. Slope at not less than 1:200 (1/16 inch per foot).
- B. Lap joints, except for expansion joints, at least 25 mm (one inch) in the direction of flow. Rivet and seal or solder lapped joints.
- C. Support gutters in brackets spaced not more than 600 mm (24 inch) on centers, brackets attached to facial or wood nailer by at least two screws or nails.
  - 1. For copper or copper clad stainless steel gutters use brass or bronze brackets.
  - 2. For stainless steel gutters use stainless steel brackets.
  - 3. For aluminum gutters use aluminum brackets or stainless steel brackets.
  - 4. Use brass or stainless steel screws.
- D. Secure brackets to gutters in such a manner as to allow free movement of gutter due to expansion and contraction.
- E. Gutter Expansion Joint:
  - 1. Locate expansion joints midway between outlet tubes.
  - 2. Provide at least a 25 mm (one inch) expansion joint space between end baffles of gutters.

3. Install a cover plate over the space at expansion joint.
  4. Fasten cover plates to gutter section on one side of expansion joint only.
  5. Secure loose end of cover plate to gutter section on other side of expansion joint by a loose-locked slip joint.
- F. Outlet Tubes: Set bracket strainers loosely into gutter outlet tubes.

- - - E N D - - -

**SECTION 07 92 00  
JOINT SEALANTS**

**PART 1 - GENERAL**

**1.1 DESCRIPTION:**

- A. This section covers interior and exterior sealant and their application, wherever required for complete installation of building materials or systems.

**1.2 RELATED WORK (INCLUDING BUT NOT LIMITED TO THE FOLLOWING):**

- A. Sealing of Site Work Concrete Paving: Section 32 05 23, CEMENT AND CONCRETE FOR EXTERIOR IMPROVEMENTS.
- B. Masonry Control and Expansion Joint: Section 04 20 00, UNIT MASONRY.
- C. Glazing: Section 08 80 00, GLAZING.

**1.3 QUALITY ASSURANCE:**

- A. Installer Qualifications: An experienced installer with a minimum of three (3) years' experience and who has specialized in installing joint sealants similar in material, design, and extent to those indicated for this Project and whose work has resulted in joint-sealant installations with a record of successful in-service performance. Submit qualification.
- B. Source Limitations: Not Used.
- C. Product Testing: Not Used.
- D. Lab Tests: Not Used.

**1.4 CERTIFICATION:**

- A. Contractor is to submit to the COR written certification that joints are of the proper size and design, that the materials supplied are compatible with adjacent materials and backing, that the materials will properly perform to provide permanent watertight, airtight or vapor tight seals (as applicable), and that materials supplied meet specified performance requirements.

**1.5 SUBMITTALS:**

- A. Submit in accordance with Section 01 33 23, SHOP DRAWINGS, PRODUCT DATA, AND SAMPLES.
- C. Installer qualifications.
- D. Contractor certification.
- E. Manufacturer's installation instructions for each product used.
- F. Cured samples of exposed sealants for each color.
- G. Manufacturer's Literature and Data:
  - 1. Primers

2. Sealing compound, each type, including compatibility when different sealants are in contact with each other.

H. Manufacturer warranty.

#### **1.6 PROJECT CONDITIONS:**

A. Environmental Limitations:

1. Do not proceed with installation of joint sealants under following conditions:

- a. When ambient and substrate temperature conditions are outside limits permitted by joint sealant manufacturer or are below 4.4 degrees C (40 degrees F).
- b. When joint substrates are wet.

B. Joint-Width Conditions:

1. Do not proceed with installation of joint sealants where joint widths are less than those allowed by joint sealant manufacturer for applications indicated.

C. Joint-Substrate Conditions:

1. Do not proceed with installation of joint sealants until contaminants capable of interfering with adhesion are removed from joint substrates.

#### **1.7 DELIVERY, HANDLING, AND STORAGE:**

- A. Deliver materials in manufacturers' original unopened containers, with brand names, date of manufacture, shelf life, and material designation clearly marked thereon.
- B. Carefully handle and store to prevent inclusion of foreign materials.
- C. Do not subject to sustained temperatures exceeding 32 degrees C (90 degrees F) or less than 5 degrees C (40 degrees F).

#### **1.8 DEFINITIONS:**

- A. Definitions of terms in accordance with ASTM C717 and as specified.
- B. Backing Rod: A type of sealant backing.
- C. Bond Breakers: A type of sealant backing.
- D. Filler: A sealant backing used behind a back-up rod.

#### **1.9 WARRANTY:**

- A. Construction Warranty: Comply with FAR clause 52.246-21 "Warranty of Construction".
- B. Manufacturer Warranty: Manufacturer shall warranty their sealant for a minimum of five (5) years from the date of installation and final acceptance by the Government. Submit manufacturer warranty.

**1.10 APPLICABLE PUBLICATIONS:**

A. Publications listed below form a part of this specification to extent referenced. Publications are referenced in text by basic designation only.

B. ASTM International (ASTM):

C509-06.....Elastomeric Cellular Preformed Gasket and  
Sealing Material

C612-14.....Mineral Fiber Block and Board Thermal  
Insulation

C717-14a.....Standard Terminology of Building Seals and  
Sealants

C734-06(R2012).....Test Method for Low-Temperature Flexibility of  
Latex Sealants after Artificial Weathering

C794-10.....Test Method for Adhesion-in-Peel of Elastomeric  
Joint Sealants

C919-12.....Use of Sealants in Acoustical Applications.

C920-14a.....Elastomeric Joint Sealants.

C1021-08(R2014).....Laboratories Engaged in Testing of Building  
Sealants

C1193-13.....Standard Guide for Use of Joint Sealants.

C1248-08(R2012).....Test Method for Staining of Porous Substrate by  
Joint Sealants

C1330-02(R2013).....Cylindrical Sealant Backing for Use with Cold  
Liquid Applied Sealants

C1521-13.....Standard Practice for Evaluating Adhesion of  
Installed Weatherproofing Sealant Joints

D217-10.....Test Methods for Cone Penetration of  
Lubricating Grease

D412-06a(R2013).....Test Methods for Vulcanized Rubber and  
Thermoplastic Elastomers-Tension

D1056-14.....Specification for Flexible Cellular Materials—  
Sponge or Expanded Rubber

E84-09.....Surface Burning Characteristics of Building  
Materials

C. Sealant, Waterproofing and Restoration Institute (SWRI).  
The Professionals' Guide

D. Environmental Protection Agency (EPA):



40 CFR 59(2014).....National Volatile Organic Compound Emission  
Standards for Consumer and Commercial Products

**PART 2 - PRODUCTS**

**2.1 SEALANTS:**

A. Exterior Sealants:

1. Vertical surfaces, provide non-staining ASTM C920, Type S or M, Grade NS, Class.
2. Horizontal surfaces, provide ASTM C920, Type S or M, Grade P, Class 25, Use T.
3. Provide location(s) of exterior sealant as follows:
  - a. Joints formed where frames and subsills of windows, doors, louvers, and vents adjoin masonry, concrete, or metal frames. Provide sealant at exterior surfaces of exterior wall penetrations.
  - b. Metal to metal.
  - c. Masonry to masonry or stone.
  - d. Stone to stone.
  - e. Cast stone to cast stone.
  - f. Masonry expansion and control joints.
  - g. Wood to masonry.
  - h. Masonry joints where shelf angles occur.
  - i. Voids where items penetrate exterior walls.
  - j. Metal reglets, where flashing is inserted into masonry joints, and where flashing is penetrated by coping dowels.

B. Floor Joint Sealant:

1. ASTM C920, Type S or M, Grade P, Class 25, // ,// Use T. //S-#//
2. //S-#// Provide location(s) of floor joint sealant as follows.
  - a. Seats of metal thresholds exterior doors.
  - b. Control and expansion joints in floors, slabs, ceramic tile, and walkways.

C. Interior Sealants: Not Used.

D. Acoustical Sealant: Not Used.

**2.2 COLOR:**

- A. Sealants used with exposed masonry are to match color of mortar joints.
- B. Sealants used with unpainted concrete are to match color of adjacent concrete.

- C. Color of sealants for other locations to be light gray or aluminum, unless otherwise indicated in construction documents.

### **2.3 JOINT SEALANT BACKING:**

- A. General: Provide sealant backings of material and type that are nonstaining; are compatible with joint substrates, sealants, primers, and other joint fillers; and are approved for applications indicated by sealant manufacturer based on field experience and laboratory testing.
- B. Cylindrical Sealant Backings: ASTM C1330, of type indicated below and of size and density to control sealant depth and otherwise contribute to producing optimum sealant performance:
  - 1. Type C: Closed-cell material with a surface skin.
- C. Elastomeric Tubing Sealant Backings: Neoprene, butyl, EPDM, or silicone tubing complying with ASTM D1056 or synthetic rubber (ASTM C509), nonabsorbent to water and gas, and capable of remaining resilient at temperatures down to minus 32 degrees C (minus 26 degrees F). Provide products with low compression set and of size and shape to provide a secondary seal, to control sealant depth, and otherwise contribute to optimum sealant performance.
- D. Bond-Breaker Tape: Polyethylene tape or other plastic tape recommended by sealant manufacturer for preventing sealant from adhering to rigid, inflexible joint-filler materials or joint surfaces at back of joint where such adhesion would result in sealant failure. Provide self-adhesive tape where applicable.

### **2.4 WEEPS: NOT USED**

### **2.5 FILLER:**

- A. Mineral fiberboard: ASTM C612, Class 1.
- B. Thickness same as joint width.
- C. Depth to fill void completely behind back-up rod.

### **2.6 PRIMER:**

- A. As recommended by manufacturer of caulking or sealant material.
- B. Stain free type.

### **2.7 CLEANERS-NON POROUS SURFACES:**

- A. Chemical cleaners compatible with sealant and acceptable to manufacturer of sealants and sealant backing material. Cleaners to be free of oily residues and other substances capable of staining or harming joint substrates and adjacent non-porous surfaces and formulated to promote adhesion of sealant and substrates.

**PART 3 - EXECUTION****3.1 INSPECTION:**

- A. Inspect substrate surface for bond breaker contamination and unsound materials at adherent faces of sealant.
- B. Coordinate for repair and resolution of unsound substrate materials.
- C. Inspect for uniform joint widths and that dimensions are within tolerance established by sealant manufacturer.

**3.2 PREPARATIONS:**

- A. Prepare joints in accordance with manufacturer's instructions and SWRI (The Professionals' Guide).
- B. Clean surfaces of joint to receive caulking or sealants leaving joint dry to the touch, free from frost, moisture, grease, oil, wax, lacquer paint, or other foreign matter that would tend to destroy or impair adhesion.
  - 1. Clean porous joint substrate surfaces by brushing, grinding, blast cleaning, mechanical abrading, or a combination of these methods to produce a clean, sound substrate capable of developing optimum bond with joint sealants.
  - 2. Remove loose particles remaining from above cleaning operations by vacuuming or blowing out joints with oil-free compressed air. Porous joint surfaces include but are not limited to the following:
    - a. Concrete.
    - b. Masonry.
    - c. Unglazed surfaces of ceramic tile.
  - 3. Remove laitance and form-release agents from concrete.
  - 4. Clean nonporous surfaces with chemical cleaners or other means that do not stain, harm substrates, or leave residues capable of interfering with adhesion of joint sealants. Nonporous surfaces include but are not limited to the following:
    - a. Metal.
    - b. Glass.
    - c. Porcelain enamel.
    - d. Glazed surfaces of ceramic tile.
- C. Do not cut or damage joint edges.
- D. Apply non-staining masking tape to face of surfaces adjacent to joints before applying primers, caulking, or sealing compounds.
  - 1. Do not leave gaps between ends of sealant backings.
  - 2. Do not stretch, twist, puncture, or tear sealant backings.

3. Remove absorbent sealant backings that have become wet before sealant application and replace them with dry materials.
- E. Apply primer to sides of joints wherever required by compound manufacturer's printed instructions or as indicated by pre-construction joint sealant substrate test.
  1. Apply primer prior to installation of back-up rod or bond breaker tape.
  2. Use brush or other approved means that will reach all parts of joints. Avoid application to or spillage onto adjacent substrate surfaces.

### **3.3 BACKING INSTALLATION:**

- A. Install backing material, to form joints enclosed on three sides as required for specified depth of sealant.
- B. Where deep joints occur, install filler to fill space behind the backing rod and position the rod at proper depth.
- C. Cut fillers installed by others to proper depth for installation of backing rod and sealants.
- D. Install backing rod, without puncturing the material, to a uniform depth, within plus or minus 3 mm (1/8 inch) for sealant depths specified.
- E. Where space for backing rod does not exist, install bond breaker tape strip at bottom (or back) of joint so sealant bonds only to two opposing surfaces.

### **3.4 SEALANT DEPTHS AND GEOMETRY:**

- A. At widths up to 6 mm (1/4 inch), sealant depth equal to width.
- B. At widths over 6 mm (1/4 inch), sealant depth 1/2 of width up to 13 mm (1/2 inch) maximum depth at center of joint with sealant thickness at center of joint approximately 1/2 of depth at adhesion surface.

### **3.5 INSTALLATION:**

- A. General:
  1. Apply sealants and caulking only when ambient temperature is between 5 degrees C and 38 degrees C (40 degrees and 100 degrees F).
  2. Do not install polysulfide base sealants where sealant may be exposed to fumes from bituminous materials, or where water vapor in continuous contact with cementitious materials may be present.
  3. Do not install sealant type listed by manufacture as not suitable for use in locations specified.

4. Apply caulking and sealing compound in accordance with manufacturer's printed instructions.
  5. Avoid dropping or smearing compound on adjacent surfaces.
  6. Fill joints solidly with compound and finish compound smooth.
  7. Tool exposed joints to form smooth and uniform beds, with slightly concave surface conforming to joint configuration per Figure 5A in ASTM C1193 unless shown or specified otherwise in construction documents. Remove masking tape immediately after tooling of sealant and before sealant face starts to "skin" over. Remove any excess sealant from adjacent surfaces of joint, leaving the working in a clean finished condition.
  8. Finish paving or floor joints flush unless joint is otherwise detailed.
  9. Apply compounds with nozzle size to fit joint width.
  10. Test sealants for compatibility with each other and substrate. Use only compatible sealant. Submit test reports.
  11. Replace sealant which is damaged during construction process.
- B. Weeps: Not Used.
- C. For application of sealants, follow requirements of ASTM C1193 unless specified otherwise. Take all necessary steps to prevent three-sided adhesion of sealants.
- D. Interior Sealants: Not Used.

### **3.6 FIELD QUALITY CONTROL:**

- A. Field-Adhesion Testing: Field-test joint-sealant adhesion to joint substrates according to Method A, Field-Applied Sealant Joint Hand Pull Tab, in Appendix X1 in ASTM C1193 or Method A, Tail Procedure, in ASTM C1521.
1. Extent of Testing: Test completed elastomeric sealant joints as follows:
    - a. Perform 2 tests for first 51 m (200 feet) of joint length for each type of elastomeric sealant and joint substrate.
    - b. Perform one test for each 153 m (500 feet) of joint length thereafter or one test per each floor per elevation.
- B. Inspect joints for complete fill, for absence of voids, and for joint configuration complying with specified requirements. Record results in a field adhesion test log.

- C. Inspect tested joints and report on following:
  - 1. Whether sealants in joints connected to pulled-out portion failed to adhere to joint substrates or tore cohesively. Include data on pull distance used to test each type of product and joint substrate.
  - 2. Compare these results to determine if adhesion passes sealant manufacturer's field-adhesion hand-pull test criteria.
  - 3. Whether sealants filled joint cavities and are free from voids.
  - 4. Whether sealant dimensions and configurations comply with specified requirements.
- D. Record test results in a field adhesion test log. Include dates when sealants were installed, names of persons who installed sealants, test dates, test locations, whether joints were primed, adhesion results and percent elongations, sealant fill, sealant configuration, and sealant dimensions.
- E. Repair sealants pulled from test area by applying new sealants following same procedures used to originally seal joints. Ensure that original sealant surfaces are clean and new sealant contacts original sealant.
- F. Evaluation of Field-Test Results: Sealants not evidencing adhesive failure from testing or noncompliance with other indicated requirements, will be considered satisfactory. Remove sealants that fail to adhere to joint substrates during testing or to comply with other requirements. Retest failed applications until test results prove sealants comply with indicated requirements.

### 3.7 CLEANING:

- A. Fresh compound accidentally smeared on adjoining surfaces: Scrape off immediately and rub clean with a solvent as recommended by manufacturer of the adjacent material or if not otherwise indicated by the caulking or sealant manufacturer.
- B. Leave adjacent surfaces in a clean and unstained condition.

- - - E N D - - -

SECTION 09 91 00  
PAINTING

PART 1-GENERAL

1.1 DESCRIPTION

- A. Section specifies field and shop painting.
- B. Section specifies prime coats which may be applied in shop under other sections.
- C. Painting includes shellacs, stains, varnishes, and coatings specified.

1.2 RELATED WORK

- A. NA

1.3 SUSTAINABILITY REQUIREMENTS

- A. Materials in this section may contribute towards contract compliance with sustainability requirements.
- B. Biobased Material: For products designated by the USDA's BioPreferred® program, provide products that meet or exceed USDA recommendations for biobased content, subject to the products compliance with performance requirements in this Section. For more information regarding the product categories covered by the BioPreferred® program, visit <http://www.biopreferred.gov>.

1.4 REGULATORY REQUIREMENTS FOR RECYCLED CONTENT

- A. Products and Materials with Post-Consumer Content and Recovered Materials Content:
  - 1. Contractor is obligated by contract to satisfy Federal mandates for procurement of products and materials meeting recommendations for post-consumer content and recovered materials content; the list of designated product categories with recommendations has been compiled by the EPA - refer to <http://www.epa.gov/wastes/conservation/tools/cpg/products/>.
  - 2. Materials or products specified by this section may be obligated to satisfy this Federal mandate and Comprehensive Procurement Guidelines program.
  - 3. The EPA website also provides tools such as a Product Supplier Directory search engine and product resource guides.

1.5 SUBMITTALS

- A. Submit in accordance with Section 01 33 23, SHOP DRAWINGS, PRODUCT DATA, AND SAMPLES.
- B. Manufacturer's Literature and Data:
  - 1. Before work is started, or sample panels are prepared, submit manufacturer's literature, the current Master Painters Institute (MPI) "Approved Product List" indicating brand label, product name and product code as of the date of contract award, will be used to determine compliance with the submittal requirements of this specification. The Contractor may choose to use subsequent MPI "Approved Product List", however, only one list may be used for the entire contract and each coating system is to be from a single manufacturer. All coats on a particular substrate must be from a single manufacturer. No variation from the MPI "Approved Product List" where applicable is acceptable.

## C. Samples:

1. After painters' materials have been approved and before work is started submit samples showing each type of finish and color specified.
2. Samples to show color: Composition board, 150 by 150 (6 inch by 6 inch).
3. Panel to show transparent finishes: Wood of same species and grain pattern as wood approved for use, 100 by 250 by 3 mm (4 inch by 10 inch face by 1/4 inch) thick minimum, and where both flat and edge grain will be exposed, 250 mm (10 inches) long by sufficient size, 50 by 50 mm (2 by 2 inch) minimum or actual wood member to show complete finish.

## D. Manufacturers' Certificates indicating compliance with specified requirements:

1. Manufacturer's paint substituted for Federal Specification paints meets or exceeds performance of paint specified.
2. High temperature aluminum paint.
3. Epoxy coating.
4. Intumescent clear coating or fire retardant paint.
5. Plastic floor coating.

## 1.6 DELIVERY AND STORAGE

## A. Deliver materials to site in manufacturer's sealed container marked to show following:

1. Name of manufacturer.
2. Product type.
3. Batch number.
4. Instructions for use.
5. Safety precautions.

## B. In addition to manufacturer's label, provide a label legibly printed as following:

1. Federal Specification Number, where applicable, and name of material.
2. Surface upon which material is to be applied.
3. If paint or other coating, state coat types; prime, body or finish.

## C. Maintain space for storage, and handling of painting materials and equipment in a neat and orderly condition to prevent spontaneous combustion from occurring or igniting adjacent items.

## D. Store materials at site at least 24 hours before using, at a temperature between 18 and 30 degrees C (65 and 85 degrees F).

## 1.7 APPLICABLE PUBLICATIONS

## A. Publications listed below form a part of this specification to extent referenced. Publications are referenced in text by the basic designation only. Comply with applicable provisions and recommendations of the following, except as otherwise shown or specified.

## B. American Conference of Governmental Industrial Hygienists (ACGIH):

ACGIH TLV-BKLT-2009                      Threshold Limit Values (TLV) for Chemical Substances and Physical Agents and Biological Exposure Indices (BEIs)



ACGIH TLV-DOC-2009

Documentation of Threshold Limit Values and  
Biological Exposure Indices, (Seventh Edition)

## C. Master Painters Institute (MPI):

No. 4-13	Interior/ Exterior Latex Block Filler
No. 5-13	Exterior Alkyd Wood Primer
No. 7-13	Exterior Oil Wood Primer
No. 8-13	Exterior Alkyd, Flat MPI Gloss Level 1 (EO)
No. 9-13	Exterior Alkyd Enamel MPI Gloss Level 6 (EO)
No. 10-13	Exterior Latex, Flat (AE)
No. 11-13	Exterior Latex, Semi-Gloss (AE)
No. 31-13	Polyurethane, Moisture Cured, Clear Gloss (PV)
No. 36-13	Knot Sealer
No. 43-13	Interior Satin Latex, MPI Gloss Level 4
No. 44-13	Interior Low Sheen Latex, MPI Gloss Level 2
No. 45-13	Interior Primer Sealer
No. 46-13	Interior Enamel Undercoat
No. 47-13	Interior Alkyd, Semi-Gloss, MPI Gloss Level 5 (AK)
No. 48-13	Interior Alkyd, Gloss, MPI Gloss Level 6 (AK)
No. 50-13	Interior Latex Primer Sealer
No. 51-13	Interior Alkyd, Eggshell, MPI Gloss Level 3
No. 52-13	Interior Latex, MPI Gloss Level 3 (LE)
No. 53-13	Interior Latex, Flat, MPI Gloss Level 1 (LE)
No. 54-13	Interior Latex, Semi-Gloss, MPI Gloss Level 5 (LE)
No. 60-13	Interior/Exterior Latex Porch & Floor Paint, Low Gloss
No. 68-13	Interior/ Exterior Latex Porch & Floor Paint, Gloss
No. 71-13	Polyurethane, Moisture Cured, Clear, Flat (PV)
No. 90-13	Interior Wood Stain, Semi-Transparent (WS)
No. 94-13	Exterior Alkyd, Semi-Gloss (EO)
No. 95-13	Fast Drying Metal Primer
No. 114-13	Interior Latex, Gloss (LE) and (LG)
No. 119-13	Exterior Latex, High Gloss (acrylic) (AE)
No. 134-13	Primer, Galvanized, Water Based
No. 138-13	Interior High Performance Latex, MPI Gloss Level 2 (LF)
No. 139-13	Interior High Performance Latex, MPI Gloss Level 3 (LL)
No. 140-13	Interior High Performance Latex, MPI Gloss Level 4
No. 141-13	Interior High Performance Latex (SG) MPI Gloss Level 5

## D. Steel Structures Painting Council (SSPC):

SSPC SP 1-04	Solvent Cleaning
SSPC SP 2-04	Hand Tool Cleaning

## SSPC SP 3-04

## Power Tool Cleaning

## PART 2 - PRODUCTS

## 2.1 MATERIALS

- A. Wood Sealer: Thinned with thinner recommended by manufacturer at rate of about one part of thinner to four parts of varnish.
- B. Plastic Tape:
  - 1. Pigmented vinyl plastic film in colors as specified.
  - 2. Pressure sensitive adhesive back.
  - 3. Widths as shown.
- C. Interior/Exterior Latex Block Filler: MPI 4.
- D. Exterior Alkyd Wood Primer: MPI 5.
- E. Exterior Oil Wood Primer: MPI 7.
- F. Exterior Alkyd, Flat (EO): MPI 8.
- G. Exterior Alkyd Enamel (EO): MPI 9.
- H. Exterior Latex, Flat (AE): MPI 10.
- I. Exterior Latex, Semi-Gloss (AE): MPI 11.
- J. Polyurethane, Clear Gloss: MPI 31.
- K. Knot Sealer: MPI 36.
- L. Interior Satin Latex: MPI 43.
- M. Interior Low Sheen Latex: MPI 44.
- N. Interior Primer Sealer: MPI 45.
- O. Interior Enamel Undercoat: MPI 46.
- P. Interior Alkyd, Semi-Gloss (AK): MPI 47.
- Q. Interior Latex Primer Sealer: MPI 50.
- R. Interior Alkyd, Eggshell: MPI 51.
- S. Interior Latex, MPI Gloss Level 3 (LE): MPI 52.
- T. Interior Latex, Flat, MPI Gloss Level 1 (LE): MPI 53.
- U. Interior Latex, Semi-Gloss, MPI Gloss Level 5 (LE): MPI 54.
- V. Interior/ Exterior Latex Porch & Floor Paint, Low Gloss: MPI 60.
- W. Interior/ Exterior Latex Porch & Floor Paint, gloss: MPI 68.
- X. Polyurethane, Moisture Cured, Clear, Flat (PV): MPI 71.
- Y. Interior Wood Stain, Semi-Transparent (WS): MPI 90.
- Z. Exterior Alkyd, Semi-Gloss (EO): MPI 94.
- AA. Fast Drying Metal Primer: MPI 95.
- BB. Interior latex, Gloss (LE) and (LG): MPI 114.
- CC. Exterior Latex, High Gloss (acrylic) (AE): MPI 119.
- DD. Waterborne Galvanized Primer: MPI 134.
- EE. Interior High Performance Latex, MPI Gloss Level 2 (LF): MPI 138.
- FF. Interior High Performance Latex, MPI Gloss Level 3 (LL): MPI 139.
- GG. Interior High Performance Latex, MPI Gloss Level 4: MPI 140.
- HH. Interior High Performance Latex (SG), MPI Gloss Level 5: MPI 141.

## 2.2 PAINT PROPERTIES

- A. Use ready-mixed (including colors), except two component epoxies, polyurethanes, polyesters, paints having metallic powders packaged separately and paints requiring specified additives.
- B. Where no requirements are given in the referenced specifications for primers, use primers with pigment and vehicle, compatible with substrate and finish coats specified.

## 2.3 REGULATORY REQUIREMENTS

- A. Paint materials must conform to the restrictions of the local Environmental and Toxic Control jurisdiction or the requirements of this section, whichever is most stringent.
  - 1. Lead-Based Paint:
    - a. Lead based paint is not permitted to be used.
  - 2. Asbestos: Materials must not contain asbestos.
  - 3. Chromate, Cadmium, Mercury, and Silica: Materials must not contain zinc-chromate, strontium-chromate, Cadmium, mercury or mercury compounds or free crystalline silica.
  - 4. Human Carcinogens: Materials must not contain any of the ACGIH-BKLT and ACGIH-DOC confirmed or suspected human carcinogens.
  - 5. Use high performance acrylic paints in place of alkyd paints, where possible.
  - 6. VOC content for solvent-based paints must not exceed specified performance requirement; aromatic hydro carbons contained in solvent-based paints must not exceed one percent by weight.

## PART 3 - EXECUTION

### 3.1 JOB CONDITIONS

- A. Safety: Observe required safety regulations and manufacturer's warning and instructions for storage, handling and application of painting materials.
  - 1. Take necessary precautions to protect personnel and property from hazards due to falls, injuries, toxic fumes, fire, explosion, or other harm.
  - 2. Deposit soiled cleaning rags and waste materials in metal containers approved for that purpose. Dispose of such items off the site at end of each day's work.
- B. Atmospheric and Surface Conditions:
  - 1. Do not apply coating when air or substrate conditions are:
    - a. Less than 3 degrees C (5 degrees F) above dew point.
    - b. Below 10 degrees C (50 degrees F) or over 35 degrees C (95 degrees F), unless specifically pre-approved by the Contracting Officer and the product manufacturer.
  - 2. Do not exceed application conditions recommended by the manufacturer.
  - 3. Maintain interior temperatures until paint dries hard.
  - 4. Do no exterior painting when it is windy and dusty.
  - 5. Do not paint in direct sunlight or on surfaces that the sun will soon warm.

6. Apply only on clean, dry and frost free surfaces except as follows:
  - a. Apply water thinned acrylic and cementitious paints to damp (not wet) surfaces where allowed by manufacturer's printed instructions.
  - b. Dampened with a fine mist of water on hot dry days concrete and masonry surfaces to which water thinned acrylic and cementitious paints are applied to prevent excessive suction and to cool surface.
7. Varnishing:
  - a. Apply in clean areas and in still air.
  - b. Before varnishing vacuum and dust area.
  - c. Immediately before varnishing wipe down surfaces with a tack rag.

### 3.2 SURFACE PREPARATION

- A. Method of surface preparation is optional, provided results of finish painting produce solid even color and texture specified with no overlays.
- B. General:
  1. Remove prefinished items not to be painted such as lighting fixtures, escutcheon plates, hardware, trim, and similar items for reinstallation after paint is dried.
  2. Remove items for reinstallation and complete painting of such items and adjacent areas when item or adjacent surface is not accessible or finish is different.
  3. See other sections of specifications for specified surface conditions and prime coat.
  4. Clean surfaces for painting with materials and methods compatible with substrate and specified finish. Remove any residue remaining from cleaning agents used. Do not use solvents, acid, or steam on concrete and masonry.
- C. Wood:
  1. Sand to a smooth even surface and then dust off.
  2. Sand surfaces showing raised grain smooth between each coat.
  3. Wipe surface with a tack rag prior to applying finish.
  4. Surface painted with an opaque finish:
    - a. Coat knots, sap and pitch streaks with Knot Sealer before applying paint.
    - b. Apply two coats of Knot Sealer over large knots.
  5. After application of prime or first coat of stain, fill cracks, nail and screw holes, depressions and similar defects with wood filler paste. Sand the surface to make smooth and finish flush with adjacent surface.
  6. Before applying finish coat, reapply wood filler paste if required, and sand surface to remove surface blemishes. Finish flush with adjacent surfaces.
  7. Fill open grained wood such as oak, walnut, ash and mahogany with Wood Filler Paste, colored to match wood color.
    - a. Thin filler in accordance with manufacturer's instructions for application.
    - b. Remove excess filler, wipe as clean as possible, dry, and sand as specified.

## D. Ferrous Metals:

1. Remove oil, grease, soil, drawing and cutting compounds, flux and other detrimental foreign matter in accordance with SSPC-SP 1 (Solvent Cleaning).
2. Remove loose mill scale, rust, and paint, by hand or power tool cleaning, as defined in SSPC-SP 2 (Hand Tool Cleaning) and SSPC-SP 3 (Power Tool Cleaning). Exception: where high temperature aluminum paint is used, prepare surface in accordance with paint manufacturer's instructions.
3. Fill dents, holes and similar voids and depressions in flat exposed surfaces of hollow steel doors and frames, access panels, roll-up steel doors and similar items specified to have semi-gloss or gloss finish with TT-F-322D (Filler, Two-Component Type, For Dents, Small Holes and Blow-Holes). Finish flush with adjacent surfaces.
  - a. This includes flat head countersunk screws used for permanent anchors.
  - b. Do not fill screws of item intended for removal such as glazing beads.
4. Spot prime abraded and damaged areas in shop prime coat which expose bare metal with same type of paint used for prime coat. Feather edge of spot prime to produce smooth finish coat.
5. Spot prime abraded and damaged areas which expose bare metal of factory finished items with paint as recommended by manufacturer of item.

## E. Zinc-Coated (Galvanized) Metal, Aluminum, Copper and Copper Alloys Surfaces Specified Painted:

1. Clean surfaces to remove grease, oil and other deterrents to paint adhesion in accordance with SSPC-SP 1 (Solvent Cleaning).
2. Spot coat abraded and damaged areas of zinc-coating which expose base metal on hot-dip zinc-coated items with Organic Zinc Rich Coating. Prime or spot prime with MPI 134 (Waterborne Galvanized Primer) depending on finish coat compatibility.

## F. Masonry, Concrete, Cement Board, Cement Plaster and Stucco:

1. Clean and remove dust, dirt, oil, grease efflorescence, form release agents, laitance, and other deterrents to paint adhesion.
2. Use emulsion type cleaning agents to remove oil, grease, paint and similar products. Use of solvents, acid, or steam is not permitted.
3. Remove loose mortar in masonry work.
4. Replace mortar and fill open joints, holes, cracks and depressions with new mortar.
5. Neutralize Concrete floors to be painted by washing with a solution of 1.4 Kg (3 pounds) of zinc sulfate crystals to 3.8 L (1 gallon) of water, allow to dry three days and brush thoroughly free of crystals.
6. Repair broken and spalled concrete edges with concrete patching compound to match adjacent surfaces as specified in CONCRETE Sections. Remove projections to level of adjacent surface by grinding or similar methods.

## G. Gypsum Plaster and Gypsum Board:

1. Remove efflorescence, loose and chalking plaster or finishing materials.

2. Remove dust, dirt, and other deterrents to paint adhesion.
3. Fill holes, cracks, and other depressions with CID-A-A-1272A [Plaster, Gypsum (Spackling Compound) finished flush with adjacent surface, with texture to match texture of adjacent surface. Patch holes over 25 mm (1-inch) in diameter as specified in Section for plaster or gypsum board.

### 3.3 PAINT PREPARATION

- A. Thoroughly mix painting materials to ensure uniformity of color, complete dispersion of pigment and uniform composition.
- B. Do not thin unless necessary for application and when finish paint is used for body and prime coats. Use materials and quantities for thinning as specified in manufacturer's printed instructions.
- C. Remove paint skins, then strain paint through commercial paint strainer to remove lumps and other particles.
- D. Mix two component and two part paint and those requiring additives in such a manner as to uniformly blend as specified in manufacturer's printed instructions unless specified otherwise.
- E. For tinting required to produce exact shades specified, use color pigment recommended by the paint manufacturer.

### 3.4 APPLICATION

- A. All conduit used on this project is to be shop painted prior to delivery to the project site. Limited touch up in the field will be permitted by the VA. Start of surface preparation or painting will be construed as acceptance of the surface as satisfactory for the application of materials.
- B. Unless otherwise specified, apply paint in three coats; prime, body, and finish. When two coats applied to prime coat are the same, first coat applied over primer is body coat and second coat is finish coat.
- C. Apply each coat evenly and cover substrate completely.
- D. Allow not less than 48 hours between application of succeeding coats, except as allowed by manufacturer's printed instructions, and approved by RE/COR.
- E. Finish surfaces to show solid even color, free from runs, lumps, brush marks, laps, holidays, or other defects.
- F. Apply by brush or roller, except as otherwise specified. No spray painting will be permitted at the project location.
- H. Do not paint in closed position operable items such as access doors and panels, window sashes, overhead doors, and similar items except overhead roll-up doors and shutters.

### 3.5 PRIME PAINTING

- A. After surface preparation, prime surfaces before application of body and finish coats, except as otherwise specified.
- B. Spot prime and apply body coat to damaged and abraded painted surfaces before applying succeeding coats.

- C. Additional field applied prime coats over shop or factory applied prime coats are not required except for exterior exposed steel. Apply an additional prime coat.
  - D. Prime rebates for stop and face glazing of wood, and for face glazing of steel.
  - E. Wood and Wood Particleboard:
    - 1. Use same kind of primer specified for exposed face surface.
      - a. Exterior wood: MPI 7 (Exterior Oil Wood Primer) for new construction and MPI 5 (Exterior Alkyd Wood Primer) for repainting bare wood primer except where Interior Wood Stain, Semi-Transparent (WS) is scheduled.
      - b. Interior wood except for transparent finish: MPI 45 (Interior Primer Sealer) or MPI 46 (Interior Enamel Undercoat), thinned if recommended by manufacturer.
      - c. Transparent finishes as specified under Transparent Finishes on Wood.
    - 2. Apply one coat of primer MPI 7 (Exterior Oil Wood Primer) or MPI 5 (Exterior Alkyd Wood Primer) or sealer MPI 45 (Interior Primer Sealer) or MPI 46 (Interior Enamel Undercoat) as soon as delivered to site to surfaces of unfinished woodwork, except concealed surfaces of shop fabricated or assembled millwork and surfaces specified to have varnish, stain or natural finish.
    - 3. Back prime and seal ends of exterior woodwork, and edges of exterior plywood specified to be finished.
  - F. Metals:
    - 1. Steel and Iron: MPI 95 (Fast Drying Metal Primer).
    - 2. Zinc-coated Steel and Iron: MPI 134 (Waterborne Galvanized Primer).
    - 3. Machinery Not Factory Finished: MPI 9 (Exterior Alkyd Enamel (EO)).
  - G. Gypsum Board or and Hardboard or: Not Used.
  - H. Gypsum Plaster and Veneer Plaster: Not Used.
  - I. Concrete Masonry Units except glazed or integrally colored and decorative units:
    - 1. MPI 4 (Block Filler) on interior surfaces.
  - J. Cement Plaster or stucco or Concrete Masonry, Brick Masonry or and Cement board or Interior Surfaces of Ceilings and Walls:
    - 1. or MPI 53 (Interior Latex, Flat, MPI Gloss Level 1 LE)) or MPI 52 (Interior Latex, MPI Gloss Level 3 (LE)) or MPI 54 (Interior Latex, Semi-Gloss, MPI Gloss Level 5 (LE)) or MPI 114 (Interior Latex, Gloss (LE) and (LG)) or except use two coats where substrate has aged less than six months.
- 3.6 EXTERIOR FINISHES
- A. Apply following finish coats where specified.
  - B. Steel and Ferrous Metal, or Including Tern or:
    - 1. Two coats of MPI 8 (Exterior Alkyd, Flat (EO)) or MPI 9 (Exterior Alkyd Enamel (EO)) or MPI 94 (Exterior Alkyd, Semi-Gloss (EO)) on exposed surfaces, except on surfaces over 94 degrees C (200 degrees F).
  - C. Machinery without factory finish except for primer: Not Used.

### 3.7 INTERIOR FINISHES. NOT USED.

### 3.8 REFINISHING EXISTING PAINTED SURFACES

- A. Clean, patch and repair existing surfaces as specified under surface preparation.
- B. Remove and reinstall items as specified under surface preparation.
- C. Remove existing finishes or apply separation coats to prevent non-compatible coatings from having contact.
- D. Patched or Replaced Areas in Surfaces and Components: Apply spot prime and body coats as specified for new work to repaired areas or replaced components.
- E. Except where scheduled for complete painting apply finish coat over plane surface to nearest break in plane, such as corner, reveal, or frame.
- F. In existing rooms and areas where alterations occur, clean existing stained and natural finished wood retouch abraded surfaces and then give entire surface one coat of or Polyurethane, Moisture Cured, Clear Gloss or Polyurethane, Moisture Cured, Clear Flat (PV) or.
- G. Refinish areas as specified for new work to match adjoining work unless specified or scheduled otherwise.
- H. Coat knots and pitch streaks showing through old finish with Knot Sealer before refinishing.
- I. Sand or dull glossy surfaces prior to painting.
- J. Sand existing coatings to a feather edge so that transition between new and existing finish will not show in finished work.

### 3.9 PAINT COLOR

- A. Color and gloss of finish coats is by COR.
- B. For additional requirements regarding color see Articles, REFINISHING EXISTING PAINTED SURFACE and MECHANICAL AND ELECTRICAL FIELD PAINTING SCHEDULE.
- C. Coat Colors:
  - 1. Color of priming coat: Lighter than body coat.
  - 2. Color of body coat: Lighter than finish coat.
  - 3. Color prime and body coats to not show through the finish coat and to mask surface imperfections or contrasts.
- D. Painting, Caulking, Closures, and Fillers Adjacent to Casework:
  - 1. Paint to match color of casework where casework has a paint finish.
  - 2. Paint to match color of wall where casework is stainless steel, plastic laminate, or varnished wood.

### 3.10 PROTECTION CLEAN UP, AND TOUCH-UP

- A. Protect work from paint droppings and spattering by use of masking, drop cloths, removal of items or by other approved methods.
- B. Upon completion, clean paint from hardware, glass and other surfaces and items not required to be painted of paint drops or smears.
- C. Before final inspection, touch-up or refinished in a manner to produce solid even color and finish texture, free from defects in work which was damaged or discolored.



- - - E N D - - -

## APPENDIX

Coordinate the following abbreviations used in Section 09 91 00, PAINTING, with other Sections. Use the same abbreviation and terms consistently.

Paint or coating	Abbreviation
Acrylic Emulsion	AE (MPI 10 – flat/MPI 11 – semigloss/MPI 119 - gloss)
Alkyd Gloss Enamel	G (MPI 48)
Alkyd Semigloss Enamel	SG (MPI 47)
Aluminum Paint	AP)
Cementitious Paint	CEP (TT-P-1411)
Exterior Latex	EL?? (MPI 10 / 11 / 119)
Exterior Oil	EO (MPI 9 – gloss/MPI 8 – flat/MPI 94 – semigloss)
Fire Retardant Paint	FR
Fire Retardant Coating (Clear)	FC (intumescent type)
Heat Resistant Paint	HR
Latex Emulsion	LE (MPI 53, flat/MPI 52, eggshell/MPI 54, semigloss/MPI 114, gloss Level 6)
Latex Flat	LF (MPI 138)
Latex Gloss	LG (MPI 114)
Latex Semigloss	SG (MPI 141)
Latex Low Luster	LL (MPI 139)
Plastic Floor Coating	PL
Polyurethane Varnish	PV
Rubber Paint	RF (CID-A-A-3120 - Paint for Swimming Pools (RF))
Water Paint, Cement	WPC (CID-A-A-1555 - Water Paint, Powder).
Wood Stain	WS

- - - E N D - - -