

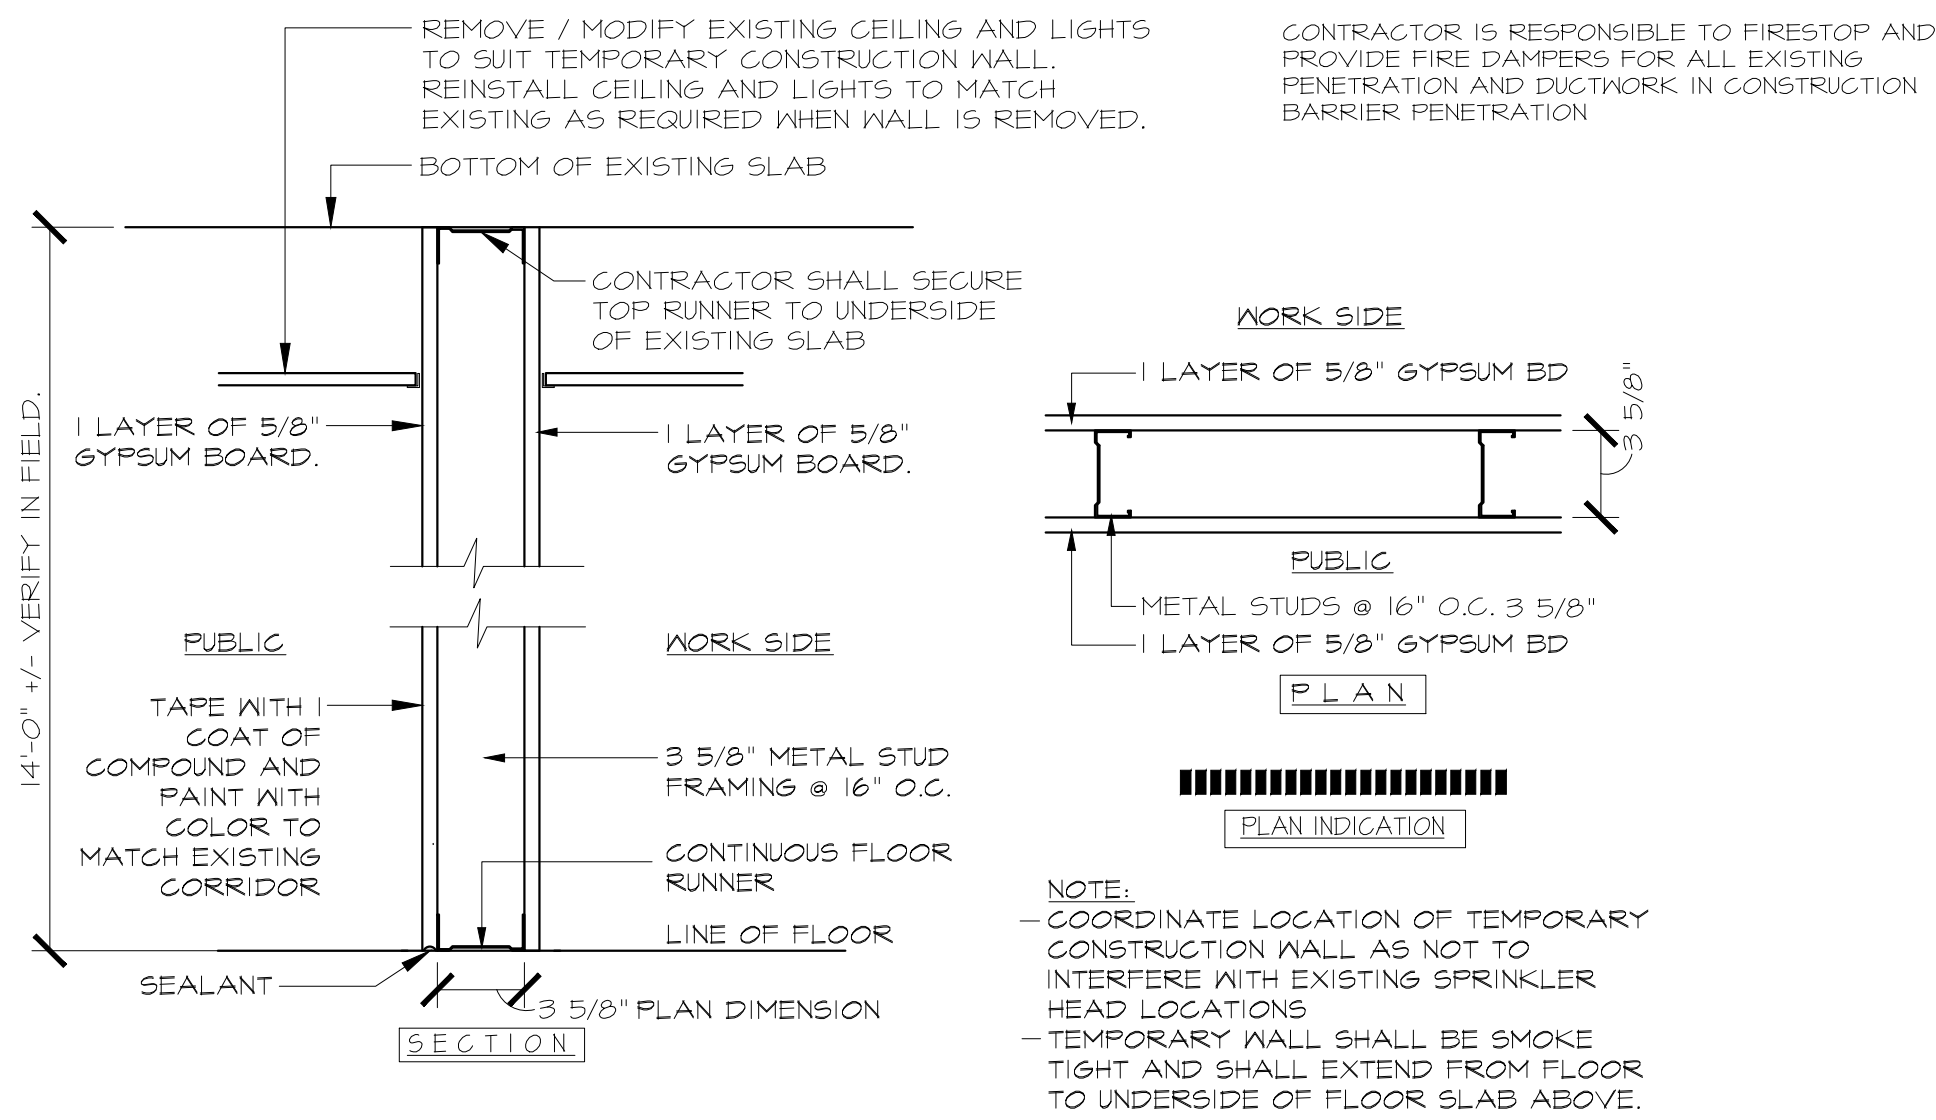
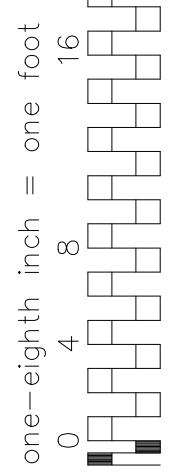
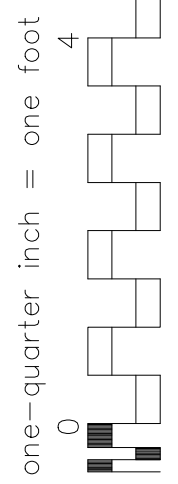
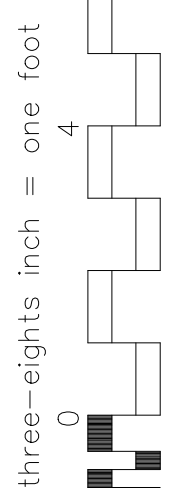
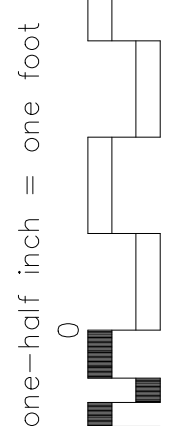
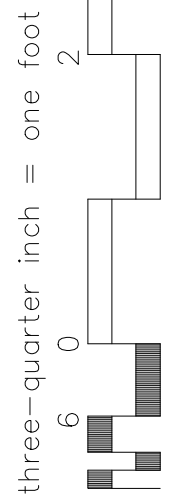


IF THIS SHEET IS NOT 30" x 42" FULL SIZE, USE GRAPHIC SCALES

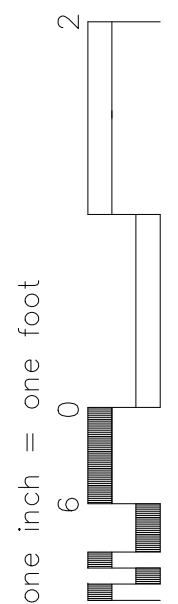

A Temporary Construction Wall
1 1/2" = 1'-0"
UL LISTED 414 OR EQUAL
1 HR RATED ASSEMBLY

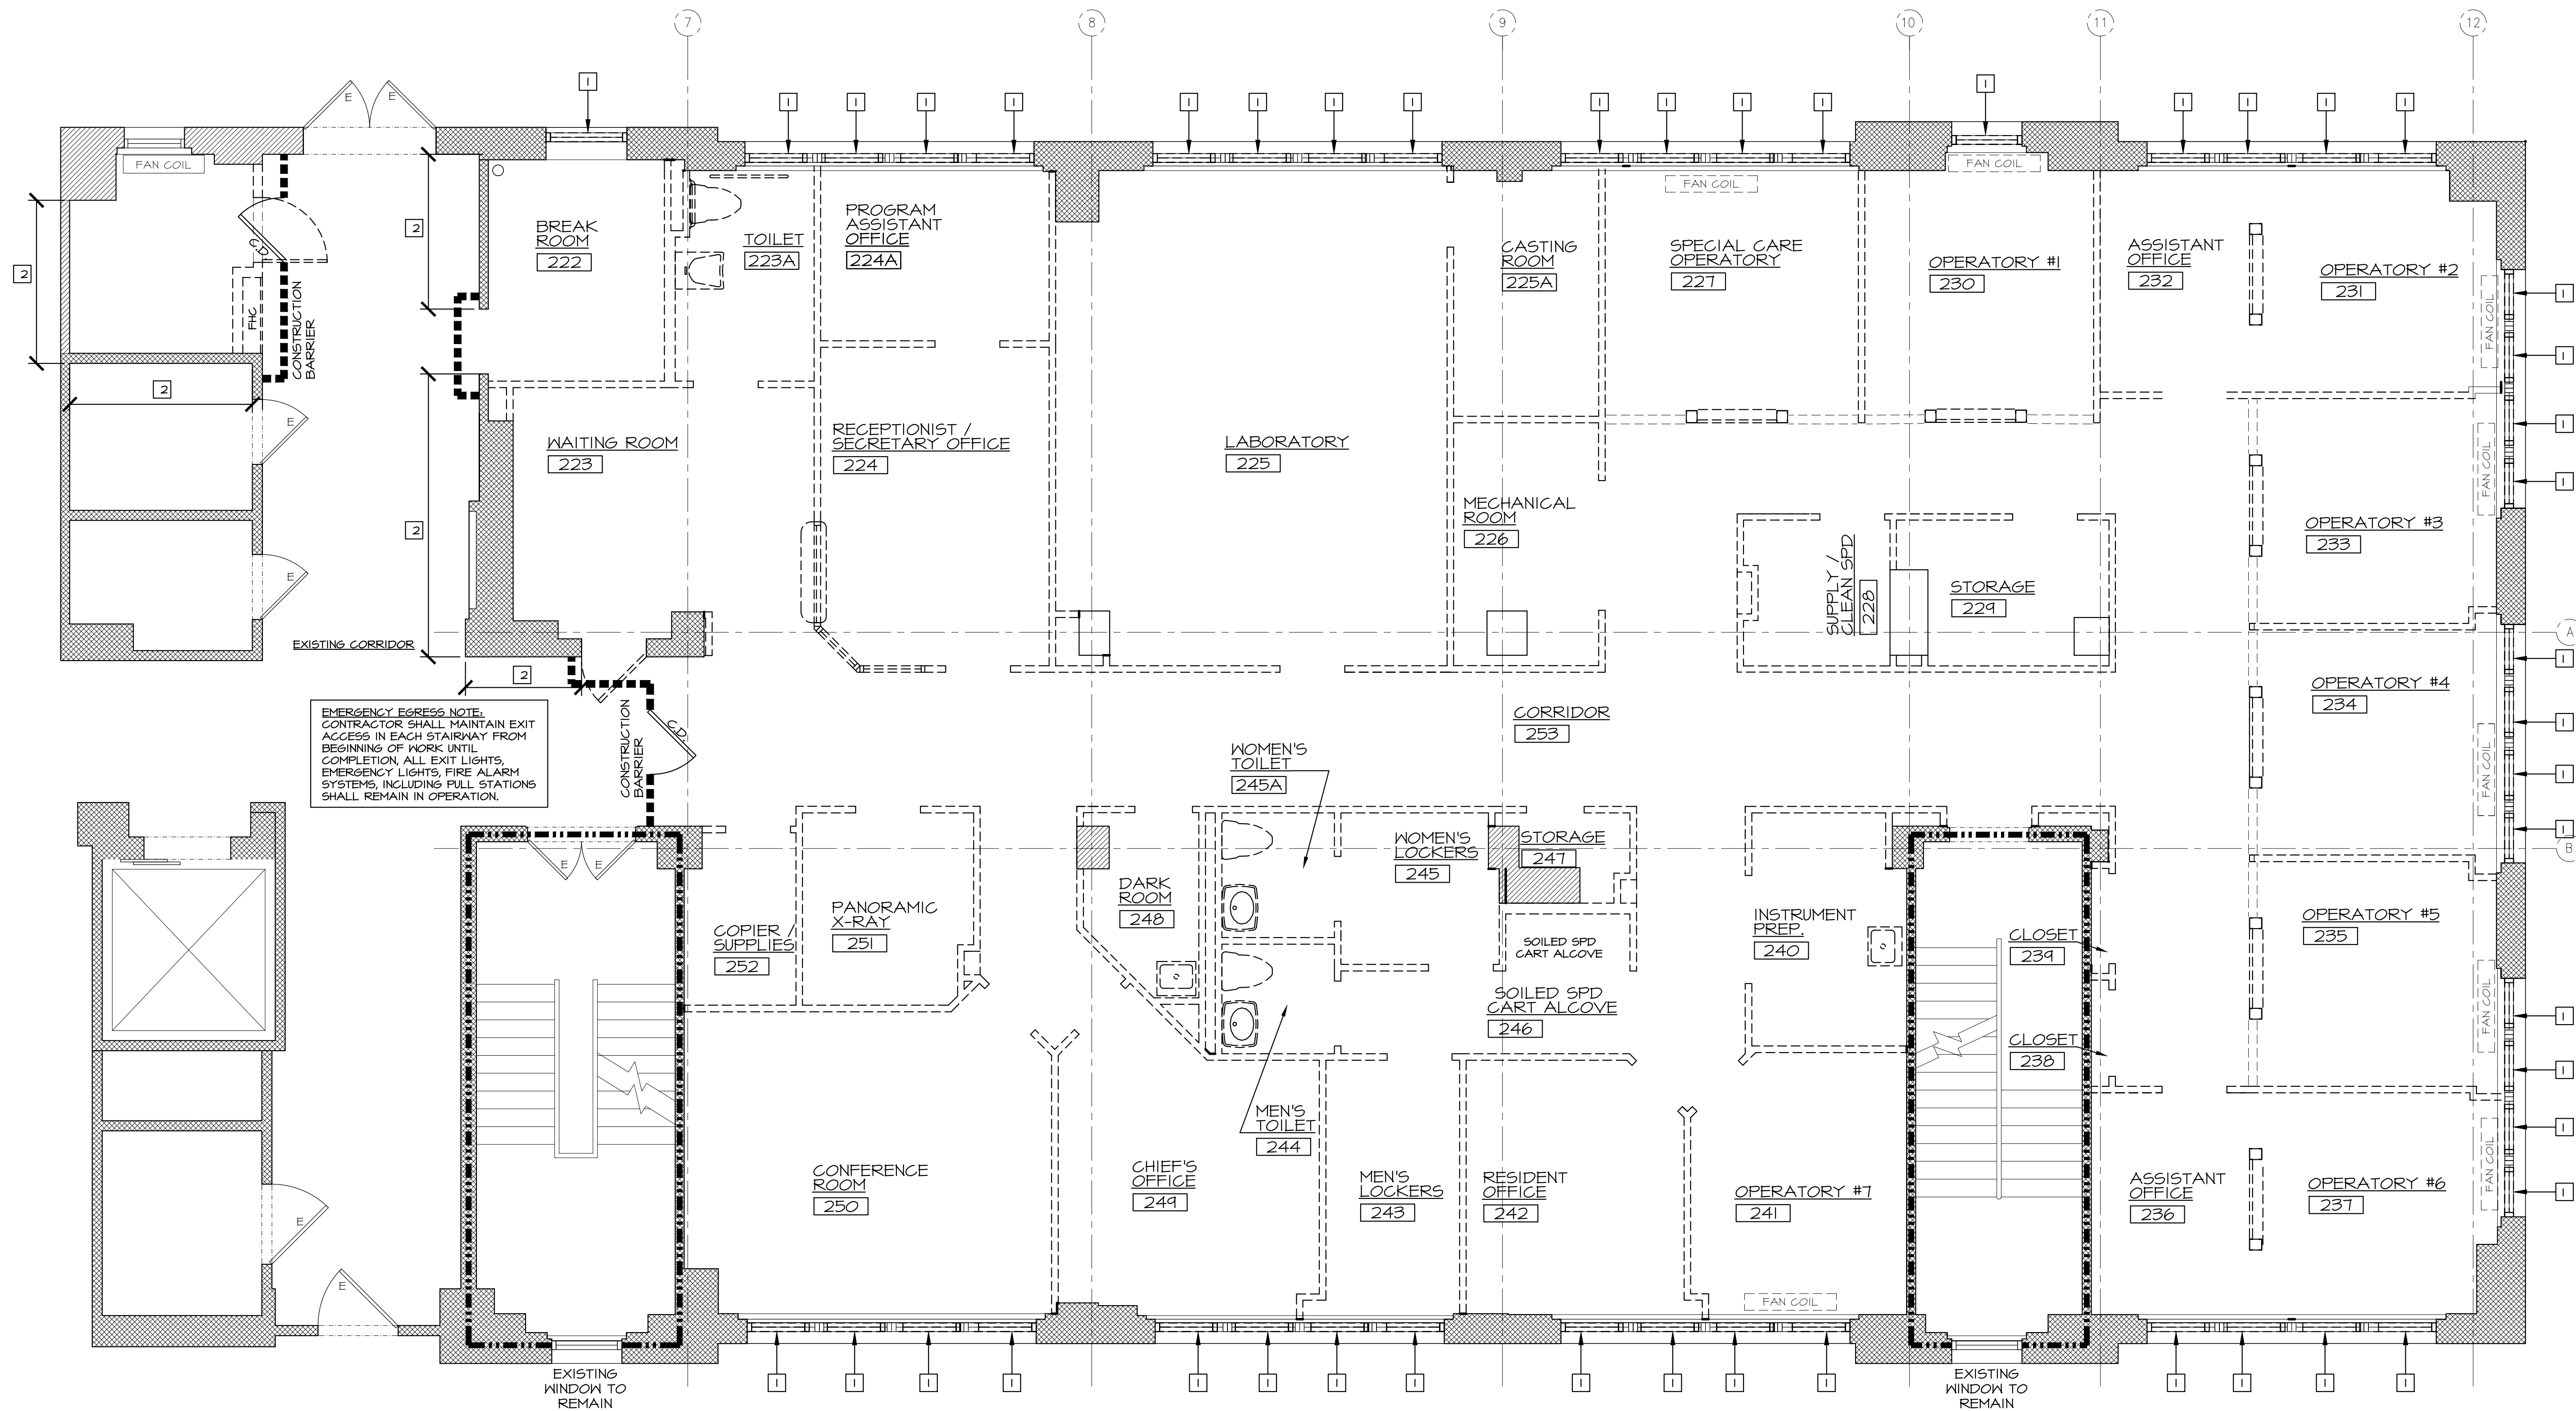

1 Demolition Floor Plan
1/4" = 1'-0"

GENERAL NOTES

1. REFER TO DEMOLITION PLAN ON SHEET AD101 FOR LOCATIONS OF DUST TIGHT CONSTRUCTION PARTITIONS AND DOORS.
2. THOROUGHLY CLEAN ALL ROOMS, TOILETS, CORRIDORS ETC OF DUST AND DEBRIS PRIOR TO COMPLETION OF WORK.
3. SEE FLOOR PLANS FOR LOCATIONS OF EXISTING FIRE AND SMOKE BARRIERS.
4. CONTRACTOR TO PROVIDE HEPA NEGATIVE PRESSURE MACHINE INSIDE CONSTRUCTION AREA. LOCATION OF EXHAUST TO BE COORDINATED WITH VA RESIDENT ENGINEER.
5. CONTRACTOR MUST COMPLY WITH VA INFECTION CONTROL REGULATIONS AND INTERIM LIFE SAFETY ALL DEBRIS BEING REMOVED FROM CONSTRUCTION AREA MUST BE SEALED IN A CLEAN GARBAGE BAG PRIOR TO LEAVING CONSTRUCTION AREA. REFER TO DRAWING 61002 FOR VA INFECTION CONTROL REQUIREMENTS.
6. CONTRACTOR SHALL TAKE ALL PRECAUTIONS AS TO AVOID SPREADING CONSTRUCTION DUST AND DEBRIS INTO REMAINDER OF HOSPITAL FLOOR DURING CONSTRUCTION. WHILE INSTALLING TEMPORARY CONSTRUCTION WALLS AND WHEN ENTERING AND EXITING CONSTRUCTION AREA, ACCESS TO WORK AREA SHALL BE COORDINATED WITH VA RESIDENT ENGINEER.
7. ALL NEW WIRING SHALL BE INSTALLED WITHIN EXISTING WALLS, CEILINGS ETC. NO WIRING IS TO BE SURFACE MOUNTED OR RUN EXPOSED. CONTRACTOR SHALL PROVIDE ALL OPENINGS IN WALLS, FLOORS AND CEILINGS AS REQUIRED FOR INSTALLATION OF NEW WORK. PATCH WALLS, FLOORS, AND CEILING AS REQUIRED AFTER INSTALLATION TO SUIT NEW FINISHES. FINAL APPROVAL OF PATCHED AREAS SHALL BE BY VA CONTRACTING OFFICER. PROVIDE FIREPROOFING AS REQUIRED.
8. ALL NEW JUNCTION BOXES, DEVICES AND COVER PLATES SHALL BE RECESSED INTO NEW EXISTING WALL CONSTRUCTION AND RECESSED IN NEW EXISTING CEILINGS. CONTRACTOR SHALL PROVIDE ALL OPENINGS IN WALLS, FLOORS AND CEILINGS AS REQUIRED FOR INSTALLATION OF NEW WORK. PATCH WALLS, FLOORS, AND CEILING AS REQUIRED AFTER INSTALLATION TO SUIT NEW FINISHES. PROVIDE FIREPROOFING AS REQUIRED. EXISTING RATINGS OF FLOORS, WALLS, CEILING ETC SHALL BE MAINTAINED.
9. CONTRACTOR SHALL PROVIDE ALL OPENINGS IN WALLS, FLOORS AND CEILINGS AS REQUIRED FOR INSTALLATION OF NEW WORK. PATCH WALLS, FLOORS, AND CEILING AS REQUIRED AFTER INSTALLATION TO SUIT NEW FINISHES. PROVIDE FIREPROOFING AS REQUIRED. EXISTING RATINGS OF FLOORS, WALLS, CEILING ETC SHALL BE MAINTAINED.
10. ALL PENETRATIONS MADE THROUGH SMOKE AND FIRE WALLS MUST BE PATCHED, SLEEVED, FIRE SAFED AND SEALED DAILY WITH LISTED/RATED FIRE STOPPING MATERIAL IN ORDER TO MAINTAIN RATING.
11. CONTRACTOR SHALL REMOVE EXISTING CEILINGS IN AREAS THAT ARE NOT INDICATED. TO RECEIVE NEW CEILING AS REQUIRED FOR THE INSTALLATION OF NEW MECHANICAL, ELECTRICAL, PLUMBING WORK ETC. REFER TO DRAWINGS FOR WORK TO BE INSTALLED. REINSTALL, PATCH OR INSTALL NEW CEILINGS TO MATCH EXISTING AS REQUIRED AFTER INSTALLATION OF NEW WORK IS COMPLETED. PROVIDE DUST OR TEMPORARY CONSTRUCTION PARTITIONS AS DIRECTED BY VA RESIDENT ENGINEER.
12. REFER TO MECHANICAL, PLUMBING, ELECTRICAL, STRUCTURAL, SPRINKLER DRAWINGS ETC FOR WORK TO BE PERFORMED.
13. FIRE SAFE/ SEAL DAILY ALL NEW AND EXISTING PIPES AND OTHER PENETRATIONS AT ALL CONCRETE SLAB LOCATIONS WITH A 2 HR FIRE RATING MIN.
14. CONTRACTOR IS RESPONSIBLE TO FIRESTOP AND PROVIDE FIRE DAMPERS FOR ALL EXISTING PENETRATION AND DUCTWORK IN CONSTRUCTION BARRIER PENETRATION.

DEMOLITION GENERAL NOTES:

1. CONTRACTOR SHALL REMOVE BRICK, INFILL AT EXISTING THIRD FLOOR DUCT PENETRATIONS THAT WILL BE USED FOR THE NEW DUCTS TO BE INSTALLED IN THIS PROJECT.

DEMOLITION WORK NOTES:

1. EXISTING WINDOW TO BE REMOVED IN ITS ENTIRETY - PREPARE OPENING TO RECEIVE NEW WINDOW. ONLY REMOVE AS MANY WINDOWS THAT NEW WINDOWS CAN BE INSTALLED SAME DAY. BUILDING MUST REMAIN WATERTIGHT AT ALL TIMES.
2. EXISTING WALL SHALL BE USED AS CONSTRUCTION BARRIER. CONTRACTOR SHALL VERIFY THAT EXISTING WALL EXTENDS UP TO DECK ABOVE. IF WALLS DO NOT EXTEND UP TO DECK, CONTRACTOR SHALL PROVIDE ONE HOUR RATED WALL CONSTRUCTION UP TO DECK. ALL EXISTING OPENINGS IN THE WALL SHALL BE PATCHED AND FIRESTOPPED.


LEGEND:

- WORK NOTE**
- INDICATES WORK NOTE NUMBER - SEE WORK NOTES/ THIS SHEET
 - EXISTING DOOR TO BE REMOVED. SEE WORK NOTE XX.
 - EXISTING WALL TO BE REMOVED. SEE WORK NOTE XXX.
 - EXISTING WINDOWS, FRAMES, AND HARDWARE TO BE REMOVED IN THEIR ENTIRETY. SEE WORK NOTE #1.
 - EXISTING DOOR, FRAME AND HARDWARE TO REMAIN. EXISTING DOOR AND FRAME SHALL BE SCRAPED AND REFINISH TO MATCH NEW DOOR FINISHES.
 - EXISTING WALLS TO REMAIN THAT CONTRACTOR SHALL REPAIR AND PREPARE EXISTING WALLS TO SUIT NEW FINISHES AS REQUIRED.
 - EXISTING FAN COIL UNITS AT WINDOWS TO REMAIN.
 - EXISTING FAN COIL UNITS AT WINDOWS TO BE RELOCATED.
 - EXISTING SMOKE RATED BARRIER (30 MIN. RATING)
 - EXISTING FIRE RATED BARRIER (1 HR RATING)
 - EXISTING FIRE RATED BARRIER (2 HR RATING)
 - TEMPORARY CONSTRUCTION WALL (1 HR RATING) SEE DETAIL "A" ON THIS SHEET.
 - 3'-0"X7'-0" MINIMUM TEMPORARY SELF CLOSING CONSTRUCTION DOOR WITH POSITIVE LATCHING. DOOR SHALL BE ONE HOUR RATED OR 1 3/4" SOLID CORE WOOD. TEMPORARY CONSTRUCTION DOOR SHALL NOT CONTAIN ANY LITES. PROVIDE STOREROOM FUNCTION LOCKSETS. DOOR SHALL SWING INTO WORK AREA.

COLUMN GRID LINES AND DESIGNATIONS ARE APPROXIMATE AND TO BE USED AS REFERENCE ONLY.

SMOKE & FIRE RATING LEGEND

- EXISTING SMOKE RATED BARRIER (30 MIN RATING)
- EXISTING FIRE RATED BARRIER (1 HR RATING)
- EXISTING FIRE RATED BARRIER (2 HR RATING)

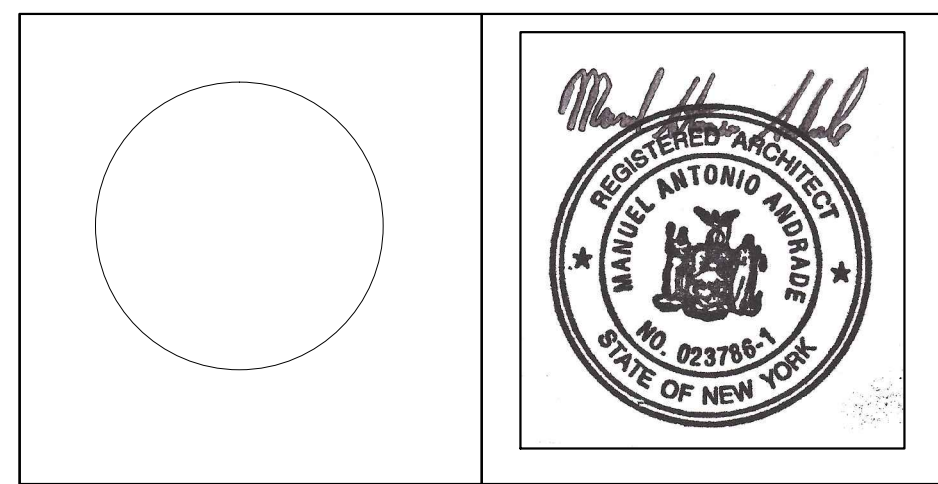

Revisions
VA FORM 08-6231, DEC 1989

Date




NOTE AND READ CAREFULLY:

The Contractor shall consult and study the requirements of each and every drawing and each specification section of this contract so that he /she may become acquainted with the project as a whole in order to determine how the work of his/hers subcontractor or vendor may affect the work required under this contract.

Written Specifications are part of this contract

KEY PLAN



AREA OF WORK

BUILDING #18

Drawing Title

DEMOLITION FLOOR PLAN

Approved: Division Chief

Approved: Service Director

Project Title

**Renovation to Dental Clinic
Building 18
Hudson Valley Healthcare System
Castle Point, New York**

Building Number

18

Checked

MA

Drawn

DW,JTL,
DC

Location

Castle Point, New York

Date

04/23/2012


Project No.

620A4-09-110

DRAWING NO.

AD101

Dwg. # OF 52

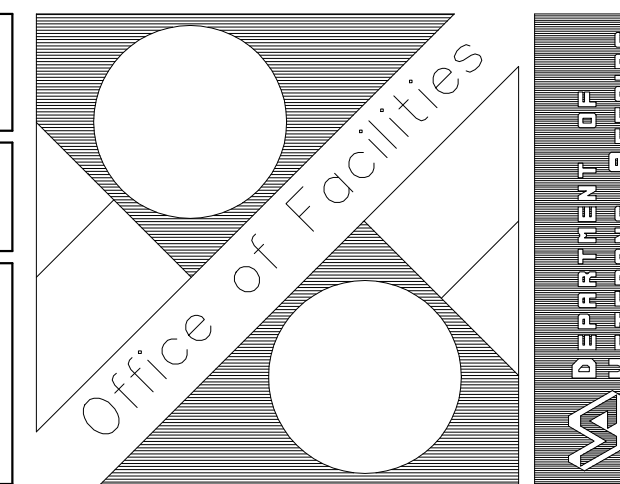

U.S. GOVERNMENT PRINTING OFFICE: 1983-400-285