

APPENDUM #1	06-11-12
Revisions	Date

CONSULTANTS:

ARCHITECT/ENGINEERS:


Drawing Title

Project Title

Project Number

Office of Construction and Facilities Management

1 SLAB PLAN

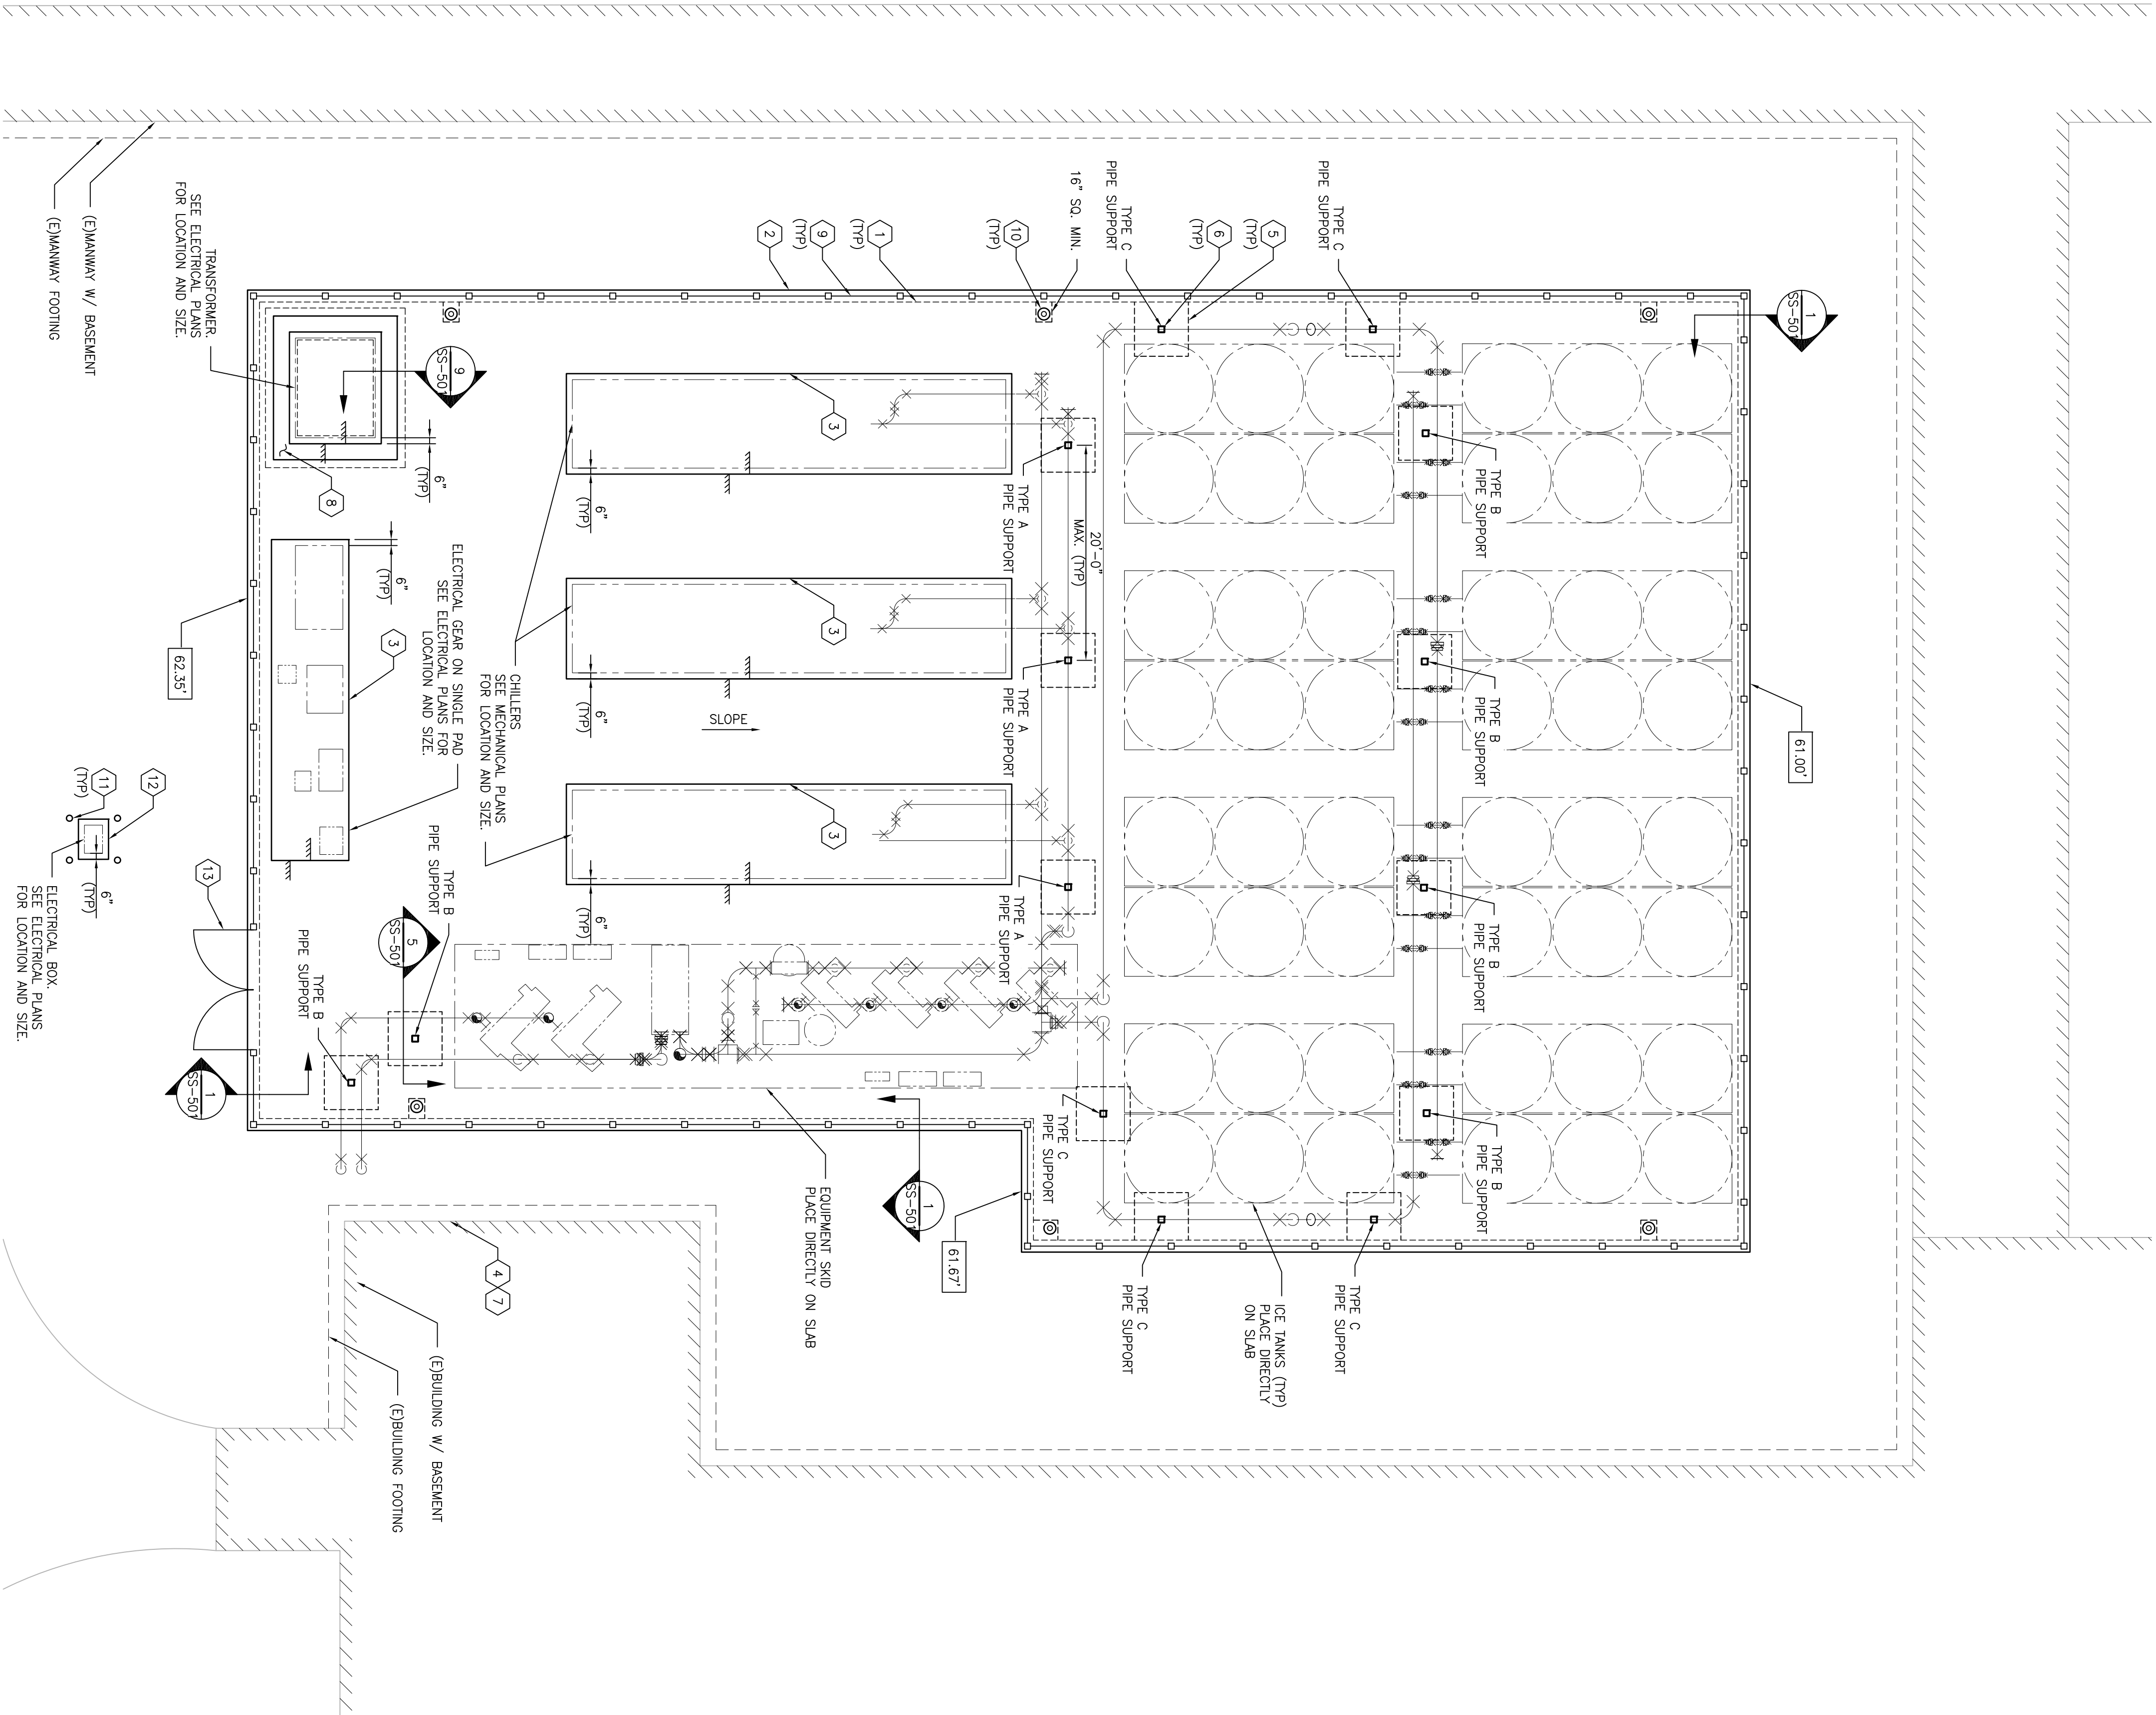

- GENERAL SHEET NOTES:**
- SEE DWG SS-501 FOR GENERAL STRUCTURAL AND CONSTRUCTION NOTES.
 - [X]X] DENOTES TOP OF CONCRETE SLAB. SEE SITE/CIVIL DWGS.
 - SLOPE DENOTES SLOPE TO LOW POINT.
 - DENOTES CHANGE IN SLAB ELEVATION.
 - COORDINATE SLAB DEPRESSIONS, EMBEDMENT REQUIREMENTS AND OPENINGS W/ MEP DWGS.
 - SEE DWG SS-501 FOR TYPICAL DETAILS.
 - ACCESS TO SITE IS RESTRICTED BY ARCHED OPENING IN WALKWAY AT ROOMWAY. CONTRACTOR TO COORDINATE DELIVERY AND STAGING OF CONSTRUCTION MATERIALS AND EQUIPMENT W/ SITE CONDITIONS.

- SHEET KENNOTES:**
- TURNED-DOWN EDGE. SEE SECTION 1/SS-501.
 - 8" CONCRETE SLAB ON GRADE. REINFORCE W/ #5 BARS @ 16" O.C. BOTTOM. EACH WAY. PROVIDE 4" DEEP LAYER CRUSHED STONE DRAINAGE FILL BELOW SLAB.
 - 4" CONCRETE EQUIPMENT PAD OVER SLAB ON GRADE. SEE DETAIL 3/SS-501.
 - SUPPORT PILING FROM EXISTING CONCRETE BASEMENT WALL. SEE DETAIL 7/SS-501.
 - 4'-6" SQUARE x 1'-4" THICK MONOLITHIC FOOTING AT PIPE SUPPORT COLUMN. REINFORCE W/ (5) #4 BARS. BOTTOM. EACH WAY. SEE SECTION 5/SS-501.
 - HESS&K 1/4" PIPE SUPPORT COLUMN. PROVIDE WASHA BEAM OVER COLUMN. SEE DETAIL 10/SS-501.
 - SUPPORT PILING FROM EXISTING CONCRETE BASEMENT WALL. SEE DETAIL 7/SS-501.
 - PROVIDE CONTAINMENT TROUGH AROUND TRANSFORMER. SEE SECTION 9/SS-501.
 - 8'-0" HIGH ALUMINUM FENCE W/ POSTS @ 6'-0" O.C. PROVIDE SHADOWBOX PROFILE BARS AND SLATS. SEE SPECIFICATIONS AND DETAIL 10/SS-501.
 - LIGHT STANDARDS. PROVIDE (4) 3/4" x 8" x 30" L.G. HOOKED ANCHOR BOLTS. ENLARGE EXISTING CONCRETE SLAB TO 10'-0" WIDE. PROVIDE 4" DEEP LAYER CRUSHED STONE DRAINAGE FILL BELOW SLAB. SEE ELECTRICAL PLANS FOR LOCATION. (SEE DETAIL 10/SS-501) A
 - STANDARD PIPE BOLLARD. SEE DETAIL 11/SS-501.
 - 4" CONCRETE SLAB ON GRADE. REINFORCE WITH 6#6-W2 1W21 WWS.
 - 8'-0" HIGH x 10'-6" 1/2" WIDE. DOUBLE-SWING. ALUMINUM GATE. MATCH STYLE OF FENCE.