


FOURTH FLOOR PLAN - ELECTRICAL
1/8"=1'-0"

GENERAL NOTES:

- CONNECT EXIT SIGNS FIXTURE TYPE E TO UNSWITCHED LEG OF LOCAL LIGHTING CIRCUIT.

NOTES BY SYMBOL: (THIS SHEET ONLY)

- CONNECT FIXTURE TO 20A-2P CIRCUIT BREAKER IN EMERGENCY LIGHTING INVERTER. IF EMERGENCY LIGHTING INVERTER ALTERNATE E1 IS NOT ACCEPTED PROVIDE FIXTURE WITH INTEGRAL EMERGENCY BATTERY BACK UP WITH THE HIGHEST LUMEN OUTPUT AVAILABLE AND CONNECT FIXTURE TO PGA-17.19.
- FIXTURE TO BE BOLTED TO PARKING STRUCTURE. E.C. TO PROVIDE FIXTURE ANCHOR BOLTS AND BOLT PATTERN TO PRE-CAST MANUFACTURER TO BE CAST INTO PARKING DECK STRUCTURE. WIRE CIRCUIT THROUGH LIGHTING CONTACTOR 'LC1' IN MAIN ELECTRIC ROOM.
- GREENHECK MODEL LB-05-S ROOF MOUNTED EXHAUST FAN 5000 CFM, 0.25 TSP, 1/2 HP, 208V. PROVIDE WITH DISCONNECT, 12" HIGH ROOFCLIMB, MOTORIZED DAMPER AND ALUMINUM HOSE. PROVIDE LINE VOLTAGE WALL MOUNTED THERMOSTAT TO CONTROL FAN DUCT DOWN FROM EXHAUST FAN TO CEILING EXHAUST GRILLE, TITUS MODEL 3552FS, 24"x48". PROVIDE ALUMINUM DUCTWORK.
- PROVIDE CONNECTION TO HEAT TRACE TAPE INSTALLED ON RAIN WATER CONDUCTOR PIPE BY P.C.

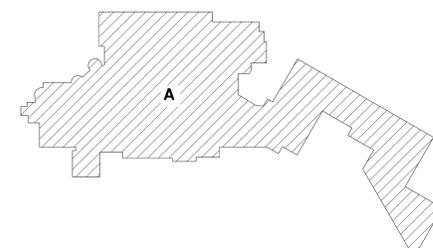

BARRY ISETT & ASSOCIATES, INC.
Multidiscipline Engineers & Consultants
Allentown, PA 610.398.0904
Pottsville, PA 610.935.2175
Forty Fort, PA 610.286.6200
Hazleton, PA 570.455.2999
Phillipsburg, NJ 908.454.9500
www.barryisett.com

REVISIONS	DATE



DRAWING TITLE FOURTH FLOOR PLAN - ELECTRICAL
FACILITY PROJECT NAME WILKES-BARRE V.A. MEDICAL CENTER

PROJECT TITLE WB VAMC PARKING GARAGE	DATE 3/10/2017
BUILDING NUMBER PARKING GARAGE	CHECKED KLP
DRAWN KLP	DRAWING NO. E-105
LOCATION 1111 EAST END BLVD, WILKES BARRE, PA	DWG. 7 OF 8



Veterans Affairs