


Lighting Control Panel Schedule

LCP Name: LCP (ADMIN. BUILDING)				
Location: ELECTRICAL CLOSET 112				
Surface/Flush: SURFACE				
Power Circuit: A-2				
RELAY #	CKT #	DESCRIPTION	LV SWITCH/SENSOR	SCENARIO
1	A-2	EXTERIOR/BREEZEWAY LTS.	PHOTOCELL/TIME CLOCK	AUTO ON/SCHED. OFF
2	A-6	RM. 104-112	TIME CLOCK	SCHED. OFF
3	A-2	EXTERIOR/BREEZEWAY LTS.	PHOTOCELL	AUTO ON/SCHED. OFF (NL)
4	SPARE	-	-	-
5	SPARE	-	-	-
6	SPARE	-	-	-
7	SPARE	-	-	-
8	SPARE	-	-	-


Lighting Control Panel Schedule

LCP Name: LCP (MAINTENANCE BUILDING)				
Location: UNHEATED STORAGE 108				
Surface/Flush: SURFACE				
Power Circuit: B1-26				
RELAY #	CKT #	DESCRIPTION	LV SWITCH/SENSOR	SCENARIO
1	B1-26	EXTERIOR LTS.	PHOTOCELL/TIME CLOCK	AUTO ON/SCHED. OFF
2	SPARE	-	-	-
3	SPARE	-	-	-
4	SPARE	-	-	-
5	SPARE	-	-	-
6	SPARE	-	-	-
7	SPARE	-	-	-
8	SPARE	-	-	-

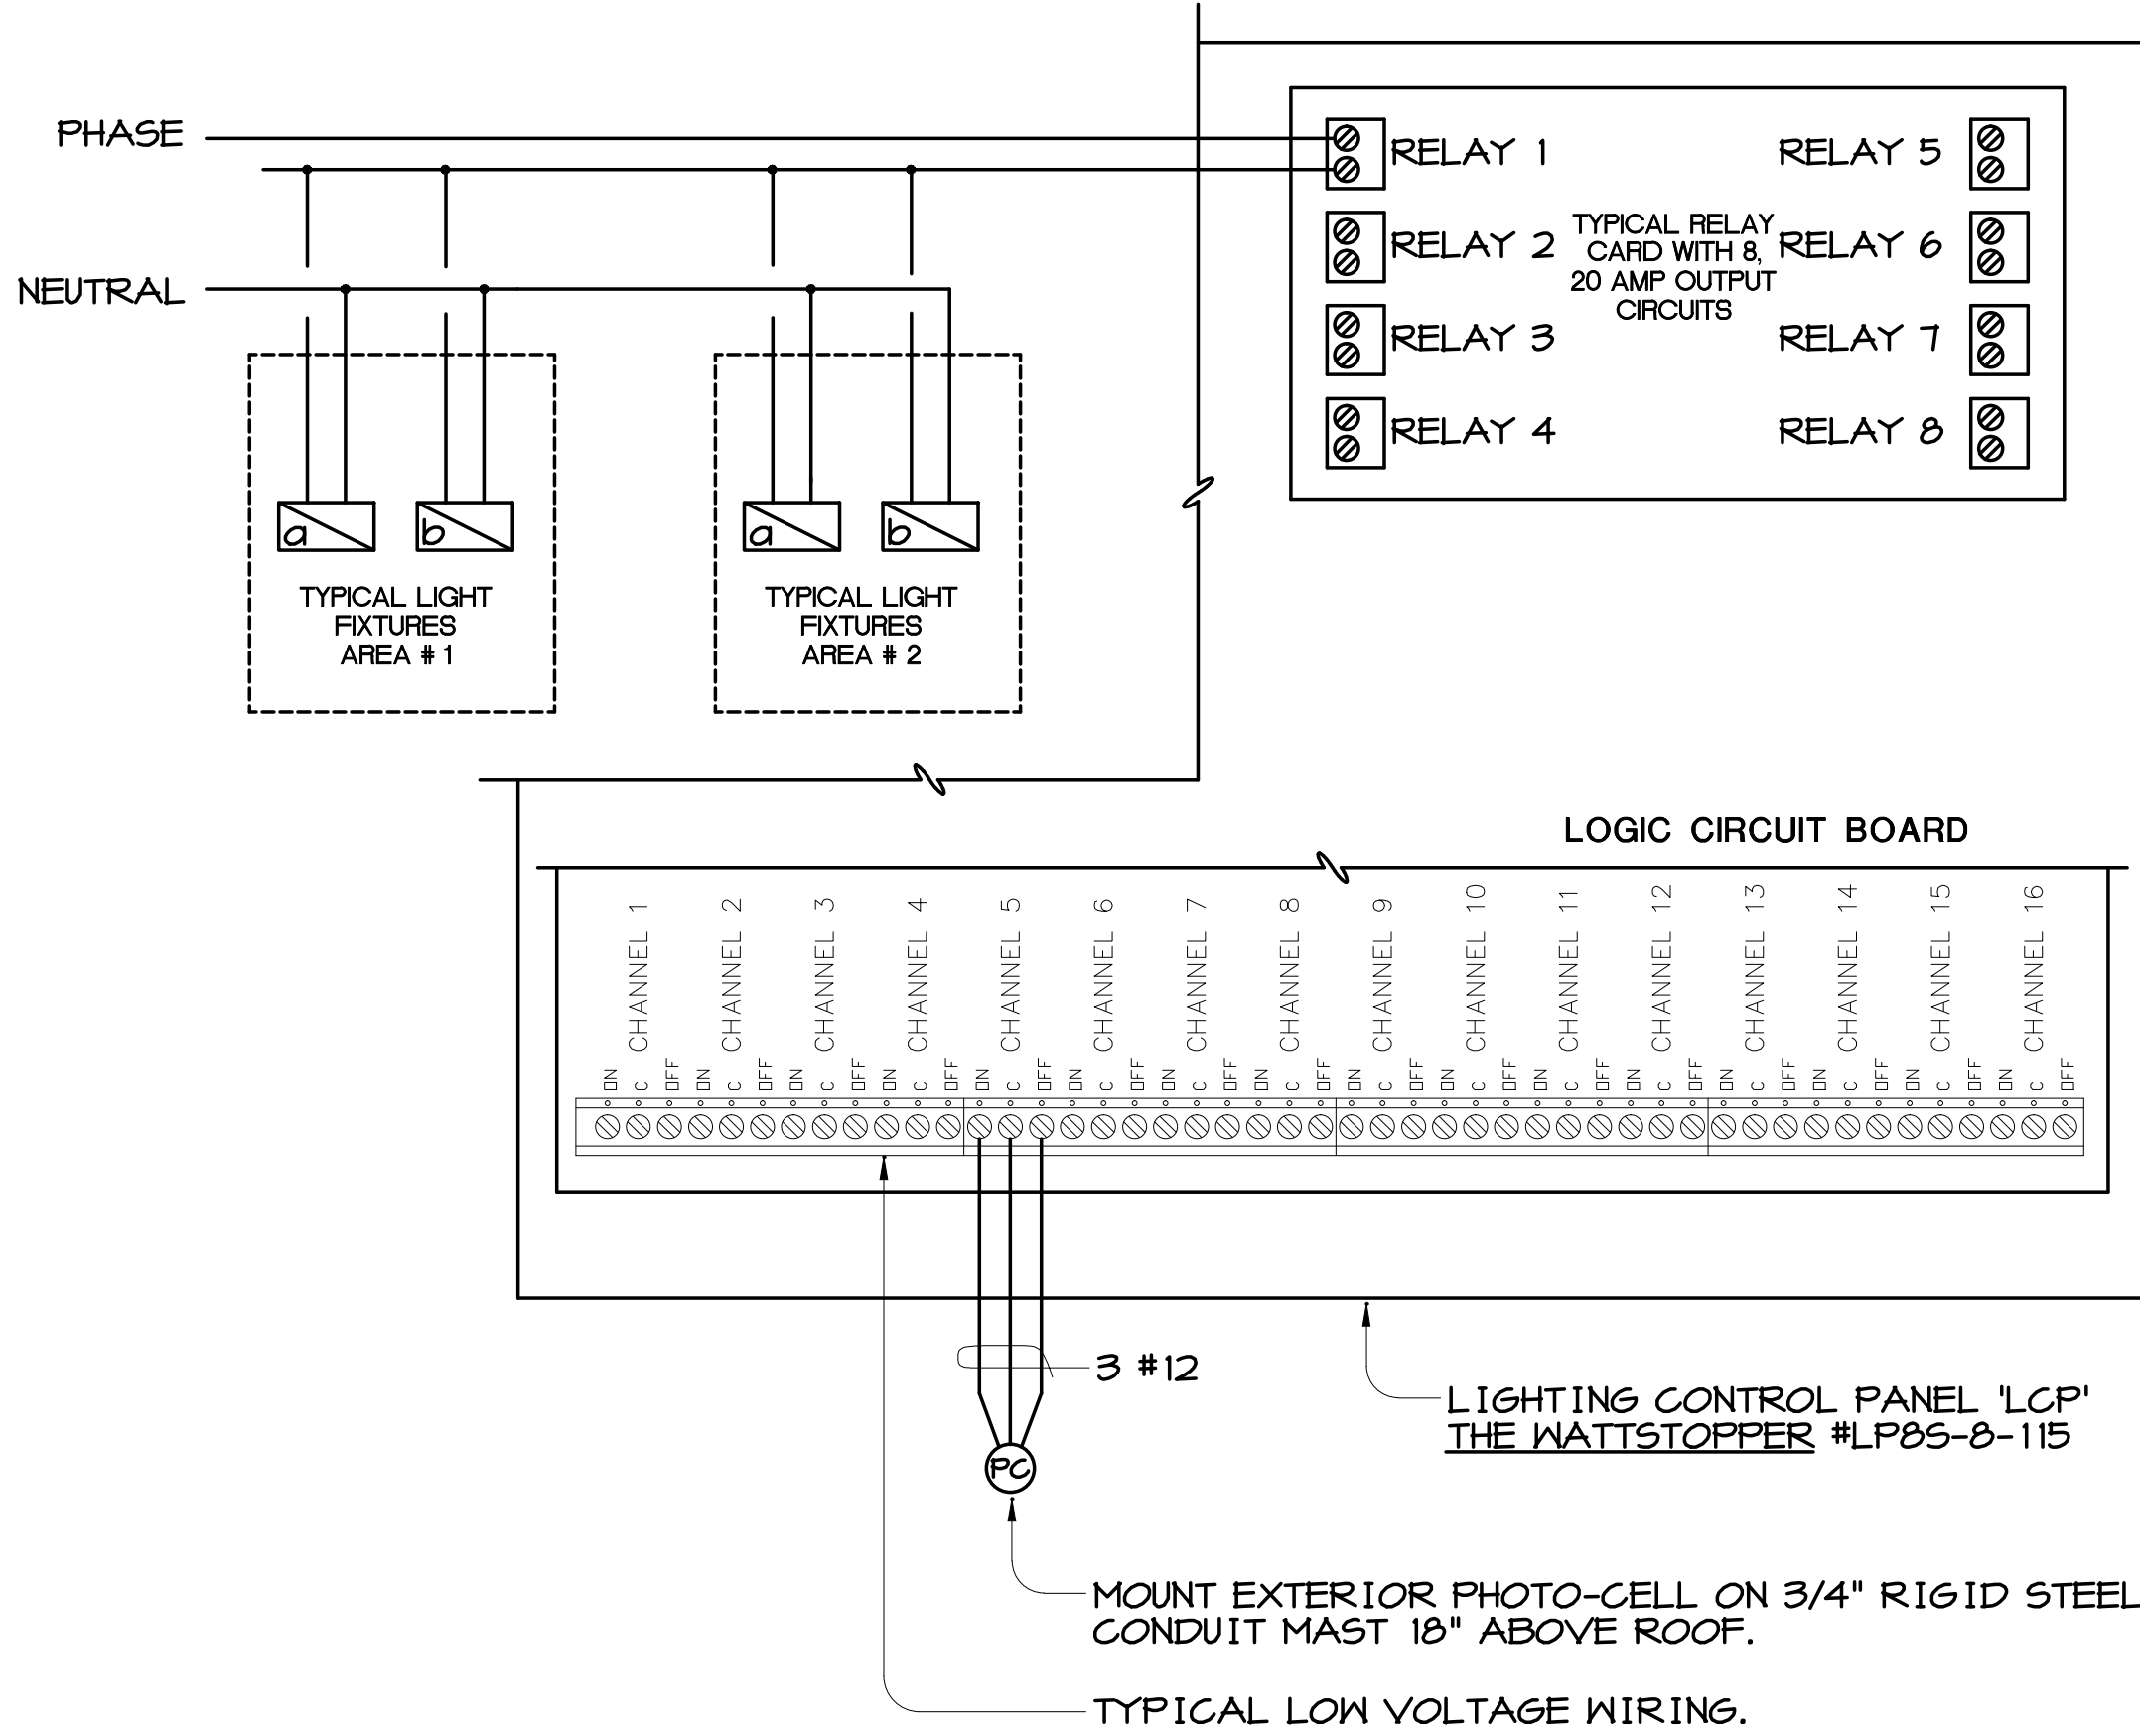


1 TYPICAL - LIGHTING CONTROL WIRING DIAGRAM

SCALE: NONE

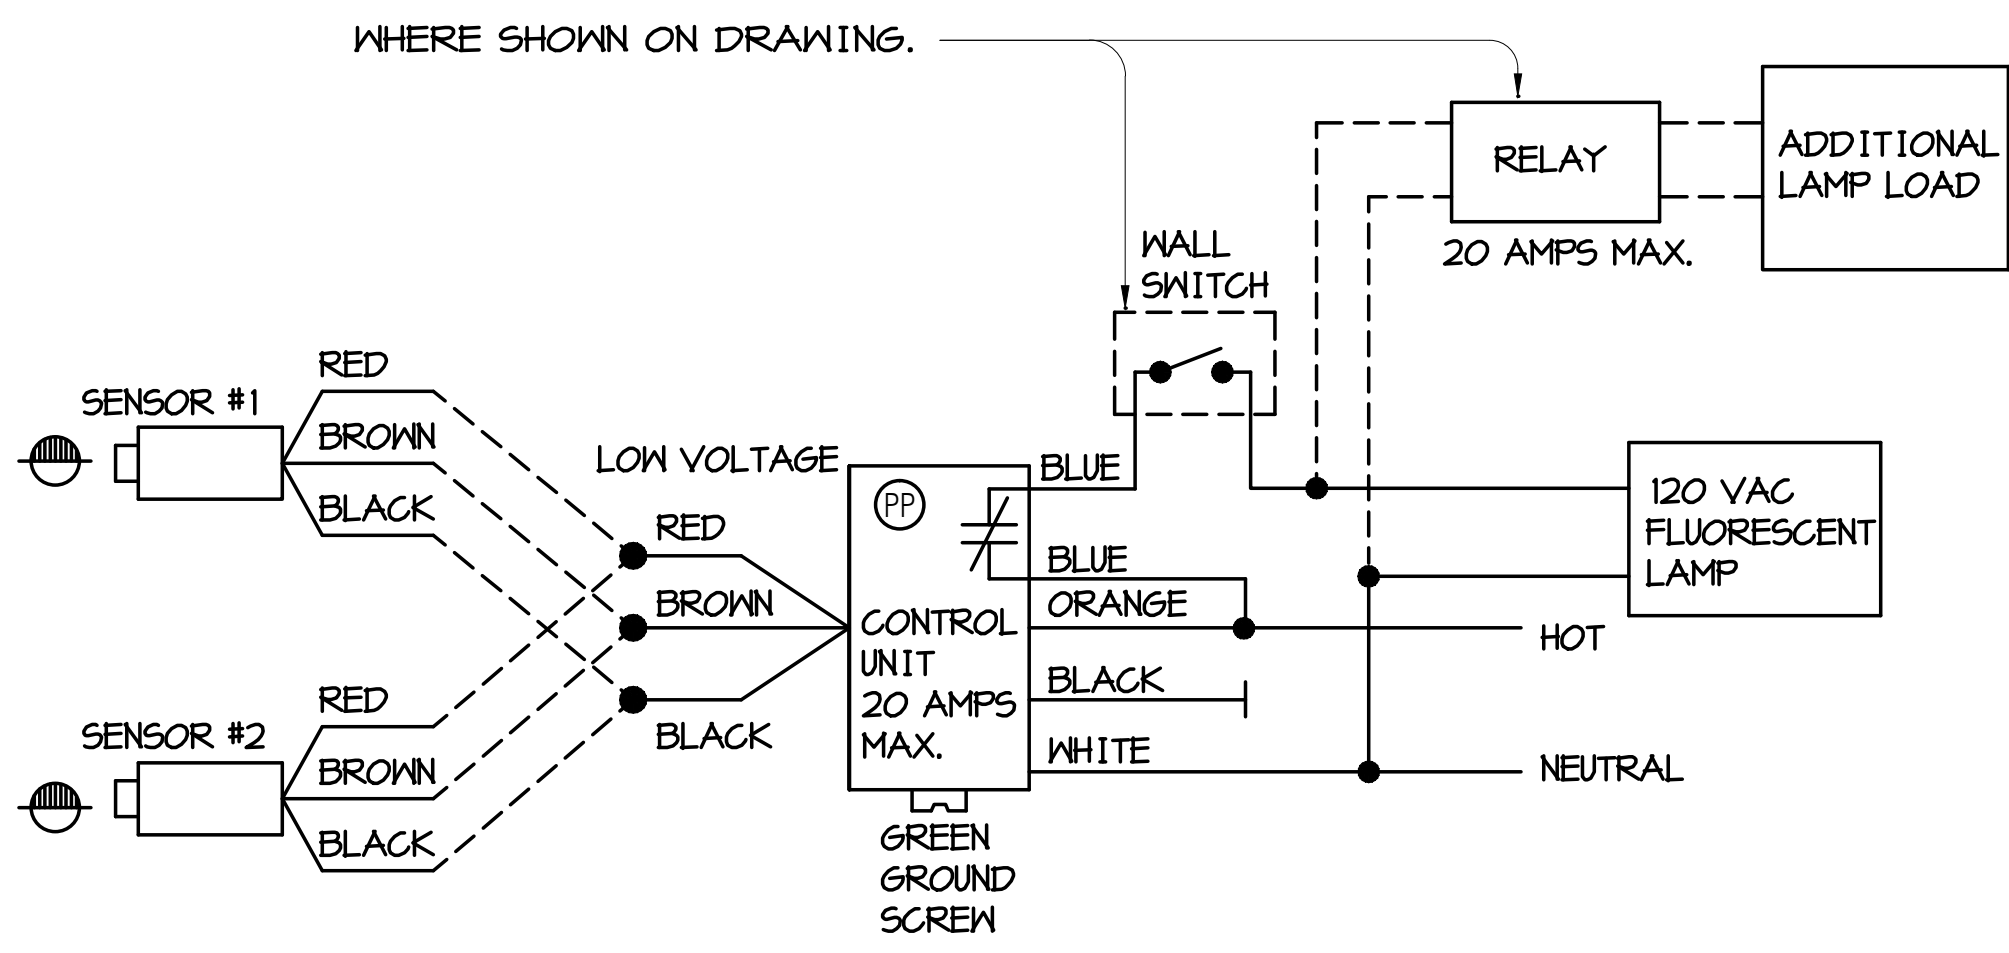


2 TYPICAL - MOTION SWITCHING SYSTEM WIRING DIAGRAM

NO SCALE

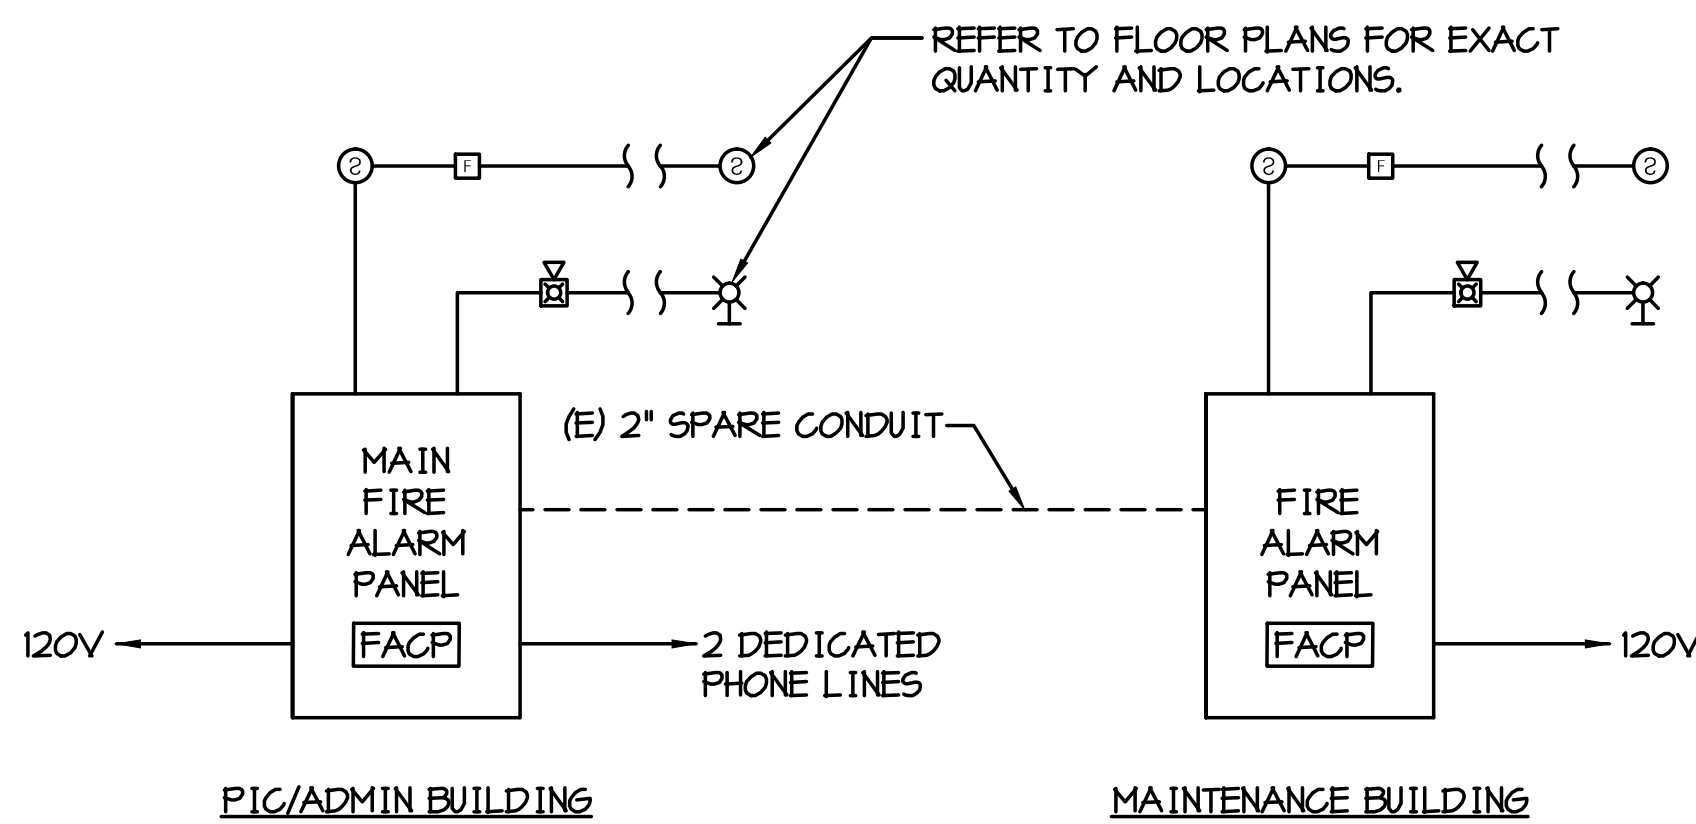


4 FIRE ALARM SCHEMATIC

NO SCALE

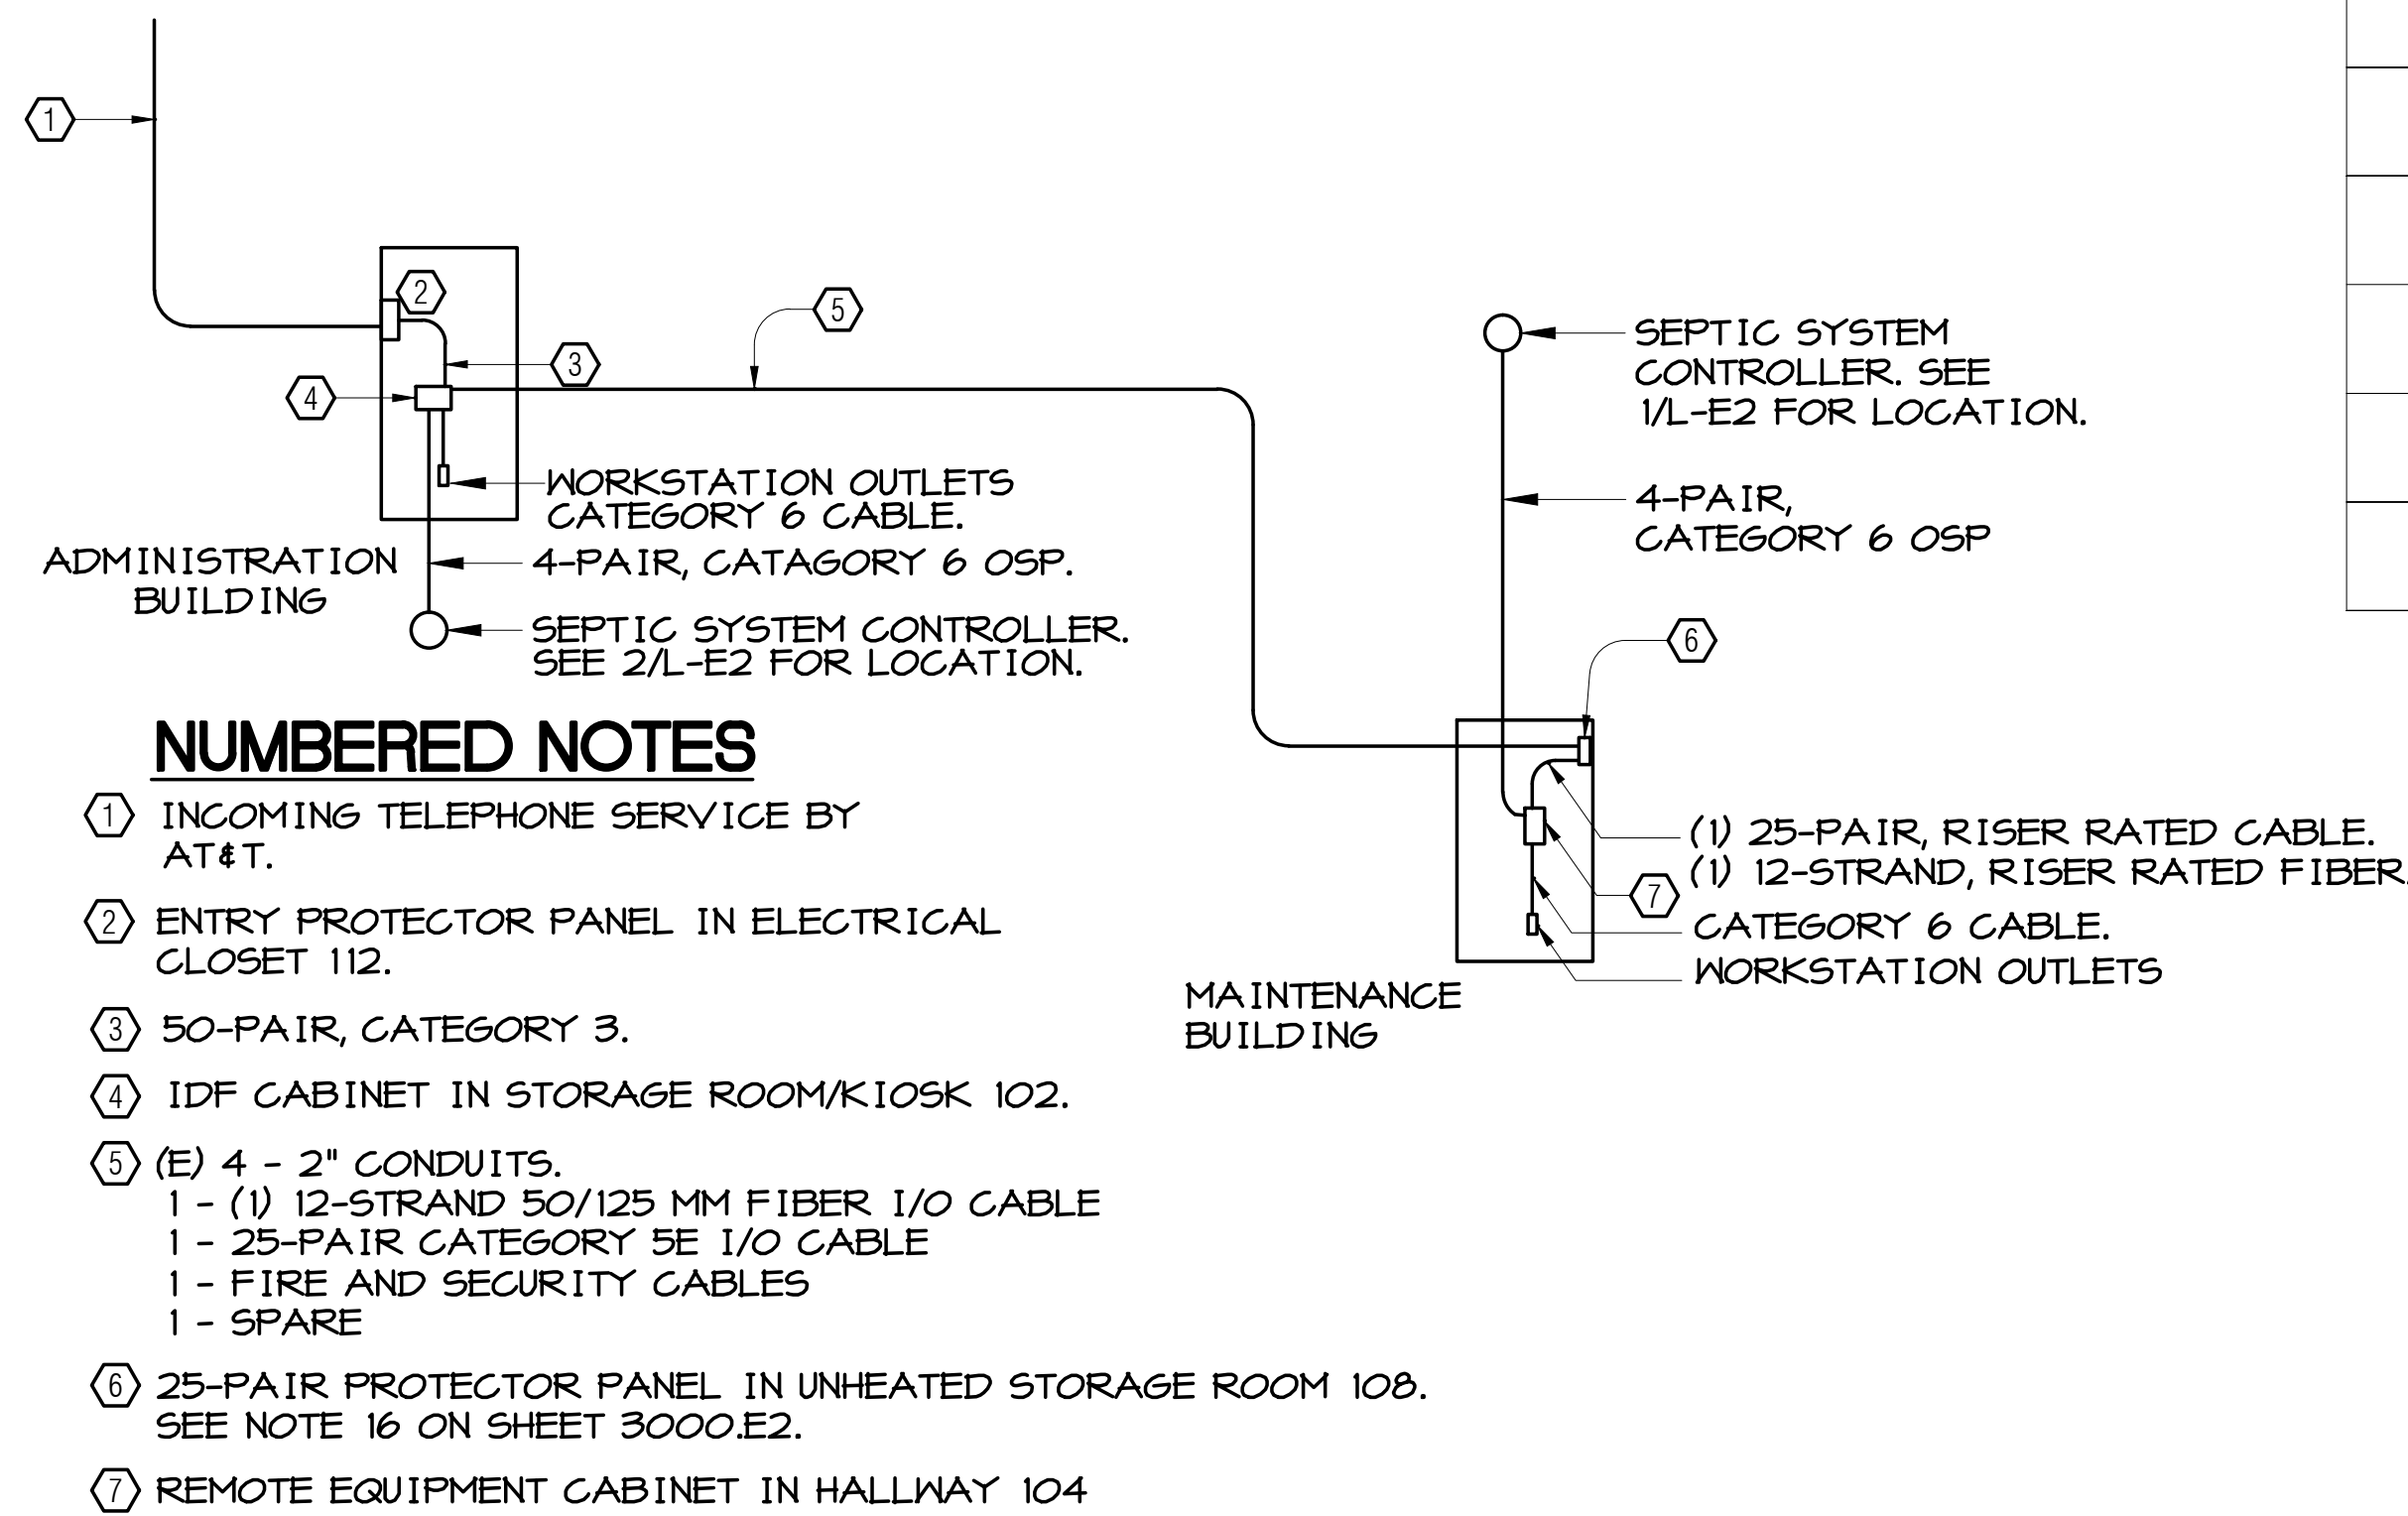

3 ONE-LINE TELECOMMUNICATIONS DIAGRAM

NO SCALE

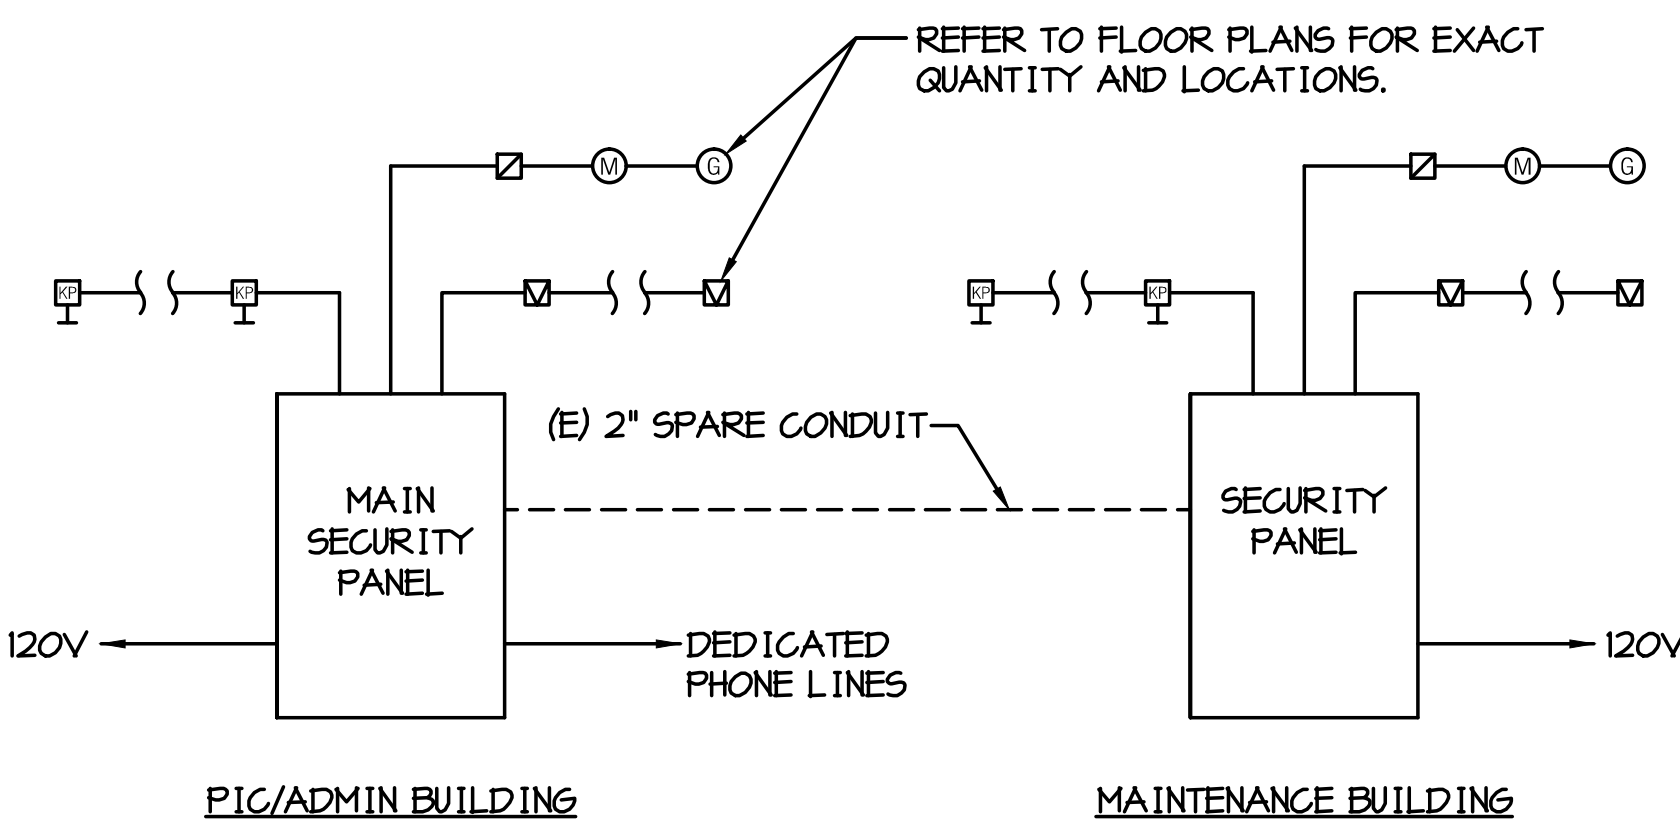

5 SECURITY SYSTEM SCHEMATIC

NO SCALE

MECHANICAL EQUIPMENT SCHEDULE

DESIGNATION	VOLTAGE/PHASE	EQUIPMENT	HP	FLA	KVA	REMARKS
HP 1	230/1	HEAT PUMP	1/3	3.0	-	-
HP 2	230/1	HEAT PUMP	1/3	3.0	-	-
HP 3	230/1	HEAT PUMP	1/3	3.0	-	-
HP 4	208/1	HEAT PUMP	1	9.5	-	-
CU 1	230/1	CONDENSING UNIT	-	20	-	-
CU 2	230/1	CONDENSING UNIT	-	15	-	-
CU 3	230/1	CONDENSING UNIT	-	20	-	-
CU 4	208/1	CONDENSING UNIT	-	34	-	-
EW 1	240/1	ELECTRIC WATER HEATER	-	20.8	5.0	-
EW 2	208/3	ELECTRIC WATER HEATER	-	37.5	4.0	-
CP 1	120/1	DOMESTIC WATER CIRCULATION PUMP	1/25	0.48	-	-
CP 2	120/1	DOMESTIC WATER CIRCULATION PUMP	1/25	0.48	-	-
SAC 1	208-230/1	SPLIT AIR CONDITIONING UNIT	-	1.18	0.03	-
SCU 1	208-230/1	SPLIT CONDENSING UNIT	-	4.0	2.16	-
EUP 1	208/1	ELECTRIC UNIT HEATER	1/40	13.1	2.6	-
EUP 2	208/1	ELECTRIC UNIT HEATER	1/40	13.1	2.6	-
EUP 3	208/1	ELECTRIC UNIT HEATER	1/40	13.1	2.6	-
EUP 4	208/1	ELECTRIC UNIT HEATER	1/40	13.1	2.6	-
EF 1	120/1	EXHAUST FAN	1/4	5.8	.70	-
EF 2	120/1	EXHAUST FAN	1/4	5.8	.70	-
EF 3	120/1	EXHAUST FAN	1/4	5.8	.70	-
EF 4	120/1	EXHAUST FAN	1/4	5.8	.70	-

CONSTRUCTION DOCUMENTS

CONSTRUCTION DOCUMENTS

Revisions		Date		Subconsultant List		Drawing Title		Project Title		Date:	
				DREYFUSS & BLACKFORD		MECHANICAL SCHEDULE AND WIRING DIAGRAMS		LOUISIANA NATIONAL CEMETERY GRAVESITE EXPANSION PHASE 1B		MARCH 22, 2012	
				CAPITAL ENGINEERING CONSULTANTS		Approved: Director, Office of Construction Management		Building Number		Project No.	
				ECOM ENGINEERING INC.		Approved: Director, Project Management Service		Checked: MSS		870CM3023B	
				BUEHLER & BUEHLER STRUCTURAL ENGINEERS, INC.		Location		LOUISIANA NATIONAL CEMETERY ZACHARY, LOUISIANA		DRAWING NO.	
				W.L. BURLE ENGINEERS, PA						E-2	
				AQUA ENGINEERING, INC.						Dwg. 126 of 137	
				THE SIERRA WEST GROUP, LLC							