one eighth inch = one foot
0 4 8 16

one quarter inch = one foot
0 4 8

three eighths inch = one foot
0 4

one half inch = one foot
0 4

three quarters inch = one foot
6" 0 2

one inch = one foot
6" 0 2

one and one half inches = one foot
6" 0 1

three inches = one foot
6" 0

VA FORM 08-6231, OCT 1978

Revisions

Date

Professional Seal

Drawing Title
ELEVENTH FLOOR PLAN
FIRE PROTECTION

Approved: Project Manager

Approved: Service Chief

Project Title

Building Number
01

Checked

Drawn

Location
VAMC, WILKES BARRE
PENNSYLVANIA

Date
10-20-2004

Project No.

Drawing No.

VAMC, WILKES BARRE

VA Department of Veterans Affairs

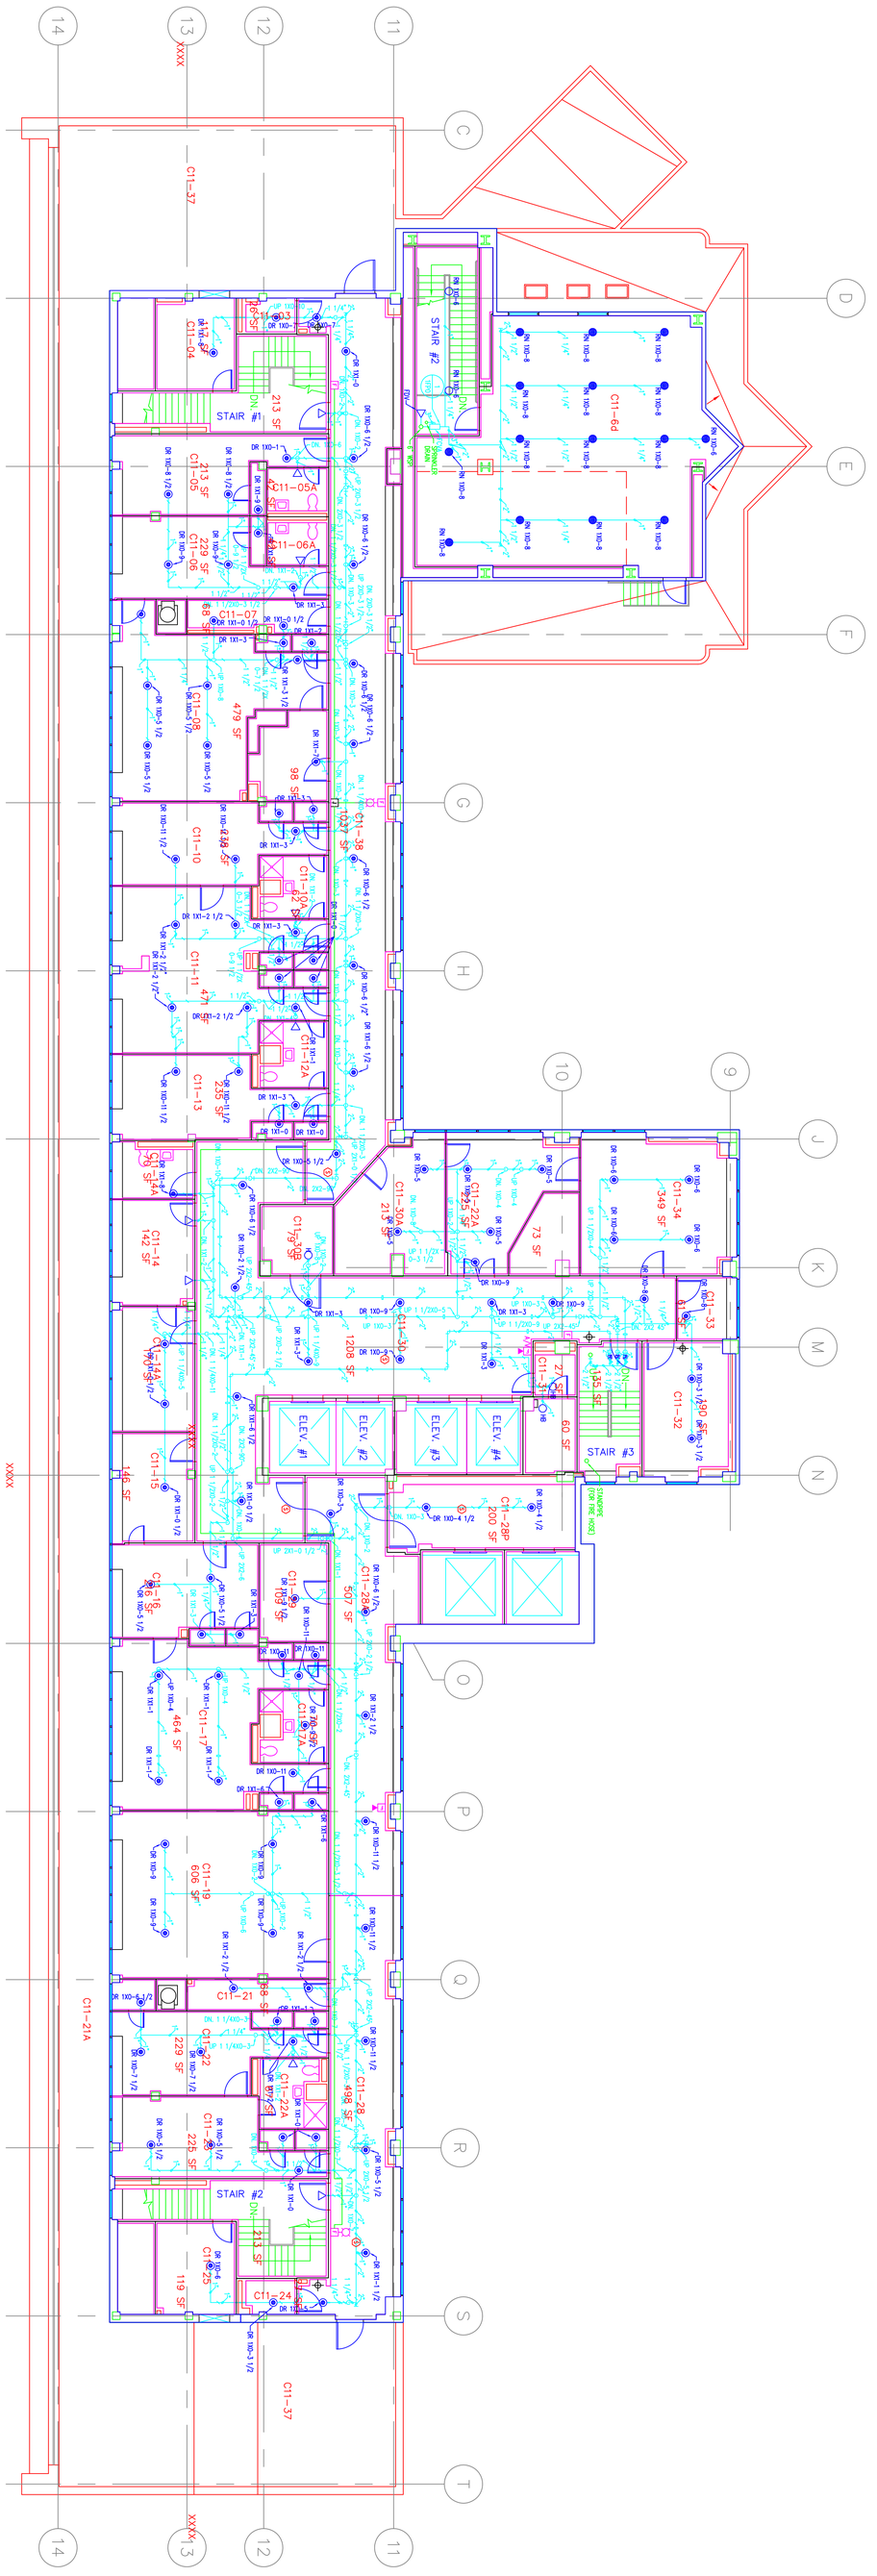

FIRE PROTECTION LEGEND

SYMBOL	NAME	DESCRIPTION
○	PNDTSPR	PENDENT SPRINKLER
◉	PNDTSPRN	PENDENT SPRINKLER
●	UPRTSPRN	UPRIGHT SPRINKLER
○	UPRTSPRR	UPRIGHT SPRINKLER
◉	DRYPNDT	DRY PENDENT SPRINKLER
⊜	FPNDTSPR	FLUSH PENDENT SPRINKLER
▷	SPRSKCR	SPRINKLER - SIDEWALK
◔	SPRSKCL	SPRINKLER - SIDEWALK
◑	PNDTSPRC	PENDENT SPRINKLER
⊗	SPRHEAD	SPRINKLER - HEAD
○	TEEUPAP	TEE ELBOW UP
○	AUXUPDN	AUXILIARY DRAIN
⊂	TEEUPDWN	TEE ELBOW DOWN
○	RISER	RISER
∩	ELBOWDN	ELBOW DOWN
○	DRIP	DRIP
ⓓ	HDETCR	HEAT DETECTOR
ⓢ	SMKDETCR	SMOKE DETECTOR
⋈	GATEVLV	GATE VALVE
⋈	SHUTOFFV	SHUT OFF VALVE
⋈	PRCTRLVL	TWO-WAY MODULATING CONTROL VALVE
⋈	GLOVLVE	GLOVE VALVE
⋈	BFLYVALV	BUTTERFLY VALVE
⋈	CHECKVLV	CHECK VALVE
—	SNGHANG	SINGLE HANGER
—	ELBOW-0	ELBOW-0
⌐	ELBOW-90	ELBOW-90
⊐	TEE-PLAN	TEE-PLAN
▭	GROVCOUP	GROOVED COUPLING
—	GROVCAP	GROOVED CAP
⋈	GSWVLV	U.S. & Y. GATE VALVE
=	GUIDE	PIPE GUIDE
—	SNGHANG	SINGLE HANGER
⊙	FAMBELL	FIRE ALARM BELL
◧◢	AVDVSR	FIRE ALARM AUDIO/VISUAL DEVICE
◧◢	FAHORN	FIRE ALARM HORN
F	FAPULSTN	MANUAL FIRE ALARM PULL STATION
F	FLOWSW	FLOW SWITCH
T	TAMPERSW	TAMPER SWITCH
◫	CABVV-C	CEILING MOUNTED JUNCTION BOX
□	CROSS	CROSS
FACP	FACP	FIRE ALARM CONTROL
▣	WETSUCW	WET PIPE FLOW SWITCH
Z	ZAM	ZONE ADDRESS MODULE
□	FAPANEL	FIRE ALARM PANEL
□	FEQUIP	FIRE EQUIPMENT
⋈	RELIEFVLV	RELIEF VALVE
◇	SOLNOVLV	SOLENOID VALVE
⊡	STROBEWALL	STROBE UNIT WALL MOUNTED
⊟	KEYBOARD	KEY BOARD
⊕	FIREXTGR	FIRE EXTINGUISHER