

# AC-PRO

AC TRIP UNIT

MICRO-CONTROLLER BASED

DATA SHEET

*State of the art technology for low voltage circuit breaker retrofitting*

## Standard trip unit functions

- ☐ Long-Time
- ☐ Short-Time
- ☐ Instantaneous
- ☐ Ground Fault
- ☐ Phase Unbalance

All functions are selectable ON/OFF, with the exception of the Long-Time function, during programming.

## True RMS

The AC-PRO is true RMS sensing on all functions, including Instantaneous.

## Programming

Settings are programmed using the ▲, ▼, and **SAVE** buttons on the front of the trip unit. All settings and last trip data are stored in non-volatile memory.

Security is provided by a **SECURITY KEY**, which must be plugged into the top of the trip unit before any trip settings can be changed.

## 16-Character LCD

The large backlit display provides continuous 3-phase current metering when the trip unit is in service. Last Trip Data and trip settings can be reviewed at any time by pressing the **REVIEW** key.


The ♦ button on the front of the trip unit is provided to adjust the LCD's contrast.

## Last Trip Data

The trip unit retains the data from the most recent trip in non-volatile memory. This information includes the type of trip and the individual phase currents at the time of trip. This information can be reviewed at any time by pressing the **REVIEW** button.

Continually pressing the **REVIEW** button will display a trip counter, which indicates the number of times the trip unit has operated on each function. The present trip unit settings will also be displayed.

Last trip data and the trip counter can be cleared at any time.

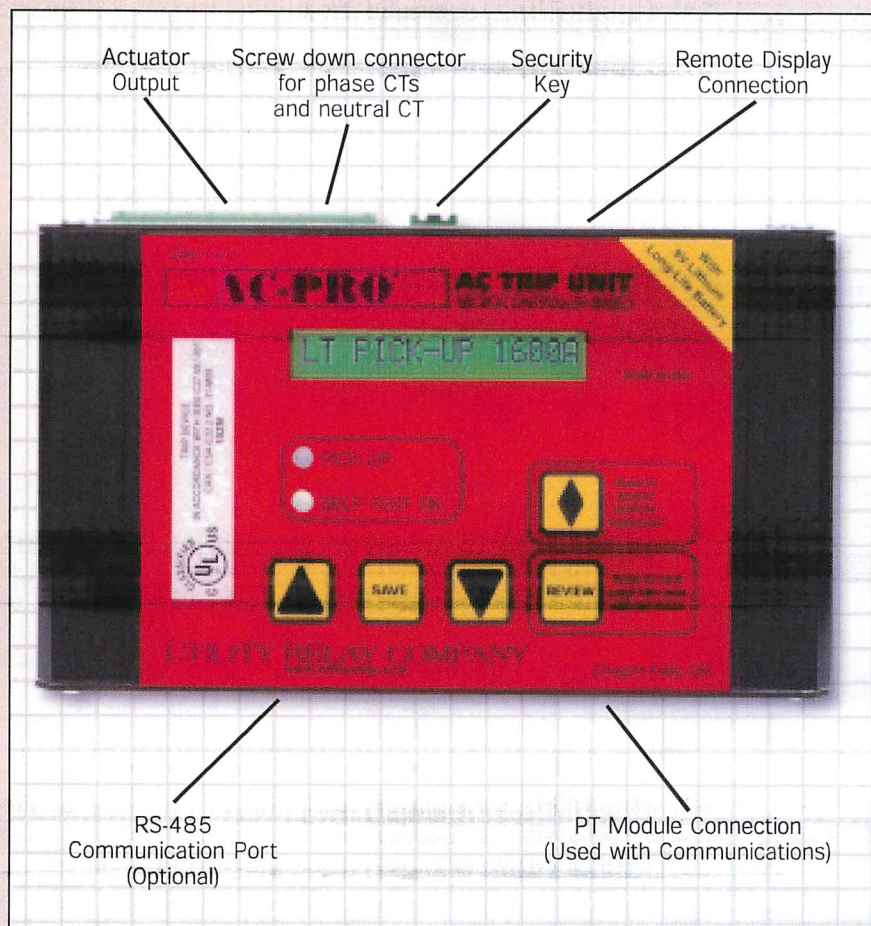

## PICK-UP Indication

The red LED on the front of the trip unit illuminates when current reaches or exceeds the Long-Time pick-up value.

## SELF-TEST OK Feature

The green LED indicates that the trip unit is operating properly. This feature:

- ☐ Continuously monitors the trip unit.
- ☐ Verifies that the actuator is connected.
- ☐ Monitors software routines.
- ☐ Monitors micro-controller.

## Special Applications

In addition to the standard 60Hz model, the AC-PRO is available in true RMS versions for 50Hz, 40Hz, and 25Hz power systems.

## Construction

- ☐ Rugged extruded aluminum housing.
- ☐ Conformally coated circuit boards.
- ☐ Contamination resistant membrane keypad.

## Warranty

2-year limited warranty.



**URC** Utility Relay Company



# AC-PRO

AC TRIP UNIT

MICRO-CONTROLLER BASED

DATA SHEET

## Complete Retrofit Kits

The AC-PRO can be supplied as part of a complete retrofit kit. Kits include all necessary brackets, mounting hardware, wiring, actuator, and installation documentation and instruction manuals.



AC-PRO retrofit Kit for G.E. AK-2-25

Kits available from stock include:

### General Electric

AK AKR AKRT AE AL

### Westinghouse

DA DB DBL DK DS DSL

### I-T-E

K KA KB KC KD KE

LG LX LK

### Siemens / Allis-Chalmers

LA-Blue LA-Gold LA-15

LA-25 LA-50 LA-75

G RL RLX

### Federal Pacific/Federal Pioneer

FP FPS FM DMB H1 H2 H3

### Sylvania/Unelec

SSPB CN2

### Roller Smith

RS BD HD

## Secondary Injection Test Set

The Model B-291 test set is micro-controller based and designed to test the AC-PRO trip unit.



The test set features a selectable frequency for testing the 60Hz, 50Hz, 40Hz and 25Hz versions of the AC-PRO.

## AC-PRO Direct Replacement

The AC-PRO trip unit is designed to use existing 1/2 or 1 amp CTs and operate the magnetically latched OEM actuators used with many older style electronic trip units.

Reusing the existing CTs and actuator can greatly reduce material costs and cut installation time to a fraction of that required for a complete retrofit.



Direct Replacement of a Static-Trip II on a Allis Chalmers LA-600 breaker

## Trip Unit Acceptance Testing


In addition to being UL CLASSIFIED and short circuit tested in accordance with ANSI C37.59, the AC-PRO has been independently tested to, and passed the following:

- ☐ ANSI/IEEE C37.90.1 – Oscillatory Wave Surge Test.
- ☐ ANSI/IEEE C37.90.1 – Fast Transient Test.
- ☐ ANSI/IEEE C37.90.2 – RFI Test.
- ☐ Capacitive Discharge Test – 1.5 kA, 80 & 180  $\mu$ s pulses applied to primary CT inputs superimposed on load current.
- ☐ Electrostatic Discharge Test – 8 kV and 15 kV direct air discharge applied to trip unit.
- ☐ Insulation Test – 2.2 kVAC, 60 Hz applied for 60 sec.
- ☐ Environmental Test – Secondary injection test trip unit at -20, +23 and +65 C. Minimum exposure of eight hours at each temperature.

## RS-485 Communications Port

The optional communications port uses the industry standard MODBUS RTU protocol. Multiple trip units can be daisy-chained together using a single shielded twisted pair wire.

Additional components supplied with a communications ready AC-PRO retrofit kit include: PT Module and cable, Communications Cable, cell wiring accessories, mounting brackets and hardware.

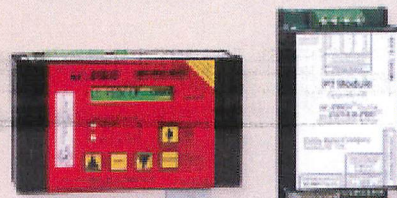

## Information monitored includes:

- ☐ Currents, 3-Phase
- ☐ Voltages, 3-Phase, L-L & L-N
- ☐ KW, 3-Phase
- ☐ KWH, Total
- ☐ Power Factor, 3-Phase
- ☐ Breaker Position
- ☐ Last Trip Data
- ☐ Trip Counter
- ☐ Alarm Conditions
- ☐ Trip Unit Settings

The AC-PRO also features remote programmability, which allows trip settings to be programmed remotely from a PC. Two addressable form-C contacts are also supplied with the PT module.

With the addition of an LCI (Local Communications Interface), multiple AC-PRO trip units can communicate directly across a local area network.

## The LCI Features:

- ☐ 4-line X 20-character display
- ☐ Rugged NEMA 4X enclosure
- ☐ RS-485 Input
- ☐ 10Base-T Ethernet port
- ☐ Programmable IP Address
- ☐ Embedded WEB Pages
- ☐ 2-year Limited Warranty

Call Toll Free: 888.289.2864

For additional information visit our website:  
[www.utilityrelay.com](http://www.utilityrelay.com)

**URC** Utility Relay Company

10100 Queens Way, Chagrin Falls, OH 44023  
Phone: 440-708-1000 Fax: 440-708-1177