

544 303
Correct Police and Security Space Deficiencies
ADDENDUM ONE

1. Delete specification section 01 00 00 1.3 and replace with the following:

Base Bid Item 1

Minor demolition of a small portion of an existing asphalt parking lot is required. Minor grading and fill to accommodate a slightly sloping lot is also required. No site contamination is anticipated. A single-story building for administrative offices and police training is to be constructed. Tie-in to existing utilities is required. Exterior construction is brick veneer over concrete masonry unit walls. Roof is planned to be standing seam hip. Interior construction is typical CMU and gypsum wallboard over steel stud framing. Typical finishes of acoustical ceilings in office and tasking areas and hard ceiling in restrooms and secure areas.

Bid Item 2

Deductive Alternate I - Same as Item 1 except: Change LED lighting to fluorescent lighting.

Bid Item 3

Deductive Alternate II - Same as Item 2 except: Delete exterior signage and floor logo.

Bid Item 4

Deductive Alternate III - Same as Item 3 except: Delete all work on new parking.

Bid Item 5

Deductive Alternate IV - Same as Item 3 except: Delete metal roofing and add asphalt shingle roofing.

Bid Item 6

Deductive Alternate V - Same as Item 3 except: Delete brick veneer and add stucco.

2. Delete specification section 01 00 00 1.4
3. Insert specification section 01 00 00 1.9 behind specification section 01 00 00 1.7.
4. Insert specification section 01 00 00 1.10 Restoration into the specifications.

5. Contractor is advised that specification section 01 00 00 1.8 is behind specification section 01 00 00 1.31.
6. Delete all references in the specifications table of contents to “bookmark error”.
7. Insert the attached Construction Risk Assessment into the specifications. All requirements of the Construction Risk Assessment are made contractual by inclusion in the project specifications.
8. Amend specification section 01 00 1.11 Physical Data to indicate that soil boring report is included in the contract solicitation documents.
9. Insert specification section 01 32 16.15
10. Insert addendum to specification section 01 33 23
11. Amend specification section 01 45 29 3.1 B 2 a to require subgrade test for building slab every 500 square feet.
12. Amend specification section 01 45 29 3.1 C to require fill and backfill material gradation for each source of material.
13. Delete specification section 01 45 29 1.1 Description and replace with the following specification: 1.1 Description: This section specifies materials testing activities and inspection services required during project construction to be provided by a testing laboratory retained by the contractor. The contractor shall pay for any and all testing required by the drawings and specifications.
14. Amend specification section 01 45 29 3.13 to include the approximate number of tests required:

a. Earthwork	
i. Compaction Tests	30
ii. Field density	30
iii. Penetration Tests	10
b. Landscaping	
i. Topsoil test	3

c. Aggregate Base	
i. Laboratory compaction	5
ii. Field density	10
iii. Aggregate gradation	10
iv. Wear	3
v. Soundness	3

d. Asphalt Concrete

i. Field density	5
ii. Aggregate gradation	5
iii. Wear	3
iv. Soundness	3
e. Concrete	
i. Making cylinders	30 sets of three
ii. Compressive strength	30 sets of three
iii. Slump tests	30
iv. Air content	30
v. Unit weight	30
vi. Gradation	30
vii. Unit weight	30
viii. FF and FL	6
f. Reinforcing Steel	
i. Tensile test	10
ii. Bend test	10
iii. Mechanical splice	5
iv. Welded splice	5
g. Masonry	
i. Test cubes	50
ii. Strength test cubes	50
iii. Mortar strength	50
iv. Grout strength	50
v. Masonry strength	10
vi. Prism test	3
h. Structural Steel	
i. Ultrasonic weld tests	30
ii. Magnetic weld tests	10
iii. Radiographic welds	30

i. Technical Personnel

j. Technicians

k. Must meet test and inspection requirements

15. Insert specification section 02 82 13.13.

16. Insert specification section 02 83 13.13

17. Amend specification section 03 30 00 2.4 A. to manufacture concrete within 15 miles of the project site.

18. Amend specification section 03 30 00 2.9 A. 1. to “minimum compressive strength: 4000 psi at 28 days.”

19. Amend specification section 03 30 00 3.12 to “Special Inspections: The contractor shall engage a special inspector and qualified testing and inspecting agency to perform field tests and inspections and prepare test reports.”
20. Amend specification section 08 71 00 to require where any keyed lock is specified to be replaced with Medeco Mortise Cylinder electronic locks to match existing hospital system.
21. Insert specification section 09 30 13.
22. Replace specification section 09 91 00 with the attached new specification 09 91 00.
23. Insert specification section 10 28 00.
24. Insert specification section 10 44 13.
25. Insert specification section 12 31 00.
26. Insert specification section 26 05 73.
27. Insert specification section 26 56 00.
28. Replace specification section 31 20 00 1.1 with the following:

1.1 DESCRIPTION

This section specifies the requirements for furnishing all equipment, materials, labor and techniques for earthwork including excavation, fill, backfill and site restoration utilizing fertilizer, seed and/or sod. All earthwork shall be the responsibility of the contractor. In the event unsuitable materials are encountered as defined in other sections, by the testing firm, or the COR, the unsuitable area shall be measured with neat line measurements. The material will be excavated and backfilled with material meeting other specifications.

Method of Payment - The contractor shall include in the bid proposal a unit price per cubic yard for removal of unsuitable material. The contractor shall also include a unit price per cubic yard for backfill. The contractor shall include in the daily report of construction the quantities of these items performed that day.

Contract Allowance - Contractor shall provide a unit price for 1,500 cubic yards of removal of unsuitable material. Contractor shall provide a unit price for 1,875 cubic yards of backfill. This amount shall be included in the base bid price for the fixed price contract. This item shall be shown as a line item in the base bid. In the event that additional removal of unsuitable material and backfill is needed, a contract modification will be executed at the same unit prices as provided in the base bid.

Unused Allowance Quantity - Any amounts not used in the execution of the contract shall be credited back to the government in the form of a credit modification.

29. Amend Drawing ES101 Sheet Note 1 to require that the 3 4” conduits be encased in 3000 PSI concrete with a 3” encasement around each conduit and the entire bank of conduits.

30. Amend Drawing ES101 Sheet Note 6 to delete the use of the existing manhole. The contractor shall provide for the communication conduits to enter a new telecommunication manhole constructed by the contractor reasonably close to the existing manhole. The communications shall then be routed into Building 100 into Room LA104. The contractor shall be responsible for providing any and all work necessary for this routing and wiring. Provide one (1) 12 strands of single mode fiber for fire alarm, phone, DDC controls, and other requirements. Provide cable television wiring and cabling for the requirements listed below. Provide cabling and wiring from Building 100 to provide cable television to the following locations: Room 118 plan north center of wall, Room 113 plan south center of wall, and Room 102 plan south center of wall. This wiring and cabling shall be run in inner duct as provided on this drawing. Provide for a cable wall outlet at each of these locations. Provide 25 pair of copper for telephone and other requirements.

31. Delete the reference in the specifications table of contents for the following specification sections:

- a. 05 36 00 Composite Metal Decking
- b. 06 20 00 Finish Carpentry
- c. 09 05 16 Subsurface Preparation for Floor Finishes
- d. 21 05 11 Common Work Results for Fire Suppression
- e. 21 05 12 Motor Requirements for Fire-Suppression Equipment
- f. 21 08 00 Commissioning of Fire Suppression System
- g. 21 10 00 Water-Based Fire-Suppression System
- h. 21 12 00 Fire Suppression Standpipes
- i. 26 05 13 Medium-Voltage Cables
- j. 26 05 36 Wire ways for Radiology Equipment
- k. 26 05 39 Underfloor Raceways for Electrical Systems
- l. 26 11 16 Secondary Unit Substations
- m. 26 12 19 Pad-Mounted, Liquid-Filled, Medium-Voltage Transformers
- n. 26 13 13 Medium Voltage Circuit Breaker Switchgear
- o. 26 13 16 Medium-Voltage Fusible Interrupter Switches
- p. 26 20 11 Isolated Power Systems
- q. 26 23 00 Low-Voltage Switchgear

- r. 26 23 13 Generator Paralleling Controls
 - s. 26 24 13 Distribution Switchboards
 - t. 26 24 19 Motor Control Centers
 - u. 26 25 11 Busways
 - v. 26 29 11 Motor Controls
 - w. 26 33 53 Static Uninterruptible Power Supply
 - x. 26 35 26 Harmonic Filters
 - y. 26 42 00 Cathodic Protection
 - z. 26 55 71 Medical and Surgical Lighting Fixtures
-
- 1 27 31 31 Voice Communications Switching and Routing Equipment - Extension
 - 2 27 32 41 Two-Way radio Equipment and Systems
 - 3 27 41 31 Master Antenna Television Equipment and Systems
 - 4 27 51 23 Intercommunications and Program Systems
 - 5 27 52 23 Nurse Call and Code Blue Systems
 - 6 27 52 31 Security Emergency Call, Duress Alarm, and Telecommunications
 - 7 27 52 41 Miscellaneous Medical Systems
 - 8 27 53 19 Distributed Radio Antenna (Within Building) Equipment and System
 - 9 28 13 53 Security Access Detection
 - 10 28 26 00 Electrical Personal Protection System
 - 11 31 20 11 Earthwork (Short Form)
 - 12 31 23 19 Dewatering
 - 13 31 32 23 Pressure Grouting Soil Stabilization
 - 14 31 62 00 Driven Piles
 - 15 31 63 16 Auger Cast Grout Piles
 - 16 31 63 26 Drilled Caissons
 - 17 32 14 16 Brick Unit Paving
 - 18 32 31 13 Chain Link Fences and Gates
 - 19 32 31 53 Perimeter Security Fences and Gates
 - 20 32 84 00 Planting Irrigation
 - 21 32 90 00 Planting
 - 22 33 08 00 Commissioning of Site Utility Systems
 - 23 33 46 13 Foundation Draining
 - 24 33 51 00 Natural-Gas Distribution
 - 25 33 63 00 Steam Energy Distribution
-
- 31. Amend Drawing QH101 Equipment Schedule to change the following:
 - a. F2017 to CC
 - b. R7250 to CC
 - c. A1040 to CC
 - d. A1015 to VV

1.8 DISPOSAL AND RETENTION

A. Materials and equipment accruing from work removed and from demolition of buildings or structures, or parts thereof, shall be disposed of as follows:


1. Reserved items which are to remain property of the Government are noted on drawings or in specifications as items to be stored. Items that remain property of the Government shall be removed or dislodged from present locations in such a manner as to prevent damage which would be detrimental to re-installation and reuse. Store such items where directed by COR.
2. Items not reserved shall become property of the Contractor and be removed by Contractor from Medical Center.
3. Items of portable equipment and furnishings located in rooms and spaces in which work is to be done under this contract shall remain the property of the Government. When rooms and spaces are vacated by the Department of Veterans Affairs during the alteration period, such items which are NOT required by drawings and specifications to be either relocated or reused will be removed by the Government in advance of work to avoid interfering with Contractor's operation.

1.10 RESTORATION

- A. Remove, cut, alter, replace, patch and repair existing work as necessary to install new work. Except as otherwise shown or specified, do not cut, alter or remove any structural work, and do not disturb any ducts, plumbing, steam, gas, or electric work without approval of the COR. Existing work to be altered or extended and that is found to be defective in any way, shall be reported to the COR before it is disturbed. Materials and workmanship used in restoring work shall conform in type and quality to that of original existing construction, except as otherwise shown or specified.
- B. Upon completion of contract, deliver work complete and undamaged. Existing work (walls, ceilings, partitions, floors, mechanical and electrical work, lawns, paving, roads, walks, etc.) disturbed or removed as a result of performing required new work, shall be patched, repaired, reinstalled, or replaced with new work, and refinished and left in as good condition as existed before commencing work.
- C. At Contractor's own expense, Contractor shall immediately restore to service and repair any damage caused by Contractor's workmen to existing piping and conduits, wires, cables, etc., of utility services or of fire protection systems and communications systems (including telephone) which are not scheduled for discontinuance or abandonment.
- D. Expense of repairs to such utilities and systems not shown on drawings or locations of which are unknown will be covered by adjustment to contract time and price in accordance with clause entitled "CHANGES" (FAR 52.243-4 and VAAR 852.236-88) and "DIFFERING SITE CONDITIONS" (FAR 52.236-2). Contractor shall not be entitled to any recovery under this specification if he has not had utilities located or utilities are shown on the drawings.

1.28 CONSTRUCTION SIGN

- A. Provide a Construction Sign where directed by the COR. All wood members shall be of framing lumber. Cover sign frame with 0.7 mm (24 gage) galvanized sheet steel nailed securely around edges and on all bearings. Provide three 100 by 100 mm (4 inch by 4 inch) posts (or equivalent round posts) set 1200 mm (four feet) into ground. Set bottom of sign level at 900 mm (three feet) above ground and secure to posts with through bolts. Make posts full height of sign. Brace posts with 50 x 100 mm (two by four inch) material as directed.
- B. Paint all surfaces of sign and posts two coats of white gloss paint. Sign components shall be metal or wood and framed MDO plywood or aluminum sign panel. The graphic process shall be surface applied vinyl or screened graphics. Background color shall be VA blue and white. Text type shall be black. Typography shall be Helvetica Bold. Sign shall be placed adjacent to the project at the direction of the COR. Border and letters shall be of black gloss paint, except project title which shall be blue gloss paint.
- C. Maintain sign and remove it when directed by the COR.
- D. Detail drawing of construction sign showing required legend and other characteristics of sign is attached hereto and made a part of this specification. Project image will be in color and supplied by the Medical Center.

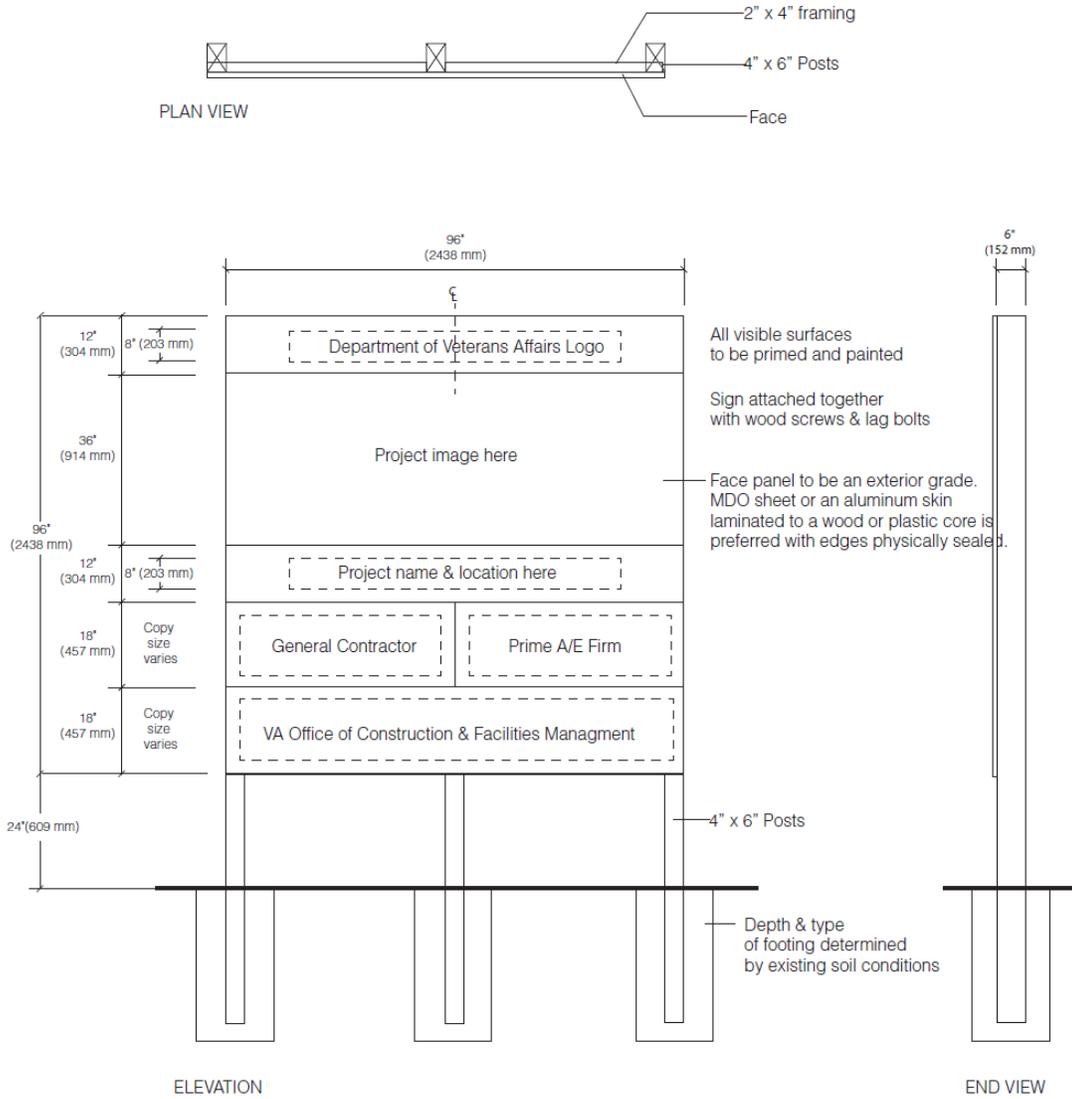

Dorn VA Medical Center
Construction/Renovation Risk Assessment Package

Instructions: Project Managers or VA Supervisors will collaborate with Infection Control, Safety Office and VA Police to complete the risk assessment package as part of managing the safe design and construction/renovation of the medical center environment. CORs shall collaborate with Infection Control, the Safety Office and the VA Police as necessary in the completion of these assessments. CORs, Infection Control Coordinator, Safety Office staff and VA Police will ensure all identified actions and control measures are implemented in their respective area of responsibility as long as the potential hazard exists. The initial assessment should be completed in the design phase. Reassess as conditions change and prior to the beginning of each project phase. The assessments are conducted by the responsible program official using the attached risk assessment forms and should be completed as follows:

1. NEPA Assessment:

- a. Using NEPA Interim Guidance for Projects PG 18-17 determined the level of Environmental Impact of the project.

2. Vertical Environmental Impact Assessment:

- a. Show the construction area and the functions/services located in adjacent areas, including floors above and below.

3. Horizontal Environmental Impact Assessment:

- a. Using a current drawing of the area, show the construction area and surrounding patient/staff areas as indicated on the example provided.

4. Interim Life Safety Measures:

- a. Evaluate each listed “Requirement or Deficiency” as related to the project’s impact on Life Safety components of the facility.
- b. Provide a summary of required actions on the sheet provided.

5. Hazard Assessment and Exposure Controls:

- a. Evaluate the potential for hazards during construction that may impact patients and staff. Indicate the required control measure for each hazard.
- b. Provide a summary of the required control measures on the sheet provided.

6. Ceiling Mounted Patient Lift:

- a. During 50% and 100% Design Reviews, the COR will verify that the patient lift design is in compliance with requirements of VHA Directive 2005-019 Seismic Safety of VHA Buildings and VA Master Design Specification 3.05.041 Seismic Restraint Requirements for Non-Structural Components. The COR will also ensure the requirements on the “Design Checklist for Ceiling Mounted Patient Lifts” are met.
- b. Complete the “After Installation Checklist for Ceiling Mounted Patient Lifts” prior to permitting the equipment to be used for patient movement.

7. Infection Control Risk Assessment:

- a. Determine and record the Location Group(s) that will be affected.
- b. Determine and record the type of construction and magnitude of disruption.
- c. Review the Infection Control Matrix using the Location and Type of Construction Groups (determined in steps a and b) and record the Class of Precautions associated with the project.
- d. Complete the Infection Control Measures List and assign responsibility for each measure.

8. Approvals:

- a. Upon completion of the risk assessment obtain approval signatures as applicable on the attached sheet. Ensure all signatures are complete prior to submitting to the Safety representative.

9. Contract Documents:

- a. Include applicable risk assessment action items in the contract documents.
- b. Provide the contractor's superintendent with copies of the completed risk assessment and action plans.
- c. File all risk assessment documents in the project file.

10. Daily Inspections:

- a. Ensure the contractor conducts and documents daily construction site inspections.

11. Construction Site Inspection:

- a. Each discipline (Infection Control, Safety Office, VA Police) shall inspect the construction site as applicable. All inspections will be documented.

12. Post Project Review:

- a. Upon Completion of the project, conduct a review of risk assessment process.
- b. Present the results to the Construction Safety Committee.

SECTION 01 32 16.15
PROJECT SCHEDULES
(SMALL PROJECTS – DESIGN/BID/BUILD)

PART 1- GENERAL

1.1 DESCRIPTION:

A. The Contractor shall develop a Critical Path Method (CPM) plan and schedule demonstrating fulfillment of the contract requirements (Project Schedule), and shall keep the Project Schedule up-to-date in accordance with the requirements of this section and shall utilize the plan for scheduling, coordinating and monitoring work under this contract (including all activities of subcontractors, equipment vendors and suppliers). Conventional Critical Path Method (CPM) technique shall be utilized to satisfy both time and cost applications.

1.2 CONTRACTOR'S REPRESENTATIVE:

A. The Contractor shall designate an authorized representative responsible for the Project Schedule including preparation, review and progress reporting with and to the Contracting Officer's Representative (COR).

B. The Contractor's representative shall have direct project control and complete authority to act on behalf of the Contractor in fulfilling the requirements of this specification section.

C. The Contractor's representative shall have the option of developing the project schedule within their organization or to engage the services of an outside consultant. If an outside scheduling consultant is utilized, Section 1.3 of this specification will apply.

1.3 CONTRACTOR'S CONSULTANT:

A. The Contractor shall submit a qualification proposal to the COR, within 10 days of bid acceptance. The qualification proposal shall include:

1. The name and address of the proposed consultant.
2. Information to show that the proposed consultant has the qualifications to meet the requirements specified in the preceding paragraph.
3. A representative sample of prior construction projects, which the proposed consultant has performed complete project scheduling services. These representative samples shall be of similar size and scope.

B. The Contracting Officer has the right to approve or disapprove the proposed consultant, and will notify the Contractor of the VA decision within seven calendar days from receipt of the qualification proposal. In case of disapproval, the Contractor shall resubmit another consultant within 10 calendar days for renewed consideration. The Contractor shall have their scheduling consultant approved prior to submitting any schedule for approval.

1.4 COMPUTER PRODUCED SCHEDULES

A. The contractor shall provide monthly, to the Department of Veterans Affairs (VA), all computer-produced time/cost schedules and reports generated from monthly project updates. This monthly computer service will include: three copies of up to five different reports (inclusive of all pages) available within the user defined reports of the scheduling software approved by the Contracting Officer; a hard copy listing of all project schedule changes, and associated data, made at the update and an electronic file of this data; and the resulting monthly updated schedule in PDM format. These must be submitted with and substantively support the contractor's monthly payment request and the signed look ahead report. The COR shall identify the five different report formats that the contractor shall provide. The contractor shall prepare the baseline schedule and all monthly updates in Microsoft Project 2010. All submissions shall include pdf copies of the schedule and shall include a file submission in the Microsoft Project format. These shall be transmitted through the Submittal Exchange Program or by email to the COR.

B. The contractor shall be responsible for the correctness and timeliness of the computer-produced reports. The Contractor shall also responsible for the accurate and timely submittal of the updated project schedule and all CPM data necessary to produce the computer reports and payment request that is specified.

C. The VA will report errors in computer-produced reports to the Contractor's representative within ten calendar days from receipt of reports. The Contractor shall reprocess the computer-produced reports and associated diskette(s), when requested by the Contracting Officer's representative, to correct errors which affect the payment and schedule for the project.

1.5 THE COMPLETE PROJECT SCHEDULE SUBMITTAL

A. Within 45 calendar days after receipt of Notice to Proceed, the Contractor shall submit for the Contracting Officer's review; three blue line copies of the interim schedule on sheets of paper 765 x 1070 mm (30 x 42 inches) and an electronic file in the previously approved CPM schedule program. The submittal shall also include three copies of a computer-produced activity/event ID schedule showing project duration; phase completion dates; and other data, including event cost.

Each activity/event on the computer-produced schedule shall contain as a minimum, but not limited to, activity/event ID, activity/event description, duration, budget amount, early start date, early finish date, late start date, late finish date and total float. Work activity/event relationships shall be restricted to finish-to-start or start-to-start without lead or lag constraints. Activity/event date constraints, not required by the contract, will not be accepted unless submitted to and approved by the Contracting Officer. The contractor shall make a separate written detailed request to the Contracting Officer identifying these date constraints and secure the Contracting Officer's written approval before incorporating them into the network diagram. The Contracting Officer's separate approval of the Project Schedule shall not excuse the contractor of this requirement. Logic events (non-work) will be permitted where necessary to reflect proper logic among work events, but must have zero duration. The complete working schedule shall reflect the Contractor's approach to scheduling the complete project. **The final Project Schedule in its original form shall contain no contract changes or delays which may have been incurred during the final network diagram development period and shall reflect the entire contract duration as defined in the bid documents.**

These changes/delays shall be entered at the first update after the final Project Schedule has been approved. The Contractor should provide their requests for time and supporting time extension analysis for contract time as a result of contract changes/delays, after this update, and in accordance with Article, **ADJUSTMENT OF CONTRACT COMPLETION**.

D. Within 30 calendar days after receipt of the complete project interim Project Schedule and the complete final Project Schedule, the Contracting Officer or his representative, will do one or both of the following:

1. Notify the Contractor concerning his actions, opinions, and objections.
2. A meeting with the Contractor at or near the job site for joint review, correction or adjustment of the proposed plan will be scheduled if required. Within 14 calendar days after the joint review, the Contractor shall revise and shall submit three blue line copies of the revised Project Schedule, three copies of the revised computer-produced activity/event ID schedule and a revised electronic file as specified by the Contracting Officer. The revised submission will be reviewed by the Contracting Officer and, if found to be as previously agreed upon, will be approved.

E. The approved baseline schedule and the computer-produced schedule(s) generated there from shall constitute the approved baseline schedule until subsequently revised in accordance with the requirements of this section.

F. The Complete Project Schedule shall contain a detailed work breakdown structure that shows the sequence of work for each item constructed. Costs for labor and material shall be shown for each structure. These costs shall also be shown on the contractor supplied schedule of values.

1.6 WORK ACTIVITY/EVENT COST DATA

A. The Contractor shall cost load all work activities/events except procurement activities. The cumulative amount of all cost loaded work activities/events (including alternates) shall equal the total contract price. Prorate overhead, profit and general conditions on all work activities/events for the entire project length. The contractor shall generate from this information cash flow curves indicating graphically the total percentage of work activity/event dollar value scheduled to be in place on early finish, late finish. These cash flow curves will be used by the Contracting Officer to assist him in determining approval or disapproval of the cost loading. Negative work activity/event cost data will not be acceptable, except on VA issued contract changes.

B. The Contractor shall cost load work activities/events for guarantee period services, test, balance and adjust various systems in accordance with the provisions in Article, FAR 52.232 – 5 (PAYMENT UNDER FIXED-PRICE CONSTRUCTION CONTRACTS) and VAAR 852.236 – 83 (PAYMENT UNDER FIXED-PRICE CONSTRUCTION CONTRACTS).

C. In accordance with FAR 52.236 – 1 (PERFORMANCE OF WORK BY THE CONTRACTOR) and VAAR 852.236 – 72 (PERFORMANCE OF WORK BY THE CONTRACTOR), the Contractor shall submit, simultaneously with the cost per work activity/event of the construction schedule required by this

Section, a responsibility code for all activities/events of the project for which the Contractor's forces will perform the work.

D. The Contractor shall cost load work activities/events for all BID ITEMS including ASBESTOS ABATEMENT. The sum of each BID ITEM work shall equal the value of the bid item in the Contractors' bid.

1.7 PROJECT SCHEDULE REQUIREMENTS

A. Show on the project schedule the sequence of work activities/events required for complete performance of all items of work. The Contractor Shall:

1. Show activities/events as:

- a. Contractor's time required for submittal of shop drawings, templates, fabrication, delivery and similar pre-construction work.
- b. Contracting Officer's and Architect-Engineer's review and approval of shop drawings, equipment schedules, samples, template, or similar items.
- c. Interruption of VA Facilities utilities, delivery of Government furnished equipment, and rough-in drawings, project phasing and any other specification requirements.
- d. Test, balance and adjust various systems and pieces of equipment, maintenance and operation manuals, instructions and preventive maintenance tasks.
- e. VA inspection and acceptance activity/event with a minimum duration of five work days at the end of each phase and immediately preceding any VA move activity/event required by the contract phasing for that phase.

2. Show not only the activities/events for actual construction work for each trade category of the project, but also trade relationships to indicate the movement of trades from one area, floor, or building, to another area, floor, or building, for at least five trades who are performing major work under this contract.

3. Break up the work into activities/events of a duration no longer than 20 work days each or one reporting period, except as to non-construction activities/events (i.e., procurement of materials, delivery of equipment, concrete and asphalt curing) and any other activities/events for which the COTR may approve the showing of a longer duration. The duration for VA approval of any required submittal, shop drawing, or other submittals will not be less than 20 work days.

4. Describe work activities/events clearly, so the work is readily identifiable for assessment of completion. Activities/events labeled "start," "continue," or "completion," are not specific and will not be allowed. Lead and lag time activities will not be acceptable.

5. The schedule shall be generally numbered in such a way to reflect either discipline, phase or location of the work.

B. The Contractor shall submit the following supporting data in addition to the project schedule:

1. The appropriate project calendar including working days and holidays.
2. The planned number of shifts per day.
3. The number of hours per shift.

Failure of the Contractor to include this data shall delay the review

of the submittal until the Contracting Officer is in receipt of the missing data.

C. To the extent that the Project Schedule or any revised Project Schedule shows anything not jointly agreed upon, it shall not be deemed to have been approved by the COR. Failure to include any element of work required for the performance of this contract shall not excuse the Contractor from completing all work required within any applicable completion date of each phase regardless of the COR's approval of the Project Schedule.

D. Compact Disk Requirements and CPM Activity/Event Record Specifications:
Submit to the VA an electronic file(s) containing one file of the data required to produce a schedule, reflecting all the activities/events of the complete project schedule being submitted.

1.8 PAYMENT TO THE CONTRACTOR:

A. Monthly, the contractor shall submit an application and certificate for payment using the AIA application and certificate for payment documents G702 & G703 reflecting updated schedule activities and cost data in accordance with the provisions of the following Article, PAYMENT AND PROGRESS REPORTING, as the basis upon which progress payments will be made pursuant to Article, FAR 52.232 – 5 (PAYMENT UNDER FIXED-PRICE CONSTRUCTION CONTRACTS) and VAAR 852.236 – 83 (PAYMENT UNDER FIXEDPRICE CONSTRUCTION CONTRACTS). The Contractor shall be entitled to a monthly progress payment upon approval of estimates as determined from the currently approved updated project schedule. Monthly payment requests shall include: a listing of all agreed upon project schedule changes and associated data; and an electronic file (s) of the resulting monthly updated schedule.

B. Approval of the Contractor's monthly Application for Payment shall be contingent, among other factors, on the submittal of a satisfactory monthly update of the project schedule.

1.9 PAYMENT AND PROGRESS REPORTING

A. Monthly schedule update meetings will be held on dates mutually agreed to by the COR and the Contractor. Contractor and their CPM consultant (if applicable) shall attend all monthly schedule update meetings. The Contractor shall accurately update the Project Schedule and all other data required and provide this information to the COR three work days in advance of the schedule update meeting. Job progress will be reviewed to verify:

1. Actual start and/or finish dates for updated/completed activities/events.
2. Remaining duration for each activity/event started, or scheduled to start, but not completed.
3. Logic, time and cost data for change orders, and supplemental agreements that are to be incorporated into the Project Schedule.
4. Changes in activity/event sequence and/or duration which have been made, pursuant to the provisions of following Article, ADJUSTMENT OF CONTRACT COMPLETION.
5. Completion percentage for all completed and partially completed activities/events.
6. Logic and duration revisions required by this section of the specifications.

7. Activity/event duration and percent complete shall be updated independently.

B. After completion of the joint review, the contractor shall generate an updated computer-produced calendar-dated schedule and supply the Contracting Officer's representative with reports in accordance with the Article, COMPUTER PRODUCED SCHEDULES, specified.

C. After completing the monthly schedule update, the contractor's representative or scheduling consultant shall rerun all current period contract change(s) against the prior approved monthly project schedule.

The analysis shall only include original workday durations and schedule logic agreed upon by the contractor and resident engineer for the contract change(s). When there is a disagreement on logic and/or durations, the Contractor shall use the schedule logic and/or durations provided and approved by the resident engineer. After each rerun update, the resulting electronic project schedule data file shall be appropriately identified and submitted to the VA in accordance to the requirements listed in articles 1.4 and 1.7. This electronic submission is separate from the regular monthly project schedule update requirements and shall be submitted to the resident engineer within fourteen (14) calendar days of completing the regular schedule update.

Before inserting the contract changes durations, care must be taken to ensure that only the original durations will be used for the analysis, not the reported durations after progress. In addition, once the final network diagram is approved, the contractor must recreate all manual progress payment updates on this approved network diagram and associated reruns for contract changes in each of these update periods as outlined above for regular update periods. This will require detailed record keeping for each of the manual progress payment updates.

D. Following approval of the CPM schedule, the VA, the General Contractor, its approved CPM Consultant, RE office representatives, and all subcontractors needed, as determined by the SRE, shall meet to discuss the monthly updated schedule. The main emphasis shall be to address work activities to avoid slippage of project schedule and to identify any necessary actions required to maintain project schedule during the reporting period. The Government representatives and the Contractor should conclude the meeting with a clear understanding of those work and administrative actions necessary to maintain project schedule status during the reporting period. This schedule coordination meeting will occur after each monthly project schedule update meeting utilizing the resulting schedule reports from that schedule update. If the project is behind schedule, discussions should include ways to prevent further slippage as well as ways to improve the project schedule status, when appropriate.

1.10 RESPONSIBILITY FOR COMPLETION

A. If it becomes apparent from the current revised monthly progress schedule that phasing or contract completion dates will not be met, the Contractor shall execute some or all of the following remedial actions:

1. Increase construction manpower in such quantities and crafts as necessary to eliminate the backlog of work.

2. Increase the number of working hours per shift, shifts per working day, working days per week, the amount of construction equipment, or any combination of the foregoing to eliminate the backlog of work.

3. Reschedule the work in conformance with the specification requirements.

B. Prior to proceeding with any of the above actions, the Contractor shall notify and obtain approval from the COR for the proposed schedule changes. If such actions are approved, the representative schedule revisions shall be incorporated by the Contractor into the Project Schedule before the next update, at no additional cost to the Government.

1.11 CHANGES TO THE SCHEDULE

A. Within 30 calendar days after VA acceptance and approval of any updated project schedule, the Contractor shall submit a revised electronic file (s) and a list of any activity/event changes including predecessors and successors for any of the following reasons:

1. Delay in completion of any activity/event or group of activities/events, which may be involved with contract changes, strikes, unusual weather, and other delays will not relieve the Contractor from the requirements specified unless the conditions are shown on the CPM as the direct cause for delaying the project beyond the acceptable limits.

2. Delays in submittals, or deliveries, or work stoppage are encountered which make rescheduling of the work necessary.

3. The schedule does not represent the actual prosecution and progress of the project.

4. When there is, or has been, a substantial revision to the activity/event costs regardless of the cause for these revisions.

B. CPM revisions made under this paragraph which affect the previously approved computer-produced schedules for Government furnished equipment, vacating of areas by the VA Facility, contract phase(s) and sub phase(s), utilities furnished by the Government to the Contractor, or any other previously contracted item, shall be furnished in writing to the Contracting Officer for approval.

C. Contracting Officer's approval for the revised project schedule and all relevant data is contingent upon compliance with all other paragraphs of this section and any other previous agreements by the Contracting Officer or the VA representative.

D. The cost of revisions to the project schedule resulting from contract changes will be included in the proposal for changes in work as specified in FAR 52.243 – 4 (Changes) and VAAR 852.236 – 88 (Changes –Supplemental), and will be based on the complexity of the revision or contract change, man hours expended in analyzing the change, and the total cost of the change.

E. The cost of revisions to the Project Schedule not resulting from contract changes is the responsibility of the Contractor.

1.12 ADJUSTMENT OF CONTRACT COMPLETION

A. The contract completion time will be adjusted only for causes specified in this contract. Request for an extension of the contract completion date by the Contractor shall be supported with a justification, CPM data and supporting evidence as the COR may deem necessary for determination as to whether or not the Contractor is entitled to an extension of time under the provisions of the contract. Submission of proof based on revised activity/event logic, durations (in work days) and costs is obligatory to any approvals. The schedule must clearly display that the Contractor has used, in full, all the float time available for the work involved in this request. The Contracting Officer's determination as to the total number of days of contract extension will be based upon the current computer-produced calendar-dated schedule for the time period in question and all other relevant information.

B. Actual delays in activities/events which, according to the computer- produced calendar-dated schedule, do not affect the extended and predicted contract completion dates shown by the critical path in the network, will not be the basis for a change to the contract completion date. The Contracting Officer will within a reasonable time after receipt of such justification and supporting evidence, review the facts and advise the Contractor in writing of the Contracting Officer's decision.

C. The Contractor shall submit each request for a change in the contract completion date to the Contracting Officer in accordance with the provisions specified under FAR 52.243 – 4 (Changes) and VAAR 852.236 – 88 (Changes – Supplemental). The Contractor shall include, as a part of each change order proposal, a sketch showing all CPM logic revisions, duration (in work days) changes, and cost changes, for work in question and its relationship to other activities on the approved network diagram.

D. All delays due to non-work activities/events such as RFI's, WEATHER, STRIKES, and similar non-work activities/events shall be analyzed on a month by month basis.

- - - E N D - - -

1. Specification section 01 33 23 shall include the attached language concerning the submittal process. All other requirements of 01 33 23 remain applicable.

Section 01 33 23 – Submittals

ELECTRONIC SUBMITTAL PROCEDURES

A. Summary:

1. Shop drawing and product data submittals shall be transmitted to Architect and construction team members in electronic (PDF) format using Submittal Exchange (www.submittalexchange.com).
2. The intent of electronic submittals is to expedite the construction process by reducing paperwork, improving information flow, and decreasing turnaround time.
3. The electronic submittal process is not intended for color samples, color charts, or physical material samples.

B. Procedures:

1. Create submittal log in Submittal Exchange by inserting required submittals listed in individual specification sections.
2. Submittal Preparation - Contractor may use any or all of the following options:
 - a. Subcontractors and Suppliers provide electronic (PDF) submittals to Contractor via the Submittal Exchange website.
 - b. Subcontractors and Suppliers provide electronic (PDF) submittals to Contractor via email.
 - c. Subcontractors and Suppliers provide paper submittals to Scanning Service which electronically scans and converts to PDF format.
3. Printed Submittals: Provide two printed sets of submittals for shop drawings for structural framing in addition to electronic submittals.
4. Contractor shall review and apply electronic stamp certifying that the submittal complies with the requirements of the Contract Documents including verification of manufacturer / product, dimensions and coordination of information with other parts of the work.
5. Contractor shall transmit each submittal to Architect using the Submittal Exchange website, www.submittalexchange.com.
6. Architect / Engineer review comments will be made available on the Submittal Exchange website for downloading. Contractor will receive email notice of completed review.
7. Distribution of reviewed submittals to subcontractors and suppliers is the responsibility of the Contractor.
8. Submit paper copies of any reviewed submittals not submitted electronically at project

closeout for record purposes in accordance with Section 01 77 19 – Contract Closeout.

C. Costs:

1. General Contractor shall include the full cost of Submittal Exchange project subscription in their proposal. This cost is included in the Contract Amount. Contact Bob Caylor with Submittal Exchange at 1-800-714-0024 x214 to verify cost prior to bid.

2. The intent is for Submittal Exchange service cost to be in lieu of postage or shipping costs typically paid for paper submittals. Service cost is a net cost savings to Contractor because submittals sent electronically do not need to be shipped physically.

3. After award of contract, training will be provided by Submittal Exchange regarding use of website and PDF submittals. Contact Submittal Exchange at 1-800-714-0024.

4. Internet Service and Equipment Requirements:

a. Email address and Internet access at Contractor's main office.

b. Adobe Acrobat (www.adobe.com), Bluebeam PDF Revu (www.bluebeam.com), or other similar PDF review software for applying electronic stamps and comments.

D. Products:

5. Basis of specification is Submittal Exchange website system for electronic construction submittals (www.submittalexchange.com) or equal.

6. Substitution may be considered if submitted prior to bid date for pre-approval. Product requirements:

a. Independently hosted, web-based system for automated tracking, storage, and distribution of contract submittals, Requests For Information, and other contract related documents. FTP sites, e-mail exchanges, and server-based systems hosted from inside a contractor's office will not be considered acceptable.

b. Utilize 256-bit SSL encryption and hosted at SAS70 Type II compliant data centers.

c. Minimum five years documented experience of use on comparable commercial construction projects. "Comparable commercial construction projects" shall be defined as documented use on a minimum of five hundred governmental, public-entity, or private sector projects each of \$1 million construction value or greater.

d. Minimum five years documented 99.5% website uptime.

e. Unlimited individual user accounts and system access for all project subcontractors, general contractor, owner staff, architect, design consultants, and sub-consultants, with no additional fees for those parties to access the system.

f. Separate locations for owner, architect, design consultant, and sub-consultant review comments with contractors restricted from viewing comments until final review or release by owner or primary design consultant.

- g. Full version histories and dates of exchanges automatically tracked and available for viewing, searching, and reporting in a linear log format compatible with AIA G712.
- h. Functionality to group submittals as required packages and apply forms and review comments to entire package simultaneously.
- i. Functionality for integrated online PDF viewing and review, including graphical markups and stamps, for owner, architect, design consultants, sub-consultants, and general contractor without need for additional software purchase.
- j. Automatic, configurable email notifications for each project team member for new and reviewed submittals and other items.
- k. Automatic, configurable email reminders of past due items.
- l. Customized, automated PDF form generation for submittals, RFIs, and other documents matching standard templates used by owner, design consultants, sub-consultants, and general contractor. Documentation and demonstration of automatic form generation using each entity's templates must be submitted as part of any substitution request.
- m. Prior to project start, system vendor shall create submittal log with all required items from project manual or submittal register. Owner or primary design consultant shall have full control over required items list and access to edit, add, or remove items during project.
- n. System vendor shall provide minimum one-hour live web meeting training sessions to contractors, design consultants, sub-consultants, and owners staff prior to project start.
- o. System vendor shall make available minimum thirty-minute live web meeting training sessions for subcontractors at least twice weekly for the entire duration of the project.
- p. System vendor shall provide access for owner, design consultants, sub-consultants, general contractor, and subcontractors to live technical support by phone and email minimum of 7 AM to 6 PM CST on standard business days at no additional cost.
- q. Allowance for scanning and printing services provided by local third-party reprographic vendor to assist with obtaining documents electronically and online print ordering.
- r. At completion of project closeout, system vendor shall provide minimum of four archival discs that include all documents and tracking logs, or the ability to download this information from the live website in a single complete archive package.

02 82 13.13
GLOVEBAG ASBESTOS ABATEMENT

PART 1 - GENERAL

1.1 SUMMARY OF THE WORK

1.1.1 CONTRACT DOCUMENTS AND RELATED REQUIREMENTS

Drawings, general provisions of the contract, including general and supplementary conditions and other Division 01 specifications, shall apply to the work of this section. The contract documents show the work to be done under the contract and related requirements and conditions impacting the project. Related requirements and conditions include applicable codes and regulations, notices and permits, existing site conditions and restrictions on use of the site, requirements for partial owner occupancy during the work, coordination with other work and the phasing of the work. In the event the Asbestos Abatement Contractor discovers a conflict in the contract documents and/or requirements or codes, the conflict must be brought to the immediate attention of the COR for resolution. Whenever there is a conflict or overlap in the requirements, the most stringent shall apply. Any actions taken by the Contractor without obtaining guidance from the COR shall become the sole risk and responsibility of the Asbestos Abatement Contractor. All costs incurred due to such action are also the responsibility of the Asbestos Abatement Contractor.

1.1.2 EXTENT OF WORK

A. Below is a brief description of the estimated quantities of asbestos containing materials to be abated by the glovebag method. These quantities are for informational purposes only and are based on the best information available at the time of the specification preparation. The Contractor shall satisfy himself as the actual quantities to be abated. Nothing in this section may be interpreted as limiting the extent of work otherwise required by this contract and related documents.

B. Removal, clean-up and disposal of ACM and asbestos contaminated elements in an appropriate regulated area in the following approximate quantities:

400 square feet of asbestos containing material.

1.1.3 RELATED WORK

A. Section 02 41 00, DEMOLITION.

1.1.4 TASKS

The work tasks are summarized as follows:

A. Pre-abatement activities including conducting a comprehensive hazardous materials assessment survey/report of all areas included in the construction are for this project, pre-abatement meeting(s), inspection(s), notifications, permits, submittal approvals, work-site

preparations, emergency procedures arrangements, and Asbestos Hazard Abatement Plans for glovebag asbestos abatement work.

B. If available, submit to the Contractor results of background air sampling; including location of samples, person who collected the samples, equipment utilized, calibration data and method of analysis. During abatement, submit to the Contractor, results of bulk material analysis and air sampling data collected during the course of the abatement. This information shall not release the Contractor from any responsibility for OSHA compliance.

C. Abatement activities including removal, clean-up and disposal of ACM waste, recordkeeping, security, monitoring, and inspections.

D. Cleaning and decontamination activities including final visual inspection, air monitoring and certification of decontamination.

1.1.5 ABATEMENT CONTRACTOR USE OF PREMISES

A. The Contractor and Contractor's personnel shall cooperate fully with the VA representative/consultant to facilitate efficient use of buildings and areas within buildings. The Contractor shall perform the work in accordance with the VA specifications, drawings, phasing plan and in compliance with any/all applicable Federal, State and Local regulations and requirements.

B. The Contractor shall use the existing facilities in the building strictly within the limits indicated in contract documents as well as the approved VA Design and Construction Procedures. VA Design and Construction Procedures drawings of partially occupied buildings will show the limits of regulated areas; the placement of decontamination facilities; the temporary location of bagged waste ACM; the path of transport to outside the building; and the temporary waste storage area for each building/regulated area. Any variation from the arrangements shown on drawings shall be secured in writing from the VA representative through the pre-abatement plan of action. The following limitations of use shall apply to existing facilities shown on drawings:

1.2 VARIATIONS IN QUANTITY

The quantities and locations of ACM included in this section are estimated, which are limited by the physical constraints imposed by occupancy of the buildings and accessibility to ACM. Accordingly, minor variations (+/- 5%) in quantities of ACM within the regulated area are considered as having no impact on contract price and time requirements of this contract. Where additional work is required beyond the above variation, the contractor shall provide unit prices for newly discovered ACM and those prices shall be used for additional work required under the contractor.

1.3 STOP ASBESTOS REMOVAL

If the COR; their field representative; (the facility Safety Officer/Manager or their designee, or the VA Professional Industrial Hygienist/ Certified Industrial Hygienist (VPIH/CIH) presents a verbal **Stop Asbestos Removal Order**, the Contractor/Personnel shall immediately stop all asbestos removal and maintain HEPA filtered negative pressure air flow in the containment and adequately wet any exposed ACM. If a verbal Stop Asbestos Removal Order is issued, the VA shall follow-up with a written order to the Contractor as soon as it is practicable.

The Contractor shall not resume any asbestos removal activity until authorized to do so in writing by the VA COR. A stop asbestos removal order may be issued at any time the VA COR determines abatement conditions/activities are not within VA specification, regulatory requirements or that an imminent hazard exists to human health or the environment. Work stoppage will continue until conditions have been corrected to the satisfaction of the VA. Standby time and costs for corrective actions will be borne by the Contractor, including the VPIH/CIH time. The occurrence of any of the following events shall be reported immediately by the Contractor's competent person to the VA.

Contracting Office or field representative using the most expeditious means (e.g., verbal or telephonic), followed up with written notification to the COR as soon as practical. The Contractor shall immediately stop asbestos removal/disturbance activities and initiate fiber reduction activities:

- A. Airborne PCM analysis results equal to or greater than 0.01 f/cc outside a regulated area or >0.05 f/cc inside a regulated area;
- B. breach or break in regulated area containment barrier(s);
- C. less than -0.02" WCG pressure in the regulated area;
- D. serious injury/death at the site;
- E. fire/safety emergency at the site;
- F. respiratory protection system failure;
- G. power failure or loss of wetting agent; or
- H. any visible emissions observed outside the regulated area.

1.4 DEFINITIONS

1.4.1 GENERAL

Definitions and explanations here are neither complete nor exclusive of all terms used in the contract documents, but are general for the work to the extent they are not stated more explicitly in another element of the contract documents. Drawings must be recognized as diagrammatic in nature and not completely descriptive of the requirements indicated therein.

1.4.2 GLOSSARY

Abatement - Procedures to control fiber release from asbestos containing materials. Includes removal, encapsulation, enclosure, demolition, and renovation activities related to asbestos containing materials (ACM).

Aerosol - Solid or liquid particulate suspended in air.

Adequately wet - Sufficiently mixed or penetrated with liquid to prevent the release of particulates. If visible emissions are observed coming from the ACM, then that material has not been adequately wetted.

Aggressive method - Removal or disturbance of building material by sanding, abrading, grinding, or other method that breaks, crumbles, or disintegrates intact ACM.

Aggressive sampling - EPA AHERA defined clearance sampling method using air moving equipment such as fans and leaf blowers to aggressively disturb and maintain in the air residual fibers after abatement.

AHERA - Asbestos Hazard Emergency Response Act. Asbestos regulations for schools issued in 1987.

Aircell - Pipe or duct insulation made of corrugated cardboard which contains asbestos.

Air monitoring - The process of measuring the fiber content of a known volume of air collected over a specified period of time. The NIOSH 7400 Method, Issue 2 is used to determine the fiber levels in air. For personal samples and clearance air testing using Phase Contrast Microscopy (PCM) analysis. NIOSH Method 7402 can be used when it is necessary to confirm fibers counted by PCM as being asbestos. The AHERA TEM analysis may be used for background, area samples and clearance samples when required by this specification, or at the discretion of the VPIH/CIH as appropriate.

Air sample filter - The filter used to collect fibers which are then counted. The filter is made of mixed cellulose ester membrane for PCM (Phase Contrast Microscopy) and polycarbonate for TEM (Transmission Electron Microscopy)

Amended water - Water to which a surfactant (wetting agent) has been added to increase the penetrating ability of the liquid.

Asbestos - Includes chrysotile, amosite, crocidolite, tremolite asbestos, anthophyllite asbestos, actinolite asbestos, and any of these minerals that have been chemically treated or altered. Asbestos also includes PACM, as defined below.

Asbestos Hazard Abatement Plan (AHAP) - Asbestos work procedures required to be submitted by the contractor before work begins.

Asbestos-containing material (ACM) - Any material containing more than one percent of asbestos.

Asbestos contaminated elements (ACE) - Building elements such as ceilings, walls, lights, or ductwork that are contaminated with asbestos.

Asbestos-contaminated soil (ACS) – Soil found in the work area or in adjacent areas such as crawlspaces or pipe tunnels which is contaminated with asbestos-containing material debris and cannot be easily separated from the material.

Asbestos-containing waste (ACW) material - Asbestos-containing material or asbestos contaminated objects requiring disposal.

Asbestos Project Monitor – Some states require that any person conducting asbestos abatement clearance inspections and clearance air sampling be licensed as an asbestos project monitor.

Asbestos waste decontamination facility - A system consisting of drum/bag washing facilities and a temporary storage area for cleaned containers of asbestos waste. Used as the exit for waste and equipment leaving the regulated area. In an emergency, it may be used to evacuate personnel.

Authorized person - Any person authorized by the VA, the Contractor, or government agency and required by work duties to be present in regulated areas.

Authorized visitor - Any person approved by the VA; the contractor; or any government agency representative having jurisdiction over the regulated area (e.g., OSHA, Federal and State EPA).

Barrier - Any surface that isolates the regulated area and inhibits fiber migration from the regulated area.

Containment Barrier - An airtight barrier consisting of walls, floors, and/or ceilings of sealed plastic sheeting which surrounds and seals the outer perimeter of the regulated area.

Critical Barrier - The barrier responsible for isolating the regulated area from adjacent spaces, typically constructed of plastic sheeting secured in place at openings such as doors, windows, or any other opening into the regulated area.

Primary Barrier – Plastic barriers placed over critical barriers and exposed directly to abatement work.

Secondary Barrier - Any additional plastic barriers used to isolate and provide protection from debris during abatement work.

Breathing zone - The hemisphere forward of the shoulders with a radius of about 150 - 225 mm (6 - 9 inches) from the worker's nose.

Bridging encapsulant - An encapsulant that forms a layer on the surface of the ACM.

Building/facility owner - The legal entity, including a lessee, which exercises control over management and recordkeeping functions relating to a building and/or facility in which asbestos activities take place.

Bulk testing - The collection and analysis of suspect asbestos containing materials.

Certified Industrial Hygienist (CIH) - A person certified in the comprehensive practice of industrial hygiene by the American Board of Industrial Hygiene.

Class I asbestos work - Activities involving the removal of Thermal System Insulation (TSI) and surfacing ACM and Presumed Asbestos Containing Material (PACM).

Class II asbestos work - Activities involving the removal of ACM which is not thermal system insulation or surfacing material. This includes, but is not limited to, the removal of asbestos-containing wallboard, floor tile and sheeting, roofing and siding shingles, and construction mastic.

Clean room/Changing room - An uncontaminated room having facilities for the storage of employee's street clothing and uncontaminated materials and equipment.

Clearance sample - The final air sample taken after all asbestos work has been done and visually inspected. Performed by the VA's professional industrial hygiene consultant/Certified Industrial Hygienist (VPIH/CIH).

Closely resemble - The major workplace conditions which have contributed to the levels of historic asbestos exposure, are no more protective than conditions of the current workplace.

Competent person - In addition to the definition in 29 CFR 1926.32(f), one who is capable of identifying existing asbestos hazards in the workplace and selecting the appropriate control strategy for asbestos exposure, who has the authority to take prompt corrective measures to eliminate them, as specified in 29 CFR 1926.32(f); in addition, for Class I and II work who is specially trained in a training course which meets the criteria of EPA's Model Accreditation Plan (40 CFR 763) for supervisor.

Contractor's Professional Industrial Hygienist (CPIH/CIH) – The asbestos abatement contractor's industrial hygienist. The industrial hygienist must meet the qualification requirements of a PIH and may be a certified industrial hygienist (CIH).

Count - Refers to the fiber count or the average number of fibers greater than five microns in length with a length-to-width (aspect) ratio of at least 3 to 1, per cubic centimeter of air.

Crawlspace – An area which can be found either in or adjacent to the work area. This area has limited access and egress and may contain asbestos materials and/or asbestos contaminated soil.

Decontamination area/unit - An enclosed area adjacent to and connected to the regulated area and consisting of an equipment room, shower room, and clean room, which is used for the decontamination of workers, materials, and equipment that are contaminated with asbestos.

Demolition - The wrecking or taking out of any load-supporting structural member and any related razing, removing, or stripping of asbestos products. VA Total – means a building or substantial part of the building is completely removed, torn or knocked down, bulldozed, flattened, or razed, including removal of building debris.

Disposal bag - Typically 6 mil thick sift-proof, dustproof, leak-tight container used to package and transport asbestos waste from regulated areas to the approved landfill. Each bag/container must be labeled/marked in accordance with EPA, OSHA and DOT requirements.

Disturbance - Activities that disrupt the matrix of ACM or PACM, crumble or pulverize ACM or PACM, or generate visible debris from ACM or PACM. Disturbance includes cutting away small amounts of ACM or PACM, no greater than the amount that can be contained in one standard sized glove bag or waste bag, in order to access a building component. In no event shall

the amount of ACM or PACM so disturbed exceed that which can be contained in one glove bag or disposal bag and shall not exceed 60 inches in length or width.

Drum - A rigid, impermeable container made of cardboard fiber, plastic, or metal which can be sealed in order to be sift-proof, dustproof, and leak-tight.

Employee exposure - The exposure to airborne asbestos that would occur if the employee were not wearing respiratory protection equipment.

Encapsulant - A material that surrounds or embeds asbestos fibers in an adhesive matrix and prevents the release of fibers.

Encapsulation - Treating ACM with an encapsulant.

Enclosure - The construction of an air tight, impermeable, permanent barrier around ACM to control the release of asbestos fibers from the material and also eliminate access to the material.

Equipment room - A contaminated room located within the decontamination area that is supplied with impermeable bags or containers for the disposal of contaminated protective clothing and equipment.

Fiber - A particulate form of asbestos, 5 microns or longer, with a length to width (aspect) ratio of at least 3 to 1.

Fibers per cubic centimeter (f/cc) - Abbreviation for fibers per cubic centimeter, used to describe the level of asbestos fibers in air.

Filter - Media used in respirators, vacuums, or other machines to remove particulate from air.

Firestopping - Material used to close the open parts of a structure in order to prevent a fire from spreading.

Friable asbestos containing material - Any material containing more than one (1) percent or asbestos as determined using the method specified in appendix A, Subpart F, 40 CFR 763, section 1, Polarized Light Microscopy, that, when dry, can be crumbled, pulverized, or reduced to powder by hand pressure.

Glovebag - Not more than a 60 x 60-inch impervious plastic bag-like enclosure affixed around an asbestos-containing material, with glove like appendages through which materials and tools may be handled.

High efficiency particulate air (HEPA) filter – An ASHRAE MERV 17 filter capable of trapping and retaining at least 99.97 percent of all mono-dispersed particles of 0.3 micrometers in diameter.

HEPA vacuum - Vacuum collection equipment equipped with a HEPA filter system capable of collecting and retaining asbestos fibers.

Homogeneous area - An area of surfacing, thermal system insulation or miscellaneous ACM that is uniform in color, texture and date of application.

HVAC - Heating, Ventilation and Air Conditioning

Industrial hygienist (IH) - A professional qualified by education, training, and experience to anticipate, recognize, evaluate and develop controls for occupational health hazards. Meets definition requirements of the American Industrial Hygiene Association (AIHA).

Industrial hygienist technician (IH Technician) - A person working under the direction of an IH or CIH who has special training, experience, certifications and licenses required for the industrial hygiene work assigned. Some states require that an industrial hygienist technician conducting asbestos abatement clearance inspection and clearance air sampling be licensed as an asbestos project monitor.

Intact - The ACM has not crumbled, been pulverized, or otherwise deteriorated so that the asbestos is no longer likely to be bound with its matrix.

Lockdown - Applying encapsulant, after a final visual inspection, on all abated surfaces at the conclusion of ACM removal prior to removal of critical barriers.

National Emission Standards for Hazardous Air Pollutants (NESHAP) - EPA's rule to control emissions of asbestos to the environment (40 CFR Part 61, Subpart M).

Negative initial exposure assessment - A demonstration by the employer which complies with the criteria in 29 CFR 1926.1101 (f)(2)(iii), that employee exposure during an operation is expected to be consistently below the PEL.

Negative pressure - Air pressure which is lower than the surrounding area, created by exhausting air from a sealed regulated area through HEPA equipped filtration units. OSHA requires maintaining -0.02" water column gauge inside the negative pressure enclosure.

Negative pressure respirator - A respirator in which the air pressure inside the facepiece is negative during inhalation relative to the air pressure outside the respirator facepiece.

Non-friable ACM - Material that contains more than 1 percent asbestos but cannot be crumbled, pulverized, or reduced to powder by hand pressure.

Organic vapor cartridge - The type of cartridge used on air purifying respirators to remove organic vapor hazardous air contaminants.

Outside air - The air outside buildings and structures, including, but not limited to, the air under a bridge or in an open ferry dock.

Owner/operator - Any person who owns, leases, operates, controls, or supervises the facility being demolished or renovated or any person who owns, leases, operates, controls, or supervises the demolition or renovation operation, or both.

Penetrating encapsulant - Encapsulant that is absorbed into the ACM matrix without leaving a surface layer.

Personal protective equipment (PPE) – equipment designed to protect user from injury and/or specific job hazard. Such equipment may include protective clothing, hard hats, safety glasses, and respirators.

Personal sampling/monitoring - Representative air samples obtained in the breathing zone for one or more workers within the regulated area using a filter cassette and a calibrated air sampling pump to determine asbestos exposure.

Permissible exposure limit (PEL) - The level of exposure OSHA allows for an 8-hour time weighted average. For asbestos fibers, the eight (8) hour time weighted average PEL is 0.1 fibers per cubic centimeter (0.1 f/cc) of air and the 30-minute Excursion Limit is 1.0 fibers per cubic centimeter (1 f/cc).

Pipe tunnel – An area, typically located adjacent to mechanical spaces or boiler rooms in which the pipes servicing the heating system in the building are routed to allow the pipes to access heating elements. These areas may contain asbestos pipe insulation, asbestos fittings, or asbestos-contaminated soil.

Polarized light microscopy (PLM) - Light microscopy using dispersion staining techniques and refractive indices to identify and quantify the type(s) of asbestos present in a bulk sample.

Polyethylene sheeting - Strong plastic barrier material 4 to 6 mils thick, semi-transparent, flame retardant per NFPA 241.

Positive/negative fit check - A method of verifying the seal of a facepiece respirator by temporarily occluding the filters and breathing in (inhaling) and then temporarily occluding the exhalation valve and of the respirator respectively.

Presumed ACM (PACM) - Thermal system insulation, surfacing, and flooring material installed in buildings prior to 1981. If the building owner has actual knowledge, or should have known through the exercise of due diligence that other materials are ACM, they too must be treated as PACM. The designation of PACM may be rebutted pursuant to 29 CFR 1926.1101 (b).

Professional IH - An IH who meets the definition requirements of AIHA; meets the definition requirements of OSHA as a "Competent Person" at 29 CFR 1926.1101 (b); has completed two specialized EPA approved courses on management and supervision of asbestos abatement projects; has formal training in respiratory protection and waste disposal; and has a minimum of four projects of similar complexity with this project of which at least three projects serving as the supervisory IH. The PIH may be either the VA's PIH (VPIH) of Contractor's PIH (CPIH/CIH).

Project designer - A person who has successfully completed the training requirements for an asbestos abatement project designer as required by 40 CFR 763 Appendix C, Part I; (B)(5).

Assigned Protection factor - A value assigned by OSHA/NIOSH to indicate the expected protection provided by each respirator class, when the respirator is properly selected and worn correctly. The number indicates the reduction of exposure level from outside to inside the respirator facepiece.

Qualitative fit test (QLFT) - A fit test using a challenge material that can be sensed by the wearer if leakage in the respirator occurs.

Quantitative fit test (QNFT) - A fit test using a challenge material which is quantified outside and inside the respirator thus allowing the determination of the actual fit factor.

Regulated area - An area established by the employer to demarcate where Class I, II, III asbestos work is conducted, and any adjoining area where debris and waste from such asbestos work may accumulate; and a work area within which airborne concentrations of asbestos exceed, or there is a reasonable possibility they may exceed the PEL.

Regulated ACM (RACM) - Friable ACM; Category I non-friable ACM that has become friable; Category I non-friable ACM that will be or has been subjected to sanding, grinding, cutting, or abrading or; Category II non-friable ACM that has a high probability of becoming or has become crumbled, pulverized, or reduced to powder by the forces expected to act on the material in the course of the demolition or renovation operation.

Removal - All operations where ACM, PACM and/or RACM is taken out or stripped from structures or substrates, including demolition operations.

Renovation - Altering a facility or one or more facility components in any way, including the stripping or removal of asbestos from a facility component which does not involve demolition activity.

Repair - Overhauling, rebuilding, reconstructing, or reconditioning of structures or substrates, including encapsulation or other repair of ACM or PACM attached to structures or substrates.

Shower room - The portion of the PDF where personnel shower before leaving the regulated area.

Supplied air respirator (SAR) - A respiratory protection system that supplies minimum Grade D respirable air per ANSI/Compressed Gas Association Commodity Specification for Air, G-7.1-1989.

Surfacing ACM - A material containing more than 1 percent asbestos that is sprayed, troweled on or otherwise applied to surfaces for acoustical, fireproofing and other purposes.

Surfactant - A chemical added to water to decrease water's surface tension thus making it more penetrating into ACM.

Thermal system ACM - A material containing more than 1 percent asbestos applied to pipes, fittings, boilers, breeching, tanks, ducts, or other structural components to prevent heat loss or gain.

Transmission electron microscopy (TEM) - A microscopy method that can identify and count asbestos fibers.

VA Professional Industrial Hygienist (VPIH/CIH) – The Department of Veterans Affairs Professional Industrial Hygienist must meet the qualifications of a PIH, and may be a Certified Industrial Hygienist (CIH).

VA Representative - The VA official responsible for on-going project work.

Visible emissions - Any emissions, which are visually detectable without the aid of instruments, coming from ACM/PACM/RACM/ACS or ACM waste material.

Waste/Equipment decontamination facility (W/EDF) – The area in which equipment is decontaminated before removal from the regulated area.

Waste generator - Any owner or operator whose act or process produces asbestos-containing waste material.

Waste shipment record - The shipping document, required to be originated and signed by the waste generator, used to track and substantiate the disposition of asbestos-containing waste material.

Wet cleaning - The process of thoroughly eliminating, by wet methods, any asbestos contamination from surfaces or objects.

1.4.3 REFERENCED STANDARDS ORGANIZATIONS

The following acronyms or abbreviations as referenced in contract/ specification documents are defined to mean the associated names. Names and addresses may be subject to change.

1. VA Department of Veterans Affairs
810 Vermont Avenue, NW
Washington, DC 20420
2. AIHA American Industrial Hygiene Association
2700 Prosperity Avenue, Suite 250
Fairfax, VA 22031
703-849-8888
3. ANSI American National Standards Institute
1430 Broadway
New York, NY 10018
212-354-3300
4. ASTM American Society for Testing and Materials
1916 Race St.
Philadelphia, PA 19103
215-299-5400

5. CFR Code of Federal Regulations
Government Printing Office
Washington, DC 20420
6. CGA Compressed Gas Association
1235 Jefferson Davis Highway
Arlington, VA 22202
703-979-0900
7. CS Commercial Standard of the National Institute of Standards and
Technology(NIST)
U. S. Department of Commerce
Government Printing Office
Washington, DC 20420
8. EPA Environmental Protection Agency
401 M St., SW
Washington, DC 20460
202-382-3949
- I. MIL-STD Military Standards/Standardization Division
Office of the Assistant Secretary of Defense
Washington, DC 20420
9. NIST National Institute for Standards and Technology
U. S. Department of Commerce
Gaithersburg, MD 20234
301-921-1000
- K. NEC National Electrical Code (by NFPA)
- L. NEMA National Electrical Manufacturer's Association
2101 L Street, NW
Washington, DC 20037
- M. NFPA National Fire Protection Association
1 Batterymarch Park
P.O. Box 9101
Quincy, MA 02269-9101
800-344-3555
- N. NIOSH National Institutes for Occupational Safety and Health
4676 Columbia Parkway
Cincinnati, OH 45226
513-533-8236

O. OSHA Occupational Safety and Health Administration
U.S. Department of Labor
Government Printing Office
Washington, DC 20402

P. UL Underwriters Laboratory
333 Pfingsten Rd.
Northbrook, IL 60062
312-272-8800

1.5 APPLICABLE CODES AND REGULATIONS

1.5.1 GENERAL APPLICABILITY OF CODES, REGULATIONS, AND STANDARDS

A. All work under this contract shall be done in strict accordance with all applicable Federal, State, and local regulations, standards and codes governing asbestos abatement, and any other trade work done in conjunction with the abatement. All applicable codes, regulations and standards are adopted into this specification and will have the same force and effect as this specification.

B. The most recent edition of any relevant regulation, standard, document or code shall be in effect. Where conflict among the requirements or with these specifications exists, the most stringent requirement(s) shall be utilized.

C. Copies of all standards, regulations, codes and other applicable documents, including this specification and those listed in Section 1.5 shall be available at the worksite in the clean change area of the worker decontamination system.

1.5.2 ASBESTOS ABATEMENT CONTRACTOR RESPONSIBILITY

The Asbestos Abatement Contractor (Contractor) shall assume full responsibility and liability for compliance with all applicable Federal, State and Local regulations related to any and all aspects of the asbestos abatement project. The Contractor is responsible for providing and maintaining training, accreditations, medical exams, medical records, personal protective equipment (PPE) including respiratory protection including respirator fit testing, as required by applicable Federal, State and Local regulations. The Contractor shall hold the VA and VPIH/CIH consultants harmless for any Contractor's failure to comply with any applicable work, packaging, transporting, disposal, safety, health, or environmental requirement on the part of himself, his employees, or his subcontractors. The Contractor will incur all costs of the CPIH/CIH, including all sampling/analytical costs to assure compliance with OSHA/EPA/State requirements related to failure to comply with the regulations applicable to the work.

1.5.3 FEDERAL REQUIREMENTS

Federal requirements which govern some aspect of asbestos abatement include, but are not limited to, the following regulations.

A. Occupational Safety and Health Administration (**OSHA**)

1. Title 29 CFR 1926.1101 - Construction Standard for Asbestos

2. Title 29 CFR 1910 Subpart I - Personal Protective Equipment
3. Title 29 CFR 1910.134 - Respiratory Protection
4. Title 29 CFR 1926 - Construction Industry Standards
5. Title 29 CFR 1910.1020 - Access to Employee Exposure and Medical Records
6. Title 29 CFR 1910.1200 - Hazard Communication
7. Title 29 CFR 1910 Subpart K - Medical and First Aid

B. Environmental Protection Agency (EPA)

1. 40 CFR 61 Subpart A and M (Revised Subpart B) - National Emission Standard for Hazardous Air Pollutants - Asbestos.
2. 40 CFR 763.80 - Asbestos Hazard Emergency Response Act (AHERA)

C. Department of Transportation (DOT)
Title 49 CFR 100 - 185 – Transportation

1.5.4 STATE REQUIREMENTS:

State requirements that apply to the asbestos abatement work, disposal, clearance, etc., include, but are not limited to, the following:

1. NC DHHS

1. 10A NCAC 41C .0601 - Asbestos Hazard Management Program
2. 40 CFR Part 61, Subpart M - National Emission Standard for Asbestos (40 CFR 61-141-157).
3. Requirements for Conducting Asbestos Work in South Carolina

1.5.5 LOCAL REQUIREMENTS

If local requirements are more stringent than federal or state standards, the local standards are to be followed.

1.5.6 STANDARDS

A. Standards which govern asbestos abatement activities include, but are not limited to, the following:

1. American National Standards Institute (ANSI) Z9.2-79 – Fundamentals Governing the Design and Operation of Local Exhaust Systems and ANSI Z88.2 - Practices for Respiratory Protection.

2. Underwriters Laboratories (UL) 586-90 - UL Standard for Safety of HEPA filter Units, 7th Edition.

B. Standards which govern encapsulation work include, but are not limited to, the following:

1. American Society for Testing and Materials (ASTM)

C. Standards which govern the fire and safety concerns in abatement work include, but are not limited to, the following:

1. National Fire Protection Association (NFPA) 241 - Standard for Safeguarding Construction, Alteration, and Demolition Operations.

2. NFPA 701 - Standard Methods for Fire Tests for Flame Resistant Textiles and Film.

3. NFPA 101 - Life Safety Code

1.5.7 EPA GUIDANCE DOCUMENTS

A. EPA guidance documents which discuss asbestos abatement work activities are listed below. These documents are made part of this section by reference. EPA publications can be ordered from (800) 424-9065.

B. Guidance for Controlling ACM in Buildings (Purple Book) EPA 560/5-85-024

C. Asbestos Waste Management Guidance EPA 530-SW-85-007.

D. A Guide to Respiratory Protection for the Asbestos Abatement Industry EPA-560-OPTS-86-001

E. Guide to Managing Asbestos in Place (Green Book) TS 799 20T July 1990

1.5.8 NOTICES

A. State and Local agencies: Send written notification as required by state and local regulations including the local fire department prior to beginning any work on ACM as follows:

B. Copies of notifications shall be submitted to the VA for the facility's records in the same time frame notification are given to EPA, State, and Local authorities.

1.5.9 PERMITS/LICENSES

The contractor shall apply for and have all required permits and licenses to perform asbestos abatement work as required by Federal, State, and Local regulations.

1.5.10 POSTING AND FILING OF REGULATIONS

Maintain two (2) copies of applicable federal, state, and local regulations. Post one copy of each at the regulated area where workers will have daily access to the regulations and keep another copy in the Contractor's office.

1.5.11 VA RESPONSIBILITIES

Prior to commencement of work:

A. Notify occupants adjacent to regulated areas of project dates and requirements for relocation, if needed. Arrangements must be made prior to starting work for relocation of desks, files, equipment, and personal possessions to avoid unauthorized access into the regulated area. Note: Notification of adjacent personnel is required by OSHA in 29 CFR 1926.1101 (k) to prevent unnecessary or unauthorized access to the regulated area.

1.5.12 EMERGENCY ACTION PLAN AND ARRANGEMENTS

A. An Emergency Action Plan shall be developed by prior to commencing abatement activities and shall be agreed to by the Contractor and the VA. The Plan shall meet the requirements of 29 CFR 1910.38 (a); (b).

B. Emergency procedures shall be in written form and prominently posted in the clean room and equipment room of the decontamination unit. Everyone, prior to entering the regulated area, must read and sign these procedures to acknowledge understanding of the regulated area layout, location of emergency exits and emergency procedures.

C. Emergency planning shall include written notification of police, fire, and emergency medical personnel of planned abatement activities; work schedule; layout of regulated area; and access to the regulated area, particularly barriers that may affect response capabilities.

D. Emergency planning shall include consideration of fire, explosion, hazardous atmospheres, electrical hazards, slips/trips and falls, confined spaces, and heat stress illness. Written procedures for response to emergency situations shall be developed and employee training in procedures shall be provided.

E. Employees shall be trained in regulated area/site evacuation procedures in the event of workplace emergencies.

1. For non-life-threatening situations - employees injured or otherwise incapacitated shall decontaminate following normal procedures with assistance from fellow workers, if necessary, before exiting the regulated area to obtain proper medical treatment.

2. For life-threatening injury or illness, worker decontamination shall take least priority after measures to stabilize the injured worker, remove them from the regulated area, and secure proper medical treatment.

F. Telephone numbers of any/all emergency response personnel shall be prominently posted in the clean room, along with the location of the nearest telephone.

G. The Contractor shall provide verification of first aid/CPR training for personnel responsible for providing first aid/CPR. OSHA requires medical assistance within 3-4 minutes of a life-threatening injury/illness. Bloodborne Pathogen training shall also be verified for those personnel required to provide first aid/CPR.

H. The Emergency Action Plan shall provide for a Contingency Plan in the event that an incident occurs that may require the modification of the Asbestos Hazard Abatement Plans during abatement. Such incidents include, but are not limited to, fire; accident; power failure; negative pressure failure; and supplied air system failure. The Contractor shall detail procedures to be followed in the event of an incident assuring that asbestos abatement work is stopped and wetting is continued until correction of the problem.

1.5.14 PRE-CONSTRUCTION MEETING

Prior to commencing the work, the Contractor shall meet with the VPCIH to present and review, as appropriate, the items following this paragraph. The Contractor's Competent Person(s) who will be on-site shall participate in the pre-start meeting. The pre-start meeting is to discuss and determine procedures to be used during the project. At this meeting, the Contractor shall provide:

A. Proof of Contractor licensing.

B. Proof the Competent Person is trained and accredited and approved for working in this State. Verification of the experience of the Competent Person shall also be presented.

C. A list of all workers who will participate in the project, including experience and verification of training and accreditation.

D. A list of and verification of training for all personnel who have current first-aid/CPR training. A minimum of one person per shift must have adequate training.

E. Current medical written opinions for all personnel working on-site meeting the requirements of 29 CFR 1926.1101 (m).

F. Current fit-tests for all personnel wearing respirators on-site meeting the requirements of 29 CFR 1926.1101 (h) and Appendix C.

G. A copy of the Contractor's Asbestos Hazard Abatement Plan. In these procedures, the following information must be detailed, specific for this project. A copy of the Contractor's Asbestos Hazard Abatement Plan (AHAP) for Class I Glovebag Asbestos Abatement. In these procedures, the following information must be detailed, specific for this project.

1. Regulated area preparation procedures;

2. Notification requirements procedure of Contractor as required in 29 CFR 1926.1101 (d);

3. If required, decontamination area set-up/layout and decontamination procedures for employees;

4. Glovebag abatement methods/procedures and equipment to be used; and

5. Personal protective equipment to be used.

H. At this meeting the Contractor shall provide all submittals as required.

I. Procedures for handling, packaging and disposal of asbestos waste.

J. Emergency Action Plan and Contingency Plan Procedures.

1.6 PROJECT COORDINATION

The following are the minimum administrative and supervisory personnel necessary for coordination of the work.

1.6.1 PERSONNEL

A. Administrative and supervisory personnel shall consist of a qualified Competent Person(s) as defined by OSHA in the Construction Standards and the Asbestos Construction Standard; Contractor Professional Industrial Hygienist and Industrial Hygiene Technicians. These employees are the Contractor's representatives responsible for compliance with these specifications and all other applicable requirements.

B. Non-supervisory personnel shall consist of an adequate number of qualified personnel to meet the schedule requirements of the project. Personnel shall meet required qualifications. Personnel utilized onsite shall be pre-approved by the VA representative. A request for approval shall be submitted for any person to be employed during the project giving the person's name; social security number; qualifications; accreditation card with color picture; Certificate of Worker's Acknowledgment; and Affidavit of Medical Surveillance and Respiratory Protection and current Respirator Fit Test.

C. Minimum qualifications for Contractor and assigned personnel are:

1. The Contractor has conducted within the last three (3) years, three (3) projects of similar complexity and dollar value as this project; has not been cited and penalized for serious violations of federal (and state as applicable) EPA and OSHA asbestos regulations in the past three (3) years; has adequate liability/occurrence insurance for asbestos work as required by the state; is licensed in applicable states; has adequate and qualified personnel available to complete the work; has comprehensive Asbestos Hazard Abatement Plans (AHAPs) for asbestos work; and has adequate materials, equipment and supplies to perform the work.
2. The Competent Person has four (4) years of abatement experience of which two (2) years were as the Competent Person on the project; meets the OSHA definition of a Competent Person; has been the Competent Person on two (2) projects of similar size and complexity as this project within the past three (3) years; has completed EPA AHERA/OSHA/State/Local training requirements/accreditation(s) and refreshers; and has all required OSHA documentation related to medical and respiratory protection.
3. The Contractor Professional Industrial Hygienist/CIH (CPIH/CIH) shall have five (5) years of monitoring experience and supervision of asbestos abatement projects; has participated as senior IH on five (5) abatement projects, three (3) of which are similar in size and complexity as this project; has developed at least one complete Asbestos Hazard Abatement Plan for asbestos abatement; has trained abatement personnel for three (3) years; has specialized EPA AHERA/OSHA training in asbestos abatement management, respiratory protection, waste disposal and asbestos inspection; has completed the NIOSH 582 Course or equivalent, Contractor/Supervisor course; and has appropriate medical/respiratory protection

records/documentation.

4. The Abatement Personnel shall have completed the EPA AHERA/OSHA abatement worker course; have training on the Asbestos Hazard Abatement Plans of the Contractor; has one year of asbestos abatement experience within the past three (3) years of similar size and complexity; has applicable medical and respiratory protection documentation; has certificate of training/current refresher and State accreditation/license.

All personnel should be in compliance with OSHA construction safety training as applicable and submit certification.

1.7 RESPIRATORY PROTECTION

1.7.1 GENERAL - RESPIRATORY PROTECTION PROGRAM

The Contractor shall develop and implement a written Respiratory Protection Program (RPP) which is in compliance with the January 8, 1998 OSHA requirements found at 29 CFR 1926.1101 and 29 CFR 1910 Subpart I;134. ANSI Standard Z88.2-1992 provides excellent guidance for developing a respiratory protection program. All respirators used must be NIOSH approved for asbestos abatement activities. The written RPP shall, at a minimum, contain the basic requirements found at 29 CFR 1910.134 (c)(1)(i - ix) - Respiratory Protection Program.

1.7.2 RESPIRATORY PROTECTION PROGRAM COORDINATOR

The Respiratory Protection Program Coordinator (RPPC) must be identified and shall have two (2) years' experience coordinating RPP of similar size and complexity. The RPPC must submit a signed statement attesting to the fact that the program meets the above requirements.

1.7.3 SELECTION AND USE OF RESPIRATORS

The procedure for the selection and use of respirators must be submitted to the VA as part of the Contractor's qualifications. The procedure must be written clearly enough for workers to understand. A copy of the Respiratory Protection Program must be available in the clean room of the decontamination unit for reference by employees or authorized visitors.

1.7.4 MINIMUM RESPIRATORY PROTECTION

Minimum respiratory protection shall be a full face powered air purifying respirator when fiber levels are maintained consistently at or below 0.5 f/cc. A higher level of respiratory protection may be provided or required, depending on fiber levels. Respirator selection shall meet the requirements of 29 CFR 1926.1101 (h); Table 1, except as indicated in this paragraph. Abatement personnel must have a respirator for their exclusive use.

1.7.5 MEDICAL WRITTEN OPINION

No employee shall be allowed to wear a respirator unless a physician or other licensed health care professional has provided a written determination they are medically qualified to wear the class of respirator to be used on the project while wearing whole body impermeable garments and subjected to heat or cold stress.

1.7.6 RESPIRATOR FIT TEST

All personnel wearing respirators shall have a current quantitative fit test which was conducted in accordance with 29 CFR 1910.134 (f) and Appendix A. Fit tests shall be done for PAPR's which have been put into a failure mode.

1.7.7 RESPIRATOR FIT CHECK

The Competent Person shall assure that the positive/negative pressure user seal check is done each time the respirator is donned by an employee. Head coverings must cover respirator head straps. Any situation that prevents an effective facepiece to face seal as evidenced by failure of a user seal check shall preclude that person from wearing a respirator inside the regulated area until resolution of the problem.

1.7.8 MAINTENANCE AND CARE OF RESPIRATORS

The Respiratory Protection Program Coordinator shall submit evidence and documentation showing compliance with 29 CFR 1910.134 (h) maintenance and care of respirators.

1.8 WORKER PROTECTION

1.8.1 TRAINING OF ABATEMENT PERSONNEL

Prior to beginning any abatement activity, all personnel shall be trained in accordance with OSHA 29 CFR 1926.1101 (k)(9) and any additional State/Local requirements. Training must include, at a minimum, the elements listed at 29 CFR 1926.1101 (k)(9)(viii). Training shall have been conducted by a third party, EPA/State approved trainer meeting the requirements of EPA 40 CFR 763 Appendix C (AHERA MAP). Initial training certificates and current refresher and accreditation proof must be submitted for each person working at the site.

1.8.2 MEDICAL EXAMINATIONS

Medical examinations meeting the requirements of 29 CFR 1926.1101 (m) shall be provided for all personnel working in the regulated area, regardless of exposure levels. A current physician's written opinion as required by 29 CFR 1926.1101 (m)(4) shall be provided for each person and shall include in the medical opinion the person has been evaluated for working in a heat and cold stress environment while wearing personal protective equipment (PPE) and is able to perform the work without risk of material health impairment.

1.8.3 PERSONAL PROTECTIVE EQUIPMENT

Provide whole body clothing, head coverings, foot coverings and any other personal protective equipment as determined by conducting the hazard assessment required by OSHA at 29 CFR 1910.132 (d). The Competent Person shall ensure the integrity of personal protective equipment worn for the duration of the project. Duct tape shall be used to secure all suit sleeves to wrists and to secure foot coverings at the ankle.

1.8.4 REGULATED AREA ENTRY PROCEDURE

The Competent Person shall ensure that each time workers enter the regulated area; they remove ALL street clothes in the clean room of the decontamination unit and put on new disposable coveralls, head coverings, a clean respirator, and then proceed through the shower room to the equipment room where they put on non-disposable required personal protective equipment.

1.8.5 DECONTAMINATION PROCEDURE

The Competent Person shall require all personnel to adhere to following decontamination procedures whenever they leave the regulated area.

A. When exiting the regulated area, remove disposable coveralls, and ALL other clothes, disposable head coverings, and foot coverings or boots in the equipment room.
B. Still wearing the respirator and completely naked, proceed to the shower. Showering is MANDATORY. Care must be taken to follow reasonable procedures in removing the respirator to avoid inhaling asbestos fibers while showering. The following procedure is required as a minimum:

1. Thoroughly wet body including hair and face. If using a PAPR hold blower above head to keep filters dry.
2. With respirator still in place, thoroughly decontaminate body, hair, respirator face piece, and all other parts of the respirator except the blower and battery pack on a PAPR. Pay particular attention to cleaning the seal between the face and respirator facepiece and under the respirator straps.
3. Take a deep breath, hold it and/or exhale slowly, completely wetting hair, face, and respirator. While still holding breath, remove the respirator and hold it away from the face before starting to breathe.

C. Carefully decontaminate the facepiece of the respirator inside and out.
If using a PAPR, shut down using the following sequence: a) first cap inlets to filters; b) turn blower off to keep debris collected on the inlet side of the filter from dislodging and contaminating the outside of the unit; c) thoroughly decontaminate blower and hoses; d) carefully decontaminate battery pack with a wet rag being cautious of getting water in the battery pack thus preventing destruction. (THIS PROCEDURE IS NOT A SUBSTITUTE FOR RESPIRATOR CLEANING!)

D. Shower and wash body completely with soap and water. Rinse thoroughly.

E. Rinse shower room walls and floor to drain prior to exiting.

F. Proceed from shower to clean room; dry off and change into street clothes or into new disposable work clothing.

1.8.6 REGULATED AREA REQUIREMENTS

The Competent Person shall meet all requirements of 29 CFR 1926.1101 (o) and assure that all requirements for Class I glovebag regulated areas at 29 CFR 1926.1101 (e) are met. All personnel in the regulated area shall not be allowed to eat, drink, smoke, chew tobacco or gum, apply cosmetics, or in any way interfere with the fit of their respirator.

1.9 DECONTAMINATION FACILITIES

1.9.1 DESCRIPTION

Provide each regulated area with separate personnel decontamination facilities (PDF) and waste/equipment decontamination facilities (W/EDF). Ensure that the PDF are the only means of

ingress and egress to the regulated area and that all equipment, bagged waste, and other material exit the regulated area only through the W/EDF.

1.9.2 GENERAL REQUIREMENTS

All personnel entering or exiting a regulated area must go through the PDF and shall follow the requirements at 29 CFR 1926.1101 (j)(1) and these specifications. All waste, equipment and contaminated materials must exit the regulated area through the W/EDF and be decontaminated in accordance with these specifications. Walls and ceilings of the PDF and W/EDF must be constructed of a minimum of 3 layers of 6 mil opaque fire retardant polyethylene sheeting and be securely attached to existing building components and/or an adequate temporary framework. A minimum of 3 layers of 6 mil poly shall also be used to cover the floor under the PDF and W/EDF units. Construct doors so that they overlap and secure to adjacent surfaces. Weight inner doorway sheets with layers of duct tape so that they close quickly after release. Put arrows on sheets so they show direction of travel and overlap. If the building adjacent area is occupied, construct a solid barrier on the occupied side(s) to protect the sheeting and reduce potential for non-authorized personnel entering the regulated area.

1.9.3 TEMPORARY FACILITIES TO THE PDF AND W/EDF

The Competent Person shall provide temporary water service connections to the PDF and W/EDF. Backflow prevention must be provided at the point of connection to the VA system. Water supply must be of adequate pressure and meet requirements of 29 CFR 1910.141(d)(3). Provide adequate temporary overhead electric power with ground fault circuit interruption (GFCI) protection. Provide a sub-panel equipped with GFCI protection for all temporary power in the clean room. Provide adequate lighting to provide a minimum of 50 foot candles in the PDF and W/EDF. Provide temporary heat, if needed, to maintain 70°F throughout the PDF and W/EDF.

1.9.4 PERSONNEL DECONTAMINATION FACILITY (PDF)

The Competent Person shall provide a PDF consisting of shower room which is contiguous to a clean room and equipment room. The PDF must be sized to accommodate the number of personnel scheduled for the project. The shower room, located in the center of the PDF, shall be fitted with as many portable showers as necessary to insure all employees can complete the entire decontamination procedure within 15 minutes. The PDF shall be constructed of opaque poly for privacy. The PDF shall be constructed to eliminate any parallel routes of egress without showering.

1. Clean Room: The clean room must be physically and visually separated from the rest of the building to protect the privacy of personnel changing clothes. The clean room shall be constructed of at least 3 layers of 6 mil opaque fire retardant poly to provide an air tight room. Provide a minimum of 3 foot wide 6 mil poly opaque fire retardant doorways. One doorway shall be the entry from outside the PDF and the second doorway shall be to the shower room of the PDF.

The floor of the clean room shall be maintained in a clean, dry condition. Shower overflow shall not be allowed into the clean room. Provide 1 storage locker per person. A portable fire extinguisher, minimum 10 pounds capacity, Type ABC, shall be provided in accordance with OSHA and NFPA Standard 10. All persons entering the regulated area shall remove all street clothing in the clean room and dress in disposable protective clothing and respiratory


protection. Any person entering the clean room does so either from the outside with street clothing on or is coming from the shower room completely naked and thoroughly washed. Females required to enter the regulated area shall be ensured of their privacy throughout the entry/exit process by posting guards at both entry points to the PDF so no male can enter or exit the PDF during her stay in the PDF.

2. Shower Room: The Competent Person shall assure that the shower room is a completely water tight compartment to be used for the movement of all personnel from the clean room to the equipment room and for the showering of all personnel going from the equipment room to the clean room. Each shower shall be constructed so water runs down the walls of the shower and into a drip pan. Install a freely draining smooth floor on top of the shower pan. The shower room shall be separated from the rest of the building and from the clean room and equipment room using air tight walls made from at least 3 layers of 6 mil opaque fire retardant poly. The shower shall be equipped with a shower head and controls, hot and cold water, drainage, soap dish and continuous supply of soap, and shall be maintained in a sanitary condition throughout its use. The controls shall be arranged so an individual can shower without assistance. Provide a flexible hose shower head, hose bibs and all other items shown on Shower Schematic.

Waste water will be pumped to a drain after being filtered through a minimum of a 100-micron sock in the shower drain; a 20 micron filter; and a final 5 micron filter. Filters will be changed a minimum of once per day or more often as needed. Filter changes must be done in the shower to prevent loss of contaminated water. Hose down all shower surfaces after each shift and clean any debris from the shower pan. Residue is to be disposed of as asbestos waste.

3. Equipment Room: The Competent Person shall provide an equipment room which shall be an air tight compartment for the storage of work equipment/tools, reusable personal protective equipment, except for a respirator and for use as a gross decontamination area for personnel exiting the regulated area. The equipment room shall be separated from the regulated area by a minimum 3-foot-wide door made with 2 layers of 6 mil opaque fire retardant poly. The equipment room shall be separated from the regulated area, the shower room and the rest of the building by air tight walls and ceiling constructed of a minimum of 3 layers of 6 mil opaque fire retardant poly. Damp wipe all surfaces of the equipment room after each shift change. Provide an additional loose layer of 6 mil fire retardant poly per shift change and remove this layer after each shift. If needed, provide a temporary electrical sub-panel equipped with GFCI in the equipment room to accommodate any equipment required in the regulated area.


4. The PDF shall be as follows: Clean room at the entrance followed by a shower room followed by an equipment room leading to the regulated area. Each doorway in the PDF shall be a minimum of 2 layers of 6 mil opaque fire retardant poly.

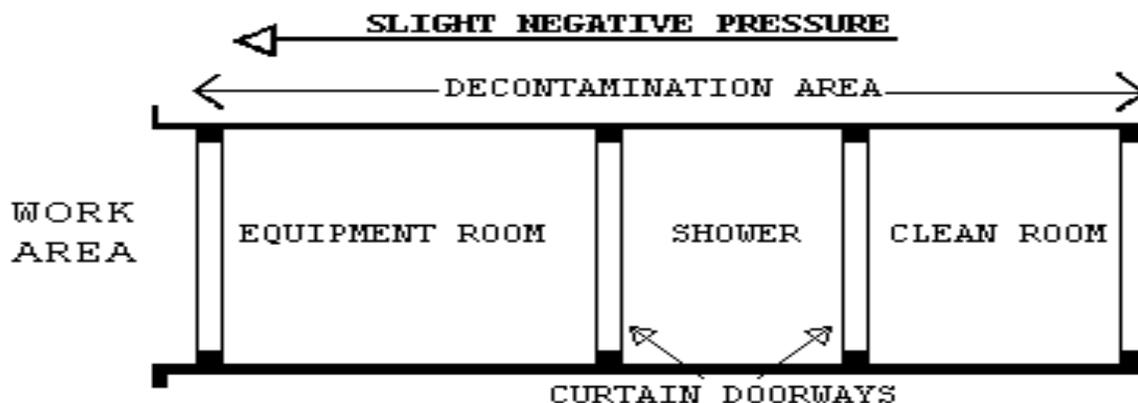

1.9.5 WASTE/EQUIPMENT DECONTAMINATION FACILITY (W/EDF)

The Competent Person shall provide a W/EDF consisting of a wash room, holding room, and clean room for removal of waste, equipment and contaminated material from the regulated area. Personnel shall not enter or exit the W/EDF except in the event of an emergency. Clean debris and residue in the W/EDF daily. All surfaces in the W/EDF shall be wiped/hosed down after each shift and all debris shall be cleaned from the shower pan. The W/EDF shall consist of the following:

1. Wash Down Station: Provide an enclosed shower unit in the regulated area just outside the Wash Room as an equipment bag and container cleaning station.
2. Wash Room: Provide a wash room for cleaning of bagged or containerized asbestos containing waste materials passed from the regulated area. Construct the wash room using 2" x 4" wood framing and 3 layers of 6 mil fire retardant poly. Locate the wash room so that packaged materials, after being wiped clean, can be passed to the Holding Room. Doorways in the wash room shall be constructed of 2 layers of 6 mil fire retardant poly.
3. Holding Room: Provide a holding room as a drop location for bagged materials passed from the wash room. Construct the holding room using 2" x 4" wood framing and 3 layers of 6 mil fire retardant poly. The holding room shall be located so that bagged material cannot be passed from the wash room to the clean room unless it goes through the holding room. Doorways in the holding room shall be constructed of 2 layers of 6 mil fire retardant poly.
4. Clean Room: Provide a clean room to isolate the holding room from the exterior of the regulated area. Construct the clean room using 2 x 4 wood framing and 2 layers of 6 mil fire retardant poly. The clean room shall be located so as to provide access to the holding room from the building exterior. Doorways to the clean room shall be constructed of 2 layers of 6 mil fire retardant poly. When a negative pressure differential system is used, a rigid enclosure separation between the W/EDF clean room and the adjacent areas shall be provided.
5. The W/EDF shall be as follows: Wash Room leading to a Holding Room followed by a Clean Room leading to outside the regulated area. See diagram.

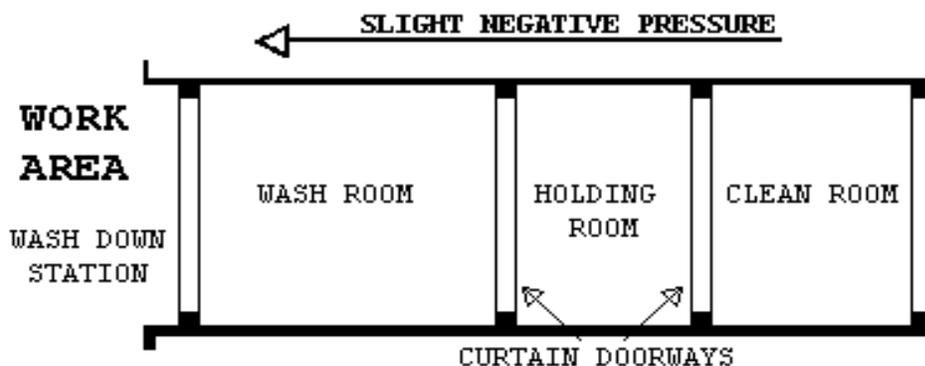

1.9.6 WASTE/EQUIPMENT DECONTAMINATION PROCEDURES

At the wash-down station in the regulated area, thoroughly wet wipe/clean contaminated equipment and/or sealed polyethylene bags and pass into Wash Room after visual inspection. When passing anything into the Wash Room, close all doorways of the W/EDF, other than the doorway between the wash-down station and the Wash Room. Keep all outside personnel clear of the W/EDF. Once inside the Wash Room, wet clean the equipment and/or bags. After cleaning and inspection, pass items into the Holding Room. Close all doorways except the doorway between the Holding Room and the Clean Room. Workers from the Clean Room/Exterior shall enter the Holding Room and remove the decontaminated/cleaned equipment/bags for removal and disposal. These personnel will not be required to wear PPE. At no time, shall personnel from the clean side be allowed to enter the Wash Room.

PART 2 - PRODUCTS, MATERIALS AND EQUIPMENT

2.1 MATERIALS AND EQUIPMENT

2.1.1 GENERAL REQUIREMENTS (ALL ABATEMENT PROJECTS)

Prior to the start of work, the contractor shall provide and maintain a sufficient quantity of materials and equipment to assure continuous and efficient work throughout the duration of the project. Work shall not start unless the following items have been delivered to the site and the CPIH/CIH has submitted verification to the VA's representative.

- A. All materials shall be delivered in their original package, container or bundle bearing the name of the manufacturer and the brand name (where applicable).
- B. Store all materials subject to damage off the ground, away from wet or damp surfaces and under cover sufficient enough to prevent damage or contamination. Flammable and combustible materials cannot be stored inside buildings. Replacement materials shall be stored outside of the regulated area until abatement is completed.
- C. The Contractor shall not block or hinder use of buildings by patients, staff, and visitors to the VA in partially occupied buildings by placing materials/equipment in any unauthorized location.
- D. The Competent Person shall inspect for damaged, deteriorating or previously used materials. Such materials shall not be used and shall be removed from the worksite and disposed of properly.
- E. Polyethylene sheeting for walls in the regulated area shall be a minimum of 4-mils. For floors and all other uses, sheeting of at least 6-mils shall be used in widths selected to minimize the frequency of joints. Fire retardant poly shall be used throughout.
- F. The method of attaching polyethylene sheeting shall be agreed upon in advance by the Contractor and the VA and selected to minimize damage to equipment and surfaces. Method of attachment may include any combination of moisture resistant duct tape furring strips, spray glue, staples, nails, screws, lumber and plywood for enclosures or other effective procedures capable of sealing polyethylene to dissimilar finished or unfinished surfaces under both wet and dry conditions.

G. Polyethylene sheeting utilized for the PDF shall be opaque white or black in color, 6 mil fire retardant poly.

H. Installation and plumbing hardware, showers, hoses, drain pans, sump pumps and waste water filtration system shall be provided by the Contractor.

I. An adequate number of HEPA vacuums, scrapers, sprayers, nylon brushes, brooms, disposable mops, rags, sponges, staple guns, shovels, ladders and scaffolding of suitable height and length as well as meeting OSHA requirements, fall protection devices, water hose to reach all areas in the regulated area, airless spray equipment, and any other tools, materials or equipment required to conduct the abatement project. All electrically operated hand tools, equipment, electric cords shall be connected to GFCI protection.

J. Special protection for objects in the regulated area shall be detailed (e.g., plywood over carpeting or hardwood floors to prevent damage from scaffolds, water and falling material).

K. Disposal bags – 2 layers of 6 mil poly for asbestos waste shall be preprinted with labels, markings and address as required by OSHA, EPA and DOT regulations.

L. The VA shall be provided an advance copy of the MSDS as required for all hazardous chemicals under OSHA 29 CFR 1910.1200 – Hazard Communication in the pre-project submittal. Chlorinated compounds shall not be used with any spray adhesive, mastic remover or other product. Appropriate encapsulate(s) shall be provided.

M. OSHA DANGER demarcation signs, as many and as required by OSHA 29 CFR 1926.1101(k)(7) shall be provided and placed by the Competent Person. All other posters and notices required by Federal and State regulations shall be posted in the Clean Room.

N. Adequate and appropriate PPE for the project and number of personnel/shifts shall be provided. All personal protective equipment issued must be based on a written hazard assessment conducted under 29 CFR 1910.132(d).

2.2 CONTAINMENT BARRIERS AND COVERINGS IN THE REGULATED AREA

2.2.1 GENERAL

Using critical barriers, seal off the perimeter to the regulated area to completely isolate the regulated area from adjacent spaces. All horizontal surfaces in the regulated area must be covered with 2 layers of 6 mil fire retardant poly to prevent contamination and to facilitate clean-up. Should adjacent areas become contaminated, immediately stop work and clean up the contamination at no additional cost to the Government. Provide firestopping and identify all fire barrier penetrations due to abatement work as specified in Section 2.2.8; FIRESTOPPING.

2.2.2 PREPARATION PRIOR TO SEALING THE REGULATED AREA

A. Place all tools, scaffolding, materials and equipment needed for working in the regulated area prior to erecting any plastic sheeting. Remove all uncontaminated removable furniture, equipment and/or supplies from the regulated area before commencing work, or completely cover with 2 layers of 6-mil fire retardant poly sheeting and secure with duct tape. Lock out and tag out any HVAC systems in the regulated area.

2.2.3 CONTROLLING ACCESS TO THE REGULATED AREA

A. Access to the regulated area is allowed only through the personnel decontamination facility (PDF), if required. All other means of access shall be eliminated and OSHA Danger demarcation signs posted as required by OSHA. If the regulated area is adjacent to or within view of an occupied area, provide a visual barrier of 6 mil opaque fire retardant poly sheeting to prevent building occupant observation. If the adjacent area is accessible to the public, the barrier must be solid.

2.2.4 CRITICAL BARRIERS

A. Completely separate any openings into the regulated area from adjacent areas using fire retardant poly at least 6 mils thick and duct tape. Individually seal with 2 layers of 6 mil poly and duct tape all HVAC openings into the regulated area. Individually seal all lighting fixtures, clocks, doors, windows, convectors, speakers, or any other objects in the regulated area. Heat must be shut off any objects covered with poly.

2.2.5 SECONDARY BARRIERS

A. A loose layer of 6 mil fire retardant poly shall be used as a drop cloth to protect the floor/horizontal surfaces from debris generated during the glovebag abatement. This layer shall be replaced as needed during the work.

2.2.6 EXTENSION OF THE REGULATED AREA

A. If the enclosure of the regulated area is breached in any way that could allow contamination to occur, the affected area shall be included in the regulated area and constructed as per this section. If the affected area cannot be added to the regulated area, decontamination measures must be started immediately and continue until air monitoring indicates background levels are met.

2.2.7 FIRESTOPPING

A. Through penetrations caused by cables, cable trays, pipes, sleeves must be fire stopped with a fire-rated firestop system providing an air tight seal.

B. Firestop materials that are not equal to the wall or ceiling penetrated shall be brought to the attention of the VA Representative. The Contractor shall list all areas of penetration, the type of sealant used, and whether or not the location is fire rated. Any discovery of penetrations during abatement shall be brought to the attention of the VA Representative immediately. All walls, floors and ceilings are considered fire rated unless otherwise determined by the VA Representative or Fire Marshall.

C. Any visible openings whether or not caused by a penetration shall be reported by the Contractor to the VA Representative for a sealant system determination. Firestops shall meet ASTM E814 and UL 1479 requirements for the opening size, penetrant, and fire rating needed.

2.3 MONITORING, INSPECTION AND TESTING 2.3.1 GENERAL

A. Perform throughout abatement work monitoring, inspection and testing inside and around the regulated area in accordance with the OSHA requirements and these specifications. OSHA requires that the Employee exposure to asbestos must not exceed 0.1 fibers per cubic centimeter (f/cc) of air, averaged over an 8-hour work shift. The CPIH/CIH is responsible for and shall inspect and oversee the performance of the Contractor IH Technician. The IH Technician shall continuously inspect and monitor conditions inside the regulated area to ensure compliance

with these specifications. In addition, the CPIH/CIH shall personally manage air sample collection, analysis, and evaluation for personnel, regulated area, and adjacent area samples to satisfy OSHA requirements. Additional inspection and testing requirements are also indicated in other parts of this specification.

B. The VA will employ an independent industrial hygienist (VPIH/CIH) consultant and/or use its own IH to perform various services on behalf of the VA. The VPIH/CIH will perform the necessary monitoring, inspection, testing, and other support services to ensure that VA patients, employees, and visitors will not be adversely affected by the abatement work, and that the abatement work proceeds in accordance with these specifications, that the abated areas or abated buildings have been successfully decontaminated. The work of the VPIH/CIH consultant in no way relieves the Contractor from their responsibility to perform the work in accordance with contract/specification requirements, to perform continuous inspection, monitoring and testing for the safety of their employees, and to perform other such services as specified. The cost of the VPIH/CIH and their services will be borne by the VA except for any repeat of final inspection and testing that may be required due to unsatisfactory initial results. Any repeated final inspections and/or testing, if required, will be paid for by the Contractor.

C. If fibers counted by the VPIH/CIH during abatement work, either inside or outside the regulated area, utilizing the NIOSH 7400 air monitoring method, exceed the specified respective limits, the Contractor shall stop work. The Contractor may request confirmation of the results by analysis of the samples by TEM.

Request must be in writing and submitted to the VA's representative. Cost for the confirmation of results will be borne by the Contractor for both the collection and analysis of samples and for the time delay that may/does result for this confirmation. Confirmation sampling and analysis will be the responsibility of the CPIH/CIH with review and approval of the VPIH/CIH. An agreement between the CPIH/CIH and the VPIH/CIH shall be reached on the exact details of the confirmation effort, in writing, including such things as the number of samples, location, collection, quality control on-site, analytical laboratory, interpretation of results and any follow-up actions. This written agreement shall be cosigned by the IH's and delivered to the VA's representative.

2.3.2 SCOPE OF SERVICES OF THE VPIH/CIH CONSULTANT

A. The purpose of the work of the VPIH/CIH is to: Assure quality; resolve problems; and prevent the spread of contamination beyond the regulated area. In addition, their work includes performing the final inspection and testing to determine whether the regulated area or building has been adequately decontaminated. All air monitoring is to be done utilizing PCM/TEM. The VPIH/CIH will perform the following tasks:

1. Task 1: Establish background levels before abatement begins by collecting background samples. Retain samples for possible TEM analysis.

2. Task 2: Perform continuous air monitoring, inspection, and testing outside the regulated area during actual abatement work to detect any faults in the regulated area isolation and any adverse impact on the surroundings from regulated area activities.

3. Task 3: Perform unannounced visits to spot check overall compliance of work with contract/specifications. These visits may include any inspection, monitoring, and testing inside and outside the regulated area and all aspects of the operation except personnel monitoring.
 4. Task 4: Provide support to the VA representative such as evaluation of submittals from the Contractor, resolution of unforeseen developments, etc.
 5. Task 5: Perform, in the presence of the VA representative, final inspection and testing of a decontaminated regulated area or building at the conclusion of the abatement and clean-up work to certify compliance with all regulations and the VA requirements/specifications.
 6. Task 6: Issue certificate of decontamination for each regulated area or building and project report.
- B. All data, inspection results and testing results generated by the VPIH/CIH will be available to the Contractor for information and consideration. The Contractor shall cooperate with and support the VPIH/CIH for efficient and smooth performance of their work.
- C. The monitoring and inspection results of the VPIH/CIH will be used by the VA to issue any Stop Removal orders to the Contractor during abatement work and to accept or reject a regulated area or building as decontaminated.

2.3.3 MONITORING, INSPECTION AND TESTING BY ABATEMENT CONTRACTOR CPIH/CIH

The Contractor's CPIH/CIH is responsible for managing all monitoring, inspections, and testing required by these specifications, as well as any and all regulatory requirements adopted by these specifications. The CPIH/CIH is responsible for the continuous monitoring of all subsystems and procedures which could affect the health and safety of the Contractor's personnel. Safety and health conditions and the provision of those conditions inside the regulated area for all persons entering the regulated area is the exclusive responsibility of the Contractor/Competent Person. The person performing the personnel and area air monitoring inside the regulated area shall be an IH Technician, who shall be trained and shall have specialized field experience in sampling and analysis. The IH Technician shall have successfully completed a NIOSH 582 Course or equivalent and provide documentation. The IH Technician shall participate in the AIHA Asbestos Analysis Registry or participate in the Proficiency Analytic Testing program of AIHA for fiber counting quality control assurance. The IH Technician shall also be an accredited EPA AHERA/State Contractor/Supervisor (or Abatement Worker) and Building Inspector. The IH Technician shall have participated in five abatement projects collecting personal and area samples as well as responsibility for documentation on substantially similar projects in size and scope. The analytic laboratory used by the Contractor to analyze the samples shall be AIHA accredited for asbestos PAT and approved by the VA prior to start of the project. A daily log shall be maintained by the CPIH/CIH or IH Technician, documenting all OSHA requirements for air personal monitoring for asbestos in 29 CFR 1926.1101(f), (g) and Appendix A. This log shall be made available to the VA representative and the VPIH/CIH upon request. The log will contain, at a minimum, information on personnel or area samples, other persons represented by the sample, the date of sample collection, start and stop times for sampling, sample volume, flow rate, and fibers/cc. The CPIH/CIH shall collect and analyze samples for each representative job being done in the regulated area, i.e., removal, wetting, clean-up, and load-out. No fewer than

two personal samples per shift shall be collected and one area sample per 1,000 square feet of regulated area where abatement is taking place and one sample per shift in the clean room area shall be collected. In addition to the continuous monitoring required, the CPIH/CIH will perform inspection and testing at the final stages of abatement for each regulated area as specified in the CPIH/CIH responsibilities. Additionally, the CPIH/CIH will monitor and record pressure readings within the containment daily with a minimum of two readings at the beginning and at the end of a shift, and submit the data in the daily report.

2.4 ASBESTOS HAZARD ABATEMENT PLAN

The Contractor shall have established Asbestos Hazard Abatement Plan (AHAP) in printed form and loose leaf folder consisting of simplified text, diagrams, sketches, and pictures that establish and explain clearly the ways and procedures to be followed during all phases of the work by the Contractor's personnel. The AHAP must be modified as needed to address specific requirements of the project. The AHAP shall be submitted for review and approval prior to the start of any abatement work. The minimum topics and areas to be covered by the AHAP(s) are:

- A. Minimum Personnel Qualifications
- B. Contingency Plans and Arrangements
- C. Security and Safety Procedures
- D. Respiratory Protection/Personal Protective Equipment Program and Training
- E. Medical Surveillance Program and Recordkeeping
- F. Regulated Area Requirements for Glovebag Abatement
- G. Decontamination Facilities and Entry/Exit Procedures (PDF and W/EDF)
- H. Monitoring, Inspections, and Testing
- I. Removal Procedures for Piping ACM Using the Glovebag Method
- J. Disposal of ACM waste
- K. Regulated Area Decontamination/Clean-up
- L. Regulated Area Visual and Air Clearance
- M. Project Completion/Closeout

2.5 SUBMITTALS

2.5.1 PRE-START MEETING SUBMITTALS

Submit to the VA a minimum of 14 days prior to the pre-start meeting the following for review and approval. Meeting this requirement is a prerequisite for the pre-start meeting for this project:

A. Submit a detailed work schedule for the entire project reflecting contract documents and the phasing/schedule requirements from the CPM chart.

B. Submit a staff organization chart showing all personnel who will be working on the project and their capacity/function. Provide their qualifications, training, accreditations, and licenses, as appropriate. Provide a copy of the "Certificate of Worker's Acknowledgment" and the "Affidavit of Medical Surveillance and Respiratory Protection" for each person.

C. Submit Asbestos Hazard Abatement Plan developed specifically for this project, incorporating the requirements of the specifications, prepared, signed and dated by the CPIH/CIH.

D. Submit the specifics of the materials and equipment to be used for this project with manufacturer names, model numbers, performance characteristics, pictures/diagrams, and number available for the following:

1. Supplied air system, negative air machines, HEPA vacuums, air monitoring pumps, calibration devices, pressure differential monitoring device and emergency power generating system.
2. Waste water filtration system, shower system, containment barriers.
3. Encapsulants, surfactants, hand held sprayers, airless sprayers, glove bags, and fire extinguishers.
4. Respirators, protective clothing, personal protective equipment.
5. Fire safety equipment to be used in the regulated area.

E. Submit the name, location, and phone number of the approved landfill; proof/verification the landfill is approved for ACM disposal; the landfill's requirements for ACM waste; the type of vehicle to be used for transportation; and name, address, and phone number of subcontractor, if used. Proof of asbestos training for transportation personnel shall be provided.

F. Submit required notifications and arrangements made with regulatory agencies having regulatory jurisdiction and the specific contingency/emergency arrangements made with local health, fire, ambulance, hospital authorities and any other notifications/arrangements.

G. Submit the name, location and verification of the laboratory and/or personnel to be used for analysis of air and/or bulk samples. Personal air monitoring must be done in accordance with OSHA 29 CFR 1926.1101(f) and Appendix A. And area or clearance air monitoring in accordance with EPA AHERA protocols.

H. Submit qualifications verification: Submit the following evidence of qualifications. Make sure that all references are current and verifiable by providing current phone numbers and documentation.

1. Asbestos Abatement Company: Project experience within the past 3 years; listing projects first most similar to this project: Project Name; Type of Abatement; Duration; Cost; Reference Name/Phone Number; Final Clearance; and Completion Date.

2. List of project(s) halted by owner, A/E, IH, regulatory agency in the last 3 years: Project Name; Reason; Date; Reference Name/Number; and Resolution.

3. List asbestos regulatory citations (e.g., OSHA), notices of violations (e.g., Federal and state EPA), penalties, and legal actions taken against the company including and of the company's officers (including damages paid) in the last 3 years. Provide copies and all information needed for verification.

I. Submit information on personnel: Provide a resume; address each item completely; copies of certificates, accreditations, and licenses. Submit an affidavit signed by the CPIH/CIH stating that all personnel submitted below have medical records in accordance with OSHA 29 CFR 1926.1101(m) and 29 CFR 1910.20 and that the company has implemented a medical surveillance program and written respiratory protection program, and maintains recordkeeping in accordance with the above regulations. Submit the phone number and doctor/clinic/hospital used for medical evaluations.

1. CPIH/CIH and IH Technician: Name; years of abatement experience; list of projects similar to this one; certificates, licenses, accreditations for proof of AHERA/OSHA specialized asbestos training; professional affiliations; number of workers trained; samples of training materials; samples of AHAP(s) developed; medical opinion; and current respirator fit test.

2. Competent Person (s)/Supervisor(s): Number; names; social security numbers; years of abatement experience as Competent Person/Supervisor; list of similar projects in size/complexity as Competent Person/Supervisor; as a worker; certificates, licenses, accreditations; proof of AHERA/OSHA specialized asbestos training; maximum number of personnel supervised on a project; medical opinion (asbestos surveillance and respirator use); and current respirator fit test.

3. Workers: Numbers; names; social security numbers; years of abatement experience; certificates, licenses, accreditations; training courses in asbestos abatement and respiratory protection; medical opinion (asbestos surveillance and respirator use); and current respirator fit test.

J. Submit copies of State license for asbestos abatement; copy of insurance policy, including exclusions with a letter from agent stating in plain language the coverage provided and the fact that asbestos abatement activities are covered by the policy; copy of AHAP(s) incorporating the requirements of this specification; information on who provides your training, how often; who provides medical surveillance, how often; who performs and how is personal air monitoring of abatement workers conducted; a list of references of independent laboratories/IH's familiar with your air monitoring and Asbestos Hazard Abatement Plans; copies of monitoring results of the five referenced projects listed and analytical method(s) used.

K. Rented equipment must be decontaminated prior to returning to the rental agency.

L. Submit, before the start of work, the manufacturer's technical data for all types of encapsulates, all MSDS, and application instructions.

2.5.2 SUBMITTALS DURING ABATEMENT

A. The Competent Person shall maintain and submit a daily log at the regulated area documenting the dates and times of the following: purpose, attendees and summary of meetings; all personnel entering/exiting the regulated area; document and discuss the resolution of unusual events such as barrier breaching, equipment failures, emergencies, and any cause for stopping work; representative air monitoring and results/TWAs/ELs. Submit this information daily to the VPIH/CIH.

B. The CPIH/CIH shall document and maintain the inspection and approval of the regulated area preparation prior to start of work and daily during work.

1. Removal of any poly barriers.

2. Visual inspection/testing by the CPIH/CIH or IH Technician prior to application of lockdown encapsulate.

3. Packaging and removal of ACM waste from regulated area.

4. Disposal of ACM waste materials; copies of Waste Shipment Records/landfill receipts to the VA's representative on a weekly basis.

2.5.3 SUBMITTALS AT COMPLETION OF ABATEMENT

The CPIH/CIH shall submit a project report consisting of the daily log book requirements and documentation of events during the abatement project including Waste Shipment Records signed by the landfill's agent. It will also include information on the containment and transportation of waste from the containment with applicable Chain of Custody forms. The report shall include a certificate of completion, signed and dated by the CPIH/CIH, in accordance with Attachment #1. All clearance and perimeter area samples must be submitted. The VA Representative will retain the abatement report after completion of the project and provide copies of the abatement report to VAMC Office of Engineer and the Safety Office.

2.6 ENCAPSULANTS

2.6.1 TYPES OF ENCAPSULANTS

A. The following four types of encapsulates must comply with performance requirements as stated in paragraph 2.6.2:

1. Removal encapsulate - used as a wetting agent to remove ACM.

2. Bridging encapsulant - provides a tough, durable coating on ACM.

3. Penetrating encapsulant - penetrates/encapsulates ACM at least (1/2").

4. Lockdown encapsulant - seals microscopic fibers on surfaces after ACM removal.

2.6.2 PERFORMANCE REQUIREMENTS

Encapsulants shall meet the latest requirements of EPA; shall not contain toxic or hazardous substances; or solvents; and shall comply with the following performance requirements:

A. General Requirements for all Encapsulants:

1. ASTM E84: Flame spread of 25; smoke emission of 50.
2. University of Pittsburgh Protocol: Combustion Toxicity; zero mortality.
3. ASTM C732: Accelerated Aging Test; Life Expectancy - 20 years.
4. ASTM E96: Permeability - minimum of 0.4 perms.

B. Bridging/Penetrating Encapsulants:

1. ASTM E736: Cohesion/Adhesion Test - 24 kPa (50 lbs/ft²).
2. ASTM E119: Fire Resistance - 3 hours (Classified by UL for use on fibrous/cementitious fireproofing).
3. ASTM D2794: Gardner Impact Test; Impact Resistance - minimum 43 in/lb.
4. ASTM D522: Mandrel Bend Test; Flexibility - no rupture or cracking.

C. Lockdown Encapsulants:

1. ASTM E119: Fire resistance - 3 hours (tested with fireproofing over encapsulant applied directly to steel member).
2. ASTM E736: Bond Strength - 48 kPa (100 lbs/ft²) (test compatibility with cementitious and fibrous fireproofing).
3. In certain situations, encapsulants may have to be applied to hot pipes/equipment. The encapsulant must be able to withstand high temperatures without cracking or off-gassing any noxious vapors during application.

2.7 CERTIFICATES OF COMPLIANCE

The Contractor shall submit to the VA representative certification from the manufacturer indicating compliance with performance requirements for encapsulants when applied according to manufacturer recommendations.

2.8 RECYCLABLE PROTECTIVE CLOTHING

If recyclable clothing is provided, all requirements of EPA, DOT and OSHA shall be met.

PART 3 – EXECUTION

3.1 REGULATED AREA PREPARATIONS

3.1.1 SITE SECURITY

A. Regulated area access is to be restricted only to authorized, trained/accredited and protected personnel. These may include the Contractor's employees, employees of Subcontractors, VA employees and representatives, State and local inspectors, and any other designated individuals.

A list of authorized personnel shall be established prior to commencing the project and be posted in the clean room of the decontamination unit.

B. Entry into the regulated area by unauthorized individuals shall be reported immediately to the Competent Person by anyone observing the entry. The Competent Person shall immediately require any unauthorized person to leave the regulated area and then notify the VA COR or VA Representative using the most expeditious means.

C. A log book shall be maintained in the clean room of the decontamination unit. Anyone who enters the regulated area must record their name, affiliation, time in, and time out for each entry.

D. Access to the regulated area shall be through a single decontamination unit. All other access (doors, windows, hallways, etc.) shall be sealed or locked to prevent entry to or exit from the regulated area. The only exceptions for this requirement are the waste/equipment load-out area which shall be sealed except during the removal of containerized asbestos waste from the regulated area, and emergency exits. Emergency exits shall not be locked from the inside; however, they shall be sealed with poly sheeting and taped until needed. In any situation where exposure to high temperatures which may result in a flame hazard, fire retardant poly sheeting must be used.

E. The Contractor's Competent Person shall control site security during abatement operations in order to isolate work in progress and protect adjacent personnel. A 24-hour security system shall be provided at the entrance to the regulated area to assure that all entrants are logged in/out and that only authorized personnel are allowed entrance.

F. The Contractor will have the VA's assistance in notifying adjacent personnel of the presence, location and quantity of ACM in the regulated area and enforcement of restricted access by the VA's employees.

G. The regulated area shall be locked during non-working hours and secured by VA Representative or Competent Person. The VA Police should be informed of asbestos abatement regulated areas to provide security checks during facility rounds and emergency response.

3.1.2 OSHA DANGER SIGNS

Post OSHA DANGER signs meeting the specifications of OSHA 29 CFR 1926.1101 at any location and approaches to the regulated area where airborne concentrations of asbestos may exceed ambient background levels. Signs shall be posted at a distance sufficiently far enough away from the regulated area to permit any personnel to read the sign and take the necessary measures to avoid exposure. Additional signs will be posted following construction of the regulated area enclosure.

3.1.3.1 SHUT DOWN - LOCK OUT ELECTRICAL

Shut down and lock out/tag out electric power to the regulated area. Provide temporary power and lighting. Insure safe installation including GFCI of temporary power sources and equipment by compliance with all applicable electrical code requirements and OSHA requirements for temporary electrical systems. Electricity shall be provided by the VA.

3.1.3.2 SHUT DOWN - LOCK OUT HVAC

Shut down and lock out/tag out heating, cooling, and air conditioning system (HVAC) components that are in, supply or pass through the regulated area. Investigate the regulated area and agree on pre-abatement condition with the VA's representative. Seal all intake and exhaust vents in the regulated area with duct tape and 2 layers of 6-mil poly. Also, seal any seams in system components that pass through the regulated area. Remove all contaminated HVAC system filters and place in labeled 6-mil poly disposal bags for disposal as asbestos waste.

3.1.4 CONTAINMENT BARRIERS AND COVERINGS FOR THE REGULATED AREA

3.1.4.1 GENERAL

Seal off any openings at the perimeter of the regulated area with critical barriers to completely isolate the regulated area and to contain all airborne asbestos contamination created by the abatement activities. Should the adjacent area past the regulated area become contaminated due to improper work activities, the Contractor shall suspend work inside the regulated area, continue wetting, and clean the adjacent areas in accordance with procedures described in these specifications. Any and all costs associated with the adjacent area cleanup shall not be borne by the VA.

3.1.4.2 PREPARATION PRIOR TO SEALING OFF

Place all materials, equipment and supplies necessary to isolate the regulated area inside the regulated area. Remove all movable material/equipment as described above and secure all unmovable material/equipment as described above. Properly secured material/equipment shall be considered to be outside the regulated area.

3.1.4.3 CONTROLLING ACCESS TO THE REGULATED

Access to the regulated area is allowed only through the personnel decontamination facility (PDF). All other means of access shall be eliminated and OSHA DANGER demarcation signs posted as required by OSHA. If the regulated area is adjacent to, or within view of an occupied area, provide a visual barrier of 6 mil opaque fire retardant poly to prevent building occupant observation. If the adjacent area is accessible to the public, the barrier must be solid and capable of withstanding the negative pressure.

3.1.4.4 CRITICAL BARRIERS

The regulated area must be completely separated from the adjacent area(s) and the outside by at least 2 layers of 6 mil fire retardant poly and duct tape/spray adhesive. Individually seal all supply and exhaust ventilation openings, lighting fixtures, clocks, doorways, windows, convectors, speakers, and other openings into the regulated area with 2 layers of 6 mil fire retardant poly, and taped securely in place with duct tape/spray adhesive. Critical barriers must remain in place until all work and clearances have been completed. Light fixtures shall not be operational during abatement. Auxiliary lighting shall be provided. If needed, provide plywood squares 6" x 6" x 3/8" held in place with one 6d smooth masonry/galvanized nail driven through the center of the plywood square and duct tape on the poly so as to clamp the poly to the wall/surface. Locate plywood squares at each end, corner, and 4' maximum on centers.

3.1.4.5 EXTENSION OF THE REGULATED AREA

If the regulated area barrier is breached in any manner that could allow the passage of asbestos fibers or debris, the Competent Person shall immediately stop work, continue wetting, and proceed to extend the regulated area to enclose the affected area as per procedures described in this specification. If the affected area cannot be enclosed, decontamination measures and cleanup shall start immediately.

All personnel shall be isolated from the affected area until decontamination/cleanup is completed as verified by visual inspection and air monitoring. Air monitoring at completion must indicate background levels.

3.1.4.6 FLOOR BARRIERS:

All floors within 10' of glovebag work shall be covered with 2 layers of 6 mil fire retardant poly.

3.1.5 SANITARY FACILITIES

The Contractor shall provide sanitary facilities for abatement personnel and maintain them in a clean and sanitary condition throughout the abatement project.

3.1.6 PRE-CLEANING

3.1.6.1 PRE-CLEANING MOVABLE OBJECTS

The VA will provide water for abatement purposes. The Contractor shall connect to the existing VA system. The service to the shower(s) shall be supplied with backflow prevention.

Pre-cleaning of ACM contaminated items shall be performed after the enclosure has been erected and negative pressure has been established in the work area. PPE must be donned by all workers performing precleaning activities. After items, have been pre-cleaned and decontaminated, they may be removed from the work area for storage until the completion of abatement in the work area. Pre-clean all movable objects within the regulated area using a HEPA filtered vacuum and/or wet cleaning methods as appropriate. After cleaning, these objects shall be removed from the regulated area and carefully stored in an uncontaminated location.

3.1.6.2 PRE-CLEANING FIXED OBJECTS

Pre-cleaning of ACM contaminated items shall be performed after the enclosure has been erected and negative pressure has been established in the work area. Pre-clean all fixed objects in the regulated area using HEPA filtered vacuums and/or wet cleaning techniques as appropriate.

Careful attention must be paid to machinery behind grills or gratings where access may be difficult but contamination may be significant. Also, pay particular attention to wall, floor and ceiling penetration behind fixed items. After pre-cleaning, enclose fixed objects with 2 layers of 6-mil poly and seal securely in place with duct tape. Objects (e.g., permanent fixtures, shelves, electronic equipment, laboratory tables, sprinklers, alarm systems, closed circuit TV equipment and computer cables) which must remain in the regulated area and that require special ventilation or enclosure requirements should be designated here along with specified means of protection. Contact the manufacturer for special protection requirements.

3.1.6.3 PRE-CLEANING SURFACES IN THE REGULATED AREA

Pre-cleaning of ACM contaminated items shall be performed after the enclosure has been erected and negative pressure has been established in the work area. Pre-clean all surfaces in the regulated area using HEPA filtered vacuums and/or wet cleaning methods as appropriate. Do not use any methods that would raise dust such as dry sweeping or vacuuming with equipment not

equipped with HEPA filters. Do not disturb asbestos containing materials during this pre-cleaning phase.

3.1.7 PRE-ABATEMENT ACTIVITIES

3.1.7.1 PRE-ABATEMENT MEETING

The VA representative, upon receipt, review, and substantial approval of all pre-abatement submittals and verification by the CPIH/CIH that all materials and equipment required for the project are on the site, will arrange for a pre-abatement meeting between the Contractor, the CPIH/CIH, Competent Person(s), the VA representative(s), and the VPIH/CIH. The purpose of the meeting is to discuss any aspect of the submittals needing clarification or amplification and to discuss any aspect of the project execution and the sequence of the operation. The Contractor shall be prepared to provide any supplemental information/documentation to the VA's representative regarding any submittals, documentation, materials or equipment. Upon satisfactory resolution of any outstanding issues, the VA's representative will issue a written order to proceed to the Contractor. No abatement work of any kind described in the following provisions shall be initiated prior to the VA written order to proceed.

3.1.7.2 PRE-ABATEMENT INSPECTIONS AND PREPARATIONS

Before any work begins on the construction of the regulated area, the Contractor will:

A. Conduct a space-by-space inspection with an authorized VA representative and prepare a written inventory of all existing damage in those spaces where asbestos abatement will occur. Still or video photography may be used to supplement the written damage inventory. Document will be signed and certified as accurate by both parties.

B. The VA Representative, the Contractor, and the VPIH/CIH must be aware of VA A/E Quality Alert 07/09 indicating the failure to identify asbestos in the areas listed as well as common issues when preparing specifications and contract documents. This is especially critical when demolition is planned, because AHERA surveys are non-destructive, and ACM may remain undetected. A NESHAPS (destructive) ACM inspection should be conducted on all building structures that will be demolished. Ensure the following areas are inspected on the project: Lay-in ceilings concealing ACM; ACM behind walls/windows from previous renovations; inside utility chases/walls; transite piping/ductwork/sheets; behind radiators; lab fume hoods; transite lab countertops; roofing materials; below window sills; water/sewer lines; electrical conduit coverings; crawl spaces (previous abatement contamination); flooring/mastic covered by carpeting/new flooring; exterior insulated wall panels; on underground fuel tanks; and steam line trench coverings.

C. Ensure that all furniture, machinery, equipment, curtains, drapes, blinds, and other movable objects required to be removed from the regulated area have been cleaned and removed or properly protected from contamination.

D. If present and required, remove and dispose of carpeting from floors in the regulated area.

E. Inspect existing firestopping in the regulated area. Correct as needed.

3.1.7.3 PRE-ABATEMENT CONSTRUCTION AND OPERATIONS

A. Perform all preparatory work for the first regulated area in accordance with the approved work schedule and with this specification.

B. Upon completion of all preparatory work, the CPIH/CIH will inspect the work and systems and will notify the VA's representative when the work is completed in accordance with this specification. The VA's representative may inspect the regulated area and the systems with the VPIH/CIH and may require that upon satisfactory inspection, the Contractor's employees perform all major aspects of the approved AHAP(s), especially worker protection, respiratory systems, contingency plans, decontamination procedures, and monitoring to demonstrate satisfactory operation.

C. The CPIH/CIH shall document the pre-abatement activities described above and deliver a copy to the VA's representative.

D. Upon satisfactory inspection of the installation of and operation of systems the VA's representative will notify the Contractor in writing to proceed with the asbestos abatement work in accordance with this specification.

3.2 REMOVAL OF PIPING ACM

3.2.1 WETTING MATERIALS

A. Use amended water for the wetting of ACM prior to removal. The Competent Person shall assure the wetting of ACM meets the definition of "adequately wet" in the EPA NESHAP's regulation and OSHA's "wet methods" for the duration of the project. A removal encapsulant may be used instead of amended water with written approval of the VA's representative.

B. Amended Water: Provide water to which a surfactant has been added shall be used to wet the ACM and reduce the potential for fiber release during disturbance of ACM. The mixture must be equal to or greater than the wetting provided by water amended by a surfactant consisting one ounce of 50% polyoxymethylene ester and 50% polyoxymethylene ether mixed with 5 gallons (19L) of water.

C. Removal Encapsulant: Provide a penetrating encapsulant designed specifically for the removal of ACM. The material must, when used, result in adequate wetting of the ACM and retard fiber release during disturbance equal to or greater than the amended water described above in B.

3.2.2 SECONDARY BARRIER AND WALKWAYS

A. Install as a drop cloth a 6 mil poly sheet at the beginning of each work shift where removal is to be done during that shift. Completely cover floors and any walls within 10 feet (3 meters) of the area where work is to be done. Secure the secondary barrier with duct tape to prevent it from moving or debris from getting behind it. Remove the secondary barrier at the end of the shift or as work in the area is completed. Keep residue on the secondary barrier wetted. When removing, fold inward to prevent spillage and place in a disposal bag.

B. Install walkways using 6 mil black poly between the regulated area and the decontamination facilities (PDF and W/EDF) to protect the primary layers from contamination and damage. Install the walkways at the beginning of each shift and remove at the end of each shift.

3.2.3 WET REMOVAL OF ACM

A. Using acceptable glovebag procedures, adequately and thoroughly wet the ACM to be removed prior to removal with amended water or when authorized by VA, removal encapsulant to reduce/prevent fiber release to the air. Adequate time (at a minimum two hours) must be allowed for the amended water or removal encapsulant to saturate the ACM. Abatement personnel must not disturb dry ACM. Use a fine spray of amended water or removal encapsulant. Saturate the material sufficiently to wet to the substrate without causing excessive dripping. The material must be sprayed repeatedly/continuously during the removal process in order to maintain adequately wet conditions. Removal encapsulants must be applied in accordance with the manufacturer's written instructions. Perforate or carefully separate, using wet methods, an outer covering that is painted or jacketed in order to allow penetration and wetting of the material. Where necessary, carefully remove covering while wetting to minimize fiber release.

In no event shall dry removal occur except when authorized in writing by the VPIH/CIH and VA when a greater safety hazard (e.g., electricity) is present

3.3 GLOVEBAG REMOVAL PROCEDURES

3.3.1 GENERAL

All applicable OSHA requirements and glovebag manufacturer's recommendations shall be met during glove bagging operations. In cases where live steam lines are present, the lines must be shut down prior to any work being performed on the system. **No abatement work shall be conducted on live, pressurized steam lines.** The Contractor may choose to use a High Temperature Glovebag in which a temperature rating ranges from 300°F to 700°F on steam lines that have recently been shut down and remain at high temperature for some time. In the case where a glovebag is not feasible, the Contractor will need to build a full negative pressure containment of sufficient size and follow all regulations as it pertains to removal.

1. Mix the surfactant with water in the garden sprayer, following the manufacturer's directions.
2. Have each employee put on a HEPA filtered respirator approved for asbestos and check the fit using the positive/negative fit check.
3. Have each employee put on a disposable full-body suit. Remember, the hood goes over the respirator straps.
4. Check closely the integrity of the glove bag to be used. Check all seams, gloves, sleeves, and glove openings. OSHA requires the bottom of the bag to be seamless.
 1. Check the pipe where the work will be performed. If it is damaged (broken lagging, hanging, etc.), wrap the entire length of the pipe in poly sheeting and "candy stripe" it with duct tape.
6. Attach glovebag with required tools per manufacturer's instructions.

7. Using the smoke tube and aspirator bulb, test 10% of glove bags by placing the tube into the water porthole (two-inch opening to glove bag), and fill the bag with smoke and squeeze it. If leaks are found, they should be taped closed using duct tape and the bag should be retested with smoke.
8. Insert the wand from the water sprayer through the water porthole.
9. Insert the hose end from a HEPA vacuum into the upper portion of the glove bag.
10. Wet and remove the pipe insulation.
11. If the section of pipe is covered with an aluminum jacket, remove it first using the wire cutters to cut any bands and the tin snips to remove the aluminum. It is important to fold the sharp edges in to prevent cutting the bag when placing it in the bottom.
12. When the work is complete, spray the upper portion of the bag and clean-push all residue into the bottom of the bag with the other waste material. Be very thorough. Use adequate water.
13. Put all tools, after washing them off in the bag, in one of the sleeves of glove bag and turn it inside out, drawing it outside of the bag. Twist the sleeve tightly several times to seal it and tape it several tight turns with duct tape. Cut through the middle of the duct tape and remove the sleeve. Put the sleeve in the next glove bag or put it in a bucket of water to decontaminate the tools after cutting the sleeve open.
14. Turn on the HEPA vacuum and collapse the bag completely. Remove the vacuum nozzle, seal the hole with duct tape, twist the bag tightly several times in the middle, and tape it to keep the material in the bottom during removal of the glove bag from the pipe.
15. Slip a disposal bag over the glove bag (still attached to the pipe). Remove the tape securing the ends, and slit open the top of the glove bag and carefully fold it down into the disposal bag. Double bag and gooseneck waste materials.

3.3.2 NEGATIVE PRESSURE GLOVEBAG PROCEDURE

1. In addition to the above requirements, the HEPA vacuum shall be run continuously during the glovebag procedure until completion at which time the glovebag will be collapsed by the HEPA vacuum prior to removal from the pipe/component.
2. The HEPA vacuum shall be attached and operated as needed to prevent collapse of the glovebag during the removal process.

3.4 LOCKDOWN ENCAPSULATION

3.4.1 GENERAL

Lockdown encapsulation is an integral part of the ACM removal. At the conclusion of ACM removal and before removal of the primary barriers, all piping surfaces shall be encapsulated with a bridging encapsulant.

3.4.2 SEALING EXPOSED EDGES

Seal edges of ACM exposed by removal work with two coats of encapsulant. Prior to sealing, permit the exposed edges to dry completely to permit penetration of the encapsulant.

3.5 DISPOSAL OF ACM WASTE MATERIALS

3.5.1 GENERAL

Dispose of waste ACM and debris which is packaged in accordance with these specifications, OSHA, EPA and DOT. The landfill requirements for packaging must also be met. Transport will be in compliance with 49 CFR 100–185 regulations. Disposal shall be done at an approved landfill. Disposal of non-friable ACM shall be done in accordance with applicable regulations.

3.5.2 PROCEDURES

A. The VA must be notified at least 24 hours in advance of any waste removed from the containment.

B. Asbestos waste shall be packaged and moved through the W/EDF into a covered transport container in accordance with procedures in this specification. Waste shall be double-bagged and wetted with amended water prior to disposal. Wetted waste can be very heavy. Bags shall not be overfilled. Bags shall be securely sealed to prevent accidental opening and/or leakage. The top shall be tightly twisted and goose necked prior to tightly sealing with at least three wraps of duct tape. Ensure that unauthorized persons do not have access to the waste material once it is outside the regulated area. All transport containers must be covered at all times when not in use. NESHAP's signs must be on containers during loading and unloading. Material shall not be transported in open vehicles. If drums are used for packaging, the drums shall be labeled properly and shall not be re-used.

1. Waste Load Out: Waste load out shall be done in accordance with the procedures in W/EDF Decontamination Procedures. Sealed waste bags shall be decontaminated on exterior surfaces by wet cleaning and/or HEPA vacuuming before being placed in the second waste bag and sealed, which then must also be wet wiped or HEPA vacuumed.

2. Asbestos waste with sharp edged components, i.e., nails, screws, lath, strapping, tin sheeting, jacketing, metal mesh, etc., which might tear poly bags shall be wrapped securely in burlap before packaging and, if needed, use a poly lined fiber drum as the second container, prior to disposal.

3.6 PROJECT DECONTAMINATION

3.6.1 GENERAL

A. The entire work related to project decontamination shall be performed under the close supervision and monitoring of the CPIH/CIH.

B. If the asbestos abatement work is in an area which was contaminated prior to the start of abatement, the decontamination will be done by cleaning the primary barrier poly prior to its removal and cleanings of the surfaces of the regulated area after the primary barrier removal.

C. If the asbestos abatement work is in an area which was uncontaminated prior to the start of abatement, the decontamination will be done by cleaning the primary barrier poly prior to its removal, thus preventing contamination of the building when the regulated area critical barriers are removed.

3.6.2 REGULATED AREA CLEARANCE

Air testing and other requirements which must be met before release of the Contractor and re-occupancy of the regulated area space are specified in Final Testing Procedures.

3.6.3 WORK DESCRIPTION

Decontamination includes the clearance air testing in the regulated area and the decontamination and removal of the enclosures/facilities installed prior to the abatement work including primary/critical barriers, PDF and W/EDF facilities, and negative pressure systems.

3.6.4 PRE-DECONTAMINATION CONDITIONS

A. Before decontamination starts, all ACM waste from the regulated area shall be removed, all waste collected and removed, and the secondary barrier of poly removed and disposed of along with any gross debris generated by the work.

B. At the start of decontamination, the following shall be in place:

1. Critical barriers over all openings consisting of two layers of 6 mil poly which is the sole barrier between the regulated area and the rest of the building or outside.
2. Decontamination facilities, if required for personnel and equipment in operating condition.

3.6.5 FIRST CLEANING

Carry out a first cleaning of all surfaces of the regulated area including items of remaining poly sheeting, tools, scaffolding, ladders/staging by wet methods and/or HEPA vacuuming. Do not use dry dusting/sweeping/air blowing methods. Use each surface of a wetted cleaning cloth one time only and then dispose of as contaminated waste.

Continue this cleaning until there is no visible residue from abated surfaces or poly or other surfaces. Remove all filters in the air handling system and dispose of as ACM waste in accordance with these specifications. The negative pressure system shall remain in operation during this time. Additional cleaning(s) may be needed as determined by the CPIH/VPIH/CIH.

3.6.6 PRE-CLEARANCE INSPECTION AND TESTING

The CPIH/CIH and VPIH/CIH will perform a thorough and detailed visual inspection at the end of the cleaning to determine whether there is any visible residue in the regulated area. If the visual inspection is acceptable, the CPIH/CIH will perform pre-clearance sampling using aggressive clearance as detailed in 40 CFR 763 Subpart E (ASHERA) Appendix A (III)(B)(7)(d). If the sampling results show values below 0.01 f/cc, then the Contractor shall notify the VA's representative of the results with a brief report from the CPIH/CIH documenting the inspection and sampling results and a statement verifying that the regulated area is ready for lockdown encapsulation. The VA reserves the right to utilize their own VPIH/CIH to perform a pre-clearance inspection and testing for verification.

3.6.7 LOCKDOWN ENCAPSULATION OF ABATED SURFACES

With the express written permission of the VA's representative, perform lockdown encapsulation of all surfaces from which asbestos was abated in accordance with the procedures in this specification.

3.7 FINAL VISUAL INSPECTIONS AND AIR CLEARANCE TESTING

3.7.1 GENERAL

Notify the VA representative 24 hours in advance for the performance of the final visual inspection and testing. The final visual inspection and testing will be performed by the VPIH/CIH after the final cleaning.

3.7.2 FINAL VISUAL INSPECTION

Final visual inspection will include the entire regulated area, the PDF, all poly sheeting, seals over HVAC openings, doorways, windows, and any other openings. If any debris, residue, dust or any other suspect material is detected, the final cleaning shall be repeated at no cost to the VA. Dust/material samples may be collected and analyzed at no cost to the VA at the discretion of the VPIH/CIH to confirm visual findings. When the regulated area is visually clean the final testing can be done.

3.7.3 FINAL AIR CLEARANCE TESTING

A. After an acceptable final visual inspection by the VPIH/CIH and VA Representative, the VPIH/CIH will perform the final clearance testing. Air samples will be collected and analyzed in accordance with procedures for AHERA in this specification. If work is less than 260 lf/160 sf/35 cf, 5 PCM samples shall be collected for clearance and a minimum of one field blank. If work is equal to or more than 260 lf/160 sf/35 cf, AHERA TEM sampling shall be performed for clearance. TEM analysis shall be done in accordance with procedures for EPA AHERA in this specification. If the release criteria are not met, the Contractor shall repeat the final cleaning and continue decontamination procedures until clearance is achieved. All additional inspection and testing costs will be borne by the Contractor.

B. If release criteria are met, proceed to perform the abatement closeout and to issue the certificate of completion in accordance with these specifications.

3.7.4 FINAL AIR CLEARANCE PROCEDURES

1. Contractor's Release Criteria: Work in a regulated area is complete when the regulated area is visually clean and airborne fiber levels have been reduced to or below 0.01 f/cc as measured by the AHERA PCM protocol, or 70 AHERA structures per square millimeter (s/mm²) by AHERA TEM.

B. Air Monitoring and Final Clearance Sampling: To determine if the elevated airborne fiber counts encountered during abatement operations have been reduced to the specified level, the VPIH/CIH will secure samples and analyze them according to the following procedures:

1. Fibers Counted: "Fibers" referred to in this section shall be either all fibers regardless of composition as counted in the NIOSH 7400 PCM method or asbestos fibers counted using the AHERA TEM method.

2. Aggressive Sampling: All final air testing samples shall be collected using aggressive sampling techniques except where soil is not encapsulated or enclosed. Samples will be collected on 0.8 μ MCE filters for PCM analysis and 0.45 μ Polycarbonate filters for TEM. A minimum of 1200 Liters of using calibrated pumps shall be collected for clearance samples. Before pumps are started, initiate aggressive air mixing sampling as detailed in 40 CFR 763 Subpart E (AHERA) Appendix A (III)(B)(7)(d). Air samples will be collected in areas subject to normal air circulation away from corners, obstructed locations, and locations near windows, doors, or vents. After air sampling pumps, have been shut off, circulating fans shall be shut off. The negative pressure system shall continue to operate.

3.7.5 CLEARANCE SAMPLING USING PCM

A. The VPIH/CIH will perform clearance samples as indicated by the specification.
B. The NIOSH 7400 PCM method will be used for clearance sampling with a minimum collection volume of 1200 Liters of air. A minimum of 5 PCM clearance samples shall be collected. All samples must be equal to or less than 0.01 f/cc to clear the regulated area.

3.7.6 CLEARANCE SAMPLING USING TEM

A. Clearance requires 13 samples be collected; 5 inside the regulated area; 5 outside the regulated area; and 3 field blanks. B. The TEM method will be used for clearance sampling with a minimum collection volume of 1200 Liters of air. A minimum of 13 clearance samples shall be collected. All samples must be equal to or less than 70 AHERA structures per square millimeter (s/mm²) AHERA TEM.

3.7.7 LABORATORY TESTING OF PCM SAMPLES

The services of an AIHA accredited laboratory will be employed by the VA to perform analysis for the PCM air samples. The accredited laboratory shall be successfully participating in the AIHA Proficiency Analytical Testing (PAT) program. Samples will be sent daily by the VPIH/CIH so that verbal/faxed reports can be received within 24 hours. A complete record, certified by the laboratory, of all air monitoring tests and results will be furnished to the VA's representative and the Contractor.

3.7.8 LABORATORY TESTING OF TEM SAMPLES

Samples shall be sent by the VPIH/CIH to a NIST accredited laboratory for analysis by TEM. The laboratory shall be successfully participating in the NIST Airborne Asbestos Analysis (TEM) program. Verbal/faxed results from the laboratory shall be available within 24 hours after receipt of the samples. A complete record, certified by the laboratory, of all TEM results shall be furnished to the VA's representative and the Contractor.

3.8 ABATEMENT CLOSEOUT AND CERTIFICATE OF COMPLIANCE

3.8.1 COMPLETION OF ABATEMENT WORK

After thorough decontamination, seal negative air machines with 2 layers of 6 mil poly and duct tape to form a tight seal at the intake/outlet ends before removal from the regulated area. Complete asbestos abatement work upon meeting the regulated area visual and air clearance criteria and fulfilling the following:

A. Remove all equipment, materials, and debris from the project area.

B. Package and dispose of all asbestos waste as required. Dispose of waste ACM and debris which is packaged in accordance with these specifications, OSHA, EPA and DOT. The landfill requirements for packaging must also be met. Transport will be in compliance with 49 CFR 100–185 regulations.

C. Repair or replace all interior finishes damaged during the abatement work.

D. The VA will be notified of any waste removed from the containment prior to 24 hours.

E. Fulfill other project closeout requirements as specified elsewhere in this specification.

3.8.2 CERTIFICATE OF COMPLETION BY CONTRACTOR

The CPIH/CIH shall complete and sign the "Certificate of Completion" in accordance with Attachment 1 at the completion of the abatement and decontamination of the regulated area.

3.8.3 WORK SHIFTS

All work shall be done during administrative hours (8:00 AM to 4:30 PM) Monday - Friday excluding Federal Holidays. Any change in the work schedule must be approved in writing by the VA Representative.

3.8.4 RE-INSULATION

If required as part of the contract, replace all asbestos containing insulation with suitable non-asbestos material. Provide MSDS for all replacement materials. Refer to Section 23 07 11, HVAC, PLUMBING, AND BOILER PLANT INSULATION.

**ATTACHMENT #1
CERTIFICATE OF COMPLETION**

DATE: _____ VA Project #: _____

PROJECT NAME: _____ Abatement Contractor: _____

VAMC/ADDRESS: _____

1. I certify that I have personally inspected, monitored and supervised the abatement work of (specify regulated area or Building):

which took place from / / to / /

2. That throughout the work all applicable requirements/regulations and the VA's specifications were met.

3. That any person who entered the regulated area was protected with the appropriate personal protective equipment and respirator and that they followed the proper entry and exit procedures and the proper operating procedures for the duration of the work.

4. That all employees of the Abatement Contractor engaged in this work were trained in respiratory protection, were experienced with abatement work, had proper medical surveillance documentation, were fit-tested for their respirator, and were not exposed at any time during the work to asbestos without the benefit of appropriate respiratory protection.

5. That I performed and supervised all inspection and testing specified and required by applicable regulations and VA specifications.

6. That the conditions inside the regulated area were always maintained in a safe and healthy condition and the maximum fiber count never exceeded 0.5 f/cc, except as described below.

7. That all glovebag work was done in accordance with OSHA requirements and the manufacturer's recommendations.

CPIH/CIH Signature/Date: _____

CPIH/CIH Print Name: _____

Abatement Contractor Signature/Date: _____

Abatement Contractor Print Name : _____

ATTACHMENT #2

CERTIFICATE OF WORKER'S ACKNOWLEDGMENT

PROJECT NAME: _____ DATE: _____

PROJECT ADDRESS: _____

ABATEMENT CONTRACTOR'S NAME: _____

WORKING WITH ASBESTOS CAN BE HAZARDOUS TO YOUR HEALTH. INHALING ASBESTOS HAS BEEN LINKED WITH VARIOUS TYPES OF CANCERS. IF YOU SMOKE AND INHALE ASBESTOS FIBERS, YOUR CHANCES OF DEVELOPING LUNG CANCER IS GREATER THAN THAT OF THE NONSMOKING PUBLIC.

Your employer's contract with the owner for the above project requires that: You must be supplied with the proper personal protective equipment including an adequate respirator and be trained in its use. You must be trained in safe and healthy work practices and in the use of the equipment found at an asbestos abatement project. You must receive/have a current medical examination for working with asbestos. These things shall be provided at no cost to you. By signing this certificate, you are indicating to the owner that your employer has met these obligations.

RESPIRATORY PROTECTION: I have been trained in the proper use of respirators and have been informed of the type of respirator to be used on the above indicated project. I have a copy of the written Respiratory Protection Program issued by my employer. I have been provided for my exclusive use, at no cost, with a respirator to be used on the above indicated project.

TRAINING COURSE: I have been trained by a third party, State/EPA accredited trainer in the requirements for an AHERA/OSHA Asbestos Abatement Worker training course, 32 hours minimum duration. I currently have a valid State accreditation certificate. The topics covered in the course include, as a minimum, the following:

- Physical Characteristics and Background Information on Asbestos
- Potential Health Effects Related to Exposure to Asbestos
- Employee Personal Protective Equipment
- Establishment of a Respiratory Protection Program
- State of the Art Work Practices
- Personal Hygiene
- Additional Safety Hazards
- Medical Monitoring
- Air Monitoring
- Relevant Federal, State and Local Regulatory Requirements, Procedures, and Standards
- Asbestos Waste Disposal

MEDICAL EXAMINATION: I have had a medical examination within the past 12 months which was paid for by my employer. This examination included: health history, occupational history, pulmonary function test, and may have included a chest x-ray evaluation. The physician issued a positive written opinion after the examination.

Signature: _____

Printed Name: _____

Social Security Number: _____

Witness: _____

ATTACHMENT #3

AFFIDAVIT OF MEDICAL SURVEILLANCE, RESPIRATORY PROTECTION AND TRAINING/ACCREDITATION

VA PROJECT NAME AND NUMBER: _____

VA MEDICAL FACILITY: _____

ABATEMENT CONTRACTOR'S NAME AND ADDRESS: _____

1. I verify that the following individual

Name: _____ Social Security Number: _____

who is proposed to be employed in asbestos abatement work associated with the above project by the named Abatement Contractor, is included in a medical surveillance program in accordance with 29 CFR 1926.1101(m), and that complete records of the medical surveillance program as required by 29 CFR 1926.1101(m)(n) and 29 CFR 1910.20 are kept at the offices of the Abatement Contractor at the following address.

Address: _____

2. I verify that this individual has been trained, fit-tested and instructed in the use of all appropriate respiratory protection systems and that the person is capable of working in safe and healthy manner as expected and required in the expected work environment of this project.

3. I verify that this individual has been trained as required by 29 CFR 1926.1101(k). This individual has also obtained a valid State accreditation certificate. Documentation will be kept on-site.

4. I verify that I meet the minimum qualifications criteria of the VA specifications for a CPIH.

Signature of CPIH/CIH: Date: _____

Printed Name of CPIH/CIH: _____

Signature of Contractor: Date: _____

Printed Name of Contractor: _____

ATTACHMENT #4

ABATEMENT CONTRACTOR/COMPETENT PERSON(S) REVIEW AND ACCEPTANCE OF THE VA'S ASBESTOS SPECIFICATIONS

VA Project Location: _____

VA Project #: _____

VA Project Description: _____

This form shall be signed by the Asbestos Abatement Contractor Owner and the Asbestos Abatement Contractor's Competent Person(s) prior to any start of work at the VA related to this Specification. If the Asbestos Abatement Contractor's/Competent Person(s) has not signed this form, they shall not be allowed to work on-site.

I, the undersigned, have read VA's Asbestos Specification regarding the asbestos abatement requirements. I understand the requirements of the VA's Asbestos Specification and agree to follow these requirements as well as all required rules and regulations of OSHA/EPA/DOT and State/Local requirements. I have been given ample opportunity to read the VA's Asbestos Specification and have been given an opportunity to ask any questions regarding the content and have received a response related to those questions. I do not have any further questions regarding the content, intent and requirements of the VA's Asbestos Specification.

At the conclusion of the asbestos abatement, I will certify that all asbestos abatement work was done in accordance with the VA's Asbestos Specification and all ACM was removed properly and no fibrous residue remains on any abated surfaces.

Abatement Contractor Owner's Signature _____ Date _____

Abatement Contractor Competent Person(s) _____ Date _____

-- END- - - -

**SECTION 02 83 33.13
LEAD-BASED PAINT REMOVAL AND DISPOSAL**

PART 1 - GENERAL

1.1 DESCRIPTION

This section specifies the requirements for a comprehensive hazardous materials assessment survey/report, abatement/disposal of lead-based paint (LBP), and controls needed to limit occupational and environmental exposure to lead hazards.

1.1.2 EXTENT OF WORK

A. These quantities are for informational purposes only and are based on the best information available at the time of the specification preparation. The contractor shall satisfy himself as the actual quantities to be abated. Nothing in this section may be interpreted as limiting the extent of work otherwise required by this contract and related documents.

B. Removal, clean up and disposal of lead based paint materials in an appropriate regulated area in the following approximate quantities.

400 square feet of lead based paint material.

1.2 RELATED WORK

A. Section 02 82 11, TRADITIONAL ASBESTOS ABATEMENT.

B. Section 02 41 00, DEMOLITION.

C. Section 09 91 00, PAINTING.

1.3 APPLICABLE PUBLICATIONS

A. The publications listed below form a part of this specification to the extent referenced. The publications are referred to in the text by basic designation only.

B. Code of Federal Regulations (CFR):

CFR 29 Part 1910.....Occupational Safety and Health Standards

CFR 29 Part 1926.....Safety and Health Regulations for Construction

CFR 40 Part 148.....Hazardous Waste Injection Restrictions

CFR 40 Part 260.....Hazardous Waste Management System: General

CFR 40 Part 261.....Identification and Listing of Hazardous Waste

CFR 40 Part 262.....Standards Applicable to Generators of Hazardous
Waste

CFR 40 Part 263.....Standards Applicable to Transporters of
Hazardous Waste

CFR 40 Part 264.....Standards for Owners and Operations of Hazardous Waste Treatment, Storage, and Disposal Facilities

CFR 40 Part 265.....Interim Status Standards for Owners and Operators of Hazardous Waste Treatment, Storage, and Disposal Facilities

CFR 40 Part 268.....Land Disposal Restrictions

CFR 49 Part 172.....Hazardous Material Table, Special Provisions, Hazardous Material Communications, Emergency Response Information, and Training Requirements

CFR 49 Part 178.....Specifications for Packaging

C. National Fire Protection Association (NFPA):

NFPA 701-2004.....Methods of Fire Test for Flame-Resistant Textiles and Films

D. National Institute for Occupational Safety and Health (NIOSH)
NIOSH OSHA Booklet 3142. Lead in Construction

E. Underwriters Laboratories (UL)

UL 586-1996 (Rev 2009).. High-Efficiency, Particulate, Air Filter Units

F. American National Standards Institute

Z9.2-2006.....Fundamentals Governing the Design and Operation of Local Exhaust Systems

Z88.6-2006.....Respiratory Protection

1.4 DEFINITIONS

A. Action Level: Employee exposure, without regard to use of respirations, to an airborne concentration of lead of 30 micrograms per cubic meter of air averaged over an 8-hour period. As used in this section, "30 micrograms per cubic meter of air" refers to the action level.

B. Area Monitoring: Sampling of lead concentrations within the lead control area and inside the physical boundaries which is representative of the airborne lead concentrations which may reach the breathing zone of personnel potentially exposed to lead.

C. Physical Boundary: Area physically roped or partitioned off around an enclosed lead control area to limit unauthorized entry of personnel. As used in this section, "inside boundary" shall mean the same as "outside lead control area."

D. Certified Industrial Hygienist (CIH): As used in this section, refers to an Industrial Hygienist employed by the Contractor and is certified by the American Board of Industrial Hygiene in comprehensive practice.

E. Change Rooms and Shower Facilities: Rooms within the designated physical boundary around the lead control area equipped with separate storage facilities for clean protective work clothing and equipment and for street clothes which prevent cross- contamination.

F. Competent Person: A person capable of identifying lead hazards in the work area and is authorized by the contractor to take corrective action.

G. Decontamination Room: Room for removal of contaminated personal protective equipment (PPE).

H. Eight-Hour Time Weighted Average (TWA): Airborne concentration of lead averaged over an 8-hour workday to which an employee is exposed.

I. High Efficiency Particulate Air (HEPA) Filter Equipment: HEPA filtered vacuuming equipment with a UL 586 filter system capable of collecting and retaining lead-contaminated paint dust. A high efficiency particulate filter means 99.97 percent efficient against 0.3 micron size particles.

J. Lead: Metallic lead, inorganic lead compounds, and organic lead soaps. Excluded from this definition are other organic lead compounds.

K. Lead Control Area: An enclosed area or structure with full containment to prevent the spread of lead dust, paint chips, or debris of lead containing paint removal operations. The lead control area is isolated by physical boundaries to prevent unauthorized entry of personnel.

L. Lead Permissible Exposure Limit (PEL): Fifty micrograms per cubic meter of air as an 8-hour time weighted average as determined by 29 CFR 1910.1025. If an employee is exposed for more than 8 hours in a work day, the PEL shall be determined by the following formula. $PEL \text{ (micrograms/cubic meter of air)} = 400/\text{No. of hrs. worked per day}$.

M. Personnel Monitoring: Sampling of lead concentrations within the breathing zone of an employee to determine the 8-hour time weighted average concentration in accordance with 29 CFR 1910.1025. Samples shall be representative of the employee's work tasks. Breathing zone shall be considered an area within a hemisphere, forward of the shoulders, with a radius of 6 to 9 inches and the center at the nose or mouth of an employee.

1.5 QUALITY ASSURANCE

A. Before exposure to lead-contaminated dust, provide workers with a comprehensive medical examination as required by 29 CFR 1926.62 (I) (1) (i) & (ii). The examination shall not be required if adequate records show that employees have been examined as required by 29 CFR 1926.62(I) without the last year.

B. Medical Records: Maintain complete and accurate medical records of employees in accordance with 29 CFR 1910.20.

C. CIH Responsibilities: The Contractor shall employ a certified Industrial Hygienist who will be responsible for the following:

1. Certify Training.
2. Review and approve lead-containing paint removal plan for conformance to the applicable referenced standards.
3. Inspect lead-containing paint removal work for conformance with the approved plan.
4. Direct monitoring.
5. Ensure work is performed in strict accordance with specifications at all times.
6. Ensure hazardous exposure to personnel and to the environment is adequately controlled at all times.

D. Training: Train each employee performing paint removal, disposal and air sampling operations prior to the time of initial job assignment, in accordance with 29 CFR 1926.62.

E. Training Certification: Submit certificates signed and dated by the CIH and by each employee stating that the employee has received training.

F. Respiratory Protection Program:

1. Furnish each employee required to wear a negative pressure respirator or other appropriate type with a respirator fit test at the time of initial fitting and at least every 6 months thereafter as required by 29 CFR 1926.62.
2. Establish and implement a respiratory protection program as required by 29 CFR 1910.134, 29 CFR 1910.1025, and 29 CFR 1926.62.

G. Hazard Communication Program: Establish and implement a Hazard Communication Program as required by 29 CFR 1910.1200.

H. Hazardous Waste Management: The Hazardous Waste Management plan shall comply with applicable requirements of Federal, State, and local hazardous waste regulations and address:

1. Identification of hazardous wastes associated with the work.
2. Estimated quantities of wastes to be generated and disposed of.
3. Names and qualifications of each contractor that will be transporting, storing, treating, and disposing of the wastes. Include the facility location and a 24-hour point of contact. Furnish two copies of EPA, state, and, local hazardous waste permit applications, permits, and EPA Identification numbers.

4. Names and qualifications (experience and training) of personnel who will be working on-site with hazardous wastes.
5. List of waste handling equipment to be used in performing the work, to include cleaning, volume reduction, and transport equipment.
6. Spill prevention, containment, and cleanup contingency measures to be implemented.
7. Work plan and schedule for waste containment, removal and disposal.

Wastes shall be cleaned up and containerized daily.

8. Cost for hazardous waste disposal according to this plan.

I. Safety and Health Compliance:

1. In addition to the detailed requirements of this specification, comply with laws, ordinances, rules, and regulations of federal, state, and local authorities regarding removing, handling, storing, transporting, and disposing of lead waste materials. Comply with the applicable requirements of the current issue of 29 CFR 1910.1025.

Submit matters regarding interpretation of standards to the COR for resolution before starting work.

2. Where specification requirements and the referenced documents vary, the most stringent requirements shall apply.

3. Follow all applicable local laws, ordinances, criteria, rules and regulations regarding removing, handling, storing, transporting, and disposing of lead-contaminated materials.

J. Pre-Construction Conference: Along with the CIH, meet with the COR to discuss in detail the lead-containing paint removal work plan, including work procedures and precautions for the work plan.

1.6 SUBMITTALS

A. Submit the following in accordance with Section 01 33 23, SHOP DRAWINGS, PRODUCT DATA, AND SAMPLES.

B. Manufacturer's Catalog Data:

Vacuum filters

Respirators

C. Instructions: Paint removal materials. Include applicable material safety data sheets.

D. Statements Certifications and Statements:

1. Qualifications of CIH: Submit name, address, and telephone number of the CIH selected to perform responsibilities in paragraph entitled "CIH Responsibilities." Provide previous experience of the CIH.

Submit proper documentation that the Industrial Hygienist is certified by the American Board of Industrial Hygiene in comprehensive practice, including certification number and date of certification/recertification.

2. Testing Laboratory: Submit the name, address, and telephone number of the testing laboratory selected to perform the monitoring, testing, and reporting of airborne concentrations of lead. Provide proper documentation that persons performing the analysis have been judged proficient by successful participation within the last year in the National Institute for Occupational Safety and Health (NIOSH) Proficiency Analytical Testing (PAT) Program. The laboratory shall be accredited by the American Industrial Hygiene Association (AIHA). Provide AIHA documentation along with date of accreditation/reaccreditation.

3. Lead-Containing Paint Removal Plan:

a. Submit a detailed job-specific plan of the work procedures to be used in the removal of lead-containing paint. The plan shall include a sketch showing the location, size, and details of lead control areas, location and details of decontamination rooms, change rooms, shower facilities, and mechanical ventilation system.

b. Include in the plan, eating, drinking, smoking and restroom procedures, interface of trades, sequencing of lead related work, collected wastewater and paint debris disposal plan, air sampling plan, respirators, protective equipment, and a detailed description of the method of containment of the operation to ensure that airborne lead concentrations of 30 micrograms per cubic meter of air are not exceeded outside of the lead control area.

c. Include air sampling, training and strategy, sampling methodology, frequency, duration of sampling, and qualifications of air monitoring personnel in the air sampling portion on the plan.

4. Field Test Reports: Monitoring Results: Submit monitoring results to the COR within 3 working days, signed by the testing laboratory employee performing the air monitoring, the employee that analyzed the sample, and the CIH.

5. Records:

a. Completed and signed hazardous waste manifest from treatment or disposal facility.

b. Certification of Medical Examinations.

c. Employee training certification.

PART 2 PRODUCTS

PAINT REMOVAL PRODUCTS: Submit applicable Material Safety Data Sheets for paint removal products used in paint removal work. Use the least toxic product, suitable for the job and acceptable to the Industrial Hygienist.

PART 3 EXECUTION

3.1 PROTECTION

A. Notification: Notify the COR 20 days prior to the start of any paint removal work.

B. Lead Control Area Requirements.

1. Establish a lead control area by completely enclosing with containment screens any area or structure where lead-containing paint removal operations will be performed.
2. Contain removal operations by the use of a negative pressure full containment system with at least one change room and with HEPA filtered exhaust.

C. Protection of Existing Work to Remain: Perform paint removal work without damage or contamination of adjacent areas. Where existing work is damaged or contaminated, restore work to its original condition.

D. Boundary Requirements: Provide physical boundaries around the lead control area by roping off the area [designated on the drawings] or providing curtains, portable partitions or other enclosures to ensure that airborne concentrations of lead will not reach 30 micrograms per cubic meter of air outside of the lead control area.

E. Heating, Ventilating and Air Conditioning (HVAC) Systems: Shut down, lock out, and isolate HVAC systems that supply, exhaust, or pass through the lead control areas. Seal intake and exhaust vents in the lead control area with 6-mil plastic sheet and tape. Seal seams in HVAC components that pass through the lead control area.

F. Change Room and Shower Facilities: Not required.

G. Mechanical Ventilation System:

1. Use adequate ventilation to control personnel exposure to lead in accordance with 29 CFR 1926.57.
2. To the extent feasible, use fixed local exhaust ventilation connected to HEPA filters or other collection systems, approved by the industrial hygienist. Local exhaust ventilation systems shall be designed, constructed, installed, and maintained in accordance with ANSI Z9.2.
3. If air from exhaust ventilation is recirculated into the work place, the system shall have a high efficiency filter with reliable back-up filter and controls to monitor the concentration of lead in the return air and to bypass the recirculation system automatically if it fails. Air may be recirculated only where exhaust to the outside is not feasible.

H. Personnel Protection: Personnel shall wear and use protective clothing and equipment as specified herein. Eating, smoking, or drinking is not permitted in the lead control area. No one will be permitted in the lead control area unless they have been given appropriate training and protective equipment.

I. Warning Signs: Provide warning signs at approaches to lead control areas. Locate signs at such a distance that personnel may read the sign and take the necessary precautions before entering the area. Signs shall comply with the requirements of 29 CFR 1926.62.

3.2 WORK PROCEDURES

A. Prior to beginning any work the contractor shall conduct a comprehensive hazardous materials assessment survey/report to determine the extent, if any, of LBP.

B. Perform removal of lead-containing paint in accordance with approved lead-containing paint removal plan. Use procedures and equipment required to limit occupational and environmental exposure to lead when lead- containing paint is removed in accordance with 29 CFR 1926.62, except as specified herein. Dispose of removed paint chips and associated waste in compliance with Environmental Protection Agency (EPA), federal, state, and local requirements.

C. Personnel Exiting Procedures:

1. Whenever personnel exit the lead-controlled area, they shall perform the following procedures and shall not leave the work place wearing any clothing or equipment worn during the work day:

a. Vacuum themselves off.

b. Remove protective clothing in the decontamination room, and place them in an approved impermeable disposal bag.

c. Change to clean clothes prior to leaving the physical boundary designated around the lead-contaminated job site.

D. Monitoring: Monitoring of airborne concentrations of lead shall be in accordance with 29 CFR 1910.1025 and as specified herein. Air monitoring, testing, and reporting shall be performed by a CIH or an Industrial Hygiene (IH) Technician who is under the direction of the CIH:

1. The CIH or the IH Technician under the direction of the CIH shall be on the job site directing the monitoring, and inspecting the lead containing paint removal work to ensure that the requirements of the Contract have been satisfied during the entire lead-containing paint removal operation.

2. Take personal air monitoring samples on employees who are anticipated to have the greatest risk of exposure as determined by the CIH. In addition, take air monitoring samples on at least 25 percent of the work crew or a minimum of two employees, whichever is greater, during each work shift.

3. Submit results of air monitoring samples, signed by the CIH, within 24 hours after the air samples are taken. Notify the COR immediately of exposure to lead at or in excess of the action level of 30 micrograms per cubic meter of air outside of the lead control area.

E. Monitoring During Paint Removal Work:

1. Perform personal and area monitoring during the entire paint removal operation. Sufficient area monitoring shall be conducted at the physical boundary to ensure unprotected personnel are not exposed above 30 micrograms per cubic meter of air at all times. If the outside boundary lead levels are at or exceed 30 micrograms per cubic meter of air, work shall be stopped and the CIH shall immediately correct the condition(s) causing the increased levels and notify the COR immediately.

2. The CIH shall review the sampling data collected on that day to determine if condition(s) requires any further change in work methods. Removal work shall resume when approval is given by the CIH. The Contractor shall control the lead level outside of the work boundary to less than 30 micrograms per cubic meter of air at all times. As a minimum, conduct area monitoring daily on each shift in which lead paint removal operations are performed in areas immediately adjacent to the lead control area.

3. For outdoor operations, at least one sample on each shift shall be taken on the downwind side of the lead control area. If adjacent areas are contaminated, clean and visually inspect contaminated areas. The CIH shall certify that the area has been cleaned of lead contamination.

3.3 LEAD-CONTAINING PAINT REMOVAL

A. Remove paint within the areas designated in the comprehensive hazardous materials assessment survey/report as containing LBP in order to completely expose the substrate. Take whatever precautions are necessary to minimize damage to the underlying substrate.

B. Indoor Lead Paint Removal: Select paint removal processes to minimize contamination of work areas with lead-contaminated dust or other lead contaminated debris/waste. This paint removal process should be described in the lead-containing paint removal plan. Perform manual sanding and scraping to the maximum extent feasible.

C. Mechanical Paint Removal and Blast Cleaning: Perform mechanical paint removal and blast cleaning in lead control areas using negative pressure full containments with HEPA filtered exhaust. Collect paint residue and spent grit (used abrasive) from blasting operations for disposal in accordance with EPA, state and local requirements.

D. Outside Lead Paint Removal: Select removal processes to minimize contamination of work areas with lead-contaminated dust or other lead contaminated debris/waste. This paint removal process should be described in the lead-containing paint removal plan. Perform manual sanding and scraping to the maximum extent feasible.

3.4 SURFACE PREPARATIONS

Avoid flash rusting or other deterioration of the substrate. Provide surface preparations for painting in accordance with Section 09 91 00, PAINTING.

3.5 CLEANUP AND DISPOSAL

A. Cleanup: Maintain surfaces of the lead control area free of accumulations of paint chips and dust. Restrict the spread of dust and debris; keep waste from being distributed over the work area. Do not dry sweep or use compressed air to clean up the area. At the end of each shift and when the paint removal operation has been completed, clean the area of visible lead paint contamination by vacuuming with a HEPA filtered vacuum cleaner and wet mopping the area.

B. Certification: The CIH shall certify in writing that the inside and outside the lead control area air monitoring samples are less than 30 micrograms per cubic meter of air, the respiratory protection for the employees was adequate, the work procedures were performed in accordance with 29 CFR 1926.62, and that there were no visible accumulations of lead-contaminated paint and dust on the worksite. Do not remove the lead control area or roped-off boundary and warning signs prior to the COR's receipt of the CIH's certification. Reclean areas showing dust or residual paint chips.

C. Testing of Lead-Containing Paint Residue and Used Abrasive Where indicated or when directed by the COR, test lead containing paint residue and used abrasive in accordance with 40 CFR 261 for hazardous waste.

D. Disposal:

1. Collect lead-contaminated waste, scrap, debris, bags, containers, equipment, and lead-contaminated clothing, which may produce airborne concentrations of lead particles.

2. Store removed paint, lead-contaminated clothing and equipment, and lead-contaminated dust and cleaning debris into U.S. Department of Transportation (49 CFR 178) approved 55-gallon drums. Properly labels each drum to identify the type of waste (49 CFR 172) and the date lead-contaminated wastes were first put into the drum. Obtain and complete the Uniform Hazardous Waste Manifest forms from the Activity Staff Civil Engineer. Comply with land disposal restriction notification requirements as required by 40 CFR 268:

a. At least 14 days prior to delivery, notify the COR who will arrange for job site inspection of the drums and manifests by the PWC Hazardous Waste Storage Facility personnel.

b. As necessary, make lot deliveries of hazardous wastes to the PWC Hazardous Waste Storage Facility to ensure that drums do not remain on the jobsite longer than 90 calendar days from the date affixed to each drum.

a. Collect lead-contaminated waste, scrap, debris, bags, containers, equipment, and lead-contaminated clothing which may produce airborne concentrations of lead particles. Label the containers in accordance with 29 CFR 1926.62. Dispose of lead-contaminated waste material at a EPA or state approved hazardous waste treatment, storage, or disposal facility off Government property.

b. Store waste materials in U.S. Department of Transportation (49 CFR 178) approved 55-gallon drums. Properly label each drum to identify the type of waste (49 CFR 172) and the date the drum was filled. The COR or an authorized representative will assign an area for interim storage of waste-containing drums. Do not store hazardous waste drums in interim storage longer than 90 calendar days from the date affixed to each drum.

c. Handle, store, transport, and dispose lead or lead-contaminated waste in accordance with 40 CFR 260, 40 CFR 261, 40 CFR 262, 40 CFR 263, 40 CFR 264, and 40 CFR 265. Comply with land disposal restriction notification requirements as required by 40 CFR 268.

E. Disposal Documentation Submit written evidence that the hazardous waste treatment, storage, or disposal facility (TSD) is approved for lead disposal by the EPA and state or local regulatory agencies. Submit one copy of the completed manifest, signed and dated by the initial transporter in accordance with 40 CFR 262.

**SECTION 09 30 13
CERAMIC/PORCELAIN TILING**

PART 1 - GENERAL

1.1 DESCRIPTION:

A. This section specifies interior ceramic, porcelain and quarry tile, marble thresholds and window stools, terrazzo divider strips, waterproofing membranes for thin-set applications, crack isolation membranes, and tile backer board.

1.2 RELATED WORK:

A. Sustainable Design Requirements: Section 01 81 13, SUSTAINABLE CONSTRUCTION REQUIREMENTS

B. Preformed expansion joints in tile flooring: Section 07 95 13, EXPANSION JOINT COVER ASSEMBLIES.

C. Sealing of Joints: Section 07 92 00, JOINT SEALANTS.

D. Color, Texture, Pattern, and Size of Field Tile and Trim Shapes, and Color of Grout Specified: Section 09 06 00, SCHEDULE FOR FINISHES.

E. Metal and Gypsum Lathing and Gypsum Plaster: Section 09 23 00, GYPSUM PLASTERING.

F. Lathing and Portland Cement Based Plaster: Section 09 24 00, PORTLAND CEMENT PLASTERING.

G. Metal and Resilient Edge Strips at Joints with New Resilient Flooring, and Carpeting: Section 09 65 19, RESILIENT TILE FLOORING and Section 09 68 00, CARPETING.

1.3 SUBMITTALS:

A. Submit in accordance with Section 01 33 23, SHOP DRAWINGS, PRODUCT DATA, AND SAMPLES.

B. Sustainable Design Submittals as described below:

1. Volatile organic compounds per volume as specified in PART

2 - PRODUCTS.

C. Samples:

1. Base tile, each type, each color, each size.

2. Mosaic floor tile panels, 228 by 228 mm (9 by 9 inches), each type, color, size and pattern.

3. Paver tile, each size, type, color and pattern.

4. Quarry tile, each type, color, and size.

5. Porcelain tile, each type, color, patterns and size.
6. Wall (or wainscot) tile, each color, size and pattern.
7. Trim shapes, bullnose cap and cove including bullnose cap and base pieces at internal and external corners of vertical surfaces, each type, color, and size.
8. Therapeutic pool tile, panels 305 mm (12 inches) square, each type, size, color, typical lettering and special shapes.

D. Product Data:

1. Ceramic and porcelain tile, marked to show each type, size, and shape required.
 2. Chemical resistant mortar and grout (epoxy and furan).
 3. Cementitious backer unit.
 4. Dry-set Portland cement mortar and grout.
 5. Divider strip.
 6. Elastomeric membrane and bond coat.
 7. Reinforcing tape.
 8. Leveling compound.
 9. Latex-Portland cement mortar and grout.
 10. Commercial Portland cement grout.
 11. Organic adhesive.
 12. Slip resistant tile.
 13. Waterproofing isolation membrane.
 14. Fasteners.
- E. Certification:
1. Master grade certificate, ANSI A137.1.
 2. Manufacturer's certificates indicating that the following materials comply with specification requirements:
 - a. Chemical resistant mortar and grout (epoxy and furan).
 - b. Modified epoxy emulsion.

- c. Commercial Portland cement grout.
 - d. Cementitious backer unit.
 - e. Dry-set Portland cement mortar and grout.
 - f. Elastomeric membrane and bond coat.
 - g. Reinforcing tape.
 - h. Latex-Portland cement mortar and grout.
 - i. Leveling compound.
 - j. Organic adhesive.
 - k. Waterproof isolation membrane.
 - l. Factory back mounted tile documentation for suitability for application in wet area.
- F. Installer Qualifications:
- 1. Submit letter stating installer's experience.

1.4 DELIVERY AND STORAGE:

- A. Deliver materials in containers with labels legible and intact and grade-seals unbroken.
- B. Store material to prevent damage or contamination.

1.5 QUALITY ASSURANCE:

- A. Installers to be from a company specializing in performing installation of products specified and have a minimum of three (3) years' experience.
- B. Each type and color of tile to be provided from a single source.
- C. Each type and color of mortar, adhesive, and grout to be provided from the same source.

1.6 WARRANTY:

- A. Construction Warranty: Comply with FAR clause 52.246-21, "Warranty of Construction".

1.7 APPLICABLE PUBLICATIONS:

- A. Publications listed below form a part of this specification to the extent referenced. Publications are referenced in text by basic designation only.

- B. American National Standards Institute (ANSI):

A10.20-06(R2011).....Safe Operating Practices for Tile, Terrazzo and
Marble Work A108/A118/A136-14 Installation of
Ceramic Tile

- A108.01-13.....Subsurface and Preparations by Other Trades
- A108.02-13.....Materials, Environmental, and Workmanship
- A108.1A-14.....Installation of Ceramic Tile in the Wet-Set Method with Portland Cement Mortar
- A108.1B-10.....Installation of Ceramic Tile on a Cured Portland Cement Mortar Setting Bed with Dry-Set or Latex-Portland Cement Mortar
- A108.1C-10.....Contractors Option; Installation of Ceramic Tile in the Wet-Set method with Portland Cement Mortar or Installation of Ceramic Tile on a Cured Portland Cement Mortar Setting Bed with Dry-Set or Latex-Portland Cement Mortar
- A108.4-09.....Ceramic Tile with Organic Adhesives or Water Cleanable Tile-Setting Epoxy Adhesive
- A108.6-10.....Ceramic Tile with Chemical Resistant, Water Cleanable Tile-Setting and -Grouting Epoxy
- A108.8-10.....Ceramic Tile with Chemical Resistant Furan Resin Mortar and Grout
- A108.10-10.....Grout in Tilework
- A108.13-10.....Load Bearing, Bonded, Waterproof Membranes for Thin-Set Ceramic Tile and Dimension Stone
- A118.1-12.....Dry-Set Portland Cement Mortar
- A118.3-13.....Chemical Resistant, Water Cleanable Tile-Setting and -Grouting Epoxy and Water Cleanable Tile-Setting Epoxy Adhesive
- A118.4-12.....Latex-Portland Cement Mortar
- A118.5-10.....Chemical Resistant Furan Mortars and Grouts
- A118.6-10.....Cement Grouts for Tile Installation
- A118.7-10.....High Performance Cement Grouts for Tile Installation
- A118.9-10.....Cementitious Backer Units

A118.10-14.....Load Bearing, Bonded, Waterproof Membranes for Thin-Set Ceramic Tile and Dimension Stone Installation

A136.1-13.....Organic Adhesives for Installation of Ceramic Tile

A137.1-12.....American National Standard Specifications for Ceramic Tile

C. ASTM International (ASTM):

A666-10.....Annealed or Cold-Worked Austenitic Stainless Steel Sheet, Strip, Plate and Flat Bar

A1064/A1064M-14.....Carbon-Steel Wire and Welded Wire Reinforcement, Plain and Deformed, for Concrete

C109/C109M-13.....Standard Test Method for Compressive Strength of Hydraulic Cement Mortars (Using 2 inch. or [50-mm] Cube Specimens)

C241/C241M-13.....Abrasion Resistance of Stone Subjected to Foot Traffic

C348-14.....Standard Test Method for Flexural Strength of Hydraulic-Cement Mortars

C627-10.....Evaluating Ceramic Floor Tile Installation Systems Using the Robinson-Type Floor Tester

C954-11.....Steel Drill Screws for the Application of Gypsum Board on Metal Plaster Base to Steel Studs from 0.033 in (0.84 mm) to 0.112 in (2.84 mm) in thickness

C979/C979M-10.....Pigments for Integrally Colored Concrete

C1002-14.....Steel Self-Piercing Tapping Screws for the Application of Panel Products

C1027-09.....Test Method for Determining Visible Abrasion Resistance of Glazed Ceramic Tile

C1127-01(R2009).....Standard Guide for Use of High Solids Content, Cold Liquid-Applied Elastomeric Waterproofing Membrane with an Integral Wearing Surface

C1178/C1178M-13.....Standard Specification for Coated Glass Mat Water-Resistant Gypsum Backing Panel

C1325-14.....Non-Asbestos Fiber-Mat Reinforced Cementitious

Backer Units

C1353/C1353M-09(R2013)..Abrasion Resistance of Dimension Stone
Subjected to Foot Traffic Using a Rotary
Platform, Double-Head Abraser

D1204-14.....Test Method for Linear Dimensional Changes of
Nonrigid Thermoplastic Sheeting or Film at
Elevated Temperature

D2240-05(R2010)Test Method for Rubber Property – Durometer
Hardness

D2497-07(R2012)Tolerances for Manufactured Organic-Base
Filament Single Yarns

D3045-92(R2010).....Heat Aging of Plastics Without Load

D4397-10.....Standard Specification for Polyethylene
Sheeting for Construction, Industrial and
Agricultural Applications

D5109-12.....Standard Test Methods for Copper-Clad
Thermosetting Laminates for Printed Wiring
Boards

D. Code of Federal Regulation (CFR):

40 CFR 59.....Determination of Volatile Matter Content, Water
Content, Density Volume Solids, and Weight
Solids of Surface Coating

E. Marble Institute of America (MIA): Design Manual III-2007

F. Tile Council of North America, Inc. (TCNA):

Handbook for Ceramic Tile Installation (2014)
DCOF AcuTest-2012.....Dynamic Coefficient of Friction Test

PART 2 - PRODUCTS

2.1 TILE:

A. Comply with ANSI A137.1, Standard Grade, except as modified:

1. Inspection procedures listed under the Appendix of ANSI A137.1.

2. Abrasion Resistance Classification:

a. Tested in accordance with values listed in Table 1, ASTM C1027.

b. Class V, 12000 revolutions for floors in Corridors, Kitchens, Storage including Refrigerated Rooms

c. Class IV, 6000 revolutions for remaining areas.

3. Slip Resistant Tile for Floors:

a. Coefficient of friction, when tested in accordance with ANSI A137.1 and measured per the TCNA DCOF AcuTest.

1) Equal to or greater than .42 for level interior tile floors that will be walked on when wet.

b. Tile Having Abrasive Grains:

1) Unglazed Ceramic Mosaic Tile: Abrasive grains throughout body of the tile.

2) Quarry Tile: Abrasive grains uniformly embedded in face at rate of approximately 7.5 percent of surface area.

c. Porcelain Paver Tile: Matte surface finish with raised ridges spaced uniformly over tile surface.

4. Mosaic tile may be mounted or joined together by a resinous bonding material along tile edges.

5. Back mounted tiles in showers, therapeutic pools, natatorium, hydrotherapy, whirlpool baths, and congregate baths. Provide certification that the factory mounted tile has been used successfully in service at three (3) projects and is suitable for wet locations.

6. Factory Blending: For tile with color variations, within the ranges selected during sample submittals blend tile in the factory and package so tile units taken from one (1) package show the same range in colors as those taken from other packages and match approved samples.

7. Factory-Applied Temporary Protective Coating:

a. Protect exposed face surfaces (top surface) of tile against adherence of mortar and grout by pre-coating with a continuous film of hot applied petroleum paraffin wax.

b. Do not coat unexposed tile surfaces.

c. Pre-wax tiles set or grouted with furan or epoxy or latex modified mortars.

B. Unglazed Ceramic Mosaic Tile: Nominal 6 mm (1/4 inch) thick with cushion edges.

C. Unglazed Quarry Tile: Nominal 13 mm (1/2 inch) thick, square edges.

D. Glazed Wall Tile: Cushion edges, glazing.

E. Porcelain Paver Tile: Nominal 8 mm (5/16 inch) thick, with cushion edges. Porcelain tile produced by the dust pressed method are to be made of approximately 50% feldspar; the remaining 50% is to be made up of various high-quality light firing ball clays yielding a tile with a water absorption rate of 0.5% or less and a breaking strength of between 176 to 181 kg (390 to 400 lbs.).

F. Trim Shapes:

1. Conform to applicable requirements of adjoining floor and wall tile.
2. Use slip resistant trim shapes for horizontal surfaces of showers, congregated baths, natatorium, hydrotherapy, therapeutic pool, overflow ledges, recessed steps, shower curbs, drying area curbs, and seats.
3. Use trim shapes sizes conforming to size of adjoining field wall tile including existing spaces unless detailed on construction documents or specified otherwise.
4. Internal and External Corners:
 - a. Square internal and external corner joints are not acceptable.
 - b. External corners including edges: Use bullnose shapes.
 - c. Internal corners: Use cove shapes.
 - d. Base to floor internal corners: Use special shapes providing integral cove vertical and horizontal joint.
 - e. Base to floor external corners: Use special shapes providing bullnose vertical edge with integral cove horizontal joint. Use stop at bottom of openings having bullnose return to wall.
 - f. Wall top edge internal corners: Use special shapes providing integral cove vertical joint with bullnose top edge.
 - g. Wall top edge external corners: Use special shapes providing bullnose vertical and horizontal joint edge.
 - h. For unglazed ceramic mosaic and glazed wall tile installed in Portland cement mortar setting bed, use cove and bullnose shapes as applicable. When ceramic mosaic wall and base tile is required, use C Series cove and bullnose shapes.
 - i. For unglazed ceramic mosaic and glazed wall tile installed in dry-set Portland cement mortar, latex-Portland cement mortar, and organic adhesive (thin set methods), use cove and surface bullnose shapes as applicable.
 - j. For quarry tile work, use cove and bullnose shapes as applicable.
 - k. Provide cove and bullnose shapes for countertops, stools, saddles, where indicated in construction documents, and required to complete tile work.

2.2 BACKER UNITS:

A. Cementitious Backer Units:

1. Use in showers or wet areas.
2. Conform to ASTM C1325; Type A.
3. Use in maximum lengths available to minimize end to end butt joints.

B. Glass Mat Water Resistant Backing Board:

1. Use in showers or wet areas.
2. Conform to ASTM C1178/C1178M.
3. Use in maximum lengths available to minimize end to end butt joints.

2.3 JOINT MATERIALS FOR CEMENTITIOUS BACKER UNITS:

A. Reinforcing Tape: Vinyl coated woven glass fiber mesh tape, open weave, 50 mm (2 inches) wide. Tape with pressure sensitive adhesive backing will not be permitted.

B. Tape Embedding Material: Latex-Portland cement mortar complying with ANSI A108.01.

C. Joint material, including reinforcing tape, and tape embedding material, are to be as specifically recommended by the backer unit manufacturer.

2.4 FASTENERS:

A. Screws for Cementitious Backer Units.

1. Standard screws for gypsum board are not acceptable.
2. Minimum 11 mm (7/16 inch) diameter head, corrosion resistant coated, with washers.
3. ASTM C954 for steel 1 mm (0.033 inch) thick.
4. ASTM C1002 for steel framing less than 0.0329 inch thick.

B. Washers: Galvanized steel, 13 mm (1/2 inch) minimum diameter.

2.5 SETTING MATERIALS OR BOND COATS:

A. Conform to TCNA Handbook for Ceramic Tile Installation.

B. Portland Cement Mortar: ANSI A108.02.

C. Latex-Portland Cement Mortar: ANSI A118.4.

1. For wall applications, provide non-sagging, latex-Portland cement mortar complying with ANSI A118.4.

2. Prepackaged Dry-Mortar Mix: Factory-prepared mixture of Portland cement; dry, redispersible, ethylene vinyl acetate additive; and other ingredients to which only water needs to be added at Project site.

D. Dry-Set Portland Cement Mortar: ANSI A118.1. For wall applications, provide non-sagging, latex-Portland cement mortar complying with ANSI A118.1.

E. Organic Adhesives: ANSI A136.1, Type 1.

F. Chemical-Resistant Bond Coat:

1. Epoxy Resin Type: ANSI A118.3.

2. Furan Resin Type: ANSI A118.5.

G. Elastomeric Waterproofing Membrane and Bond Coat:

1. TCNA F122-14 (on ground concrete) and TCNA F112A-14 (above ground concrete).

2. ANSI A118.10.

3. One component polyurethane, liquid applied material having the following additional physical properties:

a. Hardness: Shore "A" between 40-60.

b. Elongation: Between 300-600 percent.

c. Tensile strength: Between .27 - .41 Newton per square millimeter (40-60 pounds per square inch gauge).

d. No volatile compounds (VOC).

4. Coal tar modified urethanes are not acceptable.

H. Waterproofing Isolation Membrane:

1. Sheet System TCNA F122-14 (on-ground concrete) and TCNA F122A-14 (above-ground concrete).

2. Composite sheet consisting of ASTM D5109, Type II, Grade I Chlorinated Polyethylene (CM) sheet reinforced on both sides with a non-woven polyester fiber.

3. Designed for use in wet areas as an isolation and positive waterproofing membranes for thin-set bonding of sheet to substrate and thin-set bonding of ceramic and porcelain tile or marble to sheet. Suited for both horizontal and vertical applications.

4. Conform to the following additional physical properties:

Property	Units	Results	Test Method
Hardness Shore A	Points	70-80	ASTM D2240 (10 Second Reading)
Shrinkage	Percent	5 maximum	ASTM D1204
Brittleness		No crack remains flexible at temperature -37 degrees C (-35 degrees F)	ASTM D2497 13mm (1/2-inch Mandrel Bend)
Retention of Properties after Heat Aging	Percent of original	80 Tensile 80 Breaking 80 Elongation	ASTM D3045, 90 degrees C (194 degrees F) for 168 hours

5. Manufacturer's standard sheet size with prefabricated or preformed inside and outside corners.

6. Sheet manufacturer's solvent welding liquid or xylene and edge sealant.

2.6 GROUTING MATERIALS:

A. Coloring Pigments:

1. Pure mineral pigments, lime proof and nonfading, complying with ASTM C979/C979M.
2. Coloring pigments may only be added to grout by the manufacturer.
3. Job colored grout is not acceptable.
4. Use is required in Commercial Portland Cement Grout, Dry-Set Grout, and Latex-Portland Cement Grout.

B. Sand-Portland Cement Grout: ANSI A108.10, consisting of white or gray cement and white or colored aggregate as required to produce color indicated. Zero VOC content.

C. Standard Cement Grout: ANSI A118.6.

D. High Performance Tile Grout: ANSI A118.7 with a VOC content of 65 g/L or less when calculated according to 40 CFR 59 (EPA Method 24).

1. Polymer Type: Ethylene vinyl acetate or acrylic additive, in dry, redispersible form, prepackaged with other dry ingredients.

2. Polymer Type: Acrylic resin or styrene-butadiene rubber in liquid latex form for addition to prepackaged dry-grout mix.

E. Water-Cleanable Epoxy Grout: ANSI A118.3, with a VOC content of 65 g/L or less when calculated according to 40 CFR 59 (EPA Method 24).

1. Provide product capable of withstanding continuous and intermittent exposure to temperatures of up to 60 and 100 degrees C (140 and 212 degrees F), respectively, and certified by manufacturer for intended use.

2.7 PATCHING AND LEVELING COMPOUND:

A. Portland cement base, polymer-modified, self-leveling compound, manufactured specifically for resurfacing and leveling concrete floors. Products containing gypsum are not acceptable.

B. Provide a patching and leveling compound with the following minimum physical properties:

1. Compressive strength - 25 MPa (3500 psig) per ASTM C109/C109M.

2. Flexural strength - 7 MPa (1000 psig) per ASTM C348 (28-day value).

3. Tensile strength – 4.1 MPa (600 psi) per ANSI 118.7.

4. Density – 1.9.

C. Capable of being applied in layers up to 38 mm (1-1/2 inches) thick without fillers and up to 101 mm (4 inches) thick with fillers, being brought to a feather edge, and being troweled to a smooth finish.

D. Primers, fillers, and reinforcement as required by manufacturer for application and substrate condition.

E. Ready for use in 48 hours after application.

2.8 MARBLE:

A. Soundness Classification in accordance with MIA Design Manual III Groups.

B. Thresholds:

1. Group A, Minimum abrasive hardness (Ha) of 10.0 per ASTM C1353/C1353M or ASTM C241/C241M.

2. Honed finish on exposed faces.

3. Thickness and contour as indicated in construction documents.

4. Fabricate from one piece without holes, cracks, or open seams; full depth of wall or frame opening by full width of wall or frame opening; 19 mm (3/4-inch) minimum thickness and 6 mm (1/4-inch) minimum thickness at beveled edge.

5. Set not more than 13 mm (1/2-inch) above adjoining finished floor surfaces, with transition edges beveled on a slope of no greater than 1:2. On existing floor slabs provide 13 mm (1/2-inch) above ceramic tile surface with bevel edge joint top flush with adjacent floor.

6. One piece full width of door opening. Notch thresholds to match profile of doorjamb.

C. Window Stools:

1. Group A or B.

2. Polished finish on exposed faces.

3. Size and thickness as indicated in construction documents.

2.9 METAL DIVIDER STRIPS:

A. Terrazzo type divider strips.

B. Heavy top type strip with 5 mm (3/16 inch) wide top and 38 mm (1 1/2 inch) long leg. Height to match tile and setting-bed thickness.

C. Embedded leg perforated and deformed for keying to mortar.

D. Half-hard brass white zine alloy nickel silver stainless-steel, ASTM A666, 300 Series exposed-edge material.

2.10 WATER:

A. Clean, potable and free from salts and other injurious elements to mortar and grout materials.

2.11 CLEANING COMPOUNDS:

A. Specifically designed for cleaning masonry and concrete and which will not prevent bond of subsequent tile setting materials including patching and leveling compounds and elastomeric waterproofing membrane and coat.

B. Materials containing acid or caustic Material are not acceptable.

2.12 FLOOR MORTAR BED REINFORCING:

A. ASTM A1064/A1064M welded wire fabric without backing, MW3 x MW3 (2 x 2-W0.5 x W0.5).

2.13 POLYETHYLENE SHEET:

A. Polyethylene sheet conforming to ASTM D4397.

B. Nominal thickness: 0.15 mm (6 mils).

PART 3 - EXECUTION

3.1 ENVIRONMENTAL REQUIREMENTS:

A. Maintain ambient temperature of work areas at not less than 16 degrees C (60 degrees F), without interruption, for not less than 24 hours before installation and not less than three (3) days after installation.

B. Maintain higher temperatures for a longer period of time where required by manufacturer's recommendation and ANSI Specifications for installation.

C. Do not install tile when the temperature is above 38 degrees C (100 degrees F).

D. Do not install materials when the temperature of the substrate is below 16 degrees C (60 degrees F).

E. Do not allow temperature to fall below 10 degrees C (50 degrees F) after third day of completion of tile work.

3.2 ALLOWABLE TOLERANCE:

A. Variation in plane of sub-floor, including concrete fills leveling compounds and mortar beds:

1. Not more than 6 mm in 3048 mm (1/4 inch in 10 feet) from required elevation where Portland cement mortar setting bed is used.

2. Not more than 3 mm in 3048 mm (1/8 inch in 10 feet) where dry-set Portland cement, and latex-Portland cement mortar setting beds and chemical-resistant bond coats are used.

B. Variation in Plane of Wall Surfaces:

1. Not more than 6 mm in 2438 mm (1/4 inch in 8 feet) from required plane where Portland cement mortar setting bed is used.

2. Not more than 3 mm in 2438 mm (1/8 inch in 8 feet) where dry-set or latex-Portland cement mortar or organic adhesive setting materials is used.

3.3 SURFACE PREPARATION:

A. Cleaning New Concrete or Masonry:

1. Chip out loose material, clean off all oil, grease dirt, adhesives, curing compounds, and other deterrents to bonding by mechanical method, or by using products specifically designed for cleaning concrete and masonry.

2. Use self-contained power blast cleaning systems to remove curing compounds and steel trowel finish from concrete slabs where ceramic tile will be installed directly on concrete surface with thin-set materials.

3. Steam cleaning or the use of acids and solvents for cleaning will not be permitted.

B. Patching and Leveling:

1. Mix and apply patching and leveling compound in accordance with manufacturer's instructions.

2. Fill holes and cracks and align concrete floors that are out of required plane with patching and leveling compound.

a. Thickness of compound as required to bring finish tile system to elevation shown on construction documents.

b. Float finish except finish smooth for elastomeric waterproofing.

c. At substrate expansion, isolation, and other moving joints, allow joint of same width to continue through underlayment.

3. Apply patching and leveling compound to concrete and masonry wall surfaces that are out of required plane.

4. Apply leveling coats of material compatible with wall surface and tile setting material to wall surfaces, other than concrete and masonry that are out of required plane.

C. Mortar Bed for Slopes to Drains:

1. Slope compound to drain where drains are shown on construction documents.

2. Install mortar bed in depressed slab sloped to drains not less than 3.2 mm in 305 mm (1/8 inch per foot).

3. Allow not less than 50 mm (2 inch) depression at edge of depressed slab.

4. Screed for slope to drain and float finish.

5. Cure mortar bed for not less than seven (7) days. Do not use curing compounds or coatings.

6. Perform flood test to verify mortar bed slopes to drain before installing tile. Contracting Officer Representative (COR) to be present during flood test.

D. Additional preparation of concrete floors for tile set with epoxy, or furan-resin is to be in accordance with the manufacturer's printed instructions.

E. Cleavage Membrane:

1. Install polythene sheet as cleavage membrane in depressed slab when waterproof membrane is not scheduled or indicated.

2. Turn up at edge of depressed floor slab to top of floor.

F. Walls:

1. In showers or other wet areas cover studs with polyethylene sheet.

2. Apply patching and leveling compound to concrete and masonry surfaces that are out of required plane.

3. Apply leveling coats of material compatible with wall surface and tile setting material to wall surfaces, other than concrete and masonry that are out of required plane.

4. Apply metal lath to framing in accordance with ANSI A108.1:

a. Use fasteners specified in paragraph "Fasteners." Use washers when lath opening is larger than screw head.

- b. Apply scratch and leveling coats to metal lath in accordance with ANSI A108.1C.
- c. Total thickness of scratch and leveling coats:
 - 1) Apply 9 mm to 16 mm (3/8 inch to 5/8 inch) thick over solid backing.
 - 2) 16 mm to 19 mm (5/8 to 3/4 inch) thick on metal lath over studs.
 - 3) Where wainscots are required to finish flush with wall surface above, adjust thickness required for flush finish.
- d. Apply scratch and leveling coats more than 19 mm (3/4 inch) thick in two (2) coats.

SPEC WRITER NOTE: Use paragraph below when alterations occur in existing work and removal of existing finish flooring and walls occurs.

G. Existing Floors and Walls:

- 1. Remove existing composition floor finishes and adhesive. Prepare surface by grinding, chipping, self-contained power blast cleaning or other suitable mechanical methods to completely expose uncontaminated concrete or masonry surfaces. Follow safety requirements of ANSI A10.20.
- 2. Remove existing concrete fill or topping to structural slab. Clean and level the substrate for new setting bed and waterproof membrane or cleavage membrane.
- 3. Where new tile bases are required to finish flush with plaster above or where they are extensions of similar bases in conjunction with existing floor tiles, cut channel in floor slab and expose rough wall construction sufficiently to accommodate new tile base and setting material.

3.4 CEMENTITIOUS BACKER UNITS:

- A. Remove polyethylene wrapping from cementitious backer units and separate to allow for air circulation. Allow moisture content of backer units to dry down to a maximum of 35 percent before applying joint treatment and tile.
- B. Install in accordance with ANSI A118.9 except as specified otherwise.
- C. Install units horizontally or vertically to minimize joints with end joints over framing members. Units with rounded edges; face rounded edge away from studs to form a “V” joint for joint treatment.
- D. Secure cementitious backer units to each framing member with screws spaced not more than 203 mm (8 inches) on center and not closer than 13 mm (1/2 inch) from the edge of the backer unit or as recommended by backer unit manufacturer. Install screws so that the screw heads are flush with the surface of the backer unit.

E. Where backer unit joins shower pans or waterproofing, lap backer unit over turned up waterproof system. Install fasteners only through top one-inch of turned up waterproof systems.

F. Do not install joint treatment for seven (7) days after installation of cementitious backer unit.

G. Joint Treatment:

1. Fill horizontal and vertical joints and corners with latex-Portland cement mortar. Apply fiberglass tape over joints and corners and embed with same mortar.

2. Leave 6 mm (1/4 inch) space for sealant at lips of tubs, sinks, or other plumbing receptors.

3.5 GLASS MAT WATER-RESISTANT BACKING BOARD:

A. Install in accordance with manufacturer's instructions.

TCNA Systems W245-1.

B. Treat joints with tape and latex-Portland cement mortar or adhesive.

3.6 MARBLE:

A. Secure thresholds and stools in position with minimum of two stainless steel dowels.

B. Set in dry-set Portland cement mortar or latex-Portland cement mortar bond coat.

C. Set threshold to finish 13 mm (1/2 inch) above ceramic tile floor unless shown otherwise on construction documents, with bevel edge joint top flush with adjacent floor similar to TCNA detail TR611-14.

3.7 METAL DIVIDER STRIPS:

A. Install metal divider strips in floor joints between ceramic and quarry tile floors and between tile floors and adjacent flooring of other materials where the finish floors are flush unless shown otherwise on construction documents.

B. Set divider strip in mortar bed to line and level centered under doors or in openings.

C. At preformed sealant joint: Refer to Section 07 95 13, EXPANSION JOINT COVER ASSEMBLIES.

1. Comply with recommendations in TCNA for Vertical and Horizontal Joint Design Essentials. TCNA Systems EJ 171.

a. Locate joint in tile surfaces directly above joint in sub-floor or where indicated when used with isolation membranes to allow off-setting of joint location from sub-floor joint.

b. Fasten full length to sub-floor using a construction adhesive.

c. Trowel setting material with full coverage over the entire leg.

2. Set tile up against the joint ensuring that the top edge of the joint is flush or slightly below the top of the tile.

3.8 CERAMIC TILE – GENERAL:

A. Comply with ANSI A108/A118/A136 series of tile installation standards applicable to methods of installation and TCNA Installation Guidelines.

B. Installing Mortar Beds for Floors:

1. Install mortar bed in a manner that does not damage cleavage or waterproof membrane; 32 mm (1-1/2 inch) minimum thickness.

2. Install floor mortar bed reinforcing centered in mortar fill.

3. Screed finish to level plane or slope to drains shown on construction documents, float finish.

4. For thin set systems cure mortar bed not less than seven (7) days. Do not use curing compounds or coatings.

5. For tile set with Portland cement paste over plastic mortar bed coordinate to set tile before mortar bed sets.

C. Setting Beds or Bond Coats:

1. Where recessed or depressed floor slabs are filled with Portland cement mortar bed, set ceramic mosaic floor tile in either Portland cement paste over plastic mortar bed or latex-Portland cement mortar over cured mortar bed except as specified otherwise, ANSI A108-1C, TCNA System F121-14 or F111-14.

2. Use quarry tile in chemical-resistant bond coat, except in floor of walk-in refrigerator rooms use:

TCNA System R612-11.

a. Portland cement paste over plastic mortar bed. ANSI A108.1A.

b. Dry-set Portland cement mortar over cured mortar bed.

ANSI A108.1B.

3. Pools Holding Water: ANSI A108.1C. Do not use latex Portland cement mortar.

4. Set floor tile in elastomeric bond coat over elastomeric membrane per ANSI 108.13, TCNA System F122-14 where indicated on construction documents.

5. Set wall tile installed over concrete or masonry in dry-set Portland cement mortar, or latex-Portland cement mortar, ANSI 108.1B and TCNA System W211-14, W221-14 or W222-14.

6. Set wall tile installed over concrete backer board in latex-Portland cement mortar, ANSI A108.1B.

7. Set wall tile installed over Portland cement mortar bed on metal lath base in Portland cement paste over plastic mortar bed, or dry-set Portland cement mortar or latex-Portland cement mortar over a cured mortar bed, ANSI A108.1C, TCNA System W231-14, W241-14.

8. Set tile over concrete in therapeutic pools in Portland cement paste or dry set Portland cement mortar, ANSI A108.1C, TCNA System P601MB-14.

9. Set tile installed over gypsum board and gypsum plaster in organic adhesive, ANSI A108.1, TCNA System W242-14.

10. Set trim shapes in same material specified for setting adjoining tile.

D. Workmanship:

1. Lay out tile work so that no tile less than one-half full size is used. Make all cuts on the outer edge of the field. Align new tile work scheduled for existing spaces to the existing tile work unless specified otherwise.

2. Set tile firmly in place with finish surfaces in true planes. Align tile flush with adjacent tile unless shown otherwise on construction documents.

3. Form intersections and returns accurately.

4. Cut and drill tile neatly without marring surface.

5. Cut edges of tile abutting penetrations, finish, or built-in items:

a. Fit tile closely around electrical outlets, piping, fixtures and fittings, so that plates, escutcheons, collars and flanges will overlap cut edge of tile.

b. Seal tile joints water tight as specified in Section 07 92 00, JOINT SEALANTS, around electrical outlets, piping fixtures and fittings before cover plates and escutcheons are set in place.

6. Completed work is to be free from hollow sounding areas and loose, cracked or defective tile.

7. Remove and reset tiles that are out of plane or misaligned.

8. Floors:

a. Extend floor tile beneath casework and equipment, except those units mounted in wall recesses.

b. Align finish surface of new tile work flush with other and existing adjoining floor finish where indicated in construction documents.

c. In areas where floor drains occur, slope tile to drains.

d. Push and vibrate tiles over 203 mm (8 inches) square to achieve full support of bond coat.

9. Walls:

- a. Cover walls and partitions, including pilasters, furred areas, and freestanding columns from floor to ceiling, or from floor to nominal wainscot heights as indicated in construction documents with tile.
- b. Finish reveals of openings with tile, except where other finish materials are indicated in construction documents.
- c. At window openings, provide tile stools and reveals.
- d. Finish wall surfaces behind and at sides of casework and equipment, except those units mounted in wall recesses, with same tile as scheduled for room proper.

10. Joints:

- a. Keep all joints in line, straight, level, perpendicular and of even width unless shown otherwise on construction documents.
- b. Make joints 2 mm (1/16 inch) wide for glazed wall tile and mosaic tile work.
- c. Make joints in quarry tile work not less than 6 mm (1/4 inch) nor more than 9 mm (3/8 inch) wide. Finish joints flush with surface of tile.
- d. Make joints in paver tile, porcelain type; maximum 3 mm (1/8 inch) wide.

11. Back Buttering: For installations indicated below, obtain 100 percent mortar coverage by complying with applicable special requirements for back buttering of tile in referenced ANSI A108/A118/A136 series of tile installation standards:

- a. Tile wall installations in wet areas, including showers, tub enclosures, laundries and swimming pools.
- b. Tile installed with chemical-resistant mortars and grouts.
- c. Tile wall installations composed of tiles 203 by 203 mm (8 by 8 inches) or larger.
- d. Exterior tile wall installations.

3.9 CERAMIC TILE INSTALLED WITH PORTLAND CEMENT MORTAR:

A. Mortar Mixes for Floor, Wall and Base Tile (including Showers, and Therapeutic Pools): ANSI A108.1A, except specified otherwise.

B. Installing Wall and Base Tile: ANSI A108.1A, except specified otherwise.

C. Installing Floor Tile: ANSI A108.1A, except as specified otherwise.
Slope mortar beds to floor drains at a minimum of 3 mm in 305 mm (1/8 inch per foot).

3.10 PORCELAIN TILE INSTALLED WITH LATEX PORTLAND CEMENT BONDING MORTAR:

A. Due to the denseness of porcelain tile use latex Portland cement bonding mortar that meets the requirements of ANSI A108.01. Mix bonding mortars in accordance with manufacturer's instructions. Provide liquid ratios and comply with dwell times during the placement of bonding mortar and tile.

3.11 THIN SET CERAMIC AND PORCELAIN TILE INSTALLED WITH DRY-SET PORTLAND CEMENT AND LATEX-PORTLAND CEMENT MORTAR:

A. Installation of Tile: ANSI A108.1B, except as specified otherwise.

B. Slope tile work to drains at not less than 3 mm in 305 mm (1/8 inch per foot).

3.12 THIN SET CERAMIC AND PORCELAIN TILE INSTALLED WITH ORGANIC ADHESIVE

A. Installation of Tile: ANSI A108.4.

3.13 THIN SET CERAMIC AND PORCELAIN TILE INSTALLED WITH CHEMICAL-RESISTANT BOND COAT:

A. Epoxy Resin Type: Install tile in accordance with Installation of Tile with Epoxy Mortar; ANSI A108.6.

B. Furan Resin Type: Proportion, mix and place in accordance with the manufacturer's printed instructions. Set tile in accordance with ANSI A108.8.

3.14 CERAMIC AND PORCELAIN TILE INSTALLED WITH ELASTOMERIC BOND COAT:

A. Surface Preparation: Prepare surfaces as specified.

B. Installation of Elastomeric Membrane: ANSI A108.10 and TCNA F122-14 (on ground concrete) and F122A-14 (above-ground concrete).

1. Prime surfaces, where required, in accordance with manufacturer's instructions.

2. Install first coat of membrane material in accordance with manufacturer's instructions, in thickness of 0.76 to 1.3 mm (30 to 50 mils).

3. Extend material over flashing rings of drains and turn up vertical surfaces not less than 101 mm (4 inches) above finish floor surface.

4. When material has set, recoat areas with a second coat of elastomeric membrane material for a total thickness of 1.3 to 1.9 mm (50 to 75 mils).

5. After curing test for leaks with 25 mm (1 inch) of water for 24 hours.

C. Installation of Tile in Elastomeric Membrane:

1. Spread no more material than can be covered with tile before material starts to set.

2. Apply tile in second coat of elastomeric membrane material in accordance with the coating manufacturer's instructions in lieu of aggregate surfacing specified in ASTM C1127. Do not install top coat over tile.

3.15 GROUTING:

A. Grout Type and Location:

1. Grout for glazed wall and base tile, paver tile and unglazed mosaic tile except for therapeutic pool Portland cement grout, latex Portland cement grout, dry-set grout, or commercial Portland cement grout.

2. Grout for quarry tile floor and base:

a. Grout for floors of walk-in refrigerated rooms: Epoxy grout.

b. Therapeutic pool areas: Portland cement grout.

c. Grout for Kitchens:

1) Chemical-resistant grout as specified and recommended by manufacturer of bond coat.

2) Use only furan resin grout within 609 mm (2 feet) of ovens, steam kettles, water heaters, steam pipes, and in rooms.

3) Epoxy grout designed for equivalent heat resistance to furan resin grout may be used for furan resin grout.

3. Grout for tile of therapeutic pools: Portland cement grout.

B. Workmanship:

1. Install and cure grout in accordance with the applicable standard.

2. Sand Portland Cement Grout: ANSI A108.10.

3. Standard Cement Grout: ANSI A118.6.

4. High Performance Grout: ANSI A118.7.

5. Epoxy Grout: ANSI A108.6.

6. Water-Cleanable Epoxy Grout: ANSI A118.3.

7. Furan and Commercial Portland Cement Grout: ANSI A118.5 and in accordance with the manufacturer's printed instructions.

3.16 MOVEMENT JOINTS:

A. Prepare tile expansion, isolation, construction and contraction joints for installation of sealant. Refer to Section 07 92 00, JOINT SEALANTS.

B. TCNA details EJ 171-14.

C. At expansion joints, rake out joint full depth of tile and setting bed and mortar bed. Do not cut waterproof or isolation membrane.

D. Rake out grout at joints between tile, tub, service sink, at toe of base, and where indicated in construction documents not less than 6 mm (1/4 inch) deep.

3.17 CLEANING:

A. Thoroughly sponge and wash tile. Polish glazed surfaces with clean dry cloths.

B. Methods and materials used are not permitted to damage or impair appearance of tile surfaces.

C. The use of acid or acid cleaners on glazed tile surfaces is prohibited.

D. Clean tile grouted with epoxy, furan and commercial Portland cement grout and tile set in elastomeric bond coat as recommended by the manufacturer of the grout and bond coat.

3.18 PROTECTION:

A. Keep traffic off tile floor, until grout and setting material is fully set and cured.

B. Where traffic occurs over tile floor is unavoidable, cover tile floor with not less than 9 mm (3/8 inch) thick plywood, wood particle board or hardboard securely taped in place. Do not remove protective cover until time for final inspection. Clean tile of any tape, adhesive and stains.

3.19 TESTING FINISH FLOOR:

A. Test floors in accordance with ASTM C627 to show compliance with codes 1 through 10.

B. Test kitchen and storage rooms.

--- E N D ---

**SECTION 09 91 00
PAINTING**

PART 1 - GENERAL

1.1 DESCRIPTION:

A. Work of this Section includes all labor, materials, equipment, and services necessary to complete the painting and finishing as shown on the construction documents and/or specified herein, including, but not limited to, the following:

1. Prime coats which may be applied in shop under other sections.
2. Prime painting unprimed surfaces to be painted under this Section.
3. Painting items furnished with a prime coat of paint, including touching up of or repairing of abraded, damaged or rusted prime coats applied by others.
4. Painting ferrous metal (except stainless steel) exposed to view.
5. Painting galvanized ferrous metals exposed to view.
6. Painting interior concrete block exposed to view.
7. Painting gypsum drywall exposed to view.
8. Painting of wood exposed to view, except items which are specified to be painted or finished under other Sections of these specifications. Back painting of all wood in contact with concrete, masonry or other moisture areas.
9. Painting pipes, pipe coverings, conduit, ducts, insulation, hangers, supports and other mechanical and electrical items and equipment exposed to view.
10. Painting surfaces above, behind or below grilles, gratings, diffusers, louvers lighting fixtures, and the like, which are exposed to view through these items.
11. Painting includes shellacs, stains, varnishes, coatings specified, and striping or markers and identity markings.
12. Incidental painting and touching up as required to produce proper finish for painted surfaces, including touching up of factory finished items.
13. Painting of any surface not specifically mentioned to be painted herein or on construction documents, but for which painting is obviously necessary to complete the job, or work which comes within the

intent of these specifications, is to be included as though specified.

1.2 RELATED WORK:

A. Activity Hazard Analysis: Section 01 35 26, SAFETY REQUIREMENTS.

B. Sustainable Design Requirements: Section 01 81 13, SUSTAINABLE DESIGN REQUIREMENTS.

C. Lead Paint Removal: Section 02 83 33.13, LEAD-BASED PAINT REMOVAL AND DISPOSAL.

D. Masonry Repairs: Section 04 05 13, MASONRY MORTARING Section 04 05 16, MASONRY GROUTING.

E. Shop prime painting of steel and ferrous metals: Division 05 - METALS, Division 08 - OPENINGS; Division 10 - SPECIALTIES; Division 11 - EQUIPMENT; Division 12 - FURNISHINGS; Division 13 – SPECIAL CONSTRUCTION; Division 14 – CONVEYING EQUIPMENT; Division 21 – FIRE SUPPRESSION; Division 22 - PLUMBING; Division 23 – HEATING; VENTILATION AND AIR-CONDITIONING; Division 26 - ELECTRICAL; Division 27 - COMMUNICATIONS; and Division 28 – ELECTRONIC SAFETY AND SECURITY sections.

F. Prefinished flush doors with transparent finishes: Section 08 14 00, WOOD DOORS.

G. Type of Finish, Color, and Gloss Level of Finish Coat: Section 09 06 00, SCHEDULE FOR FINISHES.

H. Glazed wall surfacing or tile like coatings: Section 09 96 59, HIGH-BUILD GLAZED COATINGS.

I. Multi-color Textured Wall Finish: Section 09 94 19, MULTICOLOR INTERIOR FINISHING.

J. Asphalt and concrete pavement marking: Section 32 17 23, PAVEMENT MARKINGS.

1.3 SUBMITTALS:

A. Submit in accordance with Section 01 33 23, SHOP DRAWINGS, PRODUCT DATA, AND SAMPLES.

B. Sustainable Design Submittals as described below:

1. Volatile organic compounds per volume as specified in PART 2 - PRODUCTS.

C. Painter qualifications.

D. Manufacturer's Literature and Data:

1. Before work is started, or sample panels are prepared, submit manufacturer's literature and technical data, the current Master Painters Institute (MPI) "Approved Product List" indicating brand label, product name and product code as of the date of contract award, will be used to determine compliance with the submittal requirements of this specification. The Contractor may choose to use subsequent MPI "Approved Product List", however, only one (1) list may be used for the entire contract and each coating system is to be from a single manufacturer. All coats on a particular substrate must be from a single manufacturer. No variation from the MPI "Approved Product List" where applicable is acceptable.

E. Sample Panels:

1. After painters' materials have been approved and before work is started submit sample panels showing each type of finish and color specified.

2. Panels to Show Color: Composition board, 100 x 250 mm (4 x 10 inch).

3. Panel to Show Transparent Finishes: Wood of same species and grain pattern as wood approved for use, 100 x 250 mm (4 x 10-inch face) minimum, and where both flat and edge grain will be exposed, 250 mm (10 inches) long by sufficient size, 50 x 50 mm (2 x 2 inch) minimum or actual wood member to show complete finish.

4. Attach labels to panel stating the following:

a. Federal Specification Number or manufacturers name and product number of paints used.

b. Specification code number specified in Section 09 06 00, SCHEDULE FOR FINISHES.

c. Product type and color.

d. Name of project.

5. Strips showing not less than 50 mm (2 inch) wide strips of undercoats and 100 mm (4 inch) wide strip of finish coat.

F. Sample of identity markers if used.

G. Manufacturers' Certificates indicating compliance with specified requirements:

1. Manufacturer's paint substituted for Federal Specification paints meets or exceeds performance of paint specified.

2. High temperature aluminum paint.

3. Epoxy coating.

4. Intumescent clear coating or fire retardant paint.

5. Plastic floor coating.

1.4 DELIVERY AND STORAGE:

A. Deliver materials to site in manufacturer's sealed container marked to show following:

1. Name of manufacturer.
2. Product type.
3. Batch number.
4. Instructions for use.
5. Safety precautions.

B. In addition to manufacturer's label, provide a label legibly printed as following:

1. Federal Specification Number, where applicable, and name of material.
2. Surface upon which material is to be applied.
3. Specify Coat Types: Prime; body; finish; etc.

C. Maintain space for storage, and handling of painting materials and equipment in a ventilated, neat and orderly condition to prevent spontaneous combustion from occurring or igniting adjacent items.

D. Store materials at site at least 24 hours before using, at a temperature between 7 and 30 degrees C (45 and 85 degrees F).

1.5 QUALITY ASSURANCE:

A. Qualification of Painters: Use only qualified journeyman painters for the mixing and application of paint on exposed surfaces. Submit evidence that key personnel have successfully performed surface preparation and application of coating on a minimum of three (3) similar projects within the past three (3) years.

B. Paint Coordination: Provide finish coats which are compatible with the prime paints used. Review other Sections of these specifications in which prime paints are to be provided to ensure compatibility of the total coatings system for the various substrates. Upon request from other subcontractors, furnish information on the characteristics of the finish materials proposed to be used, to ensure that compatible prime coats are used. Provide barrier coats over incompatible primers or remove and re-prime as required. Notify the Contracting Officer Representative (COR) in writing of any anticipated problems using the coating systems as specified with substrates primed by others.

1.6 MOCK-UP PANEL:

A. In addition to the samples specified herein to be submitted for approval, apply in the field, at their final location, each type and color of approved paint materials, applied 3.05 m (10 feet) wide, floor to ceiling of wall surfaces, before proceeding with the remainder of the work, for approval by the COR. Paint mock-ups to include one (1) door and frame assembly.

B. Finish and texture approved by COR will be used as a standard of quality and workmanship for remainder of work.

C. Repaint individual areas which are not approved, as determined by the COR, until approval is received.

1.7 REGULATORY REQUIREMENTS:

A. Paint materials are to conform to the restrictions of the local Environmental and Toxic Control jurisdiction.

1. Volatile Organic Compounds (VOC) Emissions Requirements: Field-applied paints and coatings that are inside the waterproofing system to not exceed limits of authorities having jurisdiction.

2. Lead-Based Paint:

a. Comply with Section 410 of the Lead-Based Paint Poisoning Prevention Act, as amended, and with implementing regulations promulgated by Secretary of Housing and Urban Development.

b. Regulations concerning prohibition against use of lead-based paint in federal and federally assisted construction, or rehabilitation of residential structures are set forth in Subpart F, Title 24, Code of Federal Regulations, Department of Housing and Urban Development.

c. Do not use coatings having a lead content over 0.06 percent by weight of non-volatile content.

d. For lead-paint removal, see Section 02 83 33.13, LEAD-BASED PAINT REMOVAL AND DISPOSAL.

3. Asbestos: Provide materials that do not contain asbestos.

4. Chromate, Cadmium, Mercury, and Silica: Provide materials that do not contain zinc-chromate, strontium-chromate, Cadmium, mercury or mercury compounds or free crystalline silica.

5. Human Carcinogens: Provide materials that do not contain any of the ACGIH-BKLT and ACGHI-DOC confirmed or suspected human carcinogens.

6. Use high performance acrylic paints in place of alkyd paints.

1.8 SAFETY AND HEALTH

A. Apply paint materials using safety methods and equipment in accordance with the following:

1. Comply with applicable Federal, State, and local laws and regulations, and with the ACCIDENT PREVENTION PLAN, including the Activity Hazard Analysis (AHA) as specified in Section 01 35 26, SAFETY REQUIREMENTS. The AHA is to include analyses of the potential impact of painting operations on painting personnel and on others involved in and adjacent to the work zone.

B. Safety Methods Used During Paint Application: Comply with the requirements of SSPC PA Guide 10.

C. Toxic Materials: To protect personnel from overexposure to toxic materials, conform to the most stringent guidance of:

1. The applicable manufacturer's Material Safety Data Sheets (MSDS) or local regulation.
2. 29 CFR 1910.1000.
3. ACHIH-BKLT and ACGIH-DOC, threshold limit values.

1.9 APPLICABLE PUBLICATIONS:

A. Publications listed below form a part of this specification to the extent referenced. Publications are referenced in the text by basic designation only.

B. American Conference of Governmental Industrial Hygienists (ACGIH):

ACGIH TLV-BKLT-2012.....Threshold Limit Values (TLV) for Chemical Substances and Physical Agents and Biological Exposure Indices (BEIs)

ACGIH TLV-DOC-2012.....Documentation of Threshold Limit Values and Biological Exposure Indices, (Seventh Edition)

C. ASME International (ASME):

A13.1-07(R2013).....Scheme for the Identification of Piping Systems

D. Code of Federal Regulation (CFR):

40 CFR 59.....Determination of Volatile Matter Content, Water Content, Density Volume Solids, and Weight Solids of Surface Coating

E. Commercial Item Description (CID):

A-A-1272A.....Plaster Gypsum (Spackling Compound)

F. Federal Specifications (Fed Spec):

TT-P-1411A.....Paint, Copolymer-Resin, Cementitious (For
Waterproofing Concrete and Masonry Walls) (CEP)

G. Master Painters Institute (MPI):

- 1.....Aluminum Paint
- 4.....Interior/ Exterior Latex Block Filler
- 5.....Exterior Alkyd Wood Primer
- 7.....Exterior Oil Wood Primer
- 8.....Exterior Alkyd, Flat MPI Gloss Level 1
- 9.....Exterior Alkyd Enamel MPI Gloss Level 6
- 10.....Exterior Latex, Flat
- 11.....Exterior Latex, Semi-Gloss
- 18.....Organic Zinc Rich Primer
- 22.....Aluminum Paint, High Heat (up to 590% - 1100F)
- 27.....Exterior / Interior Alkyd Floor Enamel, Gloss
- 31.....Polyurethane, Moisture Cured, Clear Gloss
- 36.....Knot Sealer
- 43.....Interior Satin Latex, MPI Gloss Level 4
- 44.....Interior Low Sheen Latex, MPI Gloss Level 2
- 45.....Interior Primer Sealer
- 46.....Interior Enamel Undercoat
- 47.....Interior Alkyd, Semi-Gloss, MPI Gloss Level 5

- 48.....Interior Alkyd, Gloss, MPI Gloss Level 6
- 50.....Interior Latex Primer Sealer
- 51.....Interior Alkyd, Eggshell, MPI Gloss Level 3
- 52.....Interior Latex, MPI Gloss Level 3
- 53.....Interior Latex, Flat, MPI Gloss Level 1
- 54.....Interior Latex, Semi-Gloss, MPI Gloss Level 5
- 59.....Interior/Exterior Alkyd Porch & Floor Enamel, Low Gloss
- 60.....Interior/Exterior Latex Porch & Floor Paint, Low Gloss
- 66.....Interior Alkyd Fire Retardant, Clear Top-Coat (ULC Approved)
- 67.....Interior Latex Fire Retardant, Top-Coat (ULC Approved)
- 68.....Interior/ Exterior Latex Porch & Floor Paint, Gloss
- 71.....Polyurethane, Moisture Cured, Clear, Flat
- 77.....Epoxy Cold Cured, Gloss
- 79.....Marine Alkyd Metal Primer
- 90.....Interior Wood Stain, Semi-Transparent
- 91.....Wood Filler Paste
- 94.....Exterior Alkyd, Semi-Gloss
- 95.....Fast Drying Metal Primer
- 98.....High Build Epoxy Coating
- 101.....Epoxy Anti-Corrosive Metal Primer
- 108.....High Build Epoxy Coating, Low Gloss

- 114.....Interior Latex, Gloss
- 119.....Exterior Latex, High Gloss (acrylic)
- 134.....Galvanized Water Based Primer
- 135.....Non-Cementitious Galvanized Primer
- 138.....Interior High Performance Latex, MPI Gloss Level 2
- 139.....Interior High Performance Latex, MPI Gloss Level 3
- 140.....Interior High Performance Latex, MPI Gloss Level 4
- 141.....Interior High Performance Latex (SG) MPI Gloss Level 5
- 163.....Exterior Water Based Semi-Gloss Light Industrial Coating, MPI Gloss Level 5

G. Society for Protective Coatings (SSPC):

- SSPC SP 1-82(R2004).....Solvent Cleaning
- SSPC SP 2-82(R2004).....Hand Tool Cleaning
- SSPC SP 3-28(R2004).....Power Tool Cleaning
- SSPC SP 10/NACE No.2....Near-White Blast Cleaning
- SSPC PA Guide 10.....Guide to Safety and Health Requirements

H. Maple Flooring Manufacturer’s Association (MFMA):

- I. U.S. National Archives and Records Administration (NARA):
29 CFR 1910.1000.....Air Contaminants

J. Underwriter’s Laboratory (UL)

PART 2 - PRODUCTS

2.1 MATERIALS:

- A. Conform to the coating specifications and standards referenced in PART 3. Submit manufacturer’s technical data sheets for specified coatings and solvents.

2.2 PAINT PROPERTIES:

A. Use ready-mixed (including colors), except two component epoxies, polyurethanes, polyesters, paints having metallic powders packaged separately and paints requiring specified additives.

B. Where no requirements are given in the referenced specifications for primers, use primers with pigment and vehicle, compatible with substrate and finish coats specified.

C. Provide undercoat paint produced by the same manufacturer as the finish coats. Use only thinners approved by the paint manufacturer, and use only to recommended limits.

D. VOC Content: For field applications that are inside the weatherproofing system, paints and coating to comply with VOC content limits of authorities having jurisdiction and the following VOC content limits:

1. Flat Paints and Coatings: 50 g/L.
2. Non-flat Paints and Coatings: 150 g/L.
3. Dry-Fog Coatings: 400 g/L.
4. Primers, Sealers, and Undercoaters: 200 g/L.
5. Anticorrosive and Antirust Paints applied to Ferrous Metals: 250 g/L.
6. Zinc-Rich Industrial Maintenance Primers: 340 g/L.
7. Pretreatment Wash Primers: 420 g/L.
8. Shellacs, Clear: 730 g/L.
9. Shellacs, Pigmented: 550 g/L.

E. VOC test method for paints and coatings is to be in accordance with 40 CFR 59 (EPA Method 24). Part 60, Appendix A with the exempt compounds' content determined by Method 303 (Determination of Exempt Compounds) in the South Coast Air Quality Management District's (SCAQMD) "Laboratory Methods of Analysis for Enforcement Samples" manual.

2.3 PLASTIC TAPE: NOT USED

- 1.4 Biobased Content

A. Paint products shall comply with following bio-based standards for biobased materials:

Material Type	Percent by Weight
Interior Paint	20 percent biobased material
Interior Paint – Iol Based and Solvent Alkyd	67 percent biobased material
Exterior Paint	20 percent biobased material
Wood & Concrete Stain	39 percent biobased content
Polyurethane Coatings	25 percent biobased content
Water Tank Coatings	59 percent biobased content
Wood & Concrete Sealer-Membrane Concrete Sealers	11 percent biobased content
Wood & Concrete Sealer- Penetrating Liquid	79 percent biobased content

B. The minimum-content standards are based on the weight (not the volume) of the material.

PART 3 – EXECUTION

3.1 JOB CONDITIONS:

A. Safety: Observe required safety regulations and manufacturer's warning and instructions for storage, handling and application of painting materials.

1. Take necessary precautions to protect personnel and property from hazards due to falls, injuries, toxic fumes, fire, explosion, or other harm.
2. Deposit soiled cleaning rags and waste materials in metal containers approved for that purpose. Dispose of such items off the site at end of each day's work.

B. Atmospheric and Surface Conditions:

1. Do not apply coating when air or substrate conditions are:
 - a. Less than 3 degrees C (5 degrees F) above dew point.
 - b. Below 10 degrees C (50 degrees F) or over 35 degrees C (95 degrees F), unless specifically pre-approved by the COR and the product manufacturer. Under no circumstances are application conditions to exceed manufacturer recommendations.
 - c. When the relative humidity exceeds 85 percent; or to damp or wet surfaces; unless otherwise permitted by the paint manufacturer's printed instructions.
2. Maintain interior temperatures until paint dries hard.
3. Do no exterior painting when it is windy and dusty.
4. Do not paint in direct sunlight or on surfaces that the sun will warm.

5. Apply only on clean, dry and frost free surfaces except as follows:

- a. Apply water thinned acrylic and cementitious paints to damp (not wet) surfaces only when allowed by manufacturer's printed instructions.
- b. Concrete and masonry when permitted by manufacturer's recommendations, dampen surfaces to which water thinned acrylic and cementitious paints are applied with a fine mist of water on hot dry days to prevent excessive suction and to cool surface.

6. Varnishing:

- a. Apply in clean areas and in still air.
- b. Before varnishing vacuum and dust area.
- c. Immediately before varnishing wipe down surfaces with a tack rag.

3.2 INSPECTION:

A. Examine the areas and conditions where painting and finishing are to be applied and correct any conditions detrimental to the proper and timely completion of the work. Do not proceed with the work until unsatisfactory conditions are corrected to permit proper installation of the work.

3.3 GENERAL WORKMANSHIP REQUIREMENTS:

A. Application may be by brush or roller. Spray application only upon acceptance from the COR in writing.

B. Furnish to the COR a painting schedule indicating when the respective coats of paint for the various areas and surfaces will be completed. This schedule is to be kept current as the job progresses.

C. Protect work at all times. Protect all adjacent work and materials by suitable covering or other method during progress of work. Upon completion of the work, remove all paint and varnish spots from floors, glass and other surfaces. Remove from the premises all rubbish and accumulated materials of whatever nature not caused by others and leave work in a clean condition.

D. Remove and protect hardware, accessories, device plates, lighting fixtures, and factory finished work, and similar items, or provide in place protection. Upon completion of each space, carefully replace all removed items by workmen skilled in the trades involved.

E. When indicated to be painted, remove electrical panel box covers and doors before painting walls. Paint separately and re-install after all paint is dry.

F. Materials are to be applied under adequate illumination, evenly spread and

flowed on smoothly to avoid runs, sags, holidays, brush marks, air bubbles and excessive roller stipple.

G. Apply materials with a coverage to hide substrate completely. When color, stain, dirt or undercoats show through final coat of paint, the surface is to be covered by additional coats until the paint film is of uniform finish, color, appearance and coverage, at no additional cost to the Government.

H. All coats are to be dry to manufacturer's recommendations before applying succeeding coats.

I. All suction spots or "hot spots" in plaster after the application of the first coat are to be touched up before applying the second coat.

J. Do not apply paint behind frameless mirrors that use mastic for adhering to wall surface.

3.4 SURFACE PREPARATION:

A. General:

1. The Contractor shall be held wholly responsible for the finished appearance and satisfactory completion of painting work. Properly prepare all surfaces to receive paint, which includes cleaning, sanding, and touching-up of all prime coats applied under other Sections of the work. Broom clean all spaces before painting is started. All surfaces to be painted or finished are to be completely dry, clean and smooth.

2. See other sections of specifications for specified surface conditions and prime coat.

3. Perform preparation and cleaning procedures in strict accordance with the paint manufacturer's instructions and as herein specified, for each particular substrate condition.

4. Clean surfaces before applying paint or surface treatments with materials and methods compatible with substrate and specified finish. Remove any residue remaining from cleaning agents used. Do not use solvents, acid, or steam on concrete and masonry. Schedule the cleaning and painting so that dust and other contaminants from the cleaning process will not fall in wet, newly painted surfaces.

5. Maximum Moisture Content of Substrates: When measured with an electronic moisture meter as follows:

a. Concrete: 12 percent.

b. Fiber-Cement Board: 12 percent.

c. Masonry (Clay and CMU's): 12 percent.

d. Wood: 15 percent.

e. Gypsum Board: 12 percent.

f. Plaster: 12 percent.

B. Wood:

1. Sand to a smooth even surface and then dust off.

2. Sand surfaces showing raised grain smooth between each coat.

3. Wipe surface with a tack rag prior to applying finish.

4. Surface painted with an opaque finish:

a. Coat knots, sap and pitch streaks with MPI 36 (Knot Sealer) before applying paint.

b. Apply two coats of MPI 36 (Knot Sealer) over large knots.

5. After application of prime or first coat of stain, fill cracks, nail and screw holes, depressions and similar defects with wood filler paste. Sand the surface to make smooth and finish flush with adjacent surface.

6. Before applying finish coat, reapply wood filler paste if required, and sand surface to remove surface blemishes. Finish flush with adjacent surfaces.

7. Fill open grained wood such as oak, walnut, ash and mahogany with MPI 91 (Wood Filler Paste), colored to match wood color.

a. Thin filler in accordance with manufacturer's instructions for application.

b. Remove excess filler, wipe as clean as possible, dry, and sand as specified.

C. Ferrous Metals:

1. Remove oil, grease, soil, drawing and cutting compounds, flux and other detrimental foreign matter in accordance with SSPC-SP 1 (Solvent Cleaning).

2. Remove loose mill scale, rust, and paint, by hand or power tool cleaning, as defined in SSPC-SP 2 (Hand Tool Cleaning) and SSPC-SP 3 (Power Tool Cleaning). Where high temperature aluminum paint is used, prepare surface in accordance with paint manufacturer's instructions.

3. Fill dents, holes and similar voids and depressions in flat exposed surfaces of hollow steel doors and frames, access panels, roll-up steel doors and similar items specified to have semi-gloss or gloss finish with TT-F-322D (Filler, Two-Component Type, For Dents, Small Holes and Blow-Holes). Finish flush with adjacent surfaces.

a. Fill flat head countersunk screws used for permanent anchors.

b. Do not fill screws of item intended for removal such as glazing beads.

4. Spot prime abraded and damaged areas in shop prime coat which expose bare metal with same type of paint used for prime coat. Feather edge of spot prime to produce smooth finish coat.

5. Spot prime abraded and damaged areas which expose bare metal of factory finished items with paint as recommended by manufacturer of item.

D. Surfaces Specified Painted:

1. Clean surfaces to remove grease, oil and other deterrents to paint adhesion in accordance with SSPC-SP 1 (Solvent Cleaning).

2. Spot coat abraded and damaged areas of zinc-coating which expose base metal on hot-dip zinc-coated items with MPI 18 (Organic Zinc Rich Coating). Prime or spot prime with MPI 134 (Waterborne Galvanized Primer) or MPI 135 (Non-Cementitious Galvanized Primer) depending on finish coat compatibility.

E. Masonry, Concrete, Cement Board, Cement Plaster and Stucco:

1. Clean and remove dust, dirt, oil, grease efflorescence, form release agents, laitance, and other deterrents to paint adhesion.

2. Use emulsion type cleaning agents to remove oil, grease, paint and similar products. Use of solvents, acid, or steam is not permitted.

3. Remove loose mortar in masonry work.

4. Replace mortar and fill open joints, holes, cracks and depressions with new mortar specified in Section 04 05 13, MASONRY MORTARING Section 04 05 16, MASONRY GROUTING. Do not fill weep holes. Finish to match adjacent surfaces.

5. Neutralize Concrete floors to be painted by washing with a solution of 1.4 Kg (3 pounds) of zinc sulfate crystals to 3.8 L (1 gallon) of water, allow to dry three (3) days and brush thoroughly free of crystals.

6. Repair broken and spalled concrete edges with concrete patching compound to match adjacent surfaces as specified in Division 03, CONCRETE Sections. Remove projections to level of adjacent surface by grinding or similar methods.

F. Gypsum Plaster and Gypsum Board:

1. Remove efflorescence, loose and chalking plaster or finishing materials.

2. Remove dust, dirt, and other deterrents to paint adhesion.

3. Fill holes, cracks, and other depressions with CID-A-A-1272A finished flush with adjacent surface, with texture to match texture of adjacent surface. Patch holes over 25 mm (1-inch) in diameter as specified in Section for plaster or gypsum board.

3.5 PAINT PREPARATION:

A. Thoroughly mix painting materials to ensure uniformity of color, complete dispersion of pigment and uniform composition.

B. Do not thin unless necessary for application and when finish paint is used for body and prime coats. Use materials and quantities for thinning as specified in manufacturer's printed instructions.

C. Remove paint skins, then strain paint through commercial paint strainer to remove lumps and other particles.

D. Mix two (2) component and two (2) part paint and those requiring additives in such a manner, as to uniformly blend as specified in manufacturer's printed instructions unless specified otherwise.

E. For tinting required to produce exact shades specified, use color pigment recommended by the paint manufacturer.

3.6 APPLICATION:

A. Start of surface preparation or painting will be construed as acceptance of the surface, as satisfactory for the application of materials.

B. Unless otherwise specified, apply paint in three (3) coats; prime, body, and finish. When two (2) coats applied to prime coat are the same, first coat applied over primer is body coat and second coat is finish coat.

C. Apply each coat evenly and cover substrate completely.

D. Allow not less than 48 hours between application of succeeding coats, except as allowed by manufacturer's printed instructions, and approved by COR.

E. Apply by brush or roller. Spray application for new or existing occupied spaces only upon approval by acceptance from COR in writing.

1. Apply painting materials specifically required by manufacturer to be applied by spraying.

2. In new construction and in existing occupied spaces, where paint is applied by spray, mask or enclose with polyethylene, or similar air tight material with edges and seams continuously sealed including items specified in "Building and Structural Work Field Painting"; "Work not Painted"; motors, controls, telephone, and electrical equipment, fronts of sterilizes and other recessed equipment and similar prefinished items.

F. Do not paint in closed position operable items such as access doors and panels, window sashes, overhead doors, and similar items except overhead roll-up doors and shutters.

3.7 PRIME PAINTING:

A. After surface preparation, prime surfaces before application of body and finish coats, except as otherwise specified.

B. Spot prime and apply body coat to damaged and abraded painted surfaces before applying succeeding coats.

C. Additional field applied prime coats over shop or factory applied prime coats are not required except for exterior exposed steel apply an additional prime coat.

D. Prime rabbets for stop and face glazing of wood, and for face glazing of steel.

E. Wood and Wood Particleboard:

1. Use same kind of primer specified for exposed face surface.

a. Exterior wood: MPI 7 (Exterior Oil Wood Primer) for new construction and MPI 5 (Exterior Alkyd Wood Primer) for repainting bare wood primer except where MPI 90 (Interior Wood Stain, Semi-Transparent) is scheduled.

b. Interior wood except for transparent finish: MPI 45 (Interior Primer Sealer) or MPI 46 (Interior Enamel Undercoat), thinned if recommended by manufacturer.

c. Transparent finishes as specified under “Transparent Finishes on Wood Except Floors Article” and “Finish for Wood Floors Article”.

2. Apply two (2) coats of primer MPI 7 (Exterior Oil Wood Primer) or MPI 5 (Exterior Alkyd Wood Primer) or sealer MPI 45 (Interior Primer Sealer) or MPI 46 (Interior Enamel Undercoat) to surfaces of wood doors, including top and bottom edges, which are cut for fitting or for other reason.

3. Apply one (1) coat of primer MPI 7 (Exterior Oil Wood Primer) or MPI 5 (Exterior Alkyd Wood Primer) or sealer MPI 45 (Interior Primer Sealer) or MPI 46 (Interior Enamel Undercoat) as soon as delivered to site to surfaces of unfinished woodwork, except concealed surfaces of shop fabricated or assembled millwork and surfaces specified to have varnish, stain or natural finish.

4. Back prime and seal ends of exterior woodwork, and edges of exterior plywood specified to be finished.

5. Apply MPI 67 (Interior Latex Fire Retardant, Top-Coat (UL Approved) to wood for fire retardant finish.

F. Metals except boilers, incinerator stacks, and engine exhaust pipes:

1. Steel and iron: MPI 95 (Fast Drying Metal Primer). Use MPI 101 (Cold Curing Epoxy Primer) where finish is specified.
2. Zinc-coated steel and iron: MPI 134 (Waterborne Galvanized Primer)
3. Aluminum scheduled to be painted: MPI 95 (Fast Drying Metal Primer).
4. Terne Metal: MPI 79 (Marine Alkyd Metal Primer)
5. Copper and copper alloys scheduled to be painted: MPI 95 (Fast Drying Metal Primer).
6. Machinery not factory finished: MPI 9 (Exterior Alkyd Enamel).
7. Asphalt coated metal: MPI 1 (Aluminum Paint).
8. Metal over 94 degrees C (201 degrees F), Boilers, Incinerator Stacks, and Engine Exhaust Pipes: MPI 22 (High Heat Resistant Coating).

G. Gypsum Board and Hardboard:

1. MPI 53 (Interior Latex, Flat), MPI Gloss Level 1.
2. Primer: MPI 50 (Interior Latex Primer Sealer) except use MPI 45 (Interior Primer Sealer) in shower and bathrooms.
3. Surfaces scheduled to receive vinyl coated fabric wall covering:
Use MPI 45 (Interior Primer Sealer) MPI 46 (Interior Enamel Undercoat).
4. NOT USED

H. Gypsum Plaster and Veneer Plaster: NOT USED

I. Concrete Masonry Units except glazed or integrally colored and decorative units:

1. MPI 4 (Block Filler) on interior surfaces.
2. Prime exterior surface as specified for exterior finishes.

J. Cement Plaster or stucco Concrete Masonry, Brick Masonry and Cement board Interior Surfaces of Ceilings and Walls:

1. MPI 53 (Interior Latex, Flat, MPI Gloss Level 1) MPI 52 (Interior Latex, MPI Gloss Level 3) MPI 54 (Interior Latex, Semi-Gloss, MPI Gloss Level 5) MPI 114 (Interior Latex, Gloss) except use two (2) coats where substrate has aged less than six (6) months.
2. Use MPI 138 (Interior High Performance Latex, MPI Gloss Level 2)

MPI 139 (Interior High Performance Latex, MPI Gloss level 3)

MPI 140 (Interior High Performance latex, MPI Gloss Level 4)

MPI 141 (Interior High Performance Latex, MPI Gloss Level 5)

MPI 114 (Interior Latex, Gloss) TT-P-1411A (Paint, Copolymer Resin, Cementitious) Type II
MPI 77 (Epoxy Cold Cured, Gloss MPI 98 (High Build Epoxy Coating) MPI 108 (High Build Epoxy Marine Coating) as scheduled.

K. Concrete Floors: MPI 60 (Interior/ Exterior Latex Porch & Floor Paint, Low Gloss). MPI 99 (Water-based Acrylic Curing and Sealing Compound).

3.8 EXTERIOR FINISHES:

A. Apply following finish coats where specified in Section 09 06 00, SCHEDULE FOR FINISHES.

B. Wood: NOT USED

C. Steel and Ferrous Metal, Including Tern:

1. Two (2) coats of MPI 8 (Exterior Alkyd, Flat) on exposed surfaces, except on surfaces over 94 degrees C (201 degrees F).

2. One (1) coat of MPI 22 (High Heat Resistant Coating) on surfaces over 94 degrees K (290 degrees F).

D. Machinery without factory finish except for primer: One (1) coat MPI 8 (Exterior Alkyd, Flat).

E. Concrete Masonry Units Brick Cement Plaster Concrete:

1. General:

a. Where specified in Section 09 06 00, SCHEDULE FOR FINISHES or shown.

b. Mix as specified in manufacturer's printed directions.

c. Do not mix more paint than can be used within four (4) hours after mixing. Discard paint that has started to set.

d. Dampen warm surfaces above 24 degrees C (75 degrees F) with fine mist of water before application of paint. Do not leave free water on surface.

e. Cure paint with a fine mist of water as specified in manufacturer's printed instructions.

2. Use two (2) coats of TT-P-1411 (Paint, Co-polymer-Resin, Cementitious), unless specified otherwise.

3.9 INTERIOR FINISHES:

A. Apply following finish coats over prime coats in spaces or on surfaces specified in Section 09 06 00, SCHEDULE FOR FINISHES.

B. Metal Work:

1. Apply to exposed surfaces.

2. Omit body and finish coats on surfaces concealed after installation except electrical conduit containing conductors over 600 volts.

3. Ferrous Metal, Galvanized Metal, and Other Metals Scheduled:

a. Apply two (2) coats of MPI 47 (Interior Alkyd, Semi-Gloss) unless specified otherwise.

b. Two (2) coats of MPI 48 (Interior Alkyd Gloss).

c. One (1) coat of MPI 46 (Interior Enamel Undercoat) plus one coat of MPI 47 (Interior Alkyd, Semi-Gloss) on exposed interior surfaces of alkyd-amine enamel prime finished windows.

d. NOT USED

e. Machinery: One (1) coat MPI 9 (Exterior Alkyd Enamel).

f. Asphalt Coated Metal: One (1) coat MPI 1 (Aluminum Paint).

g. NOT USED

C. Gypsum Board:

1. NOT USED

2. Two (2) coats of MPI 138 (Interior High Performance Latex, MPI Gloss Level 2).

3. NOT USED

4. NOT USED

D. Plaster: NOT USED

1. NOT USED

2. NOT USED

3. NOT USED

4. NOT USED

E. Masonry and Concrete Walls:

1. Over MPI 4 (Interior/Exterior Latex Block Filler) on CMU surfaces.

2. NOT USED

3. NOT USED

F. Wood: NOT USED

1. Sanding: NOT USED

a. NOT USED

b. NOT USED

c. NOT USED

2. Sealers: NOT USED

a. NOT USED

b. NOT USED

c. NOT USED

d. NOT USED

3. Paint Finish: NOT USED

a. NOT USED

b. NOT USED

c. NOT USED

d. NOT USED

4. Transparent Finishes on Wood Except Floors. NOT USED

5. Finish for Wood Floors: NOT USED

G. Cement Board: NOT USED

H. Concrete Floors: One (1) coat of MPI 68 (Interior/ Exterior Latex Porch & Floor Paint, Gloss).

I. Miscellaneous:

1. Apply where specified in Section 09 06 00, SCHEDULE FOR FINISHES.

2. MPI 1 (Aluminum Paint): Two (2) coats of aluminum paint.

3. Existing acoustical units scheduled to be repainted except acoustical units with a vinyl finish:

- a. Clean units free of dust, dirt, grease, and other deterrents to paint adhesion.
- b. Mineral fiber units: One (1) coat of MPI 53 (Interior Latex, Flat, MPI Gloss Level 1)
- c. Units of organic fiber or other material not having a class A rating: One (1) coat of MPI 66 (Interior Alkyd Fire Retardant, Clear Top-Coat (UL Approved))

4. NOT USED

3.10 REFINISHING EXISTING PAINTED SURFACES: NOT USED

3.11 PAINT COLOR:

A. Color and gloss of finish coats is specified in Section 09 06 00, SCHEDULE FOR FINISHES.

B. For additional requirements regarding color see Articles, "REFINISHING EXISTING PAINTED SURFACE" and "MECHANICAL AND ELECTRICAL FIELD PAINTING SCHEDULE".

C. Coat Colors:

1. Color of priming coat: Lighter than body coat.
2. Color of body coat: Lighter than finish coat.
3. Color prime and body coats to not show through the finish coat and to mask surface imperfections or contrasts.

D. Painting, Caulking, Closures, and Fillers Adjacent to Casework:

1. Paint to match color of casework where casework has a paint finish.
2. Paint to match color of wall where casework is stainless steel, plastic laminate, or varnished wood.

3.12 MECHANICAL AND ELECTRICAL WORK FIELD PAINTING SCHEDULE:

A. Field painting of mechanical and electrical consists of cleaning, touching-up abraded shop prime coats, and applying prime, body and finish coats to materials and equipment if not factory finished in space scheduled to be finished.

B. In spaces not scheduled to be finish painted in Section 09 06 00, SCHEDULE FOR FINISHES paint as specified below.

C. Paint various systems specified in Division 02 – EXISTING CONDITIONS, Division 21 – FIRE SUPPRESSION, Division 22 - PLUMBING, Division 23 –HEATING, VENTILATION AND AIR-CONDITIONING, Division 26 - ELECTRICAL, Division 27 - COMMUNICATIONS, and Division 28 – ELECTRONIC SAFETY AND SECURITY.

D. Paint after tests have been completed.

E. Omit prime coat from factory prime-coated items.

F. Finish painting of mechanical and electrical equipment is not required when located in interstitial spaces, above suspended ceilings, in concealed areas such as pipe and electric closets, pipe basements, pipe tunnels, trenches, attics, roof spaces, shafts and furred spaces except on electrical conduit containing feeders 600 volts or more.

G. Omit field painting of items specified in “BUILDING AND STRUCTURAL WORK FIELD PAINTING”; “Building and Structural Work Not Painted”.

H. Color:

1. Paint items having no color specified in Section 09 06 00, SCHEDULE FOR FINISHES to match surrounding surfaces.

2. Paint colors as specified in Section 09 06 00, SCHEDULE FOR FINISHES except for following:

a. White: Exterior unfinished surfaces of enameled plumbing fixtures. Insulation coverings on breeching and uptake inside boiler house, drums and drum-heads, oil heaters, condensate tanks and condensate piping.

b. Gray: Heating, ventilating, air conditioning and refrigeration equipment (except as required to match surrounding surfaces), and water and sewage treatment equipment and sewage ejection equipment.

c. Aluminum Color: Ferrous metal on outside of boilers and in connection with boiler settings including supporting doors and door frames and fuel oil burning equipment, and steam generation system (bare piping, fittings, hangers, supports, valves, traps and miscellaneous iron work in contact with pipe).

d. Federal Safety Red: Exposed fire protection piping hydrants, post indicators, electrical conducts containing fire alarm control wiring, and fire alarm equipment.

e. Federal Safety Orange: Entire lengths of electrical conduits containing feeders 600 volts or more.

f. Color to match brickwork sheet metal covering on breeching outside

of exterior wall of boiler house.

I. Apply paint systems on properly prepared and primed surface as follows:

1. Exterior Locations:

a. Apply two (2) coats of MPI 8 (Exterior Alkyd, Flat) to the following ferrous metal items:

Vent and exhaust pipes with temperatures under 94 degrees C (201 degrees F), roof drains, fire hydrants, post indicators, yard hydrants, exposed piping and similar items.

b. NOT USED

c. NOT USED

2. Interior Locations:

a. Apply two (2) coats of MPI 47 (Interior Alkyd, Semi-Gloss) to following items:

1) Metal under 94 degrees C (201 degrees F) of items such as bare piping, fittings, hangers and supports.

2) Equipment and systems such as hinged covers and frames for control cabinets and boxes, cast-iron radiators, electric conduits and panel boards.

3) Heating, ventilating, air conditioning, plumbing equipment, and machinery having shop prime coat and not factory finished.

b. NOT USED

c. NOT USED

d. NOT USED

e. Paint electrical conduits containing cables rated 600 volts or more using two (2) coats of MPI 9 (Exterior Alkyd Enamel) in the Federal Safety Orange color in exposed and concealed spaces full length of conduit.

3. Other exposed locations:

a. Metal surfaces, except aluminum, rails, and ladders: Two (2) coats of MPI 1 (Aluminum Paint).

b. Cloth jackets of insulation of ducts and pipes in connection with plumbing, air conditioning, ventilating refrigeration and heating systems: One (1) coat of MPI 50 (Interior Latex Primer Sealer) and one (1) coat of MPI 10 (Exterior Latex, Flat).

3.13 BUILDING AND STRUCTURAL WORK FIELD PAINTING:

A. Painting and finishing of interior and exterior work except as specified here-in-after.

1. Painting and finishing of new and existing work including colors and gloss of finish selected is specified in Finish Schedule, Section 09 06 00, SCHEDULE FOR FINISHES.
2. Painting of disturbed, damaged and repaired or patched surfaces when entire space is not scheduled for complete repainting or refinishing.
3. Painting of ferrous metal and galvanized metal.
4. Painting of wood with fire retardant paint exposed in attics, when used as mechanical equipment space (except shingles).
5. Identity painting and safety painting.

B. Building and Structural Work not Painted:

1. Prefinished items:

- a. Casework, doors, elevator entrances and cabs, metal panels, wall covering, and similar items specified factory finished under other sections.
- b. Factory finished equipment and pre-engineered metal building components such as metal roof and wall panels.

2. Finished surfaces:

- a. Hardware except ferrous metal.
- b. Anodized aluminum, stainless steel, chromium plating, copper, and brass, except as otherwise specified.
- c. Signs, fixtures, and other similar items integrally finished.

3. Concealed surfaces:

- a. Inside dumbwaiter, elevator and duct shafts, interstitial spaces, pipe basements, crawl spaces, pipe tunnels, above ceilings, attics, except as otherwise specified.
- b. Inside walls or other spaces behind access doors or panels.
- c. Surfaces concealed behind permanently installed casework and equipment.

4. Moving and operating parts:

a. Shafts, chains, gears, mechanical and electrical operators, linkages, and sprinkler heads, and sensing devices.

b. Tracks for overhead or coiling doors, shutters, and grilles.

5. Labels:

a. Code required label, such as Underwriters Laboratories Inc., Intertek Testing Service or Factory Mutual Research Corporation.

b. Identification plates, instruction plates, performance rating, and nomenclature.

6. Galvanized metal: NOT USED

7. Metal safety treads and nosing's.

8. Gaskets.

9. Concrete curbs, gutters, pavements, retaining walls, exterior exposed foundations walls and interior walls in pipe basements.

10. Face brick.

11. Structural steel encased in concrete, masonry, or other enclosure.

12. Structural steel to receive sprayed-on fire proofing.

13. Ceilings, walls, columns in interstitial spaces.

14. Ceilings, walls, and columns in pipe basements.

15. Wood Shingles.

3.14 IDENTITY PAINTING SCHEDULE:

A. Identify designated service in new buildings or projects with extensive remodeling in accordance with ASME A13.1, unless specified otherwise, on exposed piping, piping above removable ceilings, piping in accessible pipe spaces, interstitial spaces, and piping behind access panels. For existing spaces where work is minor match existing.

1. Legend may be identified using Snap-On coil plastic markers or by paint stencil applications.

2. Apply legends adjacent to changes in direction, on branches, where pipes pass through walls or floors, adjacent to operating accessories such as valves, regulators, strainers and cleanouts a minimum of 12.2 M (40 feet) apart on straight runs of piping. Identification next to plumbing fixtures is not required.

3. Locate Legends clearly visible from operating position.

4. Use arrow to indicate direction of flow using black stencil paint.
5. Identify pipe contents with sufficient additional details such as temperature, pressure, and contents to identify possible hazard. Insert working pressure shown on construction documents where asterisk appears for High, Medium, and Low Pressure designations as follows:
 - a. High Pressure - 414 kPa (60 psig) and above.
 - b. Medium Pressure - 104 to 413 kPa (15 to 59 psig).
 - c. Low Pressure - 103 kPa (14 psig) and below.
 - d. Add Fuel oil grade numbers.
6. Legend name in full or in abbreviated form as follows:

PIPING	COLOR OF EXPOSED PIPING	COLOR OF BACKGROUND	COLOR OF LETTERS	LEGEND ABBREVIATIONS
Blow-off		Green	White	Blow-off
Boiler Feedwater		Green	White	Blr Feed
A/C Condenser Water Supply		Green	White	A/C Cond Wtr Sup
A/C Condenser Water Return		Green	White	A/C Cond Wtr Ret
Chilled Water Supply		Green	White	Ch. Wtr Sup
Chilled Water Return		Green	White	Ch. Wtr Ret
Shop Compressed Air		Blue	White	Shop Air
Air-Instrument Controls		Green	White	Air-Inst Cont
Drain Line		Green	White	Drain
Emergency Shower		Green	White	Emg Shower
High Pressure Steam		Green	White	H.P. _____*
High Pressure Condensate Return		Green	White	H.P. Ret _____*
Medium Pressure Steam		Green	White	M. P. Stm _____*

Medium Pressure Condensate Return	Green	White	M.P. Ret _____*
Low Pressure Steam	Green	White	L.P. Stm _____*
Low Pressure Condensate Return	Green	White	L.P. Ret _____*
High Temperature Water Supply	Green	White	H. Temp Wtr Sup
High Temperature Water Return	Green	White	H. Temp Wtr Ret
Hot Water Heating Supply	Green	White	H. W. Htg Sup
Hot Water Heating Return	Green	White	H. W. Htg Ret
Gravity Condensate Return	Green	White	Gravity Cond Ret
Pumped Condensate Return	Green	White	Pumped Cond Ret
Vacuum Condensate Return	Green	White	Vac Cond Ret
Fuel Oil - Grade	Brown	White	Fuel Oil-Grade
(Diesel Fuel included under Fuel Oil)			
Boiler Water Sampling	Green	White	Sample
Chemical Feed	Green	White	Chem Feed
Continuous Blow-Down	Green	White	Cont. B D
Pumped Condensate	Green	White	Pump Cond
Pump Recirculating	Green	White	Pump-Recirc.
Vent Line	Green	White	Vent
Alkali	Orange	Black	Alk
Bleach	Orange	Black	Bleach
Detergent	Yellow	Black	Det
Liquid Supply	Yellow	Black	Liq Sup
Reuse Water	Yellow	Black	Reuse Wtr

Cold Water (Domestic)	White	Green	White	C.W. Dom
Hot Water (Domestic)				
Supply	White	Yellow	Black	H.W. Dom
Return	White	Yellow	Black	H.W. Dom Ret
Tempered Water	White	Yellow	Black	Temp. Wtr
Ice Water Supply	White	Green	White	Ice Wtr
Return	White	Green	White	Ice Wtr Ret
Reagent Grade Water		Green	White	RG
Reverse Osmosis		Green	White	RO
Sanitary Waste		Green	White	San Waste
Sanitary Vent		Green	White	San Vent
Storm Drainage		Green	White	St Drain
Pump Drainage		Green	White	Pump Disch
Chemical Resistant Pipe Waste		Orange	Black	Acid Waste
Vent		Orange	Black	Acid Vent
Atmospheric Vent		Green	White	ATV
Silver Recovery		Green	White	Silver Rec
Oral Evacuation		Green	White	Oral Evac
Fuel Gas		Yellow	Black	Gas
Fire Protection Water				
Sprinkler	Red	Red	White	Auto Spr
Standpipe	Red	Red	White	Stand
Sprinkler	Red	Red	White	Drain
Hot Water Supply Dom. Solar Water		Green	White	H.W. Sup Dom/SW

Hot Water Return Dom.

Solar Water

Green

White

H.W. Ret Dom/SW

7. NOT USED

8. See Sections for methods of identification, legends, and abbreviations of the following:

a. Regular compressed air lines: Section 22 15 00, GENERAL SERVICE COMPRESSED-AIR SYSTEMS.

b. Dental compressed air lines: Section 22 61 13.74, DENTAL COMPRESSED AIR PIPING / Section 22 61 19.74, DENTAL COMPRESSED-AIR EQUIPMENT.

c. Laboratory gas and vacuum lines: Section 22 62 00, VACUUM SYSTEMS FOR LABORATORY AND HEALTHCARE FACILITIES / Section 22 63 00, GAS SYSTEMS FOR LABORATORY AND HEALTHCARE FACILITIES.

d. Oral evacuation lines: Section 22 62 19.74, DENTAL VACUUM AND EVACUATION EQUIPMENT.

e. Medical Gases and vacuum lines: Section 22 62 00, VACUUM SYSTEMS FOR LABORATORY AND HEALTHCARE FACILITIES / Section 22 63 00, GAS SYSTEMS FOR LABORATORY AND HEALTHCARE FACILITIES.

f. Conduits containing high voltage feeders over 600 volts:

Section 26 05 33, RACEWAY AND BOXES FOR ELECTRICAL SYSTEMS /

Section 27 05 33, RACEWAYS AND BOXES FOR COMMUNICATIONS SYSTEMS /

Section 28 05 33, RACEWAYS AND BOXES FOR ELECTRONIC SAFETY AND SECURITY.

B. Fire and Smoke Partitions:

1. Identify partitions above ceilings on both sides of partitions except within shafts in letters not less than 64 mm (2 1/2 inches) high.

2. Stenciled message: "SMOKE BARRIER" or, "FIRE BARRIER" as applicable.

3. Locate not more than 6096 mm (20 feet) on center on corridor sides of partitions, and with a least one (1) message per room on room side of partition.

4. Use semi-gloss paint of color that contrasts with color of substrate.

C. Identify columns in pipe basements and interstitial space:

1. Apply stenciled number and letters to correspond with grid numbering and lettering indicated on construction documents.

2. Paint numbers and letters 101 mm (4 inches) high, locate 45 mm (18 inches) below overhead structural slab.
3. Apply on four (4) sides of interior columns and on inside face only of exterior wall columns.
4. Color:
 - a. Use black on concrete columns.
 - b. Use white or contrasting color on steel columns.

3.15 PROTECTION CLEAN UP, AND TOUCH-UP:

A. Protect work from paint droppings and spattering by use of masking, drop cloths, removal of items or by other approved methods.

B. Upon completion, clean paint from hardware, glass and other surfaces and items not required to be painted of paint drops or smears.

C. Before final inspection, touch-up or refinished in a manner to produce solid even color and finish texture, free from defects in work which was damaged or discolored.

- - - E N D - - -

**SECTION 10 28 00
TOILET, BATH, AND LAUNDRY ACCESSORIES**

PART 1 - GENERAL

1.1 DESCRIPTION

A. SUMMARY:

1. Section Includes: Toilet and bath accessories at dressing rooms, toilets, baths, locker rooms and other areas indicated on drawings.

1.2 RELATED REQUIREMENTS

A. Color of finishes: Section 09 06 00, SCHEDULE FOR FINISHES.

B. Ceramic Toilet and Bath Accessories: Section 09 30 13, CERAMIC/PORCELAIN TILING.

C. Shower Curtain Break Away Pendant Chain Hooks: Section 10 21 23, CUBICLE CURTAIN TRACKS.

1.3 APPLICABLE PUBLICATIONS

A. Comply with references to extent specified in this section.

B. American Society of Mechanical Engineers (ASME):

1. B18.6.4-98(R2005) - Thread Forming and Thread Cutting Tapping Screws and Metallic Drive Screws inch.

C. American Welding Society (AWS):

1. D10.4-86(2000) - Welding Austenitic Chromium-Nickle Stainless Steel Piping and Tubing.

D. ASTM International (ASTM):

1. A269/A269M-15 - Seamless and Welded Austenitic Stainless Steel Tubing for General Service.

2. A312/A312M-15b - Seamless, Welded, and Heavily Cold Worked Austenitic Stainless Steel Pipes.

3. A653/A653M-15 - Steel Sheet, Zinc-Coated (Galvanized) or Zinc-Iron Alloy-Coated (Galvannealed) by the Hot-Dip Process.

4. A666-15 - Annealed or Cold-Worked Austenitic Stainless Steel Sheet, Strip, Plate, and Flat Bar.

5. A1011/A1011M-14 - Steel, Sheet and Strip, Hot-Rolled, Carbon, Structural, High-Strength Low-Alloy, High-Strength Low-Alloy with Improved Formability, and Ultra-High Strength.
6. B30-14a - Copper Alloys in Ingot Form.
7. B75/B75M-11 - Seamless Copper Tube.
8. B221-14 - Aluminum and Aluminum-Alloy Extruded Bars, Rods, Wire, Profiles, and Tubes.
9. B221M-13 - Aluminum and Aluminum-Alloy Extruded Bars, Rods, Wire, Profiles, and Tubes (Metric).
10. B456-11e1 - Electrodeposited Coatings of Copper Plus Nickel Plus Chromium and Nickel Plus Chromium.
11. B824-14 - General Requirements for Copper Alloy Castings.
12. C1036-11e1 - Flat Glass.
13. C1048-12e1 - Heat-Strengthened and Fully Tempered Flat Glass.
14. D635-14 - Rate of Burning and/or Extent and Time of Burning of Plastics in a Horizontal Position.
15. F446-85(2009) - Grab Bars and Accessories Installed in the Bathing Area.

E. Federal Specifications (Fed. Spec.):

1. A-A-3002 - Mirror, Glass.
2. FF-S-107C (2) - Screws, Tapping and Drive.
3. WW-P-541/8B (1) - Plumbing Fixtures (Accessories, Land Use).

F. National Architectural Metal Manufacturers(NAAMM):

1. AMP 500-06 - Metal Finishes Manual.

1.4 SUBMITTALS

A. Submittal Procedures: Section 01 33 23, SHOP DRAWINGS, PRODUCT DATA, AND SAMPLES.

B. Submittal Drawings:

1. Show size, configuration, and fabrication, anchorage and installation details.
2. Show mounting locations and heights.

C. Manufacturer's Literature and Data:

1. Description of each product.
2. Installation instructions.

D. Samples:

1. Full sized, complete assembly of each product specified.
2. Approved samples may be incorporated into project.

E. Certificates: Certify each product complies with specifications.

1. Soap dispensers: Certify soap dispensers are fabricated of material that will not be affected by liquid soap, aseptic detergents, and hexachlorophene solutions.

F. Qualifications: Substantiate qualifications comply with specifications.

1. Manufacturer with project experience list.

G. Operation and Maintenance Data:

1. Care instructions for each exposed finish product.

1.5 QUALITY ASSURANCE

A. Manufacturer Qualifications:

1. Regularly manufactures specified products.

1.6 DELIVERY

A. Deliver products in manufacturer's original sealed packaging.

B. Mark packaging, legibly. Indicate manufacturer's name or brand, type, color, production run number, and manufacture date.

C. Before installation, return or dispose of products within distorted, damaged, or opened packaging.

1.7 STORAGE AND HANDLING

A. Store products indoors in dry, weathertight facility.

B. Protect products from damage during handling and construction operations.

1.8 WARRANTY

A. Construction Warranty: FAR clause 52.246-21, "Warranty of

Construction."

PART 2 - PRODUCTS

2.1 MATERIALS

A. Aluminum: ASTM B221M (ASTM B221), Alloy 6063-T5 and Alloy 6463-T5.

B. Stainless Steel:

1. Plate or Sheet: ASTM A666, Type 304, 0.8 mm (0.031 inch) thick unless otherwise specified.

2. Tubing: ASTM A269/A269M, Grade TP 304, seamless or welded.

3. Pipe: ASTM A312/A312M; Grade TP 304.

C. Steel Sheet: ASTM A653/A653M, zinc-coated (galvanized) coating designation G90.

D. Chrome Plating (Service Condition Number SC 2): ASTM B456.

E. Brass Castings: ASTM B30.

F. Copper:

1. Tubing: ASTM B75/B75M.

2. Castings: ASTM B824.

G. Glass:

1. ASTM C1036, Type 1, Class 1, Quality q2, for mirrors, and for mirror doors in medicine cabinets.

2. ASTM C1036, Type 1 Class 1 Quality q3, for shelves in medicine cabinets.

3. ASTM C1048, Kind FT, Condition A, Type 1, Class 1 for glass and mirrors in Mental Health and Behavior Patient Care Units, and Security Examination Rooms.

2.2 PRODUCTS - GENERAL

A. Basis of Design: Section 09 06 00, SCHEDULE FOR FINISHES.

B. Provide each product from one manufacturer.

C. NOT USED

2.3 PAPER TOWEL DISPENSERS

- A. Surface mounted type with sloping top.
- B. Dispensing capacity for 300 sheets of any type of paper toweling.
- C. Fabricate of stainless steel.
- D. Provide door with continuous hinge at bottom, and spring tension cam lock or tumbler lock, keyed alike, at top, and refill sight slot in front.

2.4 NOT USED

2.5 WASTE RECEPTACLES

- A. Semi-recessed type, without doors. Fed. Spec. WW-P-541, Type II.
- B. Fabricate of stainless steel.
- C. Form face frame from one piece.
- D. Provide removable waste receptacle of approximately 45 L (12 gal.) capacity, fabricated of stainless steel.
- E. Waste receptacle key locked in place.

2.6 TOILET TISSUE DISPENSERS

- A. Double roll surface mounted type.
- B. Mount on continuous back plate.
- C. Removable spindle ABS plastic or chrome plated plastic.
- D. Wood rollers are not acceptable.

2.7 GRAB BARS

- A. Fed. Spec. WW-P-541/8B, Type IV, bars, surface mounted, Class 2, grab bars and complying with ASTM F446.
- B. Fabricate from stainless steel or nylon coated steel, use one type throughout project:
 - 1. Stainless steel: Grab bars, flanges, mounting plates, supports, screws, bolts, and exposed nuts and washers.

- 2. NOT USED

- C. Mounting:

1. Floor Mounted Grab Bars: Exposed type.
2. Swing Up Grab Bars: Exposed type.
3. Metal Toilet Partitions Mounted Grab Bars: Exposed type.
4. Other Types and Locations: Concealed type.

D. Bars:

1. Fabricate to 38 mm (1-1/2 inch) outside diameter.
 - a. Stainless steel, minimum 1.2 mm (0.05 inch) thick.
 - b. Nylon coated bars, minimum 1.5 mm (0.06 inch) thick.
2. Fabricate in one continuous piece with ends turned toward walls.
 - a. Swing up grab bars and grab bars continuous around three sides of showers may be fabricated in two sections, with concealed slip joint between.
3. Continuously weld intermediate support to grab bar.
4. Swing Up Bars: Manually operated; designed to prevent bar from falling when in raised position.

E. Flange for Concealed Mounting:

1. Minimum 2.65 mm (0.1 inch) thick, maximum 79 mm (3-1/8 inch) diameter by 13 mm (1/2 inch) deep, with minimum three set screws for securing flange to back plate.
2. Insert grab bar through center of flange and continuously weld perimeter of grab bar flush to back side of flange.
3. In lieu of providing flange for concealed mounting, and back plate as specified, grab bar may be welded to back plate covered with flange.

F. Flange for Exposed Mounting:

1. Minimum 5 mm (3/16 inch) thick, maximum 79 mm (3-1/8 inch) diameter.
2. Insert grab bar through flange and continuously weld perimeter of grab bar flush to backside of flange.
3. Where mounted on partitions, provide three equally spaced, countersunk holes, sized to accommodate 5 mm (3/16 inch) diameter bolts.

4. Where mounted on floor, provide four equally spaced holes, sized to accommodate 5 mm (3/8 inch) diameter bolts, maximum 5 mm (3/8 inch) from edge of flange.

G. Back Plates:

1. Minimum 2.65 mm (0.1046 inch) thick metal.
2. Fabricate in one piece, maximum 6 mm (1/4 inch) deep, with diameter sized to fit flange. Provide slotted holes to accommodate anchor bolts.
3. Provide spreaders, through bolt fasteners, and cap nuts, where grab bars are mounted on partitions.

H. NOT USED

2.8 SHOWER CURTAIN RODS

A. Stainless steel tubing, minimum 1.27 mm (0.050 inch) wall thickness, 32 mm (1-1/4 inch) outside diameter.

B. Flanges, stainless steel rings, 66 mm (2.6 inch) minimum outside diameter, with 2 holes opposite each other for 6 mm (1/4 inch) stainless steel fastening bolts. Provide set screw within curvature of each flange for securing rod.

C. Intermediate Support: For rods over 1800 mm (72 inches) long. Provide adjustable ceiling flanges with set screws, tubular hangers and stirrups.

D. NOT USED

2.9 CLOTHES HOOKS, ROBE OR COAT

A. Fabricate hook units from chromium plated brass with satin finish, or stainless steel, using 6 mm (1/4 inch) minimum thick stock, with edges and corners rounded smooth to thickness of metal, or 3 mm (1/8 inch) minimum radius.

B. Fabricate each unit as a double hook on a single shaft, integral with or permanently fastened to wall flange, provided with concealed fastenings.

C. NOT USED

2.10 TOWEL BARS

A. Fed. Spec. WW-P-541/8B, Type IV, Bar, Surface mounted; Class 1, towel.

B. Stainless steel, or chromium plated copper alloy.

C. Bar Length: 450 and 600 mm (18 and 24 inches) as shown.

D. Finish brackets and supports to match bar.

E. NOT USED

2.11 METAL FRAMED MIRRORS

A. Fed. Spec. A-A-3002 metal frame; chromium finished steel, anodized Mirror Glass:

1. Minimum 6 mm (1/4 inch) thick.
2. Set mirror in a protective vinyl glazing tape.

B. Frames:

1. Channel or angle shaped section with face of frame minimum 9 mm (3/8 inch) wide. Fabricate with square corners.

2. Metal Thickness 0.9 mm (0.035 inch).

3. Filler:

a. Where mirrors are mounted on walls having ceramic tile wainscots not flush with wall above, provide fillers contoured to conceal void between back of mirror and wall surface.

b. Fabricate fillers from same material and finish as mirror frame.

4. Attached Shelf for Mirrors:

a. Fabricate shelf of same material and finish as mirror frame.

b. Make shelf maximum 150 mm (6 inches) in depth, and extend full width of mirror.

c. Close ends and front edge of shelf to same thickness as mirror frame width.

d. Form shelf for aluminum framed mirror as integral part of bottom frame member.

e. Form stainless steel shelf with concealed brackets to attach to mirror frame.

C. Back Plate:

1. Fabricate back plate for concealed wall hanging from zinc-coated, or cadmium plated 0.9 mm (0.036 inch) thick sheet steel, die cut to fit face of mirror frame.

2. Provide set screw type theft resistant concealed fastening system for mounting mirrors.

D. Mounting Bracket:

1. Designed to support mirror tight to wall.
2. Designed to retain mirror with concealed set screw fastenings.

E. NOT USED

2.12 MEDICINE CABINETS: NOT USED

2.13 FOOT OPERATED SOAP DISPENSER: NOT USED

2.14 SOAP DISHES: NOT USED

2.15 PAPER CUP DISPENSER: NOT USED

2.16 MOP RACKS

A. Minimum 1016 mm (40 inches) long with five holders.

B. Clamps:

1. Minimum of 1.3 mm (0.05 inch) thick stainless steel bracket retaining channel with hard rubber serrated cam; pivot mounted to channel.
2. Clamps to hold handles from 13 mm (1/2 inch) minimum to 32 mm (1-1/4 inch) maximum diameter.

C. Support:

1. Minimum 1 mm (0.04 inch) thick stainless steel hat shape channel to hold clamps away from wall as indicated.
2. Drill wall flange for 3 mm (1/8 inch) fasteners above and below clamp locations.

D. Secure clamps to support with oval head machine screws or rivets into continuous reinforcing back of clamps.

2.17 STAINLESS STEEL SHELVES (TYPE 44): NOT USED

2.18 STAINLESS STEEL SHELVES (TYPES 45,45C): NOT USED

2.19 STAINLESS STEEL SHELVES AT WHEELCHAIR LAVATORY

A. Side wall mounted:

1. Fabricate to size and shape indicated of 1.2 mm (0.05 inch) thick sheet.

2. Turn up edges and weld corners closed.
3. Fabricate brackets and weld to shelf. Drill brackets for 6 mm (1/4 inch) anchor bolts.

B. Back wall mounted:

1. Fabricate to size and shape shown of plate and tube.
2. Turn up edges and weld corners of shelf.
3. Weld tube to back plate and shelf, weld back plate to shelf, filler plate to tube, and corners of shelf with continuous welds.
4. Drill back plate for 6 mm (1/4 inch) anchor bolts.

2.20 FABRICATION - GENERAL

A. Welding, AWS D10.4.

B. Grind, dress, and finish welded joints to match finish of adjacent surface.

C. Form exposed surfaces from one sheet of stock, free of joints.

D. Provide steel anchors and components required for secure installation.

E. Form flat surfaces without distortion. Keep exposed surfaces free from scratches and dents. Reinforce doors to prevent warp or twist.

F. Isolate aluminum from dissimilar metals and from contact with building materials as required to prevent electrolysis and corrosion.

G. Hot-dip galvanized steel or stainless steel, anchors and fastening devices.

H. Shop assemble accessories and package with components, anchors, fittings, fasteners and keys.

I. Key items alike.

J. Provide templates and rough-in measurements.

K. Round and deburr edges of sheets to remove sharp edges.

2.21 FINISH

A. NOT USED

B. NOT USED

C. Stainless Steel: NAAMM AMP 500; No. 4 polished finish.

D. NOT USED

E. NOT USED

2.22 ACCESSORIES

A. Fasteners:

1. NOT USED

2. Exposed Fasteners: Stainless steel or chromium plated brass, finish to match adjacent surface.

3. Concealed Fasteners:

a. Shower, Bath Tubs, and High Moisture Areas: Stainless steel.

b. Other Locations: Steel, hot-dipped galvanized.

4. Toggle Bolts: For use in hollow masonry or frame construction.

5. Sex bolts: For through bolting on thin panels.

6. Expansion Shields: Lead or plastic for solid masonry and concrete substrate as recommended by accessory manufacturer to suit application.

7. Screws:

a. ASME B18.6.4.

b. Fed. Spec. FF-S-107, Stainless steel Type A.

B. Adhesive: As recommended by manufacturer to suit application.

PART 3 - EXECUTION

3.1 PREPARATION

A. Examine and verify substrate suitability for product installation.

1. Verify blocking to support accessories is installed and located correctly.

B. Verify location of accessories with Contracting Officer's Representative.

3.2 INSTALLATION

A. Install products according to manufacturer's instructions and approved submittal drawings.

1. When manufacturer's instructions deviate from specifications, submit proposed resolution for Contracting Officer's Representative consideration.

B. Install grab bars according to ASTM F446.

C. Set work accurately, in alignment and where indicated, parallel or perpendicular as required to line and plane of surface. Install accessories plumb, level, free of rack and twist.

D. Toggle bolt to steel anchorage plates in frame partitions and hollow masonry. Expansion bolt to concrete or solid masonry.

E. Install accessories to function as designed. Perform maintenance service without interference with performance of other devices.

F. Position and install dispensers, and other devices in countertops, clear of drawers, permitting ample clearance below countertop between devices, and ready access for maintenance.

G. Align mirrors, dispensers and other accessories even and level, when installed in battery.

H. Install accessories to prevent striking by other moving, items or interference with accessibility.

I. NOT USED

3.3 CLEANING

A. After installation, clean toilet accessories according to manufacturer's instructions.

3.4 PROTECTION

A. Protect accessories from damage until project completion.

3.5 SCHEDULE OF ACCESSORIES

-- E N D --

**SECTION 10 44 13
FIRE EXTINGUISHER CABINETS**

PART 1 - GENERAL

1.1 DESCRIPTION

This section covers recessed fire extinguisher cabinets.

1.2 RELATED WORK

- A. Acrylic glazing: Section 08 80 00, GLAZING.
- B. Field Painting: Section 09 91 00, PAINTING.

1.3 SUBMITTALS

- A. Submit in accordance with Section 01 33 23, SHOP DRAWINGS, PRODUCT DATA, AND SAMPLES.
- B. Manufacturer's Literature and Data: Fire extinguisher cabinet including installation instruction and rough opening required.

1.4 APPLICATION PUBLICATIONS

- A. The publications listed below form a part of this specification to the extent referenced. The publications are referenced in the text by the basic designation only.
- B. American Society of Testing and Materials (ASTM):
D4802-10.....Poly (Methyl Methacrylate) Acrylic Plastic Sheet

PART 2 - PRODUCTS

2.1 FIRE EXTINGUISHER CABINET

Recessed type with flat trim of size and design shown.

2.2 FABRICATION

- A. Form body of cabinet from 0.9 mm (0.0359 inch) thick sheet steel.
- B. Fabricate door and trim from 1.2 mm (0.0478 inch) thick sheet steel with all face joints fully welded and ground smooth.
 - 1. Glaze doors with 6 mm (1/4 inch) thick ASTM D4802, clear acrylic sheet, Category B-1, Finish 1.
 - 2. Design doors to open 180 degrees.
 - 3. Provide continuous hinge, pull handle, and adjustable roller catch.

2.3 FINISH

- A. Finish interior of cabinet body with baked-on semi-gloss white enamel.
- B. Finish door, frame with manufacturer's standard baked-on prime coat suitable for field painting.

PART 3 - EXECUTION

- A. Install fire extinguisher cabinets in prepared openings and secure in accordance with manufacturer's instructions.
- B. Install cabinet so that bottom of cabinet is 914 mm (36 inches) above finished floor.
- C. Provide for a fire extinguisher monitor system (FEMS) module. Provide two distinct signals that shall address removal of extinguisher and trouble. Provide a 12-24-volt DC power supply from the fire alarm system to power the FEMS. Provide all components required and necessary for a complete installation.

--- E N D ---

**SECTION 12 31 00
MANUFACTURED METAL CASEWORK**

PART 1 - GENERAL

1.1 DESCRIPTION

A. This section specifies metal casework and related accessories, including base cabinets, wall cabinets, and lockers.

B. Items specified in this section:

1. Laboratory Casework: Prefixed by "VL" AND "M:

a. Not used.

b. Not used.

1.2 RELATED WORK

A. Color of casework finish: Section 09 06 00, SCHEDULE FOR FINISHES.

B. Electrical Components: Division 26, ELECTRICAL.

1.3 QUALITY ASSURANCE

A. Approval by Contracting Officer of proposed manufacturer, or suppliers, will be based upon submission by Contractor certification that, manufacturer regularly and presently manufactures casework specified as one of their principal products.

B. Installer has technical qualifications, experience, trained personnel, and facilities to install specified items.

C. Furnish supervision of installation at construction site by a qualified technician regularly employed by casework installer.

1.4 SUBMITTALS

A. Submit in accordance with Section 01 33 23, SHOP DRAWINGS, PRODUCT DATA, AND SAMPLES.

B. Certificates:

1. Manufacturer's Certificate of qualifications specified and finish on casework.

2. Contractor's Certificate of installer's qualifications specified.

3. Safety glass meets requirements of ANSI Standard Z97.1.

C. Manufacturer's Literature and Data:

1. Brochures showing name and address of manufacturer, and catalog or model number of each item incorporated into the work.
2. Manufacturer's illustration and detailed description.
3. List of deviations from contract specifications.
4. Locks, each kind

D. Shop Drawings (1/2 Full Scale):

1. Showing details of casework construction, including kinds of materials and finish, hardware, accessories and relation to finish of adjacent construction, including specially fabricated items or components.
2. Fastenings and method of installation.
3. Location of service connections and access.

E. Samples:

1. Metal plate, 150 mm (six inch) square, showing chemical resistant finish, in each color.
2. One complete casework assembly, including cabinet(s) with drawers and cupboard.
3. One glazed sliding door with track and pertinent hardware. A complete cabinet may be submitted to fulfill this requirement.
4. Cabinets for subsequent installation may be submitted for above requirements.

1.5 APPLICABLE PUBLICATIONS

A. Publications listed below form a part of this specification to extent referenced. Publications are referenced in the text by basic designation only.

B. American Society for Testing and Materials (ASTM):

A36/A36M-08.....Carbon Structural Steel

A167-99(R 2009).....Stainless and Heat-Resisting Chromium Steel
Plate Sheet and Strip

A283/A283M-03(R 2007)...Low and Intermediate Tensile Strength Carbon

Steel Plates

A568/A568M-09.....Steel, Sheet, Carbon and High-Strength, Low-Alloy Hot-Rolled and Cold-Rolled, General Requirements

A794/A794M-09.....Standard Specification for Commercial Steel (CS), Sheet, Carbon (0.16% Maximum to 0.25% Maximum) Cold Rolled

B456-03(R2009).....Electrodeposited Coatings of Copper Plus Nickel Plus Chromium and Nickel Plus Chromium

C1036-06.....Flat Glass

C. American National Standard Institute:

Z97.1-09.....Safety Glazing Material used In Buildings

D. Builders Hardware Manufacturers Association (BHMA):

A156.1-06..... Butts and Hinges

A156.9-10.....Cabinet Hardware

A156.5-10.....Auxiliary Locks and Associated Products

A156.11-10.....Cabinet Locks

A156.16-02.....Auxiliary Hardware

E. American Welding Society (AWS):

D1.1-10.....Structural Welding Code Steel

D1.3-08.....Structural Welding Code Sheet Steel

F. National Association of Architectural Metal Manufacturers (NAAMM):

AMP 500-505-06 Series...Metal Finishes Manual

G. U.S. Department of Commerce, Product Standard (PS):

PS 1-95.....Construction and Industrial Plywood

H. Federal Specifications (Fed. Spec.):

FF-N-836D.....Nut, Square, Hexagon Cap, Slotted, Castle Knurled, Welding and Single Ball Seat

A-A-55615.....Shield, Expansion; Nail Expansion (Wood Screw and Lag Bolt Self-Threading Anchors)

PART 2 - PRODUCTS

2.1 MATERIALS

A. Sheet Steel:

1. ASTM A794, cold rolled, Class 1 finish, stretcher leveled.
2. Other types of cold rolled steel meeting requirements of ASTM A568 may be used for concealed parts.

B. Structural Steel: ASTM A283 or ASTM A36.

C. Stainless Steel: ASTM A167, Type 302B.

D. Not used.

E. Not used.

F. Not used.

G. Not used.

H. Fasteners:

1. Exposed to view, chrome plated steel or stainless steel, or finished to match adjacent surface.
2. Use round head or countersunk fasteners where exposed in cabinets.
3. Expansion Bolts: Fed Spec. A-A-55615. Do not use lead or plastic shields.
4. Nuts: Fed Spec FF-N-836. Type III, Style 15 where exposed.
5. Sex Bolts: Capable of supporting twice the load.

2.2 MANUFACTURED PRODUCTS

A. When two or more units are required, use products of one manufacturer.

B. Manufacturer of equipment assemblies, which include components made by other, shall assume complete responsibility for the final assembled unit.

C. Constituent parts which are alike, use products of a single manufacturer.

2.3 CASEWORK FABRICATION

A. General:

1. Welding: Comply with AWS Standards.
2. Reinforce with angles, channels, and gussets to support intended loads, notch tightly, fit and weld joints.
3. Constructed of sheet steel, except where reinforcing required.

B. Minimum Steel Thickness:

0.89 mm
(0.035 inch)
(20 gage) Drawer fronts, backs, bodies, closure plates or scribe and filler strips less than 75 mm (three inches) wide, sloping top, shelf reinforcement channel and shelves. Toe space or casework soffits and ceilings under sloping tops.

1.20 mm
(0.047 inch)
(18 gage) Base pedestals, casework top sides, back, and bottom panels, closure scribe and filler strips 75 mm (three inches) or more. Reinforcement for drawers with locks. Tables legs, spreaders and stretchers, when fabricated of cold rolled tubing. Metal for desks; except legs and aprons. Door exterior and interior panels, flush or glazed. Cross rails of base units. Front bottom rails, back bottom rails; rails may be 1.49 mm (0.059 inch) (16 gage) thick. Uprights or posts. Top corner gussets.

1.49 mm
(0.059 inch)
(16 gage) Aprons, apron division, reinforcing gussets, table legs, desk legs and aprons, spreaders and stretchers when formed without welding. Toe base gussets, drawer slides, and other metal work. Front top rails and back rails except top back rails may be 1.2 mm (0.047 inch) (18 gage) thick.

1.88 mm
(0.074 inch)
(14 gage) Drawer runners door tracks.

2.64 mm
(0.104 inch)
(12 gage) Base unit bottom corner gussets and leg sockets.

3 mm (0.12
Inch) (11 gage) Reinforcement for hinge reinforcement inside doors and cabinets.

C. Casework Construction:

1. Welded assembly.
2. Fabricate with enclosed uprights or posts full height or width at front, include sides, backs, bottoms, soffits, ceilings under sloping tops, headers and rail, assembled to form an integral unit.

3. Form sides to make rabbeted stile 19 to 28 mm (3/4 to 1-1/8 inch) wide, closed by channel containing shelf adjustment slots.
4. Make bottom of walls units' flush, double panel construction.
5. Make top and cross rails of "U" shaped channel.
6. Provide enclosed backs and bottoms in cabinets, including drawer units.
7. Provide finish panel on exposed cabinet backs.
8. Do not use screws and bolts in construction or assembly of casework, except to secure hardware, applied door stops, accessories, removable panels and where casework is required to fastened end to end or back to back.
9. Fabricate casework, except benches, and desks with finished end panels.
10. Close flush exposed soffits of wall hung shelving, knee spaces in counters, and toe spaces at bases.
11. In base units with sinks provide one piece, lowered backs.
12. In base units with doors provide removable backs.
13. Provide built-in raceways or tubular or channel shaped members of casework for installation of wiring and electric work. Mount junction boxes on rear of cabinets, Electric work is specified in electrical sections of specifications.
14. Provide reinforcing for hardware.
15. Size Dimensions:
 - a. Used dimensions shown or specified within tolerances specified.
 - b. Tolerance:
 - 1) Depth: 325 mm (13 inches) in lieu of 300 mm (12 inches), 450 mm (18 inches) in lieu of 400 mm (16 inches), except wall hung units above counter. 525 mm (21 inches) to 600 mm (24 inches) in lieu of 550 mm (22 inches).
 - 2) Width: Minus 25 mm (one inch).
 - 3) Height: 25 mm (one inch) plus or minus for wall hung cabinets and counter mounted cabinets, excluding sloping tops. 25 mm

(one inch) plus for floor standing cabinets, excluding base and sloping tops. Full height cabinets shown back to back same height.

4) Manufacturer's tolerance for the same length, depth or height: Not to exceed 1.58 mm (0.0625 inches).

D. Base Pedestals:

1. Provide adjustable leveling bolts accessible through stainless steel plugs, or notch in the base concealed when resilient base is applied.
2. Except where flush metal base is shown, provide toe space at front recessed 75 mm (3 inches).
3. Lockers shall be installed on concrete base.

E. Doors:

1. Hollow metal type, flush doors not less than 16 mm (5/8 inch) thick.
2. Fabricate flush metal doors of two panels formed into pans with corners welded and ground smooth. Provide flush doors with a sound deadening core.
3. Fabricate glazed metal doors with reinforced frame and construct either from one piece of steel, or have separate stiles and rails mitered and welded at corners, and welds ground smooth.
 - a. Secure removable glazing members with screws to back of doors.
 - b. Install glass in rubber or plastic glazing channels.
4. Provide sheet steel hinge reinforcement inside doors.
5. Sliding doors: Provide stops to prevent bypass.
6. Doors removable without use of tools except where equipped with locks.

F. Drawers:

1. Drawer fronts flush hollow metal type not less than 16 mm (5/8 inch) thick with sound deadening core. Fabricate of two panels formed into pans. Weld and grind smooth corners of drawer fronts.
2. Form bodies from one piece of steel, weld to drawer front.
3. Provide reinforcement for locks and provide rubber bumpers at both sides of drawer head to cushion closing.

4. Equip with roller suspension guides.

G. Not used.

H. Shelves:

1. Capable of supporting an evenly distributed minimum load of 122 kg/m² (twenty-five pounds per square foot) without visible distortion.

2. Flange shelves down 19 mm (3/4 inch) on edges, with front and bearing edges flanged back 13 mm (1/2 inch).

3. For shelves over 1050 mm (42 inches) in length and over 300 mm (12 inches) in depth install 38 mm by 13 mm by 0.9 mm (1-1/2 x 1/2 x 0.0359 inch) thick sheet steel hat channel reinforcement welded to underside midway between front and back and extending full length of shelf.

4. Weld shelves to metal back and ends unless shown adjustable.

5. Provide means of positive locking shelf in position, and to permit adjustment without use of tools.

6. On pharmacy on sloping shelf provide 13 mm (1/2 inch) wide clear acrylic plastic raised edge, 3 mm (1/8 inch) thick, secured to front edge of shelf.

I. Not used.

J. Closures and Filler Strips at Pipe Spaces:

1. Flat steel strips or plates.

2. Openings less than 200 mm (8 inches) wide: 1.2 mm (0.047 inch) thick.

3. Openings more than 200 mm (8 inches wide 0.9 mm (0.359 inches) wide.

2.4 NOT USED.

Not used.

2.5 HARDWARE

A. Factory installed.

B. Exposed hardware, except as specified otherwise, satin finished chromium plated brass or nickel plated brass or anodized aluminum.

C. Cabinet Locks:

1. Where locks are shown.

2. Locked pair of hinged door over 900 mm (36 inches) high:

- a. ANSI/BHMA A156.5, similar to E0261, Key one side.
- b. On active leaf use three-point locking device, consisting of two steel rods and lever controlled cam at lock, to operate by lever having lock cylinder housed therein.
- c. On inactive leaf use dummy lever of same design.
- d. Provide keeper holes for locking device rods and cam.
- e. Not used.

3. Door and Drawer: ANSI/BHMA A156.11 cam locks.

- a. Drawer and Hinged Door up to 900 mm (36 inches) high: E07261.
- b. Pin-tumbler, cylinder type lock with not less than four pins. Disc tumbler lock "duo A" with brass working parts and case, as manufactured by Illinois Lock Company are acceptable.
- c. Sliding Door: E07161.

4. Not used.

5. Marking of Locks and Keys:

- a. Name of manufacturer, or trademark which can readily be identified legibly marked on each lock and key change number marked on exposed face of lock.
- b. Key change numbers stamped on keys.
- c. Key change numbers to provide sufficient information for manufacturer to replace key.

D. Cabinet Hardware: ANSI BHMA A156.9.

1. Door/Drawer Pulls: B02011.

- a. One for drawers up to 575 mm (23 inches) wide.
- b. Two for drawers over 575 mm (23 inches) wide.
- c. Sliding door flush pull, each door: B02201.

2. Door in seismic zones: B03352.

- a. Do not provide thumb latch on doors equipped with three point locking device.

b. Use lever operated two-point latching device on paired doors over 900 mm (36 inches) high if three-point locking or latching device is not used.

3. Cabinet Door Catch:

a. Install at bottom of wall cabinets, top of base cabinets and top and bottom of full height cabinet doors over 1200 mm (48 inches).

b. Omit on doors with locks.

4. Drawer Slides:

a. Use B05051 for drawers over 150 mm (6 inches) deep.

b. Use B05052 for drawers 75 to 150 mm (3 to 6 inches) deep.

c. Use B05053 for drawers less than 75 mm (3 inches) deep.

5. Butt Hinges:

a. B01351, minimum 1.8 mm (0.072 inch) thick chrome plated steel leaves.

b. Minimum 3.5 mm (0.139 inch) diameter stainless steel pins.

c. Full mortise type, five knuckle design with 63 mm (2-1/2 inch) high leaves and hospital type tips.

d. Two hinges per door except use three hinges on doors 1200 mm (48 inches) and more in height. Use stainless steel leaves for tilting bin doors.

f. Do not weld hinges to doors or cabinets.

6. Pivot hinges: ANSI/BHMA A156.1 A875B.

7. Shelf Supports:

a. install in casework where adjustable shelves are noted.

b. Adjustable Shelf Standards: B04061 with shelf rest B04081.

c. Vertical Slotted Shelf Standard: B04102 with shelf brackets B04112 sized for shelf depth.

8. Sliding Doors:

a. Doors supported by two ball bearing bronze or nylon rollers or sheaves riding on a stainless-steel track.

b. Sliding Door Tracks: B07093. Plastic tracks not acceptable.

c. Doors restrained by a nylon, polyvinylchloride, or stainless steel guide at opposite end.

9. Auxiliary Hardware: ANSI A156.16.

10. Not used.

11. Not used.

2.6 METAL FINISHES

A. Comply with NAAMM 500 series and as specified.

B. Steel Cabinets including Closures and Filler Strips:

1. Acid resisting finish except hardware and stainless steel.

2. After fabrication of cabinet submerge in a degreasing bath, and thoroughly rinse to remove dirt and grease, and other foreign matter.

3. Apply non-metallic phosphate coating, then finish with baked-on acid resisting enamel not less than one mil thick.

4. Finish resistant to action of the following reagents when 10 drops (0.5 cm³) are applied to the surface and left open to the atmosphere for period of one hour.

Hydrochloric Acid 37 percent

Ethyl Alcohol

Phosphoric Acid 75 percent

Methylethyl Keytone

Sulfuric Acid 25 percent

Acetone

Glacial Acetic Acid

Ethyl Acetate

Sodium Hydroxide 10 percent

Ethyl Ether

Sodium Hydroxide (concentrated)

Carbon Tetrachloride

Ammonia Hydroxide (concentrated)

Xylene

Hydrogen Peroxide 5 percent

Phenol 85 Percent

Formaldehyde

37 percent

5. Color of finish is specified in Section, INTERIOR/EXTERIOR FINISHES, MATERIALS, AND FINISH SCHEDULES.

C. Not used.

D. Not used.

E. Stainless Steel: Mechanical finish No. 4 on sheet except No. 7 on tubing.

2.7 NOT USED.

2.8 ELECTRICAL FIXTURES

A. Comply with requirements of Division 26 – ELECTRICAL specifications for fixtures, receptacles, wiring and junction boxes required for fixtures and receptacles, included with casework.

B. Suitable for use with electrical system specified and shown.

C. Factory install in casework.

2.9 NOT USED.

A. Construct as shown.

B. Use pivot hinges on center shadow boards, secured to bottom and top of cabinet with bolts or screws.

2.10 NOT USED.

2.11 NOT USED

PART 3 - EXECUTION

3.1 COORDINATION

A. Before installing casework, verify wall and floor surfaces covered by casework have been finished.

B. Verify location and size of mechanical and electrical services as required.

C. Verify reinforcement of walls and partitions for support and anchorage of casework.

3.2 FASTENINGS AND ANCHORAGE

A. Do not anchor to wood ground strips.

B. Provide hat shape metal spacers where fasteners span gaps or spaces.

C. Use 6 mm (1/4 inch) diameter toggle or expansion bolts, or other appropriate size and type fastening device for securing casework to walls or floor. Use expansion bolts shields having holding power beyond tensile and shear strength of bolt and breaking strength of bolt head.

D. Use 6 mm (1/4 inch) diameter hex bolts for securing cabinets together.

E. Use 6 mm (1/4 inch) by minimum 38 mm (1-1/2 inch) length lag bolt anchorage to wood blocking for concealed fasteners.

F. Use not less than No. 12 or 14 wood screws with not less than 38 mm (1-1/2 inch) penetration into wood blocking.

G. Space fastening devices 300 mm (12 inches) on center with minimum of three fasteners in 900 or 1200 mm (three or four foot) unit width.

H. Anchor floor mounted cabinets with a minimum of four bolts through corner gussets. Anchor bolts may be combined with or separate from leveling device.

I. Secure cabinets in alignment with hex bolts or other internal fastener devices removable from interior of cabinets without special tools. Do not use fastener devices which require removal of tops for access.

J. Where units abut end to end anchor together at top and bottom of sides at front and back. Where units are back to back, anchor backs together at corners with hex bolts placed inconspicuously inside casework.

K. Where type, size, or spacing of fastenings is not shown or specified, show on shop drawings proposed fastenings and method of installation.

3.3 CLOSURES AND FILLER PLATES

A. Close openings larger than 6 mm (1/4 inch) wide between cabinets and adjacent walls with flat, steel closure strips, scribed to required contours, or machined formed steel fillers with returns, and secured with sheet metal screws to tubular or channel members of units, or bolts where exposed on inside.

B. Where ceilings interfere with installation of sloping tops, omit sloping tops and provide flat steel filler plates.

1. Secure filler plates to casework top members, unless shown otherwise.

2. Secure filler plates more than 150 mm (six inches) in width top edge to a continuous 25 by 25 mm (one by one inch) 0.889 mm thick steel formed steel angle with screws.

3. Anchor angle to ceiling with toggle bolts.

C. Install closure strips at exposed ends of pipe space and offset opening into concealed space.

D. Paint closure strips and fillers with same finishes as cabinets.

E. Caulk and seal laboratory furniture as specified in Section 07 92 00, JOINT SEALANTS.

3.4 CABINETS

A. Install in available space; arranged for safe and convenient operation and maintenance.

B. Align cabinets for flush joints except where shown otherwise.

C. Install cabinets level with bottom of wall cabinets in alignment and tops of base cabinets aligned.

D. Install corner cabinets with hinges on corner side with filler or spacers sufficient to allow opening of drawers.

E. Plug Buttons:

1. Install plug buttons in predrilled or pre-punched perforations not used.

2. Use chromium plate plug buttons or buttons finish to match adjacent surfaces.

F. Cabinets 6D: Ground to nearest cold water pipe in accordance with NFPA, Underwriters Laboratories, Inc., or other nationally recognized laboratory approved ground specified system.

3.5 PROTECTION TO FIXTURES, MATERIALS, AND EQUIPMENT

A. Tightly cover and protect cabinets against dirt, water chemical or mechanical injury.

B. Thoroughly clean interior and exterior of cabinets, at completion of all work.

- - - E N D - - -

**SECTION 26 05 73
OVERCURRENT PROTECTIVE DEVICE COORDINATION STUDY**

PART 1 - GENERAL

1.1 DESCRIPTION

A. This section specifies the overcurrent protective device coordination study, related calculations and analysis, indicated as the study in this section.

B. A short circuit and selective coordination study, and arc flash calculations and analysis shall be prepared for the electrical overcurrent devices to be installed under this project.

C. The study shall present a well-coordinated time-current analysis of each overcurrent protective device from the individual device up to the utility source.

1.2 RELATED WORK

A. Section 26 05 11, REQUIREMENTS FOR ELECTRICAL INSTALLATIONS: General electrical requirements that are common to more than one section of Division 26.

B. Section 26 13 13, MEDIUM-VOLTAGE CIRCUIT BREAKER SWITCHGEAR: Medium voltage circuit breaker switchgear.

C. Section 26 13 16, MEDIUM-VOLTAGE FUSIBLE INTERRUPTER SWITCHES: Medium voltage fusible interrupter switches.

D. Section 26 23 00, LOW-VOLTAGE SWITCHGEAR: Low-voltage switchgear.

E. Section 26 24 13, DISTRIBUTION SWITCHBOARDS: Low-voltage distribution switchboards.

F. Section 26 24 16, PANELBOARDS: Low-voltage panelboards.

G. Section 26 24 19, MOTOR CONTROL CENTERS: Motor control centers.

H. Section 26 32 13, ENGINE GENERATORS: Engine generators.

I. Section 26 36 23, AUTOMATIC TRANSFER SWITCHES: Automatic transfer switches.

1.3 QUALITY ASSURANCE

A. Refer to Paragraph, QUALIFICATIONS (PRODUCTS AND SERVICES), in Section 26 05 11, REQUIREMENTS FOR ELECTRICAL INSTALLATIONS.

B. The study shall be prepared by the equipment manufacturer, and performed by the equipment manufacturer's licensed electrical engineer.

1.4 SUBMITTALS

A. Submit six copies of the following in accordance with Section 26 05 11, REQUIREMENTS FOR ELECTRICAL INSTALLATIONS.

1. Product data on the software program to be used for the study. Software shall be in mainstream use in the industry, shall provide device settings and ratings, and shall show selective coordination by time-current drawings.

2. Complete study as described in paragraph 1.6. Submittal of the study shall be well-coordinated with submittals of the shop drawings for equipment in related specification sections.

3. Certifications: Two weeks prior to final inspection, submit the following:

a. Certification by the Contractor that the overcurrent protective devices have been set in accordance with the approved study.

1.5 APPLICABLE PUBLICATIONS

A. Publications listed below (including amendments, addenda, revisions, supplements, and errata) form a part of this specification to the extent referenced. Publications are referenced in the text by designation only.

B. Institute of Electrical and Electronics Engineers (IEEE):

241-90.....Recommended Practice Electrical Systems in Commercial Buildings

242-01.....Recommended Practice for Protection and Coordination of Industrial and Commercial Power Systems

399-97.....Recommended Practice for Industrial and Commercial Power Systems Analysis

1584-02.....Performing Arc-Flash Hazards Calculations

1584A-04.....Performing Arc-Flash Hazards Calculations – Amendment 1

1584B-11.....Performing Arc-Flash Hazards Calculations – Amendment 2

C. National Fire Protection Association (NFPA):

70-14.....National Electrical Code (NEC)

70E-15.....Standard for Electrical Safety in the Workplace

99-15.....Health Care Facilities Code

1.6 STUDY REQUIREMENTS

A. The study shall be in accordance with IEEE and NFPA standards.

B. The study shall include one line diagram, short-circuit and ground fault analysis, protective coordination plots for all overcurrent protective devices, and arc flash calculations and analysis.

C. One Line Diagram:

1. Show all electrical equipment and wiring to be protected by the overcurrent devices.

2. Show the following specific information:

a. Calculated fault impedance, X/R ratios, and short-circuit values at each feeder and branch circuit bus.

b. Relay, circuit breaker, and fuse ratings.

c. Generator kW/kVA and transformer kVA and voltage ratings, percent impedance, X/R ratios, and wiring connections.

d. Voltage at each bus.

e. Identification of each bus, matching the identification on the drawings.

f. Conduit, conductor, and busway material, size, length, and X/R ratios.

D. Short-Circuit Study:

1. The study shall be performed using computer software designed for this purpose. Pertinent data and the rationale employed in developing the calculations shall be described in the introductory remarks of the study.

2. Calculate the fault impedance to determine the available short circuit and ground fault currents at each bus. Incorporate applicable motor and/or generator contribution in determining the momentary and interrupting ratings of the overcurrent protective devices.

3. Present the results of the short-circuit study in a table. Include the following:

a. Device identification.

- b. Operating voltage.
- c. Overcurrent protective device type and rating.
- d. Calculated short-circuit current.

E. Coordination Study:

1. Prepare the coordination curves to determine the required settings of overcurrent protective devices to demonstrate selective coordination. Graphically illustrate on log-log paper that adequate time separation exists between devices, including the utility company upstream device if applicable. Plot the specific time-current characteristics of each overcurrent protective device in such a manner that all devices are clearly depicted.

2. The following specific information shall also be shown on the coordination curves:

- a. Device identification.
- b. Potential transformer and current transformer ratios.
- c. Three-phase and single-phase ANSI damage points or curves for each cable, transformer, or generator.
- d. Applicable circuit breaker or protective relay characteristic curves.
- e. No-damage, melting, and clearing curves for fuses.
- f. Transformer in-rush points.

3. Develop a table to summarize the settings selected for the overcurrent protective devices. Include the following in the table:

- a. Device identification.
- b. Protective relay or circuit breaker potential and current transformer ratios, sensor rating, and available and suggested pickup and delay settings for each available trip characteristic.
- c. Fuse rating and type.

F. Arc Flash Calculations and Analysis:

1. Arc flash warning labels shall comply with Section 26 05 11, REQUIREMENTS FOR ELECTRICAL INSTALLATIONS.

2. Arc flash calculations shall be based on actual over-current protective device clearing time. Maximum clearing time shall be in accordance with IEEE 1584.

3. Arc flash analysis shall be based on the lowest clearing time setting of the over-current protective device to minimize the incident energy level without compromising selective coordination.

4. Arc flash boundary and available arc flash incident energy at the corresponding working distance shall be calculated for all electrical power distribution equipment specified in the project, and as shown on the drawings.

5. Required arc-rated clothing and other PPE shall be selected and specified in accordance with NFPA 70E.

1.7 ANALYSIS

A. Analyze the short-circuit calculations, and highlight any equipment determined to be underrated as specified. Propose solutions to effectively protect the underrated equipment.

1.8 ADJUSTMENTS, SETTINGS, AND MODIFICATIONS

A. Final field settings and minor modifications of the overcurrent protective devices shall be made to conform with the study, without additional cost to the Government.

PART 2 - PRODUCTS (NOT USED)

PART 3 - EXECUTION (NOT USED)

---END---

**SECTION 26 56 00
EXTERIOR LIGHTING**

PART 1 - GENERAL

1.1 DESCRIPTION

This section specifies the furnishing, installation, and connection of exterior fixtures, poles, and supports. The terms “lighting fixtures”, “fixture” and “luminaire” are used interchangeably.

1.2 RELATED WORK

A. Section 03 30 00, CAST-IN-PLACE CONCRETE.

B. Section 09 06 00, SCHEDULE FOR FINISHES: Finishes for exterior light poles and luminaires.

C. Section 26 05 11, REQUIREMENTS FOR ELECTRICAL INSTALLATIONS: General electrical requirements and items that are common to more than one section of Division 26.

D. Section 26 05 19, LOW-VOLTAGE ELECTRICAL POWER CONDUCTORS AND CABLES (600 VOLTS AND BELOW): Low voltage power and lighting wiring.

E. Section 26 05 26, GROUNDING AND BONDING FOR ELECTRICAL SYSTEMS: Requirements for personnel safety and to provide a low impedance path for possible ground fault currents.

F. Section 26 05 33, RACEWAY AND BOXES FOR ELECTRICAL SYSTEMS: Conduits, fittings, and boxes for raceway systems.

G. Section 26 05 41, UNDERGROUND ELECTRICAL CONSTRUCTION: Underground handholes and conduits.

H. Section 26 09 23, LIGHTING CONTROLS: Controls for exterior lighting.

1.3 QUALITY ASSURANCE

A. Refer to Paragraph, QUALIFICATIONS (PRODUCTS AND SERVICES), in Section 26 05 11, REQUIREMENTS FOR ELECTRICAL INSTALLATIONS.

1.4 SUBMITTALS

A. Submit six copies of the following in accordance with Section 26 05 11, REQUIREMENTS FOR ELECTRICAL INSTALLATIONS.

1. Shop Drawings:

a. Submit the following information for each type of lighting fixture designated on the LIGHTING FIXTURE SCHEDULE, arranged in order of lighting fixture designation.

- b. Material and construction details, include information on housing and optics system.
- c. Physical dimensions and description.
- d. Wiring schematic and connection diagram.
- e. Installation details.
- f. Energy efficiency data.
- g. Photometric data based on laboratory tests complying with IES Lighting Measurements testing and calculation guides.
- h. Lamp data including lumen output (initial and mean), color rendition index (CRI), rated life (hours), and color temperature (degrees Kelvin).
- i. Ballast data including ballast type, starting method, ambient temperature, ballast factor, sound rating, system watts, and total harmonic distortion (THD).
- j. For LED lighting fixtures, submit US DOE LED Lighting Facts label, and IES L70 rated life.
- k. Submit site plan showing all exterior lighting fixtures with fixture tags consistent with Lighting Fixture Schedule as shown on drawings. Site plan shall show computer generated point-by-point illumination calculations. Include lamp lumen and light loss factors used in calculations.

2. Manuals:

- a. Submit, simultaneously with the shop drawings, complete maintenance and operating manuals, including technical data sheets, wiring diagrams, and information for ordering replacement parts.
- b. If changes have been made to the maintenance and operating manuals originally submitted, submit updated maintenance and operating manuals two weeks prior to the final inspection.

3. Certifications: Two weeks prior to final inspection, submit the following.

- a. Certification by the Contractor that the exterior lighting systems have been properly installed and tested.

1.5 APPLICABLE PUBLICATIONS

A. Publications listed below (including amendments, addenda, revisions, supplements, and errata) form a part of this specification to the extent referenced. Publications are referenced in the text by designation only.

B. Aluminum Association Inc. (AA):
AAH35.1-06.....Alloy and Temper Designation Systems for

Aluminum

C. American Association of State Highway and Transportation Officials (AASHTO):
32-LTS-6.....Structural Supports for Highway Signs,
Luminaires and Traffic Signals

D. American Concrete Institute (ACI):

318-05Building Code Requirements for Structural
Concrete

E. American National Standards Institute (ANSI):

C81.61-09Electrical Lamp Bases – Specifications for
Bases (Caps) for Electric Lamps

F. American Society for Testing and Materials (ASTM):

A123/A123M-12Zinc (Hot-Dip Galvanized) Coatings on Iron and
Steel Products

A153/A153M-09.....Zinc Coating (Hot-Dip) on Iron and Steel
Hardware

B108-03a-08Aluminum-Alloy Permanent Mold Castings

C1089-13Spun Cast Pre-stressed Concrete Poles

G. Federal Aviation Administration (FAA):

AC 70/7460-IK-07.....Obstruction Lighting and Marking

AC 150/5345-43F-06.....Obstruction Lighting Equipment

H. Illuminating Engineering Society of North America (IESNA):

HB-9-00.....Lighting Handbook

RP-8-05.....Roadway Lighting

LM-52-03.....Photometric Measurements of Roadway Sign
Installations

LM-72-10.....Directional Positioning of Photometric Data

LM-79-08.....Approved Method for the Electrical and
Photometric Measurements of Solid-State Lighting
Products

LM-80-08.....Approved Method for Measuring Lumen Maintenance
of LED Light Sources

TM-15-07.....Backlight, Up light and Glare (BUG) Ratings

I. National Electrical Manufacturers Association (NEMA):

C78.41-06.....Electric Lamps – Guidelines for Low-Pressure
Sodium Lamps

C78.42-07Electric Lamps – Guidelines for High-Pressure
Sodium Lamps

C78.43-07Electric Lamps – Single-Ended Metal-Halide
Lamps

C78.1381-98.....Electric Lamps – 70-Watt M85 Double-Ended
Metal-Halide Lamps

C82.4-02Ballasts for High-Intensity-Discharge and Low-
Pressure Sodium Lamps (Multiple-Supply Type)

C136.3-05For Roadway and Area Lighting Equipment –
Luminaire Attachments

C136.17-05Roadway and Area Lighting Equipment – Enclosed
Side-Mounted Luminaires for Horizontal-Burning
High-Intensity-Discharge Lamps – Mechanical
Interchangeability of Refractors

ICS 2-00 (R2005)Controllers, Contactors and Overload Relays
Rated 600 Volts

ICS 6-93 (R2006)Enclosures

J. National Fire Protection Association (NFPA):

70-11National Electrical Code (NEC)

K. Underwriters Laboratories, Inc. (UL):

496-08Lamp holders

773-95.....Plug-In, Locking Type Photocontrols for Use
with Area Lighting

773A-06Nonindustrial Photoelectric Switches for
Lighting Control

1029-94.....High-Intensity-Discharge Lamp Ballasts

1598-08Luminaires

8750-09.....Light Emitting Diode (LED) Equipment for Use in
Lighting Products

1.6 DELIVERY, STORAGE, AND HANDLING

Provide manufacturer's standard provisions for protecting pole finishes during transport, storage, and installation. Do not store poles on ground. Store poles so they are at least 305 mm (12 inches) above ground level and growing vegetation. Do not remove factory-applied pole wrappings until just before installing pole.

PART 2 - PRODUCTS

2.1 GENERAL REQUIREMENTS

Luminaires, materials and equipment shall be in accordance with NEC, UL, ANSI, and as shown on the drawings and specified.

2.2 POLES

A. General:

1. Poles shall be as shown on the drawings, and as specified. Finish shall be as specified on the drawings.
2. The pole and arm assembly shall be designed for wind loading of 100 mph minimum, as required by wind loading conditions at project site, with an additional 30% gust factor and supporting luminaire(s) and accessories such as shields, banner arms, and banners that have the effective projected areas indicated. The effective projected area of the pole, shall be applied at the height of the pole base, as shown on the drawings.
3. Poles shall be anchor-bolt type designed for use with underground supply conductors. Poles shall have handhole having a minimum clear opening of 65 x 125 mm (2.5 x 5 inches). Handhole covers shall be secured by stainless steel captive screws.
4. Provide a steel-grounding stud opposite handhole openings, designed to prevent electrolysis when used with copper wire.
5. Provide a base cover that matches the pole in material and color to conceal the mounting hardware pole-base welds and anchor bolts.
6. Hardware and Accessories: All necessary hardware and specified accessories shall be the product of the pole manufacturer.
7. Provide manufacturer's standard finish, as scheduled on the drawings. Where indicated on drawings, provide finishes as indicated in Section 09 06 00, SCHEDULE FOR FINISHES.

SPEC WRITER NOTE: Edit paragraph below to conform to project requirements.

B. Types:

2. Steel: Provide round steel poles having minimum 11-gauge steel with minimum yield/strength of 48,000 psi and hot-dipped galvanized iron-oxide primed factory finish

2.3 FOUNDATIONS FOR POLES

A. Foundations shall be cast-in-place concrete, having 3000 psi minimum 28-day compressive strength.

B. Foundations shall support the effective projected area of the specified pole, arm(s), luminaire(s), and accessories, such as shields, banner arms, and banners, under wind conditions previously specified in this section.

C. Place concrete in spirally-wrapped treated paper forms for round foundations, and construct forms for square foundations.

D. Rub-finish and round all above-grade concrete edges to approximately 6 mm (0.25-inch) radius.

E. Anchor bolt assemblies and reinforcing of concrete foundations shall be as shown on the drawings. Anchor bolts shall be in a welded cage or properly positioned by the tie wire to stirrups.

F. Prior to concrete pour, install electrode per Section 26 05 26, GROUNDING AND BONDING FOR ELECTRICAL SYSTEMS.

2.4 LUMINAIRES

A. Luminaires shall be weatherproof, heavy duty, outdoor types designed for efficient light utilization, adequate dissipation of lamp and ballast heat, and safe cleaning and relamping.

B. Illumination distribution patterns, BUG ratings and cutoff types as defined by the IESNA shall be as shown on the drawings.

C. Incorporate ballasts or drivers in the luminaire housing, except where otherwise shown on the drawings.

D. Lenses shall be frame-mounted, heat-resistant, borosilicate glass, with prismatic refractors, unless otherwise shown on the drawings. Attach the frame to the luminaire housing by hinges or chain. Use heat and aging-resistant, resilient gaskets to seal and cushion lenses and refractors in luminaire doors.

F. Pre-wire internal components to terminal strips at the factory.

G. Bracket-mounted luminaires shall have leveling provisions and clamp type adjustable slip-fitters with locking screws.

H. Materials shall be rustproof. Latches and fittings shall be nonferrous metal.

I. Provide manufacturer's standard finish, as scheduled on the drawings. Where indicated on drawings, match finish process and color of pole or support materials. Where indicated on drawings, provide finishes as indicated in Section 09 06 00, SCHEDULE FOR FINISHES.

J. Luminaires shall carry factory labels, showing complete, specific lamp and ballast information.

2.5 LAMPS

A. Install the proper lamps in every luminaire installed as shown on the drawings.

B. Lamps shall be general-service, outdoor lighting types.

C. High-Pressure Sodium (HPS) Lamps: Comply with NEMA C78.42, Color Rendering Index (CRI) 21 (minimum), wattage as indicated on fixture schedule. Lamps shall have minimum average rated life of 24,000 hours.

D. Low-Pressure Sodium (LPS) Lamps: Comply with NEMA C78.43, wattage as indicated on fixture schedule. Lamps shall have minimum average rated life of 18,000 hours.

E. Metal-Halide Lamps: Comply with NEMA C78.43 or NEMA C78.1381. Lamps shall be pulse start or ceramic type with wattage and correlated color temperature as indicated on fixture schedule.

F. LED sources shall meet the following requirements:

1. Operating temperature rating shall be between -40 degrees C (-40 degrees F) and 50 degrees C (120 degrees F).

2. Correlated Color Temperature (CCT): 4000K3. Color Rendering Index (CRI): ≥ 85 .

4. The manufacturer shall have performed reliability tests on the LEDs luminaires complying with Illuminating Engineering Society (IES) LM79 for photometric performance and LM80 for lumen maintenance and L70 life.

G. Mercury vapor lamps shall not be used.

2.6 NOT

2.7 NOT USED

2.8 METAL HALIDE ELECTRONIC BALLASTS

A. Ballast shall be low-frequency electronic type, and shall operate pulse start and ceramic metal halide lamps at a frequency of 90 to 200 Hz square wave.

B. Ballast shall be labeled Type '1' outdoor, suitable for recessed use, Class 'P'.

C. Ballast shall have auto-resetting thermal protector to shut off ballast when operating temperatures reach unacceptable levels.

D. Ballast shall have an end of lamp life detection and shut-down circuit.

E. Lamp current crest factor shall be 1.5 or less.

F. Ballasts shall comply with FCC Title 47 CFR Part 18 Non-consumer RFI/EMI Standards.

G. Ballast shall have a minimum ballast factor of 1.0.

H. Input current THD shall not exceed 20% for the primary lamp.

I. Ballasts shall have ANSI C62.41, category 'A' transient protection.

J. Ballasts shall have power factor greater than 90%.

K. Ballast shall have a Class 'A' sound rating.

2.9 LED DRIVERS

A. LED drivers shall meet the following requirements:

1. Drivers shall have a minimum efficiency of 85%.

2. Starting Temperature: -40 degrees C (-40 degrees F).

3. Input Voltage: 120 to 480 ($\pm 10\%$) volt.

4. Power Supplies: Class I or II output.

5. Surge Protection: The system must survive 250 repetitive strikes of "C Low" (C Low: 6kV/1.2 x 50 μ s, 10kA/8 x 20 μ s) waveforms at 1-minute intervals with less than 10% degradation in clamping voltage.

“C Low” waveforms are as defined in IEEE/ASNI C62.41.2-2002, Scenario 1 Location Category C.

6. Power Factor (PF): ≥ 0.90 .
7. Total Harmonic Distortion (THD): $\leq 20\%$.
8. Comply with FCC Title 47 CFR Part 18 Non-consumer RFI/EMI Standards.
9. Drivers shall be reduction of hazardous substances (ROHS)-compliant.

2.10 NOT USED

2.11 NOT USED

PART 3 - EXECUTION

3.1 INSTALLATION

A. Install lighting in accordance with the NEC, as shown on the drawings, and in accordance with manufacturer’s recommendations.

B. Pole Foundations:

1. Excavate only as necessary to provide sufficient working clearance for installation of forms and proper use of tamper to the full depth of the excavation. Prevent surface water from flowing into the excavation. Thoroughly compact backfill with compacting arranged to prevent pressure between conductor, jacket, or sheath, and the end of conduit.
2. Set anchor bolts according to anchor-bolt templates furnished by the pole manufacturer.
 3. Install poles as necessary to provide a permanent vertical position with the bracket arm in proper position for luminaire location.
 4. After the poles have been installed, shimmed, and plumbed, grout the spaces between the pole bases and the concrete base with non-shrink concrete grout material. Provide a plastic or copper tube, of not less than 9 mm (0.375-inch) inside diameter through the grout, tight to the top of the concrete base to prevent moisture weeping from the interior of the pole.

C. Install lamps in each luminaire.

D. Adjust luminaires that require field adjustment or aiming.

3.2 GROUNDING

Ground noncurrent-carrying parts of equipment, including metal poles, luminaires, mounting arms, brackets, and metallic enclosures, as specified in Section 26 05 26, GROUNDING AND BONDING FOR ELECTRICAL SYSTEMS. Where copper grounding conductor is connected to a metal other than copper, provide specially-treated or lined connectors suitable and listed for this purpose.

3.3 ACCEPTANCE CHECKS AND TESTS

Verify operation after installing luminaires and energizing circuits.

3.4 NOT USED

- - - E N D - - -